



GALVANISED STEEL GUIDE RAIL
THICKNESS 3mm




SHUTTER SLAT





FIRE RATED BOTTOM BAR

SHUTTER TYPE	HIGH QUALITY 2HRS FIRE SHUTTERS
SHUTTER SLATS	1.0 mm ZINCALUME STEEL SOLID SLATS
FINISHING OF SLATS	POWER COAT STANDARD RAL COLOUR
GUIDE RAIL	GALVANIZED ,3mm THICK
FINISHING OF GUIDE	POWDER COAT STANDARD RAL COLOUR
BOTTOM BAR	T-120
FINISHING OF B/BAR	POWDER COAT STANDARD RAL COLOUR
BOX DESIGN	MILD STEEL SECTION FRAME DESIGN
FINISHING OF BOX	POWDER COAT STANDARD RAL COLOUR
BOX COVER PLATE	0.8mm ZINCALUME STEEL SHEET
FINISHING OF COVER	POWDER COAT STANDARD RAL COLOUR
OPERATION	MOTORIZE WITH MANUAL OVERRIDE CHAIN
MOTOR POWER SOURCE	230 VOLTS,1 PHASE,50HZ
FIRE MODE	THERMAL FUSIBLE LINK WILL AUTO CLOSE BY GRAVITY FORCE
	WHWN ROOM TEMP RISES UP TO 71°C
	ERS-EMERGENCY RELEASE SYSTEMS READY TO RECEIVED24VDC
	FIRE SIGNAL FROM FIRE CONTROL ROOM AND SHUTTER
	SHALL CLOSE DOWN BY GRAVITY FORCE WITHOUT DELAY


LOCATION	SHUTTER NO.	CLEAR WIDTH (STRUCTURE)	CLEAR WIDTH (STRUCTURE)	QUANTITY	MOTOR POSITION
	FRS	3000 mm	3000 mm	1 NO	RH

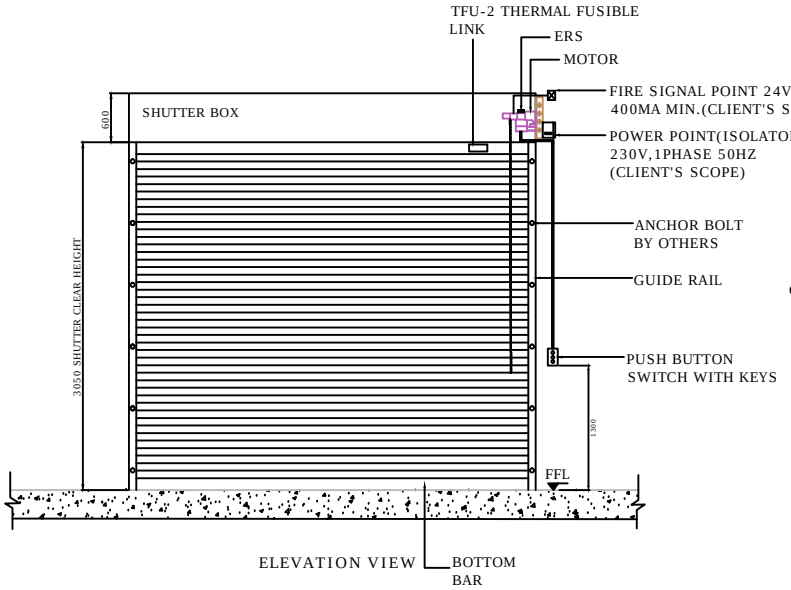

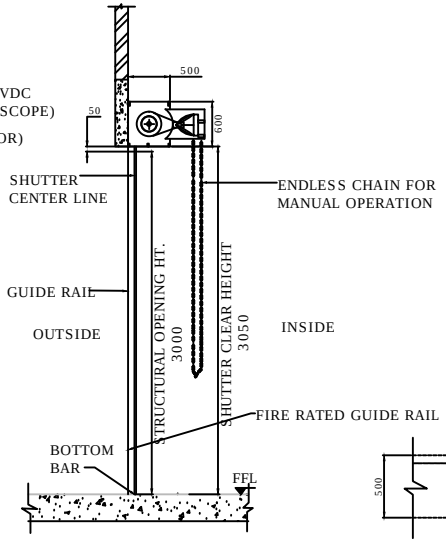

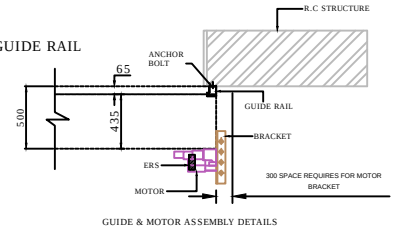

GUIDE & MOTOR ASSEMBLY DETAILS

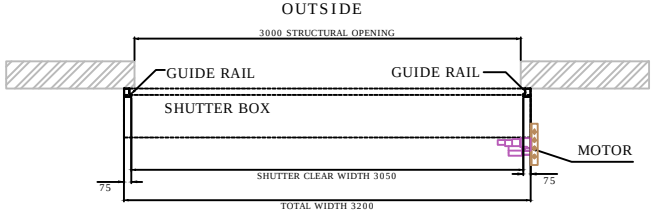

INSIDE
PLAN VIEW

CLEAR WIDTH (CW)	CLEAR HEIGHT (CH)	QUANTITY
3000	3000	01 NO

This drawing & design is the property of NIHVA TECHNOLOGIES. Not to be sold or copied to any other concern.

TITLE: FIRE RATED ROLLING SHUTTER

	NAME	SIGN	DATE
DRAWN	P.V.A		25.03.19
CHECK	V.M.T		25.03.19
REV.			
APPROVAL			

If any queries contact : projects@nihva.com

ALL DIMENSION ARE IN mm

NIHVA TECHNOLOGIES PVT. LTD.
NIHVA TECHNOLOGIES PVT. LTD. PUNE
Tel : 020 66304033
Email:- info@nihva.com
Website:- www.nihva.com

CLIENT - UNITED ARCHITECT
PROJECT - A RAYMOND
SITE - CHAKAN
DWG. NO. : NIHVA/18-19/0313
SCALE: NTS | WT: | SHEET: 01 OF 01