



Calibration and Consistency Checks on a Simulated Cohort (N = 1,000; no patient records)

Panel A: Consistency Check vs Lonstein-Carlson PF

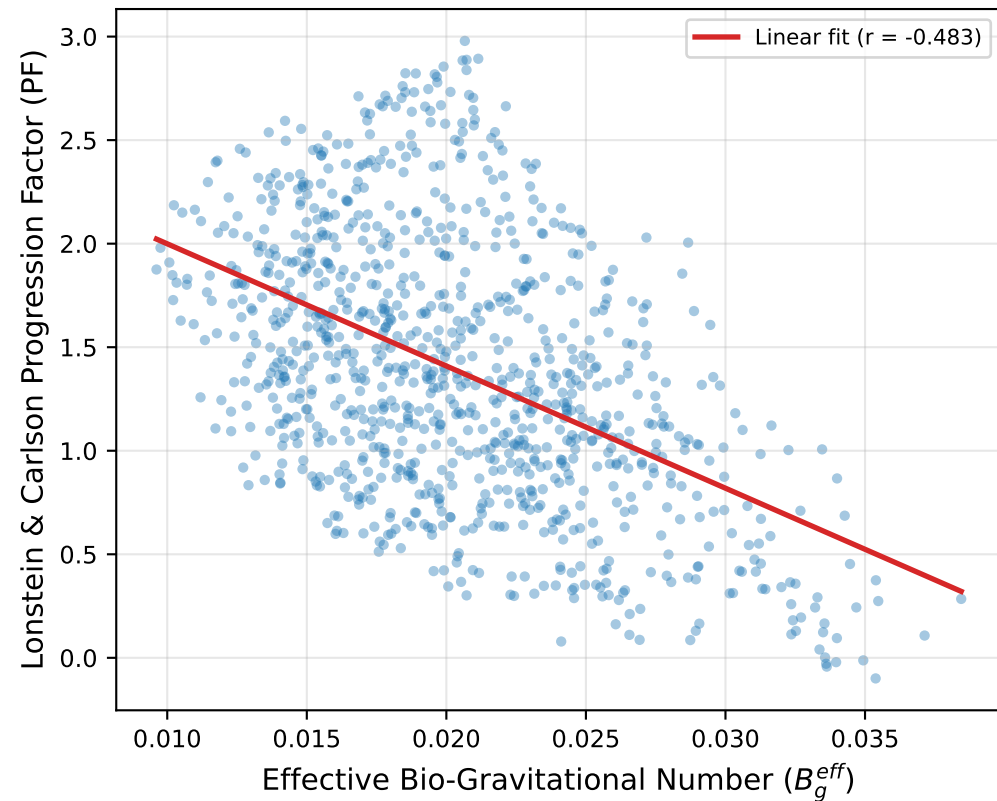

Panel B: Predicted Progression Risk

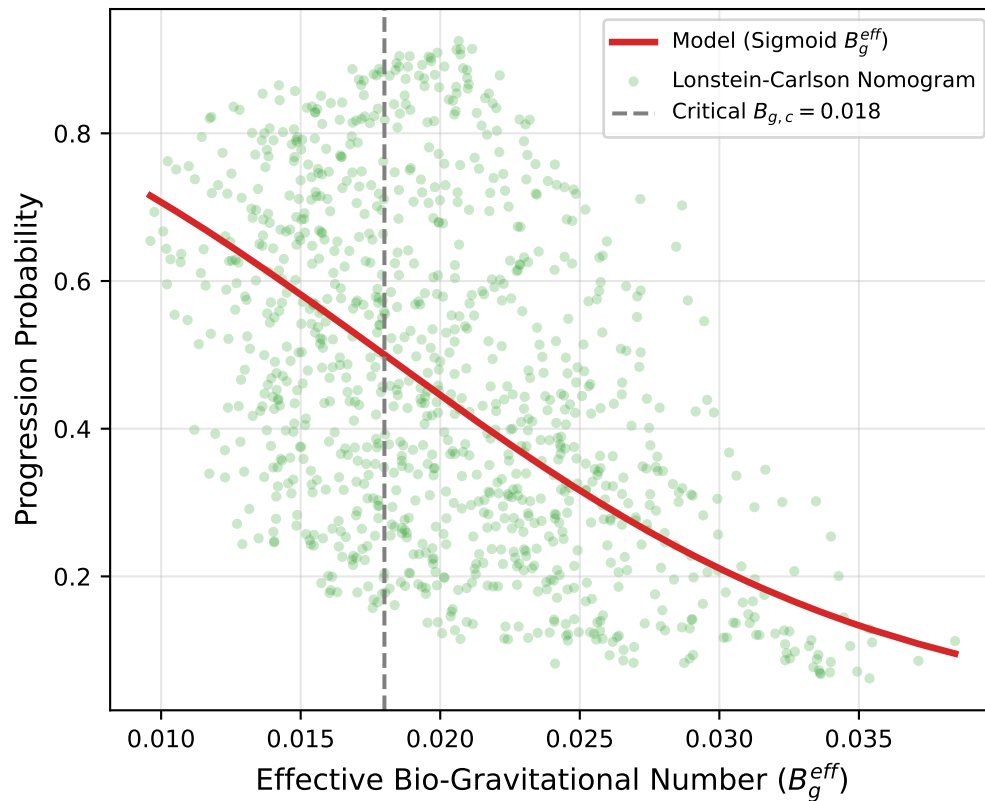

Panel C: Calibration to BrAIST Rates (overall = fit targets)

