


NOTE:
IF THERE IS A GAP BETWEEN HEAD OF
WINDOW / CURTAIN WALLING, REFER TO
DETAIL 'DET-022'.

CAVITY BARRIERS AND FIRE STRATEGY
SUPPLIED AND INSTALLED IN
ACCORDANCE WITH THE REQUIREMENTS
OF IFC SPECIFICATIONS.

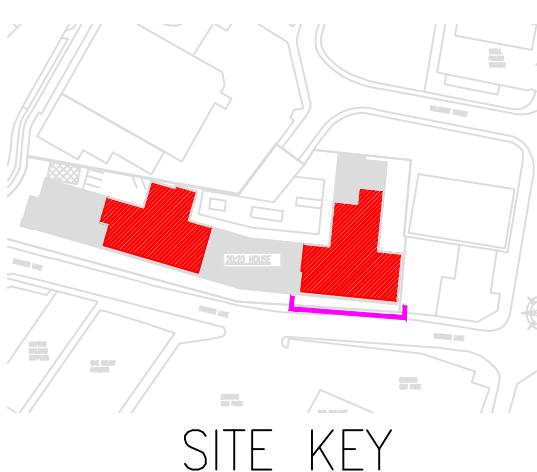

SITE KEY

-     Denoted Siderise RH25–60/60 horizontal cavity barriers run continuously round building, typically 100mm above window openings.
 -        Denoted Siderise RV–90/60 cavity barrier with OSC1 inserts to cladding panel depth.
 -   Denotes Rockwool TCB cavity barrier. To be installed from inside flats by others at every window and door. Barriers to extend 150mm past openings.
 -   Denoted Siderise non vented cavity barrier round wall vent ducting.

C01	IFC NOTE ADDED – CONSTRUCTION ISSUE	RM	28/10/21
P07	UPDATED AS PER WINTECH COMMENTS 08/10/21	RM	14/10/21
P06	UPDATED AS PER WINTECH COMMENTS 30/09/21	RM	01/10/21
P05	UPDATED AS PER WINTECH COMMENTS 16/09/21	RM	23/09/21
P04	DETAIL REFS ADDED	RM	14/9/21
P03	GENERAL UPDATES.	RM	22/06/21
P02	GENERAL UPDATES.	RM	17/06/21
P01	FIRST ISSUE	RM	19/05/21
Rev	Description	By	Date



AJ Cladding LTD
Architectural Cladding Specialists

+44 (0) 1698 339 104
ajcladding.co.uk
info@ajcladding.co.uk

Drawn By	RM	Date Created	19/05/21	Scale	1:50	at A3
Contract No.	2020					
Contract Title	20:20 HOUSE					
Drawing Title	PENTHOUSE 02 NORTH ELEVATION CAVITY BARRIER LAYOUT					
Drawing No.	2020-PH02-FS-003				Rev	C01