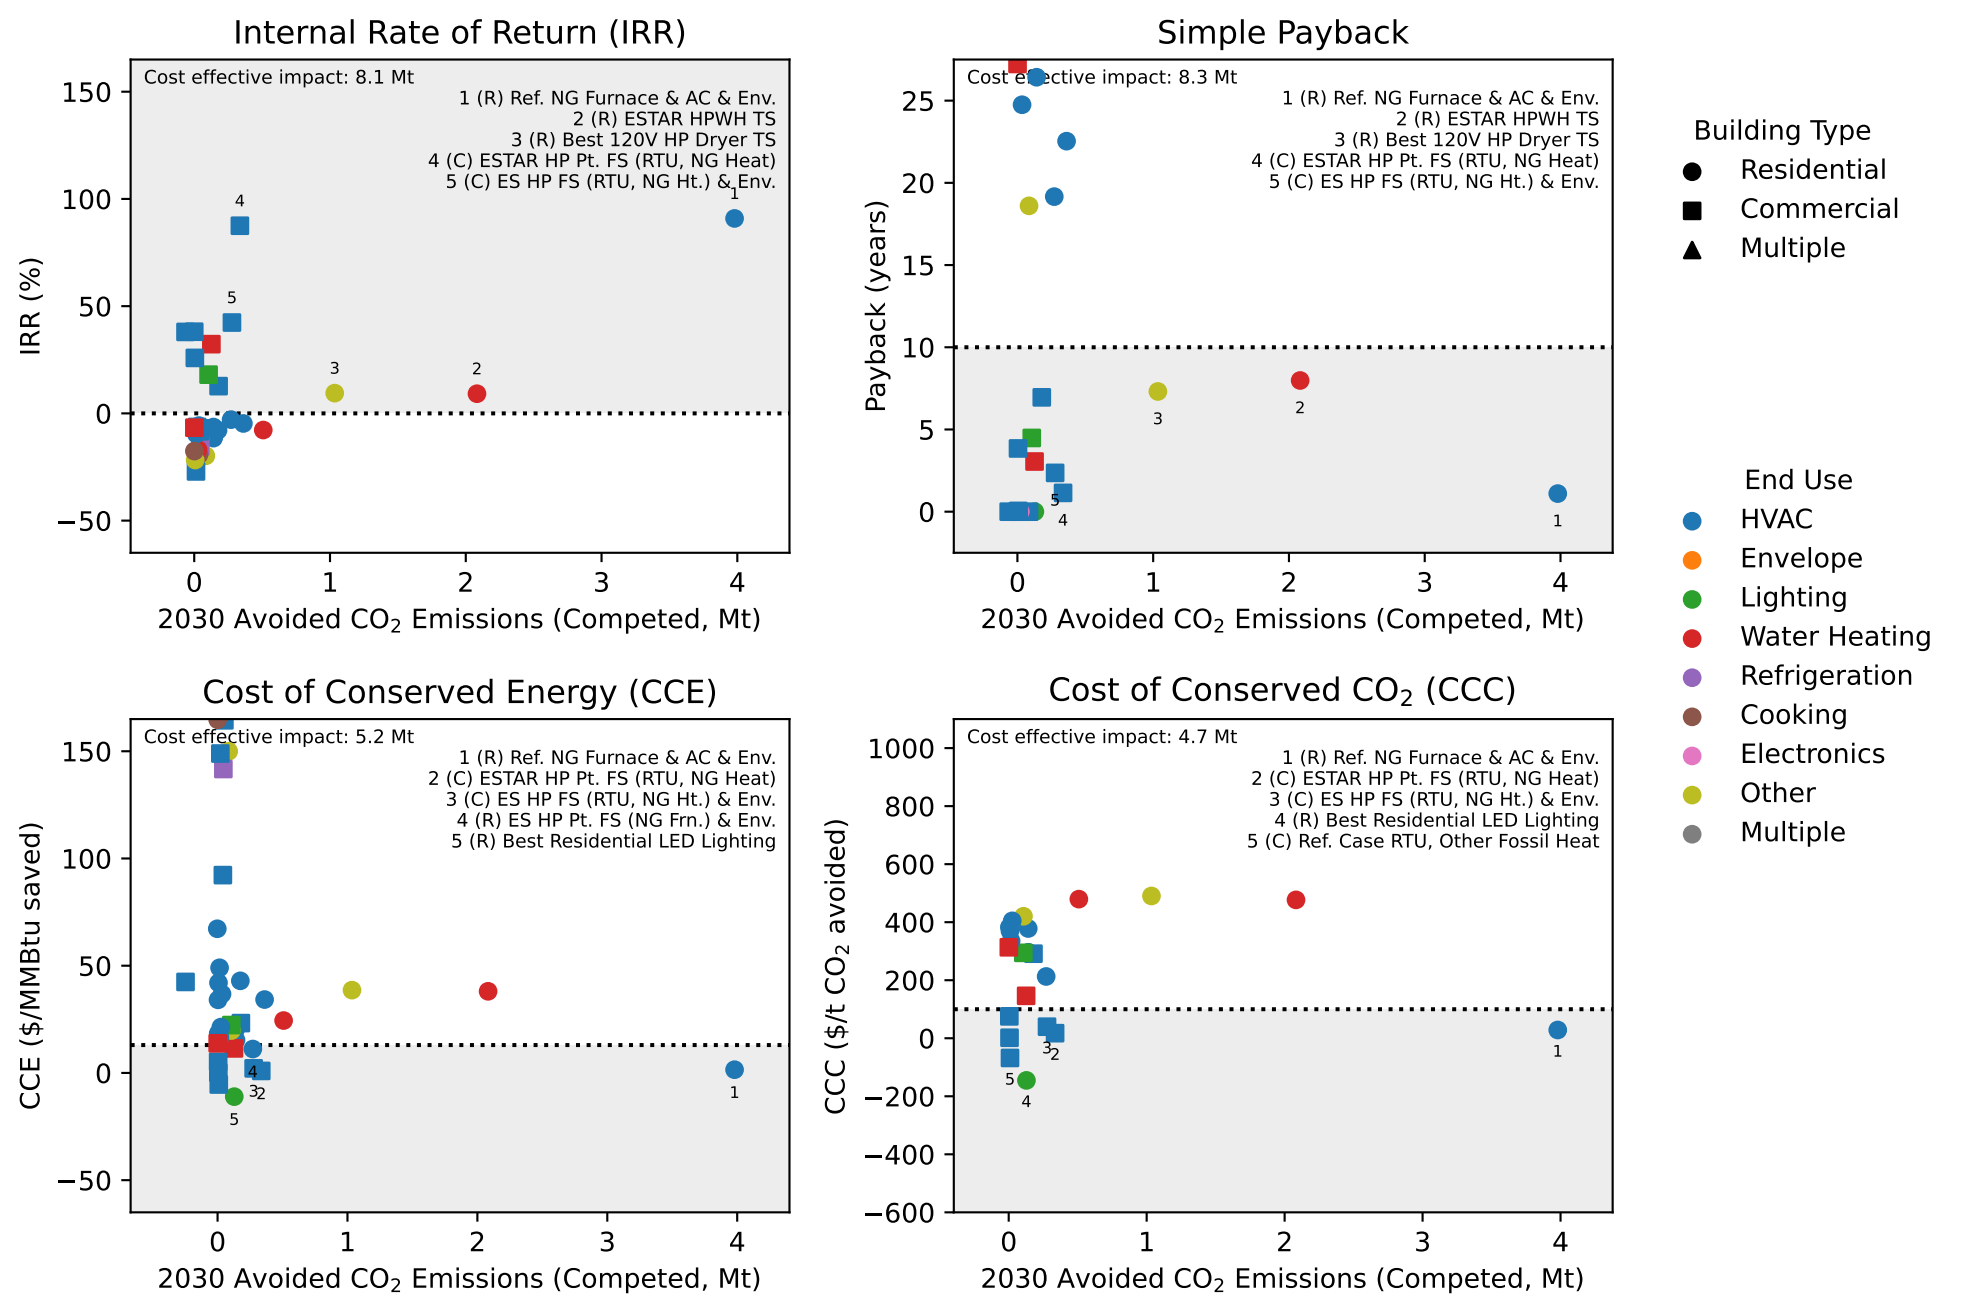
Internal Rate of Return (IRR)
Cost effective impact: 8.1 Mt
1 (R) Ref. NG Furnace & AC & Env.
2 (R) ESTAR HPWH TS
3 (R) Best 120V HP Dryer TS
4 (C) ESTAR HP Pt. FS (RTU, NG Heat)
5 (C) ES HP FS (RTU, NG Ht.) & Env.
IRR (%)
2030 Avoided CO_2 Emissions (Competed, Mt)
Simple Payback
Cost effective impact: 8.3 Mt
1 (R) Ref. NG Furnace & AC & Env.
2 (R) ESTAR HPWH TS
3 (R) Best 120V HP Dryer TS
4 (C) ESTAR HP Pt. FS (RTU, NG Heat)
5 (C) ES HP FS (RTU, NG Ht.) & Env.
Payback (years)
2030 Avoided CO_2 Emissions (Competed, Mt)
Building Type
Residential
Commercial
Multiple
End Use
HVAC
Envelope
Lighting
Water Heating
Refrigeration
Cooking
Electronics
Other
Multiple
Cost of Conserved Energy (CCE)
Cost effective impact: 5.2 Mt
1 (R) Ref. NG Furnace & AC & Env.
2 (C) ESTAR HP Pt. FS (RTU, NG Heat)
3 (C) ES HP FS (RTU, NG Ht.) & Env.
4 (R) ES HP Pt. FS (NG Frn.) & Env.
5 (R) Best Residential LED Lighting
CCE ($/MMBtu saved)
2030 Avoided CO_2 Emissions (Competed, Mt)
Cost of Conserved CO_2 (CCC)
Cost effective impact: 4.7 Mt
1 (R) Ref. NG Furnace & AC & Env.
2 (C) ESTAR HP Pt. FS (RTU, NG Heat)
3 (C) ES HP FS (RTU, NG Ht.) & Env.
4 (R) Best Residential LED Lighting
5 (C) Ref. Case RTU, Other Fossil Heat
CCC ($/t CO_2 avoided)
2030 Avoided CO_2 Emissions (Competed, Mt)