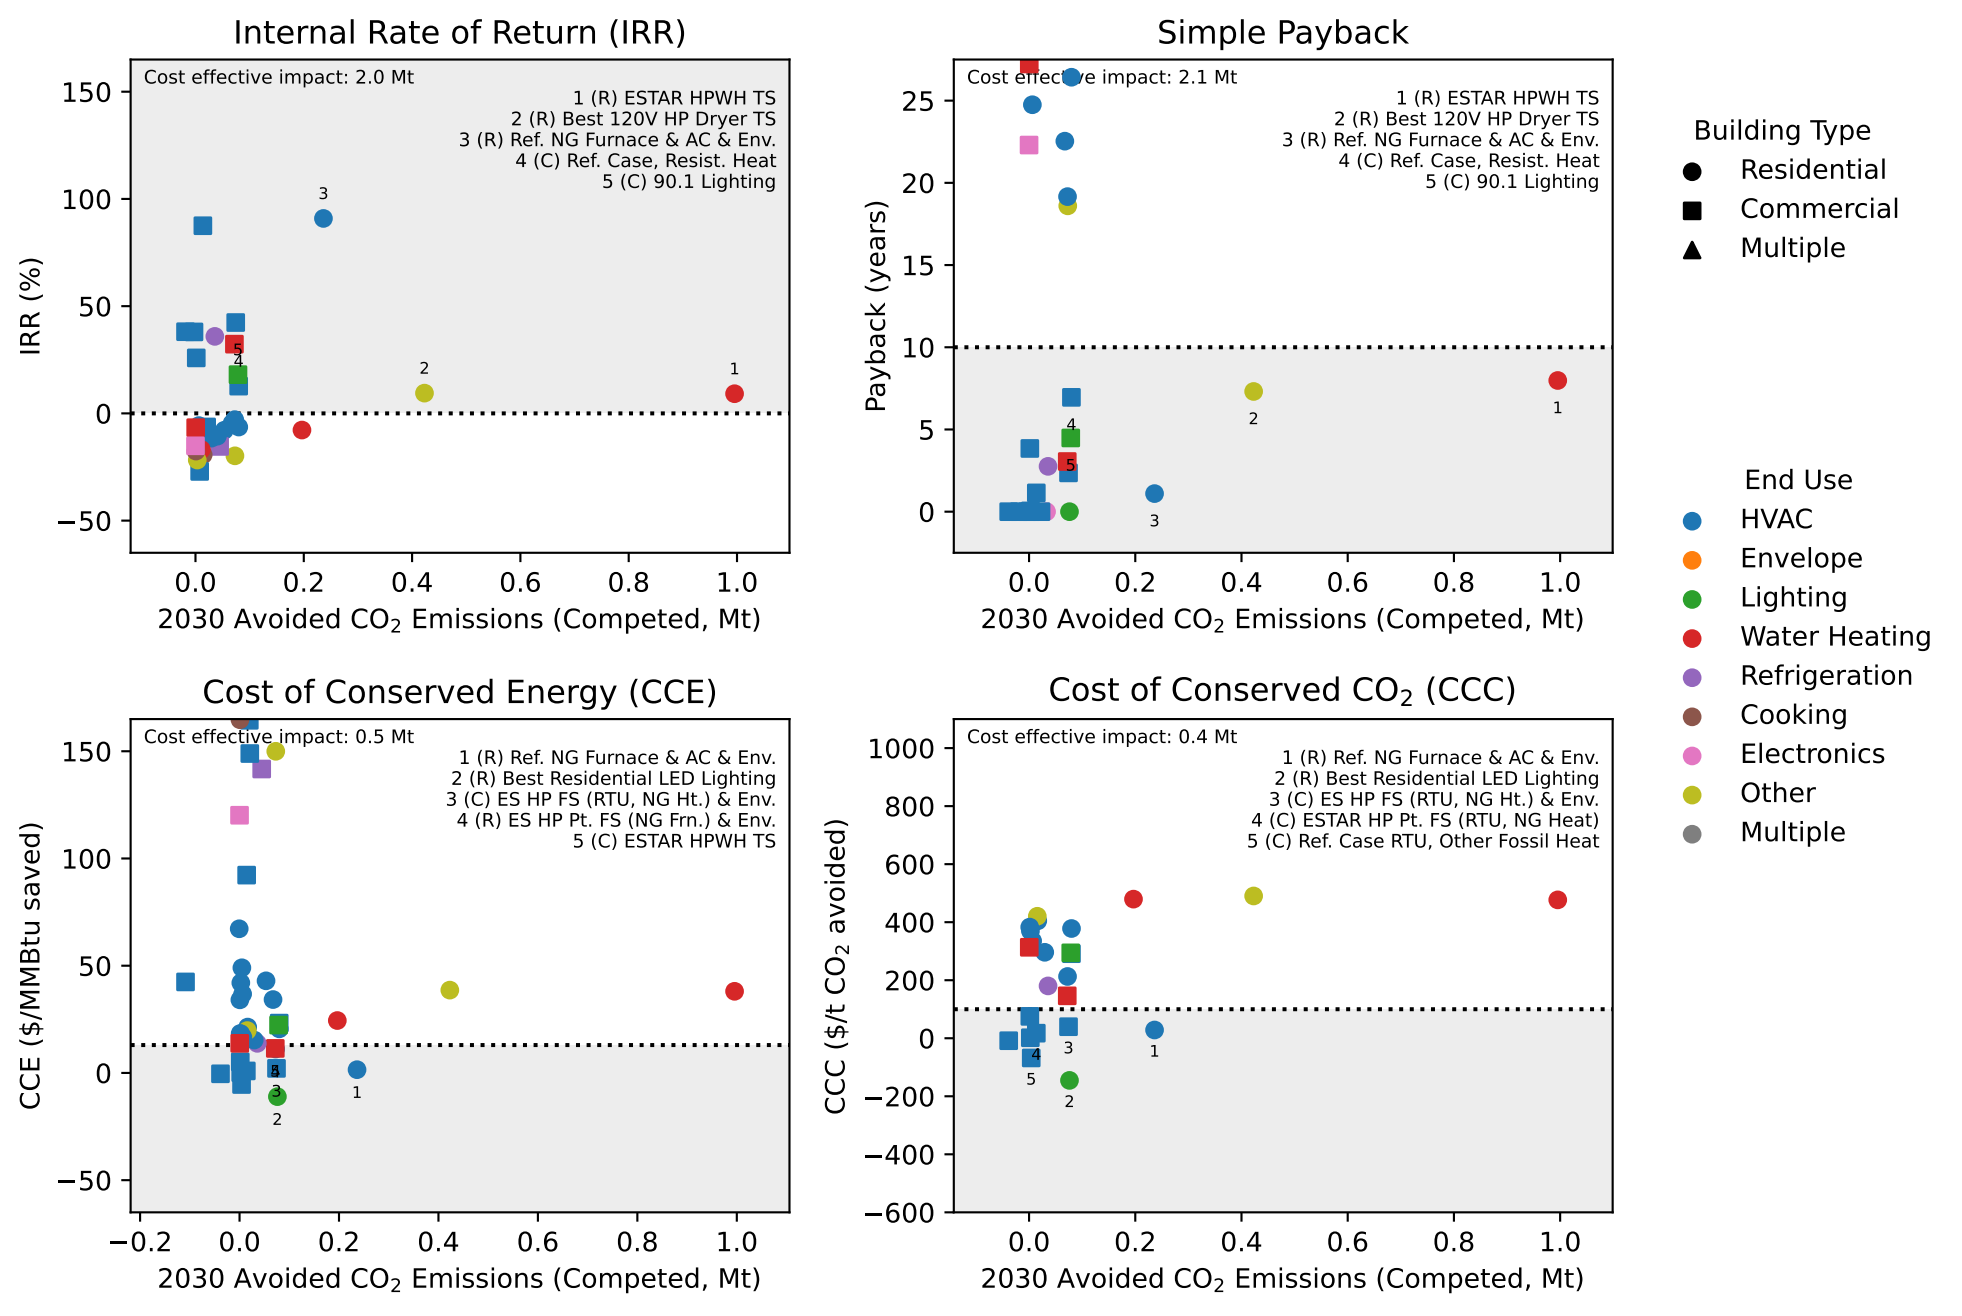
Internal Rate of Return (IRR)
Cost effective impact: 2.0 Mt
1 (R) ESTAR HPWH TS
2 (R) Best 120V HP Dryer TS
3 (R) Ref. NG Furnace & AC & Env.
4 (C) Ref. Case, Resist. Heat
5 (C) 90.1 Lighting
IRR (%)
2030 Avoided $CO_2$ Emissions (Competed, Mt)
Simple Payback
Cost effective impact: 2.1 Mt
Payback (years)
Cost of Conserved Energy (CCE)
Cost effective impact: 0.5 Mt
1 (R) Ref. NG Furnace & AC & Env.
2 (R) Best Residential LED Lighting
3 (C) ES HP FS (RTU, NG Ht.) & Env.
4 (R) ES HP Pt. FS (NG Frn.) & Env.
5 (C) ESTAR HPWH TS
CCE ($/MMBtu saved)
Cost of Conserved $CO_2$ (CCC)
Cost effective impact: 0.4 Mt
1 (R) Ref. NG Furnace & AC & Env.
2 (R) Best Residential LED Lighting
3 (C) ES HP FS (RTU, NG Ht.) & Env.
4 (C) ESTAR HP Pt. FS (RTU, NG Heat)
5 (C) Ref. Case RTU, Other Fossil Heat
CCC ($/t $CO_2$ avoided)
Building Type
Residential
Commercial
Multiple
End Use
HVAC
Envelope
Lighting
Water Heating
Refrigeration
Cooking
Electronics
Other
Multiple