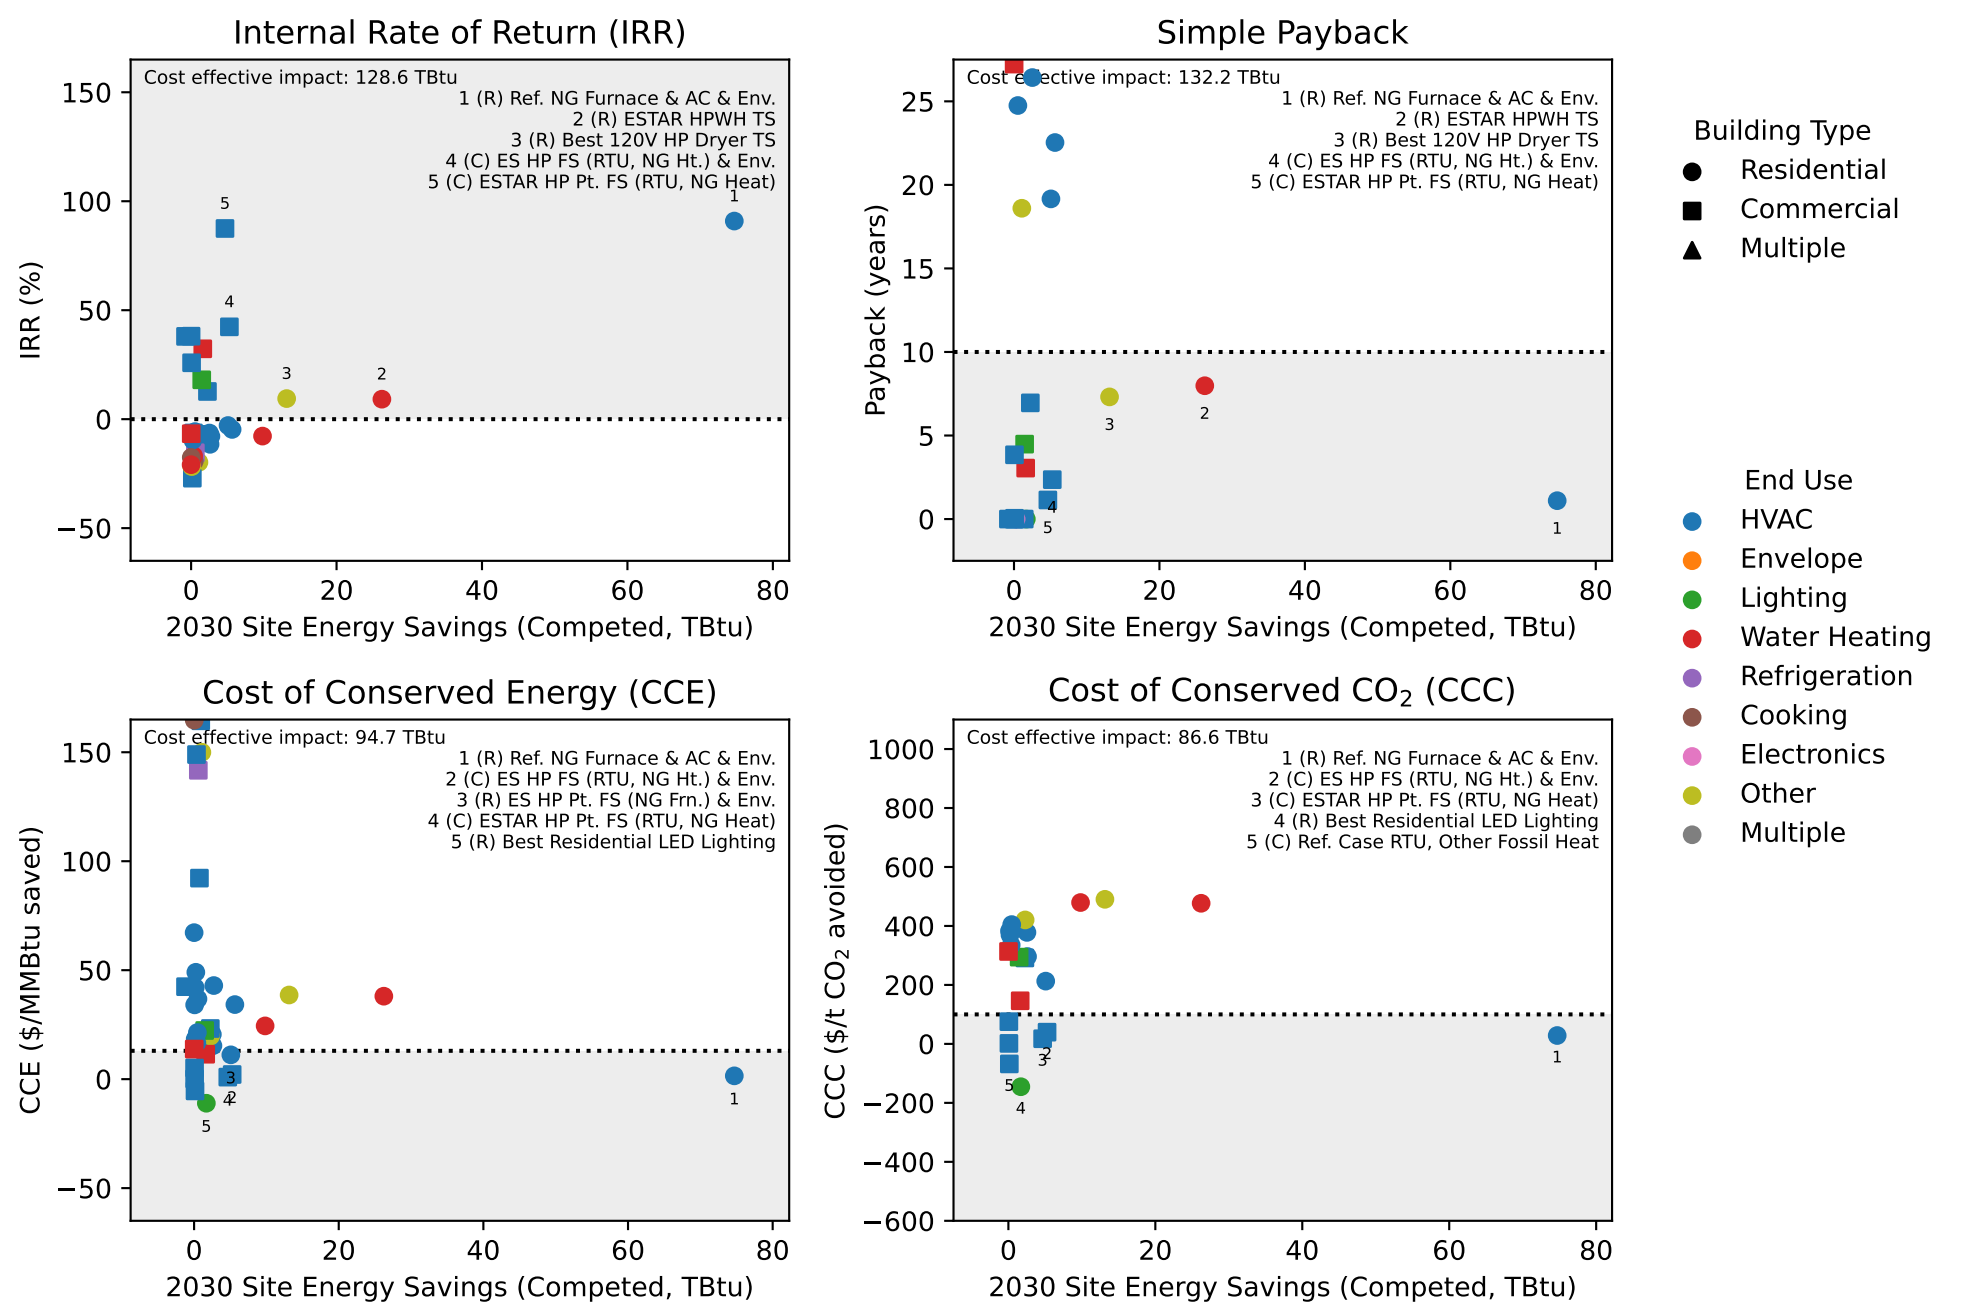
Internal Rate of Return (IRR)
Cost effective impact: 128.6 TBtu
1 (R) Ref. NG Furnace & AC & Env.
2 (R) ESTAR HPWH TS
3 (R) Best 120V HP Dryer TS
4 (C) ES HP FS (RTU, NG Ht.) & Env.
5 (C) ESTAR HP Pt. FS (RTU, NG Heat)
IRR (%)
2030 Site Energy Savings (Competed, TBtu)
Simple Payback
Cost effective impact: 132.2 TBtu
Payback (years)
Cost of Conserved Energy (CCE)
Cost effective impact: 94.7 TBtu
1 (R) Ref. NG Furnace & AC & Env.
2 (C) ES HP FS (RTU, NG Ht.) & Env.
3 (R) ES HP Pt. FS (NG Frn.) & Env.
4 (C) ESTAR HP Pt. FS (RTU, NG Heat)
5 (R) Best Residential LED Lighting
CCE ($/MMBtu saved)
Cost of Conserved CO_2 (CCC)
Cost effective impact: 86.6 TBtu
1 (R) Ref. NG Furnace & AC & Env.
2 (C) ES HP FS (RTU, NG Ht.) & Env.
3 (C) ESTAR HP Pt. FS (RTU, NG Heat)
4 (R) Best Residential LED Lighting
5 (C) Ref. Case RTU, Other Fossil Heat
CCC ($/t CO_2 avoided)
Building Type
Residential
Commercial
Multiple
End Use
HVAC
Envelope
Lighting
Water Heating
Refrigeration
Cooking
Electronics
Other
Multiple