


### SIDE WALL BAFFLE DETAIL

APPROX. WEIGHT: 4.63 LBS.  
(18) REQUIRED FOR BOX 1A  
(18) REQUIRED FOR BOX 1C

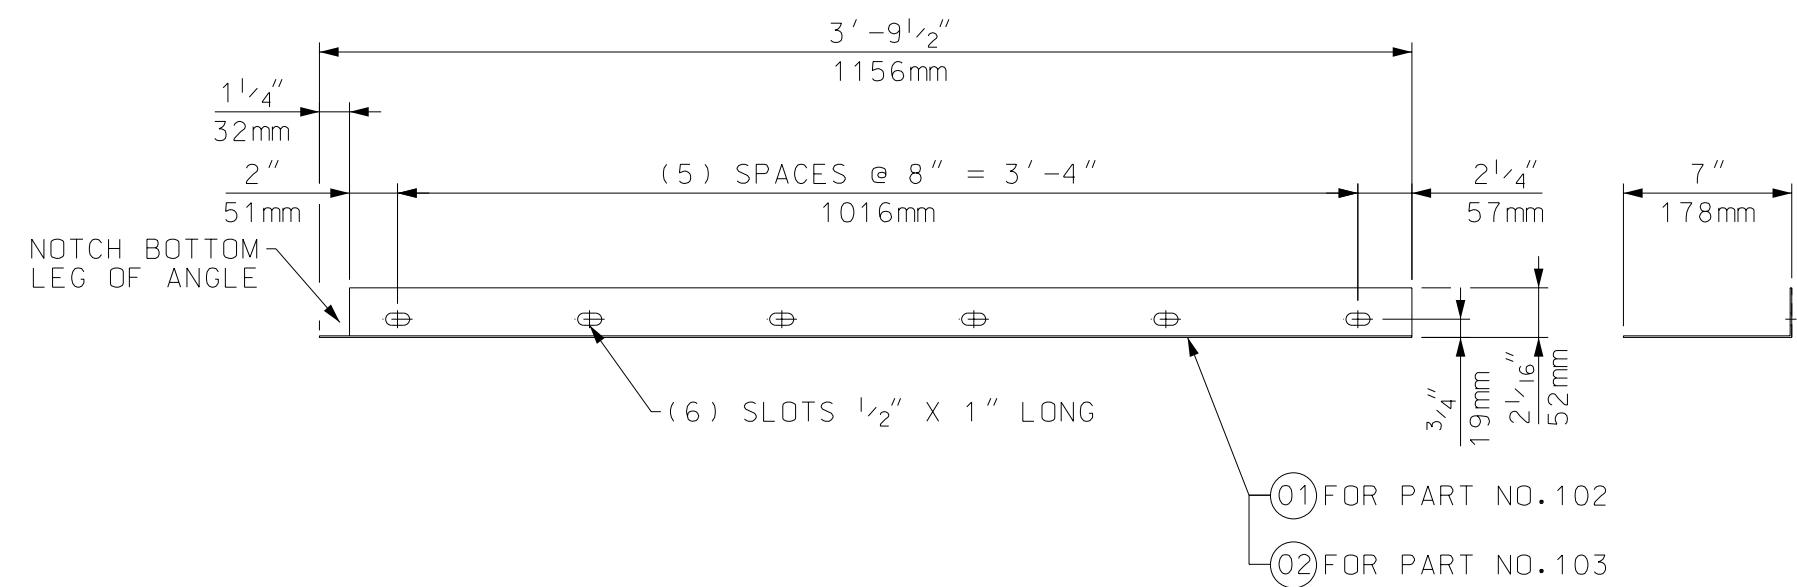


SIDE WALL BAFFLE DETAIL 102

APPROX. WEIGHT: 7.20 LBS.  
(72) REQUIRED FOR BOX 1A  
(72) REQUIRED FOR BOX 1C

SIDE WALL BAFFLE DETAIL 103

APPROX. WEIGHT: 7.20 LBS.  
(60) REQUIRED FOR BOX 2A  
(60) REQUIRED FOR BOX 2C

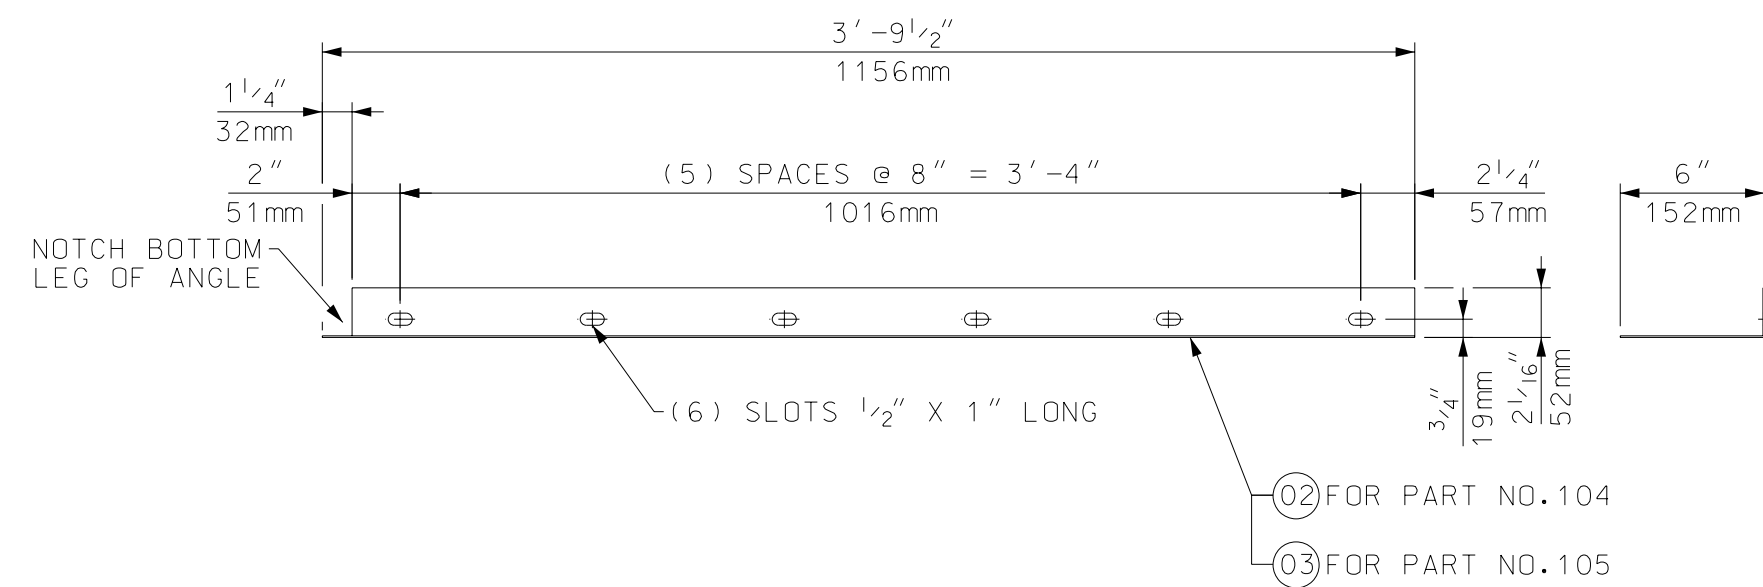


SIDE WALL BAFFLE DETAIL 104

APPROX. WEIGHT: 6.42 LBS.  
(60) REQUIRED FOR BOX 2A  
(60) REQUIRED FOR BOX 2C


SIDE WALL BAFFLE DETAIL (105)

APPROX. WEIGHT: 6.37 LBS. 0001,0002  
(40) REQUIRED FOR BOX 3A  
(40) REQUIRED FOR BOX 3C  
(20) REQUIRED FOR BOX 4A  
(20) REQUIRED FOR BOX 4C  
(20) REQUIRED FOR BOX 5A  
(20) REQUIRED FOR BOX 5C

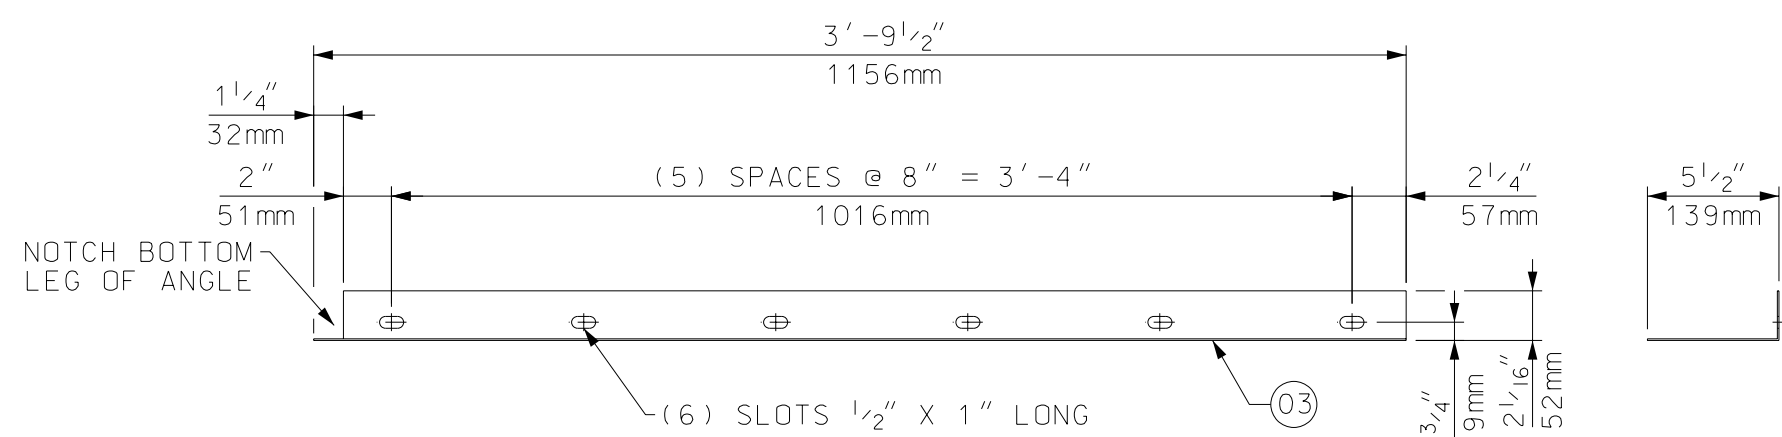


SIDE WALL BAFFLE DETAIL 106

APPROX. WEIGHT: 5.90 LBS. 0001,0002  
(100) REQUIRED FOR BOX 3A  
(100) REQUIRED FOR BOX 3C  
(120) REQUIRED FOR BOX 4A  
(120) REQUIRED FOR BOX 4C  
(120) REQUIRED FOR BOX 5A  
(120) REQUIRED FOR BOX 5C

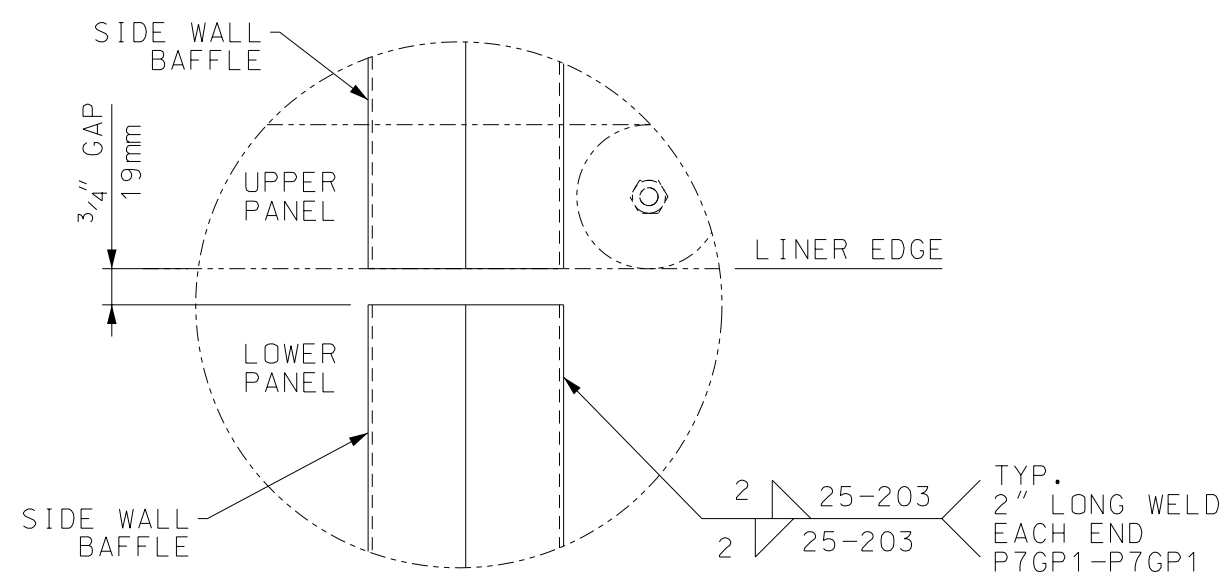


DETAIL VIEW 107

DETAIL TYP. AT ALL LOCATIONS  
WHERE SIDE WALL BAFFLES  
MEET THE EDGE OF SIDE CASING  
LINER PANELS  
SCALE: 3" = 1'-0"

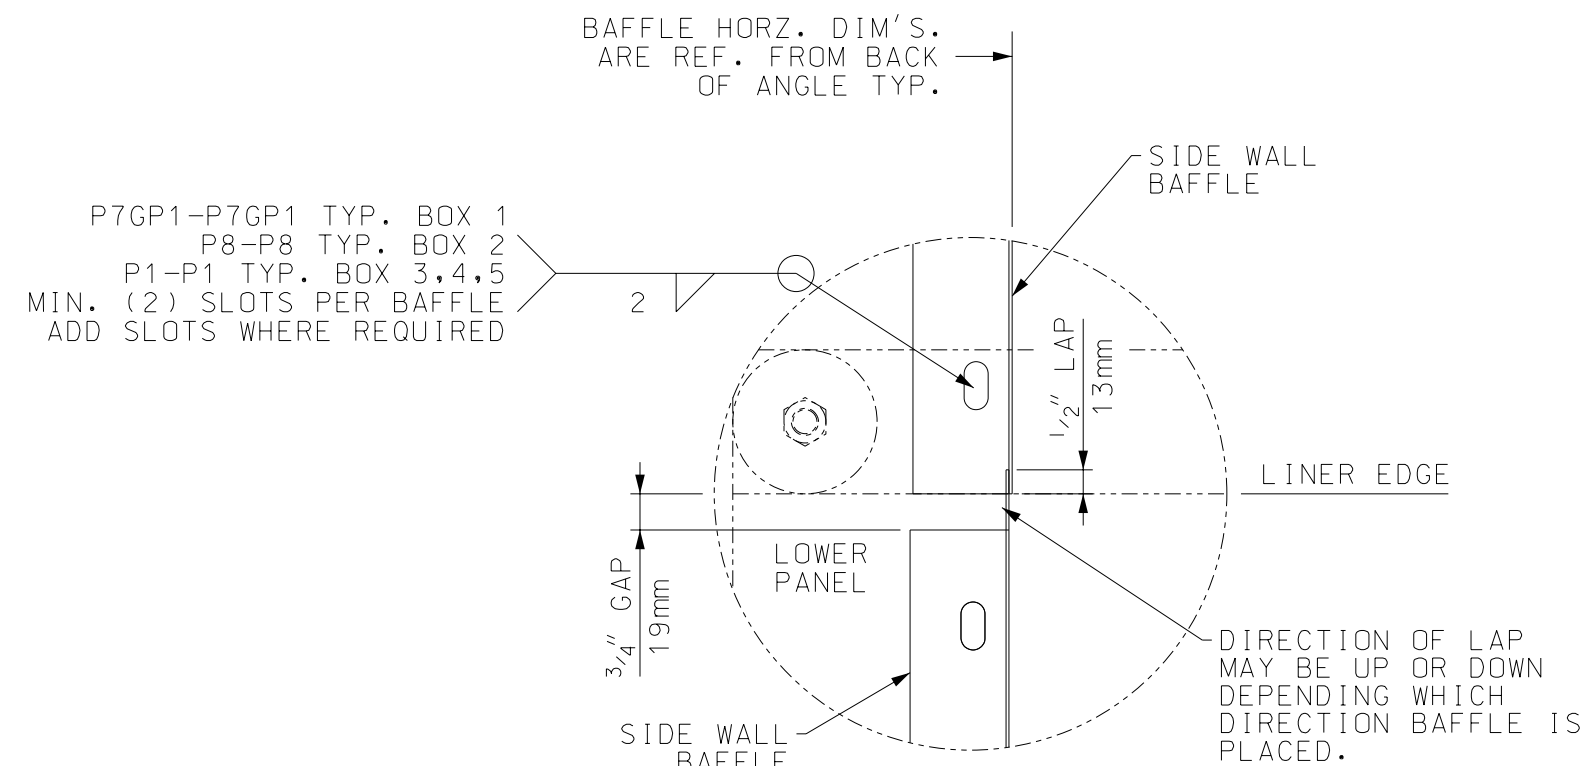


DETAIL VIEW 108

DETAIL TYP. AT ALL LOCATIONS  
WHERE SIDE WALL BAFFLES  
MEET THE EDGE OF SIDE CASING  
LINER PANELS  
SCALE: 3" = 1'-0"

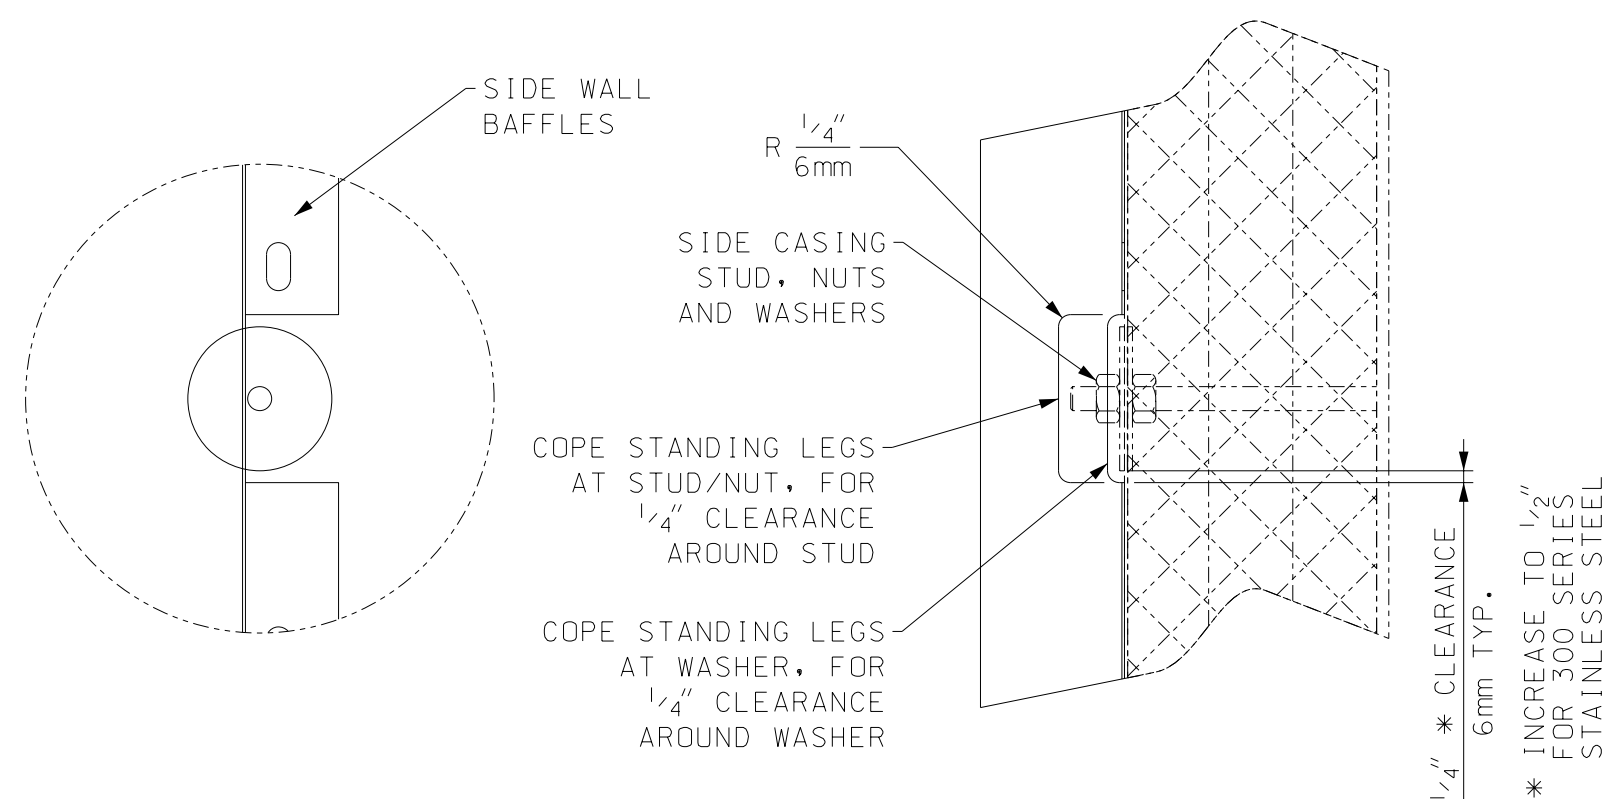

TYP.DETAIL

DETAIL TYP. AT ALL LOCATIONS  
WHERE SIDE WALL BAFFLES  
OVERLAP LINER WASHERS  
SCALE: 3" = 1'-0"

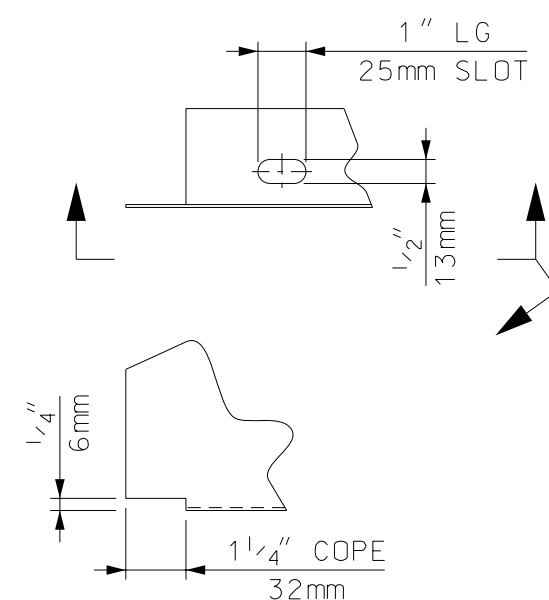

TYP. NOTCH BOTTOM DETAIL

DETAIL TYP. AT ALL LOCATIONS  
WHERE NOTCH BOTTOM  
LEG OF ANGLE  
SCALE: 3" = 1'-0"

BILL OF MATERIALS			
PART NO.	QTY.	DESCRIPTION	MAT'L. SPEC.
01	478	SO. FT. OF SHEET, 16 GA. (1.6mm) THK.	A-240 TP409
02	646	SO. FT. OF SHEET, 16 GA. (1.6mm) THK.	A-240 TP309S
03	2031	SO. FT. OF SHEET, 16 GA. (1.6mm) THK.	A-1011

NOTES:

1. FOR GENERAL NOTES SEE DRAWING V17494-BSND-0001 & 0002.
2. QUANTITIES SHOWN IS FOR (1) ONE UNIT.  
-(1) ONE UNIT REQUIRED FOR MIDDLETOWN PROJECT.  
-(1) ONE UNIT REQUIRED FOR KING MOUNTAIN PROJECT.
3. ALL WELD SIZES ARE SHOWN IN METRIC (MM).

REFERENCE DRAWINGS:

V17494-BSND-0001	- SHOP INSTALLED SIDE WALL BAFFLES (BOXES 1A THRU 5A)
V17494-BSND-0002	- SHOP INSTALLED SIDE WALL BAFFLES (BOXES 1C THRU 5C)

00	FIRST ISSUE	22-DEC-15	SP	JONES			FRY
Rev.	Description	Date	Drawn	Chkd.	Chkd.		Appr.

This drawing contains Vogt Power International's confidential and proprietary information and cannot be used, duplicated or disclosed in whole or in part, except with the express written permission of Vogt Power International. EXCEPT AS EXPRESSLY STATED IN ANY WRITTEN CONTRACT - ALL WARRANTIES RELATING TO THIS DRAWING, INCLUDING THE WARRANTIES OF MERCHANTABILITY AND FITNESS, ARE DISCLAIMED.

© Vogt Power International, Inc. all rights reserved as an unpublished work.

MIDDLETOWN ENERGY CENTER and KINGS MOUNTAIN ENERGY CENTER for NTE ENERGY and GEMMA POWER SYSTEMS	
VOGT POWER PROJECTS V17494 & V17495	Scale: 1 1/2" = 1'-0"

## SHOP INSTALLED SIDE WALL BAFFLE DETAILS

**Vogt Power**  
International

13551 Triton Park Blvd  
Suite 2000  
Louisville, Ky. 40223 USA  
[www.VogtPower.com](http://www.VogtPower.com)

Internal Drawing Status	Size	Drawing No.	Rev.
FOR RECORD	D	V17494-BSND-0003	00