



STUD LAYOUT (INSIDE VIEW)

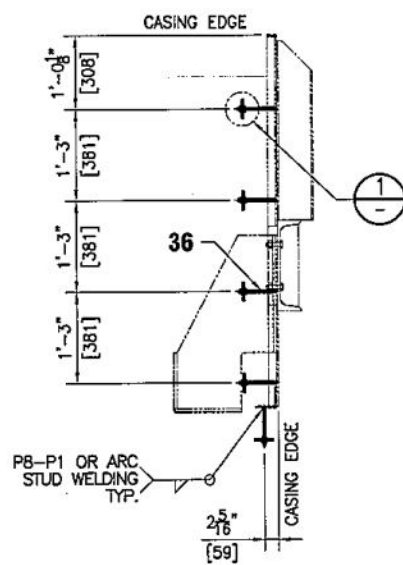

CC13 38 = 306 Pcs.
WASHER, 12 GA. (3mm)
A-240 TP409

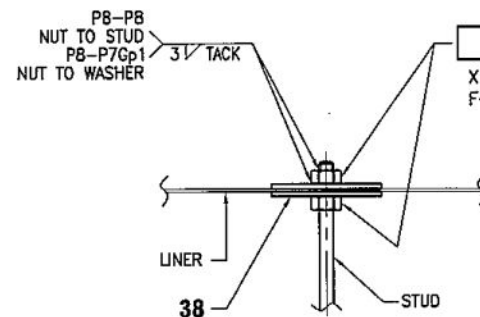

DETAIL 1 TYP.
SCALE: NTS


CC13 37 = 306 Pcs.
XEX NUT REGULAR 3/8"
F-594 TP304*

CC13 36 = 153 Pcs.
STUD 3/8" DIA. x 6 1/8" LG.
A-479 TP304*


VOGT POWER INTERNATIONAL

Review Waived

Bell, Milton Jun-01-2016

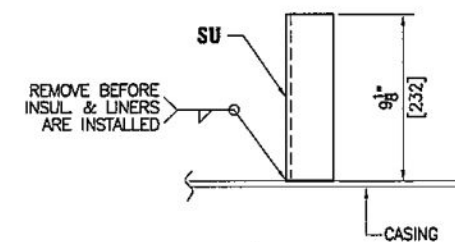

SECTION 1
SCALE: NTS



CC13 SU = 8 Pcs.
C-125x65x6x8
G3101 SS400

MATERIAL LIST FOR ASSEMBLY MK'D CC13 Q'TY: 1 No. Required									
PartNo	Description	Width	ID	Length	OD	Qty	Mat. Grade	Weight	Area
09	PL-1.5	76		302		12	A-240 TP409	3.31	0.28
09-1	PL-1.5	748		895		1	A-240 TP409	8.03	0.67
09-2	PL-1.5	895		1219		1	A-240 TP409	13.09	1.09
09-3	PL-1.5	895		1219		1	A-240 TP409	13.09	1.09
09-4	PL-1.5	895		1219		1	A-240 TP409	13.09	1.09
09-5	PL-1.5	895		1219		1	A-240 TP409	13.09	1.09
09-6	PL-1.5	895		1219		1	A-240 TP409	13.09	1.09
09-7	PL-1.5	895		1219		1	A-240 TP409	13.09	1.09
09-8	PL-1.5	895		1219		1	A-240 TP409	13.09	1.09
09-9	PL-1.5	895		1219		1	A-240 TP409	13.09	1.09
09-10	PL-1.5	895		1219		1	A-240 TP409	13.09	1.09
09-11	PL-1.5	367		895		1	A-240 TP409	3.94	0.33
09-12	PL-1.5	367		903		1	A-240 TP409	3.98	0.33
09-13	PL-1.5	903		1219		1	A-240 TP409	13.21	1.10
09-14	PL-1.5	903		1219		1	A-240 TP409	13.21	1.10
09-15	PL-1.5	903		1219		1	A-240 TP409	13.21	1.10
09-16	PL-1.5	903		1219		1	A-240 TP409	13.21	1.10
09-17	PL-1.5	903		1219		1	A-240 TP409	13.21	1.10
09-18	PL-1.5	903		1219		1	A-240 TP409	13.21	1.10
09-19	PL-1.5	903		1219		1	A-240 TP409	13.21	1.10
09-20	PL-1.5	903		1219		1	A-240 TP409	13.21	1.10
09-21	PL-1.5	903		1219		1	A-240 TP409	13.21	1.10
09-22	PL-1.5	748		903		1	A-240 TP409	8.11	0.68
16	INSULATION 2" THK 8# DENSITY (28 ROLLS)					3	Superwool Plus	390.14	60.96 m2
36	STUD 3/8" DIA. x 6 1/8" LG.			156		153	A-479 TP304*	14.80	0.75
37	HEX NUT REGULAR 3/8"					306	F-594 TP304*	3.67	-
38	WASHER 12GA. (3mm)	11	ID	76	OD	306	A-240 TP409	42.42	1.77
SU	C-125x65x6x8			232		8	G3101 SS400	-	-
Total								715.11	85.48

VOGT POWER INTERNATIONAL
V17494-CCXD-5046-01
30-May-2016

UNIT 1

Project Owner's : Gemma Power System,LLC
Project Name : Middletown Energy Center Project
Vogt Power International Job No./Cost symbol: V17494/ CC
Vogt Power International Doc. No. :
Vogt Power International P.O. No. : V0009490

This drawing contains Visavakit Patana Corp., Ltd.'s confidential and proprietary information and cannot be used, duplicated or disclosed in whole or in part, except with the express written permission of Visavakit Patana Corp., Ltd.

© Visavakit Patana Corp., Ltd. all rights reserved as an unpublished work.



VISAVAKIT PATANA CORPORATION LIMITED

OFFICE : 215/148-149 Pracharad 1 Road, Bangsue, Bangkok 10800 Tel: 0-2585-2556-8 Fax: 0-2587-6068
PLANT 1 : 28/2 Moo4, Soi Choi Ua, Pathumthani 12000 Tel: 0-2975-2811-4 Fax: 0-2975-2815
PLANT 2 : 52 Moo7, Kubangkhong, Ladunbkaew, Pathumthani 12140 Tel: 0-2979-4001-9 Fax: 0-2979-4010
www.vipco-thai.com Email : vipco@vipco-thai.com

TITLE		ISO-A (Ord)	
VOGT POWER INTERNATIONAL MIDDELTOWN ENERGY CENTER PROJECT BASMENT PANEL ASSEMBLY OUTLET BOX 1 (CC13) (LINER)		JOB NO. 1711	
REF.DWG.NO.	V17494-CCND-0011	VIPCO DWG.NO.	Y15-1711-CC13-06
REV	1	REV	1

1	24-05-16	REV. WEIGHT & AREA	Sanguanchai		
0	09/02/16	FIRST ISSUE	JU.TEEWAT		
REV	DATE	DESCRIPTION	DRAWN	CHECKED	APPROVED