
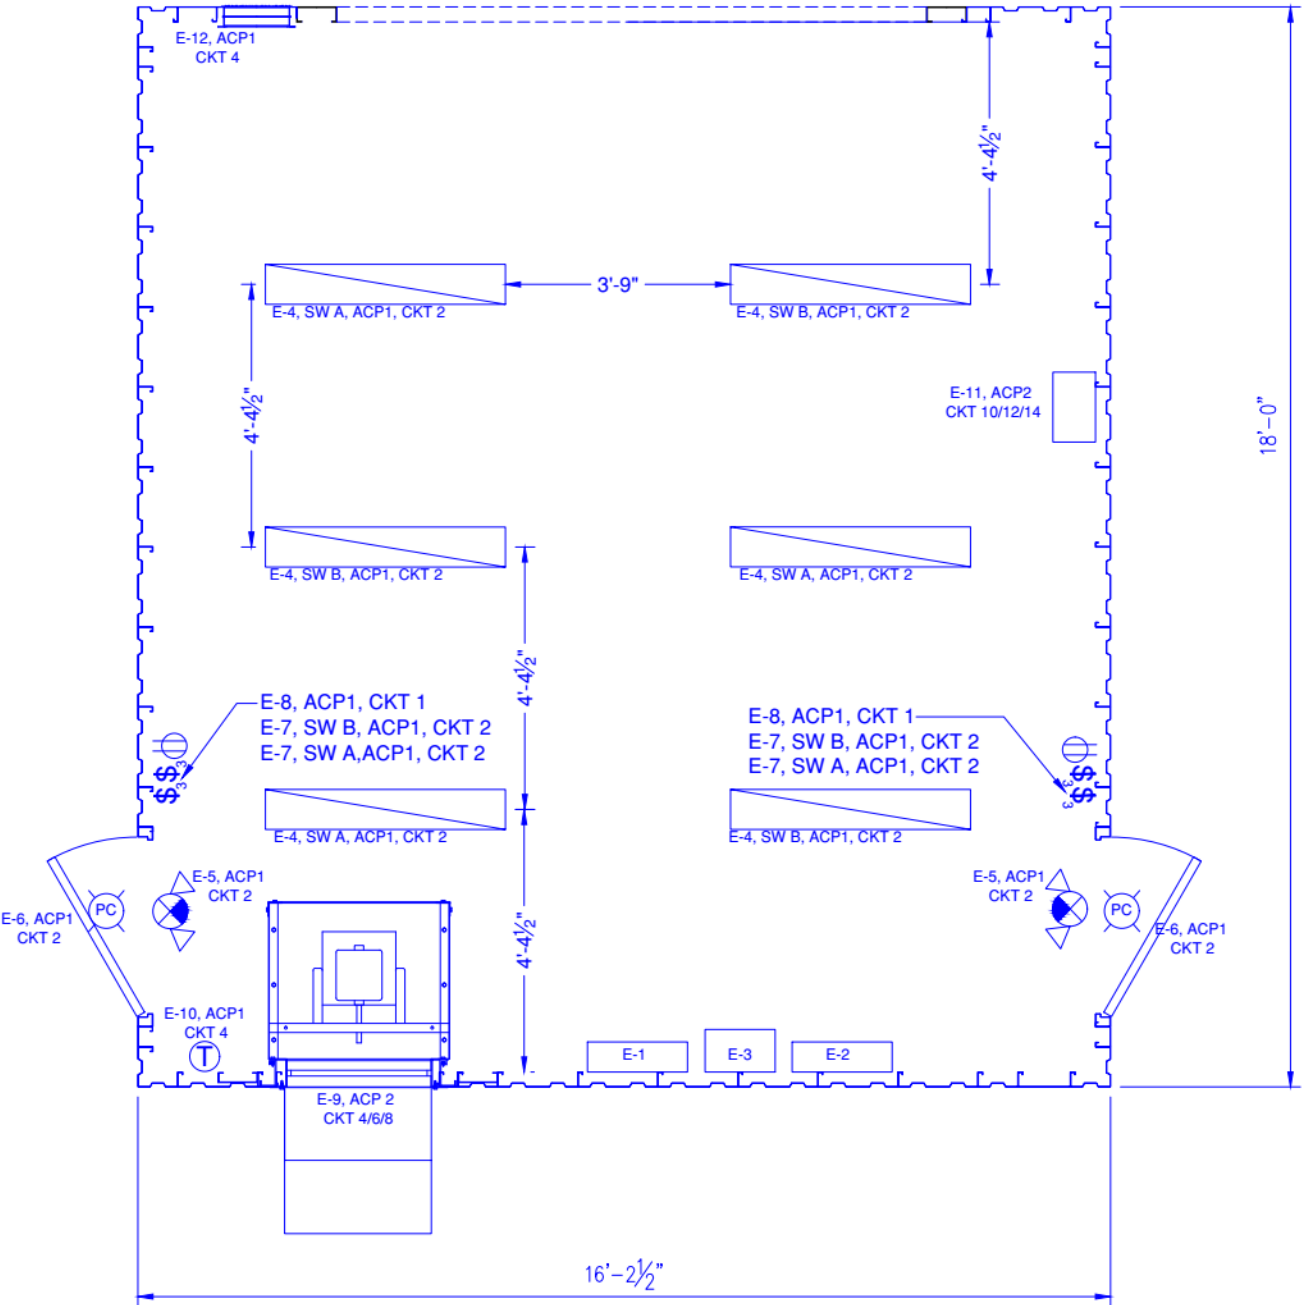


MEC/KMEC
superceded by PE stamped drawings

MINIMUM ELECTRICAL REQUIREMENTS SHOWN FOR REFERENCE
NO ELECTRICAL WIRING BY PARKLINE



ELECTRICAL FLOOR PLAN

SYMBOLS LEGEND:

\$	3-WAY SWITCH
⊕	DUPLEX RECEPTACLE
Ⓣ	THERMOSTAT
⚡	INTERIOR LIGHTING
Ⓢ	EXT LIGHT W/ PHOTO CELL
Ⓢ	EXIT / EMERG COMBO LIGHT

VOGT POWER INTERNATIONAL
V17494-BEXD-5023-03
12-Jul-2016

*FLOORPLAN NOTES ON DWG E2.

PRELIMINARY
NOT FOR
CONSTRUCTION

REVISIONS	BY
03/31/2016	JTV
4/12/2016	JTV



PARKLINE, INC.
RT. 62, ELEANOR INDUSTRIAL PARK
ELEANOR, WV 25070
EMAIL: PARKLINE@PARKLINE.COM
PHONE: 800-786-4855 FAX: 304-586-3842

PARKLINE, INC. CLAIMS PROPRIETARY RIGHTS TO THE INFORMATION, DESIGN, AND LAYOUT DISCLOSED HEREIN. THIS DRAWING IS ISSUED FOR INFORMATIONAL PURPOSES ONLY AND MAY NOT BE REPRODUCED, DISCLOSED TO OTHERS OR USED TO DESIGN OR CONSTRUCT ANY OF THE ITEMS SHOWN HEREIN WITHOUT THE EXPRESSED WRITTEN CONSENT OF PARKLINE, INC.

VOGT POWER INTERNATIONAL, INC.
LOUISVILLE, KY

JOB NO. V17494 – MIDDLETOWN ENERGY – DESTINATION: MIDDLETOWN, OH
JOB NO. V17495 – KINGS MT. ENERGY – DESTINATION: KINGS MT., NC
VPI PO#: V0009691
HP DRUM ENCLOSURE

ELECTRICAL FLOOR PLAN

DATE: 3/30/2016
DRAWN BY: JTV
SCALE: NTS

VOG-AA-E1

ORDER #: VOG-AA REVISION #: 2