


MECHANICAL  
superceded by PE stamped drawings

MINIMUM ELECTRICAL REQUIREMENTS SHOWN FOR REFERENCE  
NO ELECTRICAL WIRING BY PARKLINE

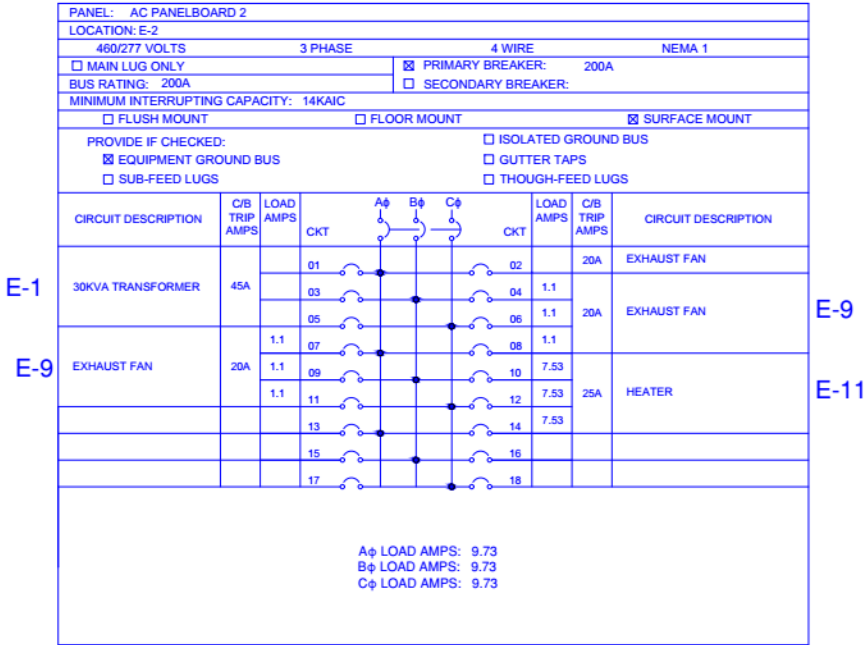

VOGT POWER INTERNATIONAL  
V17494-BEXD-5038-03  
12-Jul-2016

PRELIMINARY  
NOT FOR  
CONSTRUCTION

REVISIONS	BY
4/12/2016	JTV
4/21/2016	JTV



PARKLINE, INC.  
R. E. ELEANOR INDUSTRIAL PARK  
ELEANOR, MO 64543  
EMAIL: PARKLINE@PARKLINE.COM  
PHONE: 816.234.1111 FAX: 816.234.1112

PARKLINE, INC. CLAIMS PROPRIETARY RIGHTS TO THE INFORMATION, DESIGN, AND LAYOUT DISCLOSED HEREIN. THIS DRAWING IS ISSUED FOR INFORMATIONAL PURPOSES ONLY AND MAY NOT BE REPRODUCED, DISCLOSED TO OTHERS OR USED TO DESIGN OR CONSTRUCT ANY OF THE ITEMS SHOWN HEREIN WITHOUT THE EXPRESSED WRITTEN CONSENT OF PARKLINE, INC.

VOGT POWER INTERNATIONAL, INC.  
LOUISVILLE, KY

JOB NO. V17494 – MIDDLETOWN ENERGY – IP/LP DRUM ENCLOSURE  
JOB NO. V17495 – KINGS MT. ENERGY – DESTINATION: KINGS MT., NC  
VPI PO#: V0009691  
IP/LP DRUM ENCLOSURE

ELECTRICAL PANEL BOARD LAYOUT 2

DATE: 3/30/2016

DRAWN BY: JTV

SCALE: NTS

VOG-AB-E8

ORDER #: VOG-AB

REVISION #: 2