







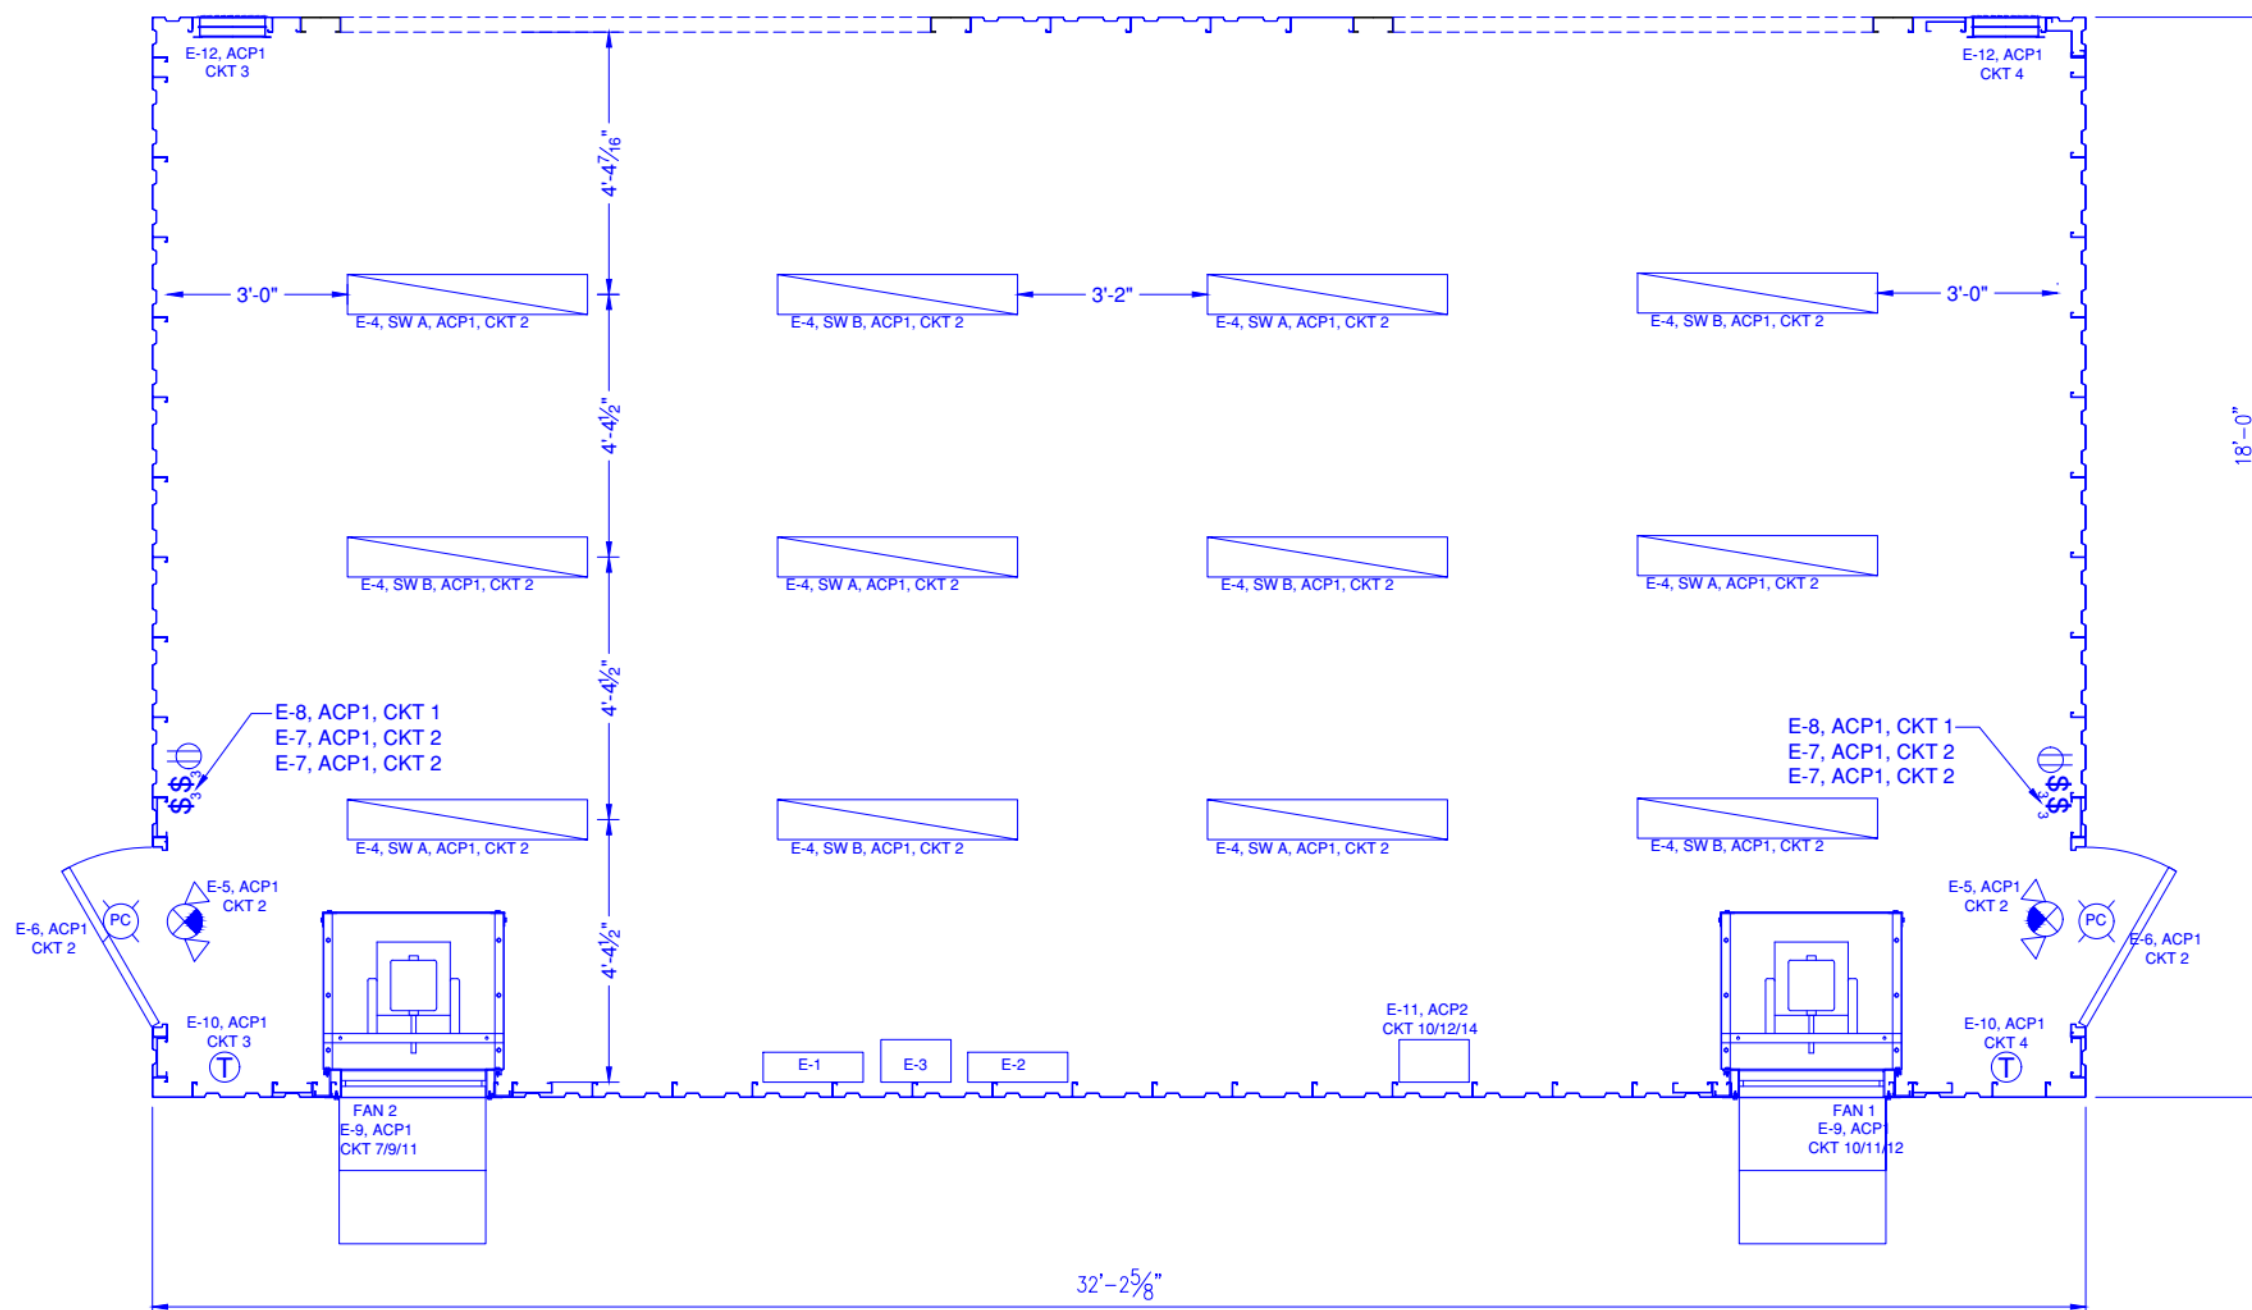

MINIMUM ELECTRICAL REQUIREMENTS SHOWN FOR REFERENCE
NO ELECTRICAL WIRING BY PARKLINE



ELECTRICAL FLOOR PLAN

VOGT POWER INTERNATIONAL
V17494-BEXD-5031-03
12-Jul-2016

**PRELIMINARY
NOT FOR
CONSTRUCTION**

SYMBOLS LEGEND:	
	3-WAY SWITCH
	DUPLEX RECEPTACLE
	THERMOSTAT
	INTERIOR LIGHTING
	EXT LIGHT W/ PHOTO CELL
	EXIT / EMERG COMBO LIGHT

*FLOORPLAN NOTES ON DWG E2.

REVISIONS	BY
3/31/2016	JTV
4/12/2016	JTV



PARKLINE, INC.
Rt. 00, ELEANOR INTERNATIONAL PARK
ELEANOR, IL 60120
EMAIL: MARKLINE@PARKLINE.COM
PHONE: 630-291-1000 FAX: 630-291-1001

PARKLINE, INC. CLAIMS PROPRIETARY RIGHTS TO THE INFORMATION, DESIGN, AND LAYOUT DISCLOSED HEREIN. THIS DRAWING IS ISSUED FOR INFORMATIONAL PURPOSES ONLY AND MAY NOT BE REPRODUCED, DISCLOSED TO OTHERS OR USED TO DESIGN OR CONSTRUCT ANY OF THE ITEMS SHOWN HEREIN WITHOUT THE EXPRESSED WRITTEN CONSENT OF PARKLINE, INC.

VOGT POWER INTERNATIONAL, INC.
LOUISVILLE, KY

JOB NO. V17494 - MIDDLETOWN ENERGY - IP/LP DRUM ENCLOSURE
 JOB NO. V17495 - KINGS MT. ENERGY - DESTINATION: KINGS MT., NC
 VPI PO#: V0009691
 IP/LP DRUM ENCLOSURE

ELECTRICAL FLOOR PLAN

VOG-AB-E1

DATE: 3/30/2016

DRAWN BY: JTV

SCALE: NTS

ORDER #:	VOG-AB
----------	--------

REVISION #: 2