

Compressed Air System Fault Detection Using Rule-Based Expert Systems with K-Means Clustering for Mode Identification and Efficiency Degradation Detection

Seán Martin Hayes · Ken Bruton · D.T.J. O'Sullivan

Received: date / Accepted: date

Abstract A rule based expert system for compressed air system fault detection and operational performance management is presented. The expert rule set takes a qualitative model based approach to fault detection, relying on fundamental engineering principles to detect when the compressed air system is not performing as expected. K-means clustering on the compressor power consumption is employed for mode identification and intelligent efficiency monitoring. The system is formally coded in MATLAB with a GUI for visualisation. The tool has been trialled on a compressed air system which is representative of installations in global industry.

Keywords Fault detection · Clustering · Compressed Air · Expert Systems · Mode Identification · Energy Efficiency

1 Introduction

In 2012 industry consumed 2,542 Mtoe of energy globally, which represented over 28% of the 8,980 Mtoe of global final energy consumption (IEA (2012)). In an Irish context, industry consumed 2.26 Mtoe of energy in 2012, representing almost 22% of Ireland's 10.3 Mtoe of final energy consumption. The business case for energy efficiency improvements in industry is clear, particularly in the high-tech sector

(Mills et al (2007)). An economic efficiency model for energy using equipment has previously been proposed which quantifies the cost-benefit of improved efficiency (Blum (2014)). Within the category of industrial energy, compressed air is recognised as an energy intensive utility, accounting for 10% of industrial electricity in the European Union (Saidur et al (2010)). Compressors are generally recognised as significant energy users in an industrial context (Wang and Brown (2013)). Energy costs typically account for 78% of the total life cycle cost of a compressed air system (Radgen (2006)). Compressed air is known colloquially in industry as the fourth fuel, due to the high electrical cost associated with generation. Compressed air systems are typically running at 19% overall system efficiency (Saidur et al (2010)), due to energy losses largely due to lost heat of generation and leakages. Oversized systems are also prevalent in industry, leading to energy wastage (Laurijssen et al (2013)).

Compressed air has been recognised as having significant energy saving potential in industry (Wang (2014)), not least through measures such as retrofitting of variable speed drives, inlet air temperature reduction, waste heat recovery, and pressure and leakage reduction (Wang (2008)). It is therefore desirable to manage the performance of air compressors in order to minimise their associated energy consumption, which is the goal of this paper.

2 Determining the operational performance of an air compressor

A wide range of configurations and types of compressed air systems are installed in industry. In many cases there exist systems which are running sub-optimally, either due to unsuitability for the task at hand or running in a faulty condition. Given that compressed air represents such a dense form of energy transport, it is beneficial in terms of long and short

This work was funded by Marine Renewable Energy Ireland (MaREI) at University College Cork

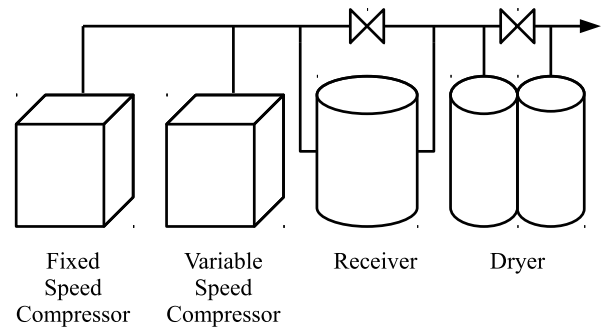
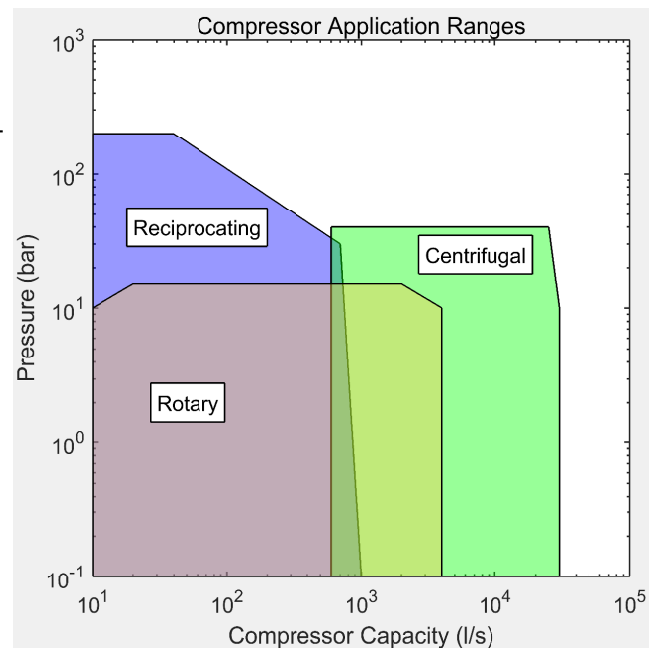
Seán Martin Hayes · Ken Bruton · D.T.J. O'Sullivan
School of Engineering
University College Cork
Ireland
Tel.: +353-21-4902913
Fax: +353-21-4276648
E-mail: sean.m.hayes@umail.ucc.ie

Table 1 Existing Compressed Air System Performance Management Methods

Performance Management Method	Advantages	Disadvantages
Maintenance Contracts	Security of asset reliability	Potential for unnecessary work
Periodic Audits	Likely to pick up on common opportunities for improvement	Dependent on skill level of auditor
Sequence Controllers	Can draw on manufacturer knowledge of system operation	Initial configuration may not be maintained due to system changes
BMS Monitoring	Desk-based site wide monitoring capability	Dependent on skill level of BMS reviewer. Unable to pick up on sensor errors

term overall energy efficiency goals to manage the performance of air compressors. Performance management is typically achieved through means such as those in Table 1. The effectiveness of measures such as energy audits has been documented (Fleiter et al (2012)). The key disadvantages of existing methods are either that they are manual and periodic in nature, or that they require the intervention of a human expert in compressed air systems to be effective. In the case of maintenance contracts and periodic audits, there is also the potential for unnecessary work to be carried out, as both these measures are typically carried out on a timescale basis. The intervention of a human expert can also lend itself to an inefficient method of performance measurement. An expert may be particularly well versed with one type of system, but not another. The disparate range of compressed air systems can lead to an expert restricting themselves to one type of system, preventing possible lessons learned to be applied in other suitable cases. If a big data approach is correctly taken lessons learned in one facility may be effectively applied in others (ODonovan et al (2015b)).

In order to analyse a particular compressed air system it is useful to understand how it might relate to other installations. The system analysed in this paper consists of two rotary tooth air compressors with a heated desiccant dryer, with the layout given in Figure 1. These machines are rotary tooth type machines, which are widely deployed across industry for applications with medium pressure and capacity requirements, as shown in Figure 2 (SEAI (2007)). The various types of compressors typically used in industry are shown in Figure 3. Reciprocating and rotary machines are both positive displacement type machines. They work through isolation of a quantity of air in a space which is then reduced in volume. Centrifugal machines are aerodynamic machines, which operate by imparting kinetic energy to air,

**Fig. 1** Test Site Compressed Air System Layout**Fig. 2** Compressor Application Suitability

which is then converted to pressure energy by stopping the moving air. The three most common types of compressor in industry are rotary, reciprocating and centrifugal machines.

Research is being carried out to define the future of compressed air system performance management. In this review the research considered is that of ongoing analysis of compressed air system data. This ongoing analysis could be designated as having any of the goals outlined in Table 2.

This review categorises industrial utility performance management methods into three high-level classifications, which are themselves subdivided into individual methods. These three categories are:

1. Quantitative model based methods
2. Qualitative model based methods
3. Process history based methods

These three categories are shown visually in Figure 4, which is adapted from previous works on system performance man-

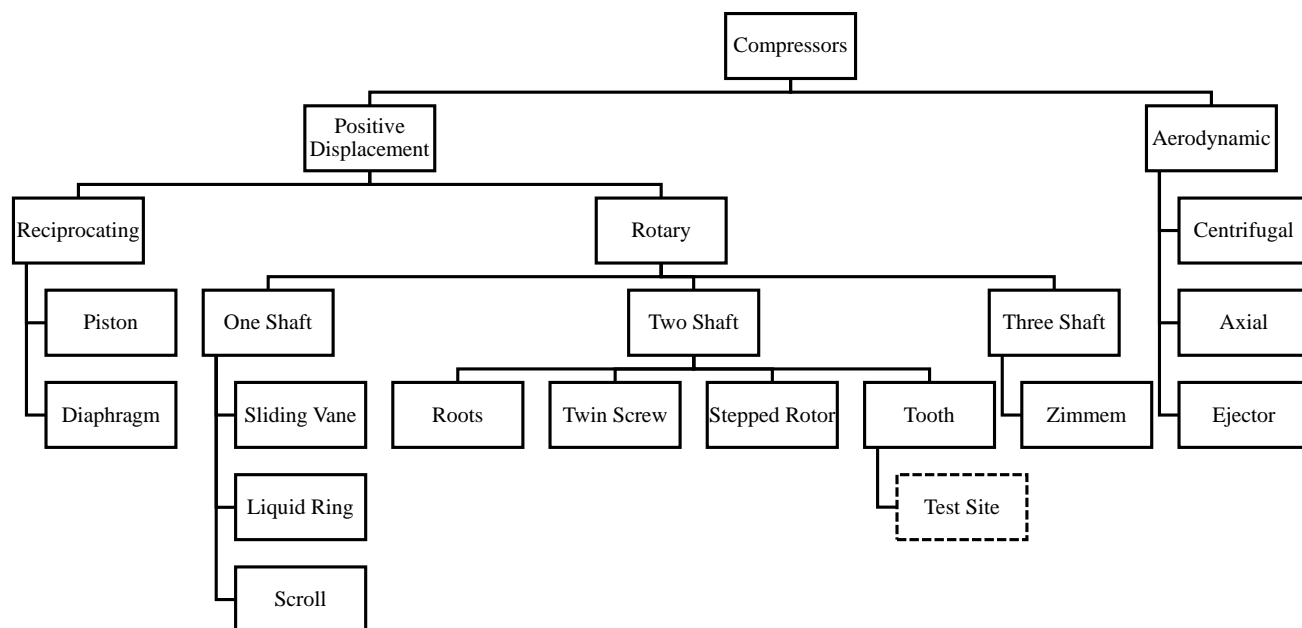


Fig. 3 Compressor Types

agement and diagnostic approaches (Katipamula and Brambley (2005), Venkatasubramanian (2003), Venkatasubramanian et al (2003a), Venkatasubramanian et al (2003b), Gao et al (2015b), Gao et al (2015a), Bruton et al (2013)).

2.1 Quantitative model based methods

In the field of compressor performance management, one approach which may be used is that of the development of a quantitative model describing the compressors operation, and analysing actual operation with respect to this modelled operation in order to achieve one of the goals outlined in Table 2. This comparison may lead to the generation of differences between measured and modelled variables, which are termed residuals. This concept of inconsistency between variables is known as redundancy.

Redundancy may be either physical or analytical. Physical redundancy relies on the installation of parallel sensors on the system being analysed. Residual differences between parallel sensors may then highlight sensor issues. This form of redundancy has historically been prevalent in safety-critical systems such as aircraft control. However in many applications space and cost requirements render this method less desirable.

Analytical or artificial redundancy may be achieved through formalisation of the fundamental relationships between the states, inputs and outputs of a system, as is the case in quantitative model based methods of performance improvement.

This inherent redundancy may take either a direct or a temporal approach.

A direct approach to analytical redundancy is to derive algebraic equations between different sensor measurements. This concept is useful when limited sensor instrumentation is present on a system, as data which may be desirable to know may be calculated from data which is available. If a sensor is available for the calculated value, the concept of redundancy may be used to generate a residual. If the residual exceeds a given threshold then a sensor fault may be present.

In contrast, temporal redundancy is obtained by analysing the difference relationships between sensor outputs and actuator inputs. If an actuator input is intended to produce a difference between sensors, and this difference is not present, then either a sensor or actuator fault may be present.

Numerical models of a system have also been used with success to analyse the potential benefits to be achieved by retrofitting measures (Murray et al (2012), Murray et al (2014)).

2.2 Qualitative model based methods

Qualitative model based methods may be distinguished from quantitative model based methods by their abstraction of the physical principles governing the operation of a system. Where quantitative methods seek precise numerical values for the parameters of a system, qualitative methods are generally satisfied with simplified models of a system.

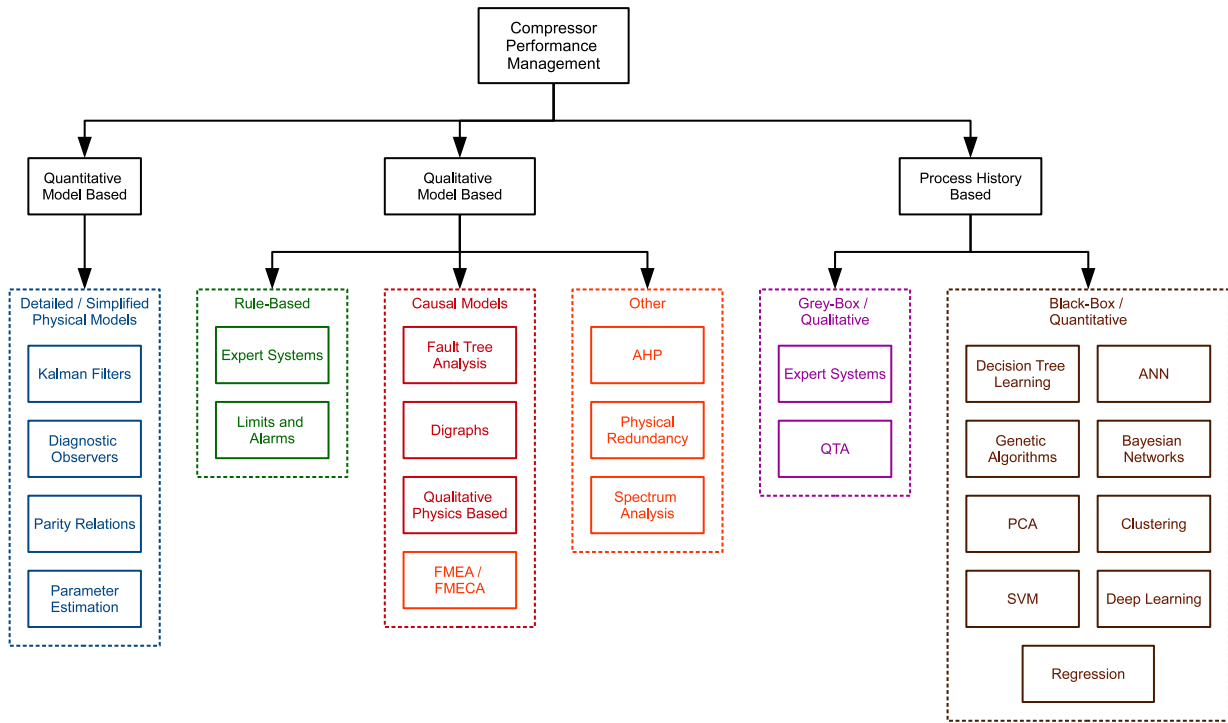


Fig. 4 Current research into performance management methods

To demonstrate this difference the example of an air compressor in operation is considered. If a quantitative model is used for analysis of this system, it can require inputs of all possible system and environmental variables (voltage, current, ambient air conditions) in order to make a calculation on what the compressed air flowrate should be. A qualitative approach to this situation would be to hypothesise that with an increase in current drawn by the compressor, an increase in compressed air flowrate should also be observed. While the quantitative approach may flag a slight decrease in performance of the machine if the expected flowrate is not met, the qualitative approach will immediately highlight a serious issue with the compressor if an increase in power does not correspond to an increase in flowrate. The time required to develop quantitative solutions is typically greater than that for qualitative solutions. This suggests that for rapid deployment of ad-hoc compressor performance management solutions, a qualitative approach may be more suitable. Of particular note in this set of performance management methods is rule-based expert systems, which have been selected as a method to trial in this paper. Rule-based expert systems have been applied with success in the area of HVAC (Bruton et al (2014a)).

2.3 Process history based methods

Process history based methods may be subdivided into qualitative and quantitative categories, or grey and black-box methods respectively.

2.3.1 Qualitative process history based methods - expert systems

Expert systems as applied to the process history methodology as opposed to the qualitative model methodology are concerned with extracting useful features from historical data, and using qualitative knowledge of the relevant system to explain and make use of these features. One example of this methodology was employed during the creation of rules in section 3. While some rules were developed using hypotheses about the compressed air system under analysis, analysis of data gathered showed that under normal conditions, the oil pressure of the air compressor rose with increasing outlet pressure, and fell with decreasing outlet pressure. While this could have been hypothesised beforehand, it was not until the data was analysed that this feature was noticed. This led to the development of a rule to flag when oil pressure did not track compressor outlet pressure.

The limitations associated with process history based expert systems are similar to those associated with quali-

Table 2 Goals of Performance Management

Goal	Description	Example Work
Fault Detection and Diagnosis	Monitor system parameters to determine when system is in fault condition and the potential reasons for the identified fault	Using vibration, pressure and current signals to diagnose valve faults for a reciprocating compressor (Tran et al (2014))
Prognostics	Monitoring system parameters to determine when a component of a system will no longer perform its intended function (Vachtsevanos et al (2006))	Determining the remaining useful life of a gaseous circuit breaker based on gas pressure and ambient temperature (Catterson and Costello (2013))
Analytics	Monitoring system parameters to discover meaningful patterns which may advise on potential improvements to system operation	Determining abnormal appliance power consumption based on analysis of individual appliances acoustic noise (Pathak et al (2015))
Automated Commissioning	Achieving, verifying and documenting that the performance of a system satisfies the current user requirement	Automatically carrying out the normal testing procedure for an air compressor by replicating the tasks normally carried out during commissioning (Mazid and Martin (2008))
Optimisation	Improving system operation or design as measured against some defined criteria	Development of a tool which delivers an optimal design for a compressed air system based on energy and life cycle costing (Friden et al (2012))
Control	Managing the operation of a system in order that operating conditions remain in line with design states and undesirable states are avoided	Development of a control algorithm for fixed speed compressors that provides the pressure control capabilities of a variable speed system while limiting energy consumption (Facchinetti et al (2014))

tative model based expert systems. In both cases a reliance is placed on the ability of the human expert to accurately determine rules and possible fault diagnoses. In the case of the oil pressure rule described above, it is hypothesised that a potential cause of fault should the oil pressure not rise when expected be that the oil pump has failed. However it is ac-

knowledge that this fault may be equally symptomatic of a blocked valve or a sensor failure.

2.3.2 Quantitative process history based methods

Quantitative methods for system fault detection seek to extract useful features from historical data in a black-box fashion. The terminology of black-box is used to denote methods which are not influenced by fundamental engineering relationships between variables, but rely on statistical and machine learning methods to extract useful features. This is distinguished from qualitative or gray-box methods which employ a modicum of understanding of the physical processes governing a systems operation.

Quantitative methods attempt to classify or group data into useful classes through pattern recognition. These methods are generally stochastic in nature, i.e. they do not assume that the future state of the system is necessarily influenced by past and present states. This gives such methods a probabilistic aspect, or a confidence rating in how accurately they are able to predict and classify system variables.

3 Rule base development and testing

3.1 Nomenclature for rule parameters

Before discussing the development of the expert rule set concerning air compressor performance assessment, it is useful to define the naming convention used. Table 3 gives the nomenclature used in rule development.

3.2 Rule formulation methodology

One of the approaches for performance management of air compressors outlined in subsection 2.2 is that of Expert Systems. This is a qualitative method which can use rule sets to encode expert knowledge about a system for flagging when a fault in operation is present. This method has been used with success in the case of HVAC (Bruton et al (2014b), House et al (2001)) and the area of air compressors (Liu (2001)). Rules for system analysis are typically derived by taking a fundamental engineering overview of the system, and hypothesising potential rules to determine particular faults.

Figure 5 shows a high level overview of the test site air compressor, which is a two-stage rotary tooth machine. The figure highlights the expected temperature changes as the compressed air is operated on by each fundamental component. These expected operations form the basis for an initial set of rules to flag when the machine is not operating as expected. To illustrate this point the first element of compression is analysed in detail.

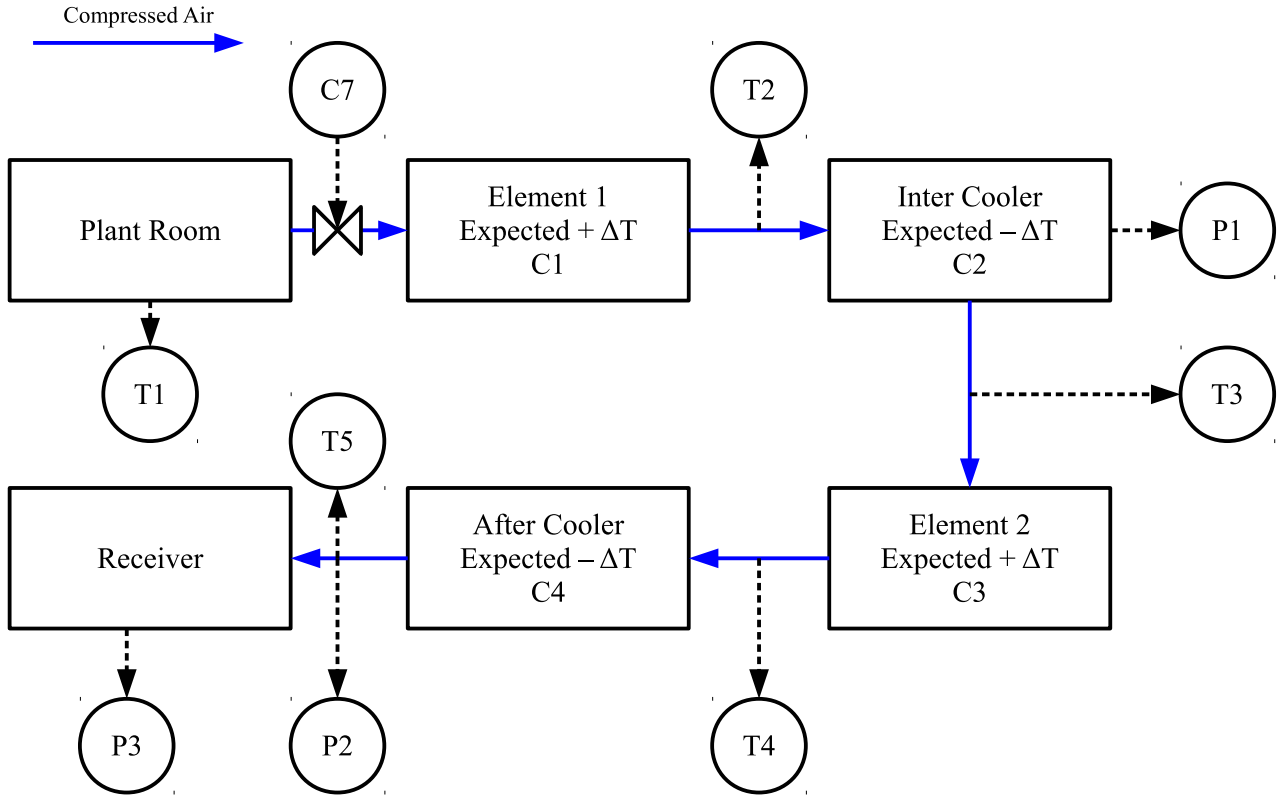


Fig. 5 Two stage compressor air flow

Element 1 of the air compressor compresses air from atmospheric pressure (101 325 Pa) to 250 000 Pa. When the compressor is at minimum loading, it is designed to produce 41 L s^{-1} of free air. It is useful to analyse the thermodynamics of compressing air at this point. Figure 6 shows the relevant thermodynamic diagrams for the compression of this volume of air isothermally, adiabatically and polytropically. The air is compressed in a space which is surrounded by ambient air, which is not an ideal heat reservoir. Therefore the isothermal compression case is not valid. The air is not however thermally isolated from its surroundings, therefore the adiabatic case is also not valid. Actual air compression typically follows the polytropic process model, with the polytropic exponent of Equation 1 ranging between 1 and 1.4.

$$P_1 V_1^n = P_2 V_2^n \quad (1)$$

where P = Absolute pressure (Pa)

V = Absolute volume (m^3)

n = Polytropic exponent

Given that the compression process taking place is not isothermal, it is logical to expect that the temperature of the compressed air will increase through the first element

of compression, in accordance with Figure 6. If a decrease in temperature is observed, then either a failure in the first stage of compression or in a temperature sensor can be determined. This forms the basis for the first rule of the rule set created for compressor performance analysis, which is summarised in Table 4.

$$\text{Rule 1. } T1 - T2 > 0 \quad (2)$$

In a similar manner to Rule 1, Rules 2, 3 and 4 fire when the expected temperature of the compressed air does not change as expected across the intercooler, second element of compression and aftercooler respectively.


$$\text{Rule 2. } T3 - T2 > 0 \quad (3)$$

$$\text{Rule 3. } T3 - T4 > 0 \quad (4)$$

$$\text{Rule 4. } T5 - T4 > 0 \quad (5)$$

Table 3 Nomenclature

Reference	Item	Value
Sensors		
T1	Plant Room Temperature	-
T2	Element 1 Outlet Temperature	-
T3	Element 2 Inlet Temperature	-
T4	Element 2 Outlet Temperature	-
T5	Final Delivery Temperature	-
P1	Compressed Air Pressure in Intercooler	-
P2	Compressed Air Final Delivery Pressure	-
P3	Compressed Air Receiver Pressure	-
P4	Oil Pressure	-
P5	Ambient Pressure	-
N1	Motor starts per 5 minutes	-
K1	Compressor power	-
Components		
C1	Element 1	-
C2	Intercooler	-
C3	Element 2	-
C4	After Cooler	-
C5	Motor	-
C6	Oil Pump	-
C7	Load/Unload Valve	-
Expected Levels		
T6	Plant Room Temperature	25 °C
T7	Element 1 Outlet Temperature	140 °C
T8	Element 2 Inlet Temperature	22 °C
T9	Element 2 Outlet Temperature	100 °C
T10	Final Delivery Temperature	21 °C
P6	Compressed Air Pressure in Intercooler	2.5 bar
P7	Compressed Air Final Delivery Pressure	7.25 bar
P8	Compressed Air Receiver Pressure	7.25 bar
N2	Motor starts per 5 minutes	1
K2	Compressor power idle	1.5 kW
K3	Compressor maximum power unloaded	8.4 kW
Warning Levels (High)		
T11	Plant Room Temperature	35 °C
T12	Element 1 Outlet Temperature	155 °C
T13	Element 2 Inlet Temperature	24 °C
T14	Element 2 Outlet Temperature	120 °C
T15	Final Delivery Temperature	21 °C
P7	Compressed Air Pressure in Intercooler	2.6 bar
P8	Compressed Air Final Delivery Pressure	7.6 bar
P9	Compressed Air Receiver Pressure	7.6 bar
N3	Motor starts per 5 minutes	2
Error Thresholds		
E1	Plant Room Temperature	5 °C
E2	Element 1 Outlet Temperature	5 °C
E3	Element 2 Inlet Temperature	5 °C
E4	Element 2 Outlet Temperature	5 °C
E5	Final Delivery Temperature	5 °C
E6	Compressed Air Pressure in Intercooler	0.1 bar
E7	Compressed Air Final Delivery Pressure	0.1 bar
E8	Compressed Air Receiver Pressure	0.1 bar
E9	Oil Pressure	0.1 bar

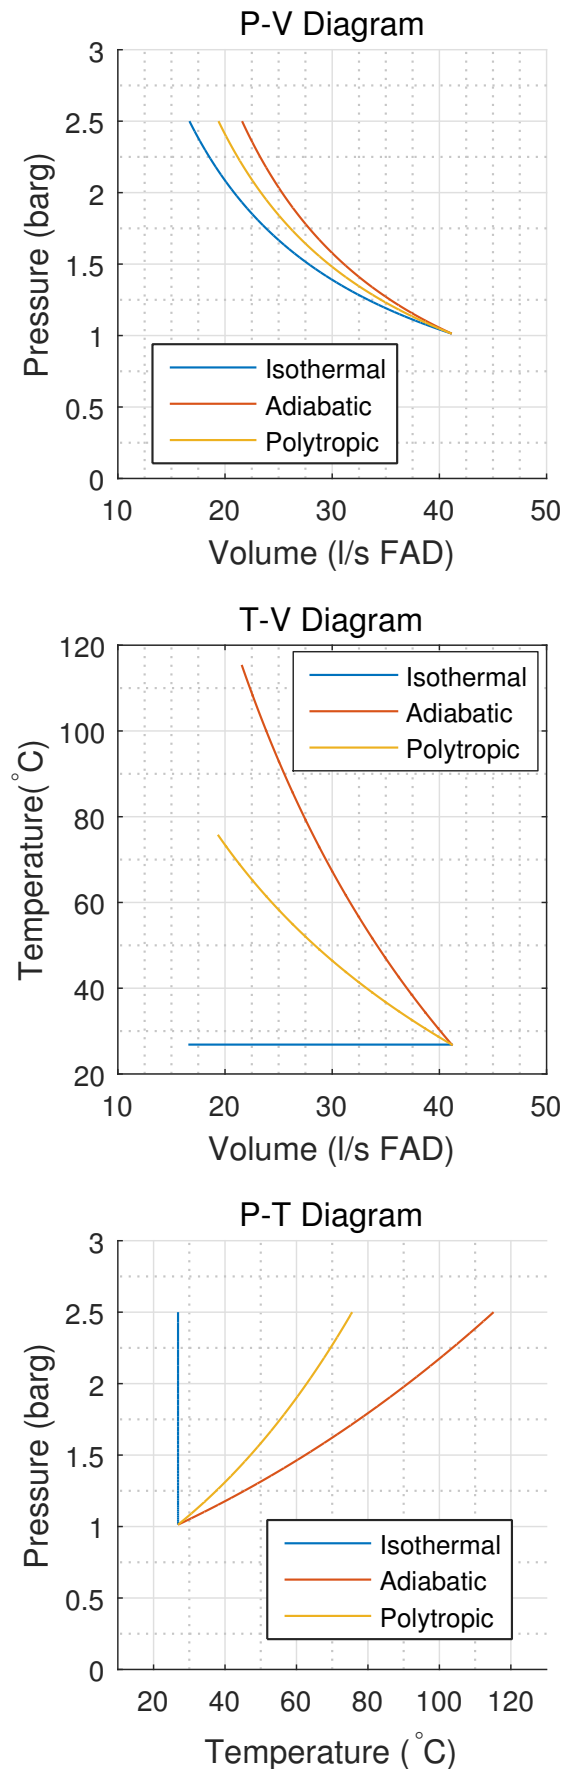**Fig. 6** Thermodynamics of Air Compression

Rules 5, 6, 7, 8 and 9 are threshold rules, in that they fire when defined thresholds for T1, T2, T3, T4 and T5 respectively are exceeded. These threshold values have been devised through a combination of historical data analysis and manufacturer defined alarm levels where available.

$$\text{Rule 5. } (T1 - E1) > T11 \quad (6)$$

$$\text{Rule 6. } (T2 - E2) > T12 \quad (7)$$

$$\text{Rule 7. } (T3 - E3) > T13 \quad (8)$$

$$\text{Rule 8. } (T4 - E4) > T14 \quad (9)$$

$$\text{Rule 9. } (T5 - E5) > T15 \quad (10)$$

The first element of compression in a two-stage compressor is designed to compress air to an intermediate pressure, before intercooling and compression to final delivery pressure by the second element of compression. If this intermediate pressure is not achieved, it is indicative of either a pressure sensor fault, or a fault in element 1 operation. If the first element of compression is faulty in operation, this will lead to excessive strain on the second element of compression to achieve final delivery pressure. Rule 10 flags when this intermediate pressure is not met.

$$\text{Rule 10. } (P1 + E6) < P6 \quad (11)$$

For a single compressor in isolation, if the final delivery pressure continues to rise when the compressor is running in unloaded mode, it is indicative of either a fault in the relevant pressure sensor, or that the load/unload valve of the compressor has failed. Rule 11 fires when this pressure rise in unloaded mode takes place.

$$\text{Rule 11. } (P2(t) - (P2(t-1))) > 0 \quad (12)$$

If the motor driving the compressor is switching on and off excessively, it will lead to premature wear and tear on the compressor mechanical drive. Rule 12 fires when a threshold for the number of motor starts has been exceeded.

$$\text{Rule 12. } \sum_{t=0}^{300s} N1 > N2 \quad (13)$$

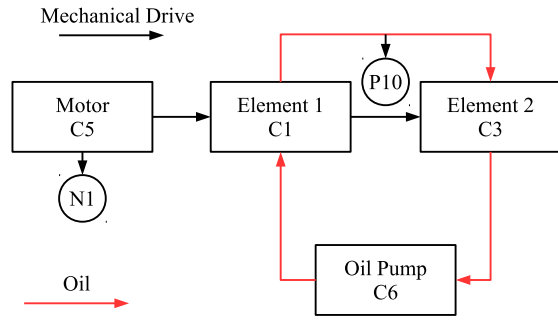


Fig. 7 Mechanical drive two stage compressor

Figure 7 shows the mechanical layout of a two stage air compressor. In an air compressor lubricated by oil, the oil should circulate when the compressor is loaded. If the oil pressure does not rise with the compressor loaded, it is indicative of a blockage in the oil circulation system, a failure of the oil pump, or a pressure sensor fault.

$$\text{Rule 13. } (P4(t) + E9) < P4(t-1) \quad (14)$$

The compression of air in both the first and second element of a two-stage air compressor follows defined thermodynamic principles. If the compression chamber were thermally isolated from its surroundings, the compression would be adiabatic. If it were in thermal contact with an ideal heat reservoir, the compression would be isothermal. Neither of these is the case, and actual air compression is polytropic, as defined by Equation 1. The temperature rise of compressed air for each of the three types of compression is given in Figure 6. The theoretical maximum temperature rise of air under compression is given by the adiabatic case. Therefore, while it is known that the air will compress polytropically, it can be assumed that if the outlet temperature of either the first or second element of compression is greater than that dictated by the adiabatic case (with the polytropic exponent of Equation 1 set to 1.4), then a fault is present in the system. This fault may either be in one of the relevant temperature sensors, or additional heat may be being supplied to the air under compression. This principle dictates when Rules 14 and 15 are fired.

$$\text{Rule 14. } T2 > T1 * \left(\frac{P1}{P5} \right)^{\frac{\gamma-1}{\gamma}} \quad (15)$$

$$\text{Rule 15. } T4 > T3 * \left(\frac{P2}{P1} \right)^{\frac{\gamma-1}{\gamma}} \quad (16)$$

where γ = heat capacity ratio of air (1.4)

Rules 1-15 are summarised in Table 4, along with the potential faults which would explain each rule being fired.

Table 4 Compressor performance assessment rule set

Rules		Potential Faults															
ID	Description	T1	T2	T3	T4	T5	P1	P2	N1	P10	C1	C2	C3	C4	C5	C6	C7
1	Element 1 Temperature Decrease	X	X								X						
2	Intercooler Temperature Increase		X	X								X					
3	Element 2 Temperature Decrease			X									X				
4	Aftercooler Temperature Increase				X	X								X			
5	Plant Room Temperature High	X															
6	Element 1 Outlet Temperature High		X								X						
7	Element 2 Inlet Temperature High			X								X					
8	Element 2 Outlet Temperature High				X								X				
9	Final Outlet Temperature High					X								X			
10	Expected Intercooler Pressure not Achieved						X				X						
11	Increase in Outlet Pressure when Unloaded							X									X
12	High Stop-Start Frequency of Motor Observed								X						X		
13	Failure of Oil Pressure to Rise under Loading									X						X	
14	Theoretical Element 1 Temperature Rise Exceeded		X								X						
15	Theoretical Element 2 Temperature Rise Exceeded				X								X				

The potential impact on system performance of each rule being fired is given in Table 5/

Table 5 Impact of rules on compressor performance

Rule	Impact		
	CA User Requirement	Energy	Maintenance / Equipment Life
1	X		X
2		X	X
3	X		X
4		X	
5		X	
6		X	X
7		X	X
8		X	X
9		X	X
10	X		
11		X	X
12		X	X
13			X
14		X	X
15		X	X

4 Operational mode identification

It was noted during rule set development that it is desirable to know the mode of operation of an air compressor when applying rules. This follows on from lessons learned in similar work relating to HVAC (Bruton et al (2014b)). With a HVAC unit, the different modes of operation that are useful to determine which rules to apply are Heating, Cooling with Outdoor Air, Mechanical Cooling with 100% Air and Mechanical Cooling with Minimum Outdoor Air, with these modes further categorised into Occupied and Unoccupied Modes (House et al (2001)). Knowing the mode of oper-

ation of equipment can ensure that rules are only applied where pertinent, reducing false positive occurrences.

The modes of operation designated for a variable speed air compressor are given in Table 6. To determine which mode of operation the compressor is actually in, the power drawn by the machine was analysed. The Compressed Air and Gas Institute (CAGI) specifies a standard data sheet for air compressors which major manufacturers adhere to (CAGI (2015)). The input power to the compressor as given on this sheet where available is also given in Table 6. Modes 1 and 3 were recognised as being useful modes to have knowledge of, despite not having prior knowledge of the associated input power from the CAGI data sheet. From visual observation of a power meter installed at the test site, it was noted that Mode 1 had an approximate power requirement of 1 kW, and Mode 2 an approximate power requirement of 20 kW

Table 6 VSD compressor operation modes

Mode	Description	CAGI Input Power (kW)
1	Idle	-
2	Unloaded	8.9
3	Minimally Loaded	-
4	VSD 0-20%	27.2
5	VSD 20-40%	31.2
6	VSD 40-60%	38.3
7	VSD 60-80%	42.6
8	VSD 80-100%	52

To monitor the power drawn by the compressor for mode identification, a clustering methodology was trialled. This unsupervised learning method allows the compressor power meter data to be grouped into distinct clusters as per Table 6. An additional benefit to be gained from this approach is that a drift upward in the geometric mean or centroid of any cluster could diagnose a decrease in efficiency of the machine at

that operating point, as more power is required to achieve the same output.

K-means clustering was used to group the electrical meter data into clusters. The general methodology of K-means clustering is shown in Figure 8. K-means clustering consists of two fundamental iterative steps preceded by one initial step. The number of clusters is set initially and denoted K . Centroids for the K clusters are then randomly initialised. All data points are then indexed according to the cluster centroid closest to them, as shown in Equation 17,

$$c^{(i)} := \min_k \|x^{(i)} - \mu_k\|^2 \quad \text{for } i = (1, 2, \dots, m) \quad (17)$$

where C is a vector of elements $c^{(i)}$ the same length as the data set X with m points $x^{(i)}$, and K is a vector of length k , i.e. the number of clusters used for clustering. The vector C gives the index of the cluster centroid closest to each point in X .

Following this step there are K clusters in the dataset X , each of which is a subset of the overall dataset and is denoted by S_j . The centroids of each cluster are recomputed as the mean of all points assigned to each cluster, as shown in Equation 18,

$$\mu_j := \frac{1}{|S_j|} \sum_{x_j \in S_j} x_j \quad \text{for } j = (1, 2, \dots, k) \quad (18)$$

where x_j is a point in the dataset X which is assigned to the j^{th} cluster. Equation 17 and Equation 18 are then iterated until the assignments of data points to different clusters no longer change.

An initial attempt was made to cluster the power consumption data into two groups, i.e. Idle/Unloaded and Loaded or Modes 1-2 and 3-8 from Table 6 respectively. K was therefore initially set to 2. The results of this exercise are shown in Figure 9. When comparing the cluster centroids to the values in Table 6 and visual observation of the compressor power under operation, it can be determined that one of the two clusters formed is of use in further analysis, i.e. $c^{(1)} = 21.3 \text{ kW}$. This is a reasonable representation of the power drawn by the compressor at minimal loading. However $c^{(2)} = 7.2 \text{ kW}$ is not as useful a value, as it is clear from Figure 9 that the cluster centroid is significantly below the clear cluster of compressor power operating in unloaded mode.

In order to try to gain more useful information about compressor power at different operating modes, K was increased to 3. The intention was that the clear distortion of $c^{(2)}$ by the grouping of compressor power in idle mode at approximately 1 kW be removed by forming a new cluster for idle mode or Mode 1 as per Table 6. The results of this exercise are shown in Figure 10. Mode identification is accurate with this approach for Modes 1, 2 and 3 as per Table 6,

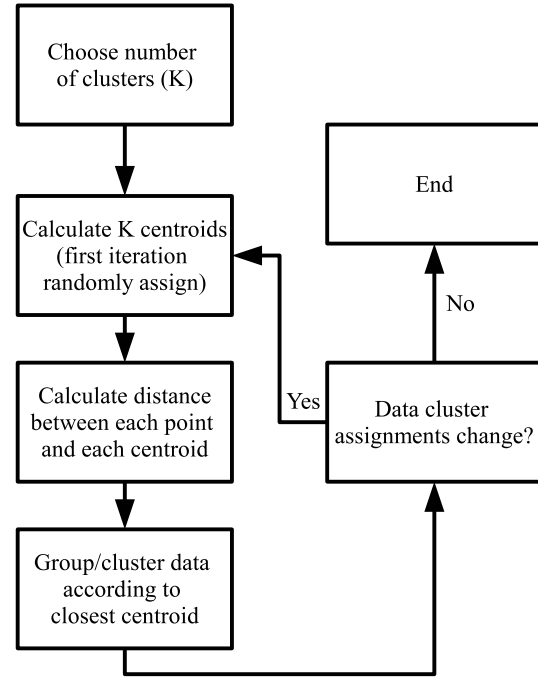


Fig. 8 K-means clustering methodology

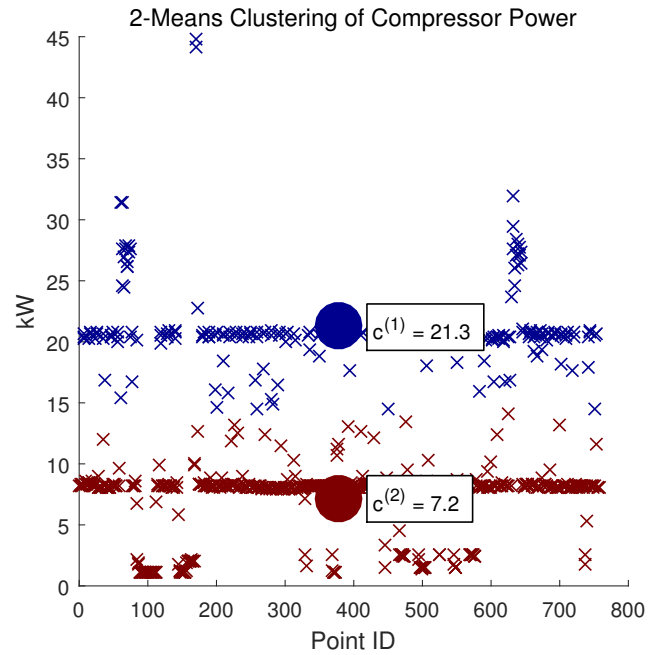


Fig. 9 2-Means Clustering Results

as the cluster centroids are consistent with both known and observed values for the different modes.

The ideal level of accuracy for mode identification would be to determine cluster centroids for each of Modes 1-8. However the test site air compressors are significantly oversized compared to the compressed air demand. It was known that at no point in the training set did the compressor operate

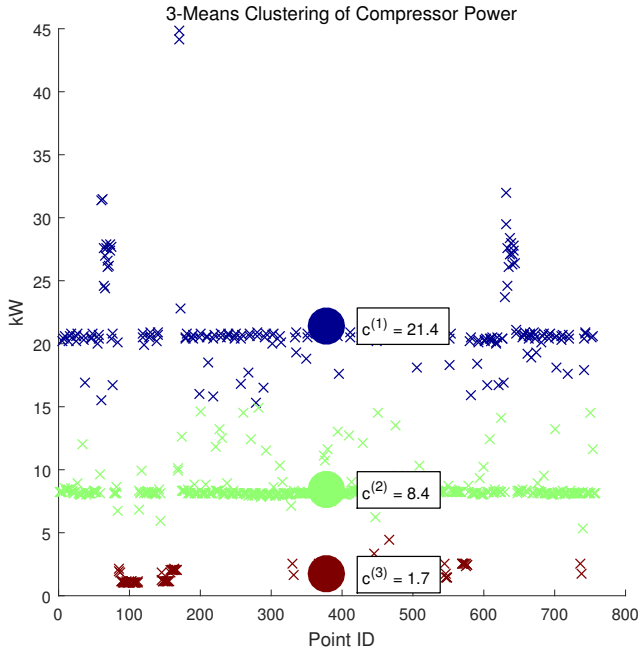


Fig. 10 3-Means Clustering Results

in Mode 8, and very rarely operated in Modes 4-7. Therefore a 7-means clustering approach was trialled. The results of this trial are shown in Figure 11. When comparing the results with Table 6, it is clear that there are two superfluous clusters in the region between Modes 2 and 3. That the analysis was unable to identify cluster centroids for Modes 5 and 6 is attributable to two factors. Firstly, there is a very low incidence of data points in these operating modes in the data set used. Secondly, the compressor takes a number of seconds to ramp up or down between Modes 2 and 3. The relatively high granularity of the data set (recording every 10 s) meant that a reasonably significant number of data points are recorded between these modes, and so the superfluous clusters have been identified.

While the 7-means clustering exercise identified superfluous clusters, it demonstrated that for the trial data set clustering was able to effectively identify five modes of operation. Therefore 5-means clustering was implemented on the data set to group the data into operational modes 1-4 and 7. The results of this implementation are shown in Figure 12. As expected this approach was able to correctly group the data into the required operational modes as per Table 6.

4.1 Mode application to rules

The clustering method for mode identification was used to apply rules only when pertinent. The applicability of rules to different modes of operation is given in Table 7.

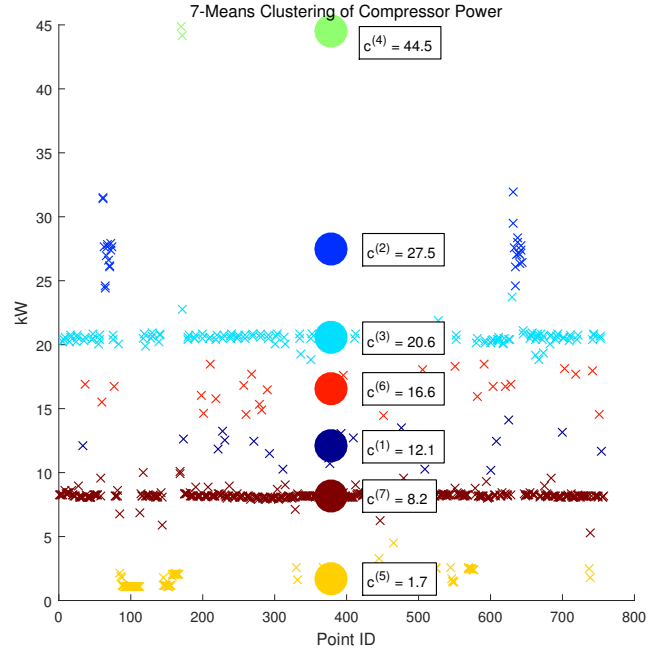


Fig. 11 7-Means Clustering Results

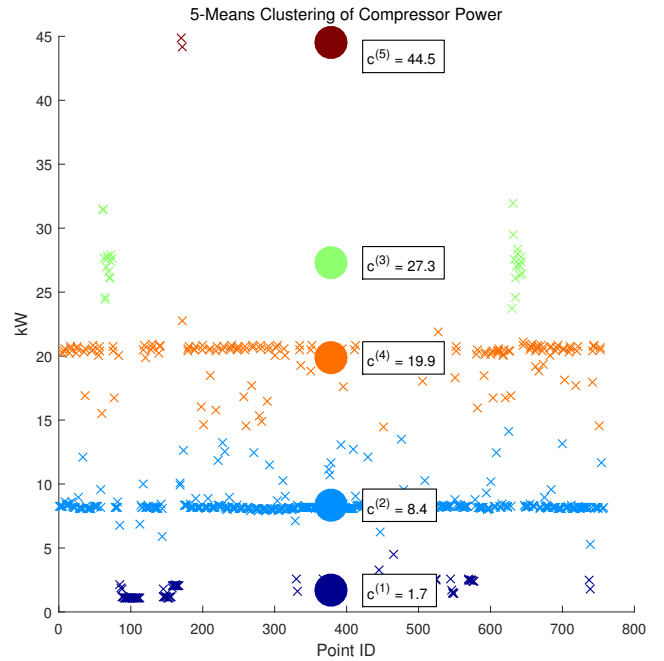



Fig. 12 5-Means Clustering Results

4.2 Mode application to efficiency monitoring

A useful application of the 5-means clustering method trialled would be to detect when the efficiency of the air compressor deteriorates. This could be achieved by continually updating the cluster centroids with new data and monitoring if there is an increase in power consumption for any given mode. The results of this approach are shown in Figure 13. There is a slight increase in power consumption for Mode

Table 7 Rule applicability of modes

Rule	Mode		
	1	2	3:8
1			X
2			X
3			X
4			X
5	X	X	X
6			X
7			X
8			X
9			X
10			X
11		X	
12			X
13			X
14			X
15			X

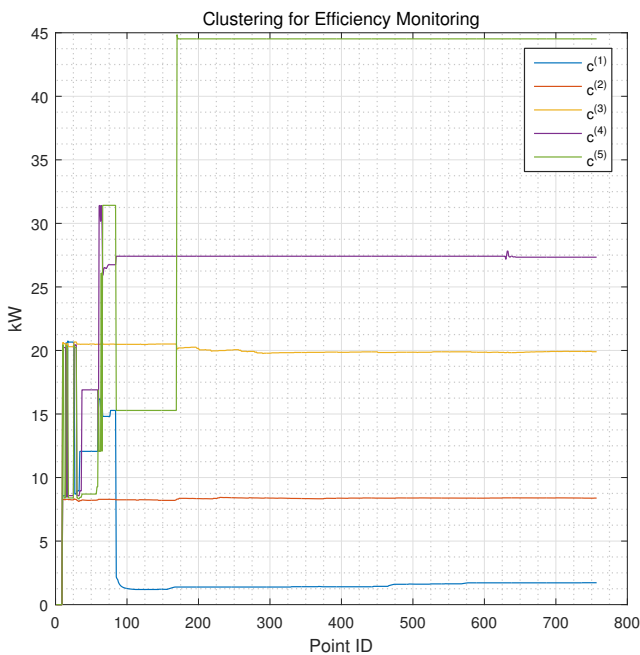**Fig. 13** Clustering for efficiency monitoring

1 which may be attributable to an increase over time in the cooling of the power electronics associated with the variable speed drive controller. Future work will monitor these cluster centroids over a longer time span, allowing for concrete determination of when the power usage of the compressor is excessive compared to historical data. The effectiveness of tracking performance metrics such as this has been demonstrated as being powerful for improving a building's operation (OSullivan et al (2004)).

5 Fault detection implementation

5.1 Data extraction

In order to apply the compressor performance rule set it was required to extract the operational data from the test site air compressors. A Modbus network was created to achieve this goal. The Modbus network daisy-chains the two air compressors on site with the compressed air dryer. A proprietary gateway exposes the Modbus registers of the 50 key performance parameters required for analysis. This gateway is supervised by a Tridium JACE box which acts as a Modbus master. The JACE box is connected to the internet using a 4G mobile modem, which allows for remote access and download of operational data. A screenshot of the web interface of the JACE box is shown in Figure 14.

5.2 Rule set and clustering implementation

The data which was extracted from the compressed air monitoring system was stored in a MySQL database, to allow for analysis using MATLAB. Clustering was used to determine the operational mode of the air compressor at any given point. This knowledge was then used to apply pertinent rules to the data as per Table 7. To allow for visualisation of the knowledge gained from the analysis a GUI was created. A screenshot of this GUI is shown in Figure 15, with testing of rule 14 shown for demonstration purposes. The top section of the GUI displays operational data relevant to the rule being checked. The lower section shows the status of the rule being checked. A value of 1 denotes that the rule has fired, and 0 that there is no issue.

It is clear that in the case of rule 14, the rule fires frequently. This suggests either that the compressed air is picking up heat in excess to the heat of compression, or that a sensor is faulty. This GUI may be used for continual analysis of the compressor performance to allow for intelligent recommendations as to when the compressor is operating sub-optimally.

6 Conclusions and future work

A rule based expert system has been created for fault detection of an industrial compressed air system. The expert system employs k-means clustering for mode identification and improved energy efficiency monitoring. Implementation has been achieved using MATLAB, with results demonstrated using a custom-built GUI.

It is planned to automate the process of data extraction from the system Modbus network, as currently Excel sheets are required to be downloaded manually and added to the

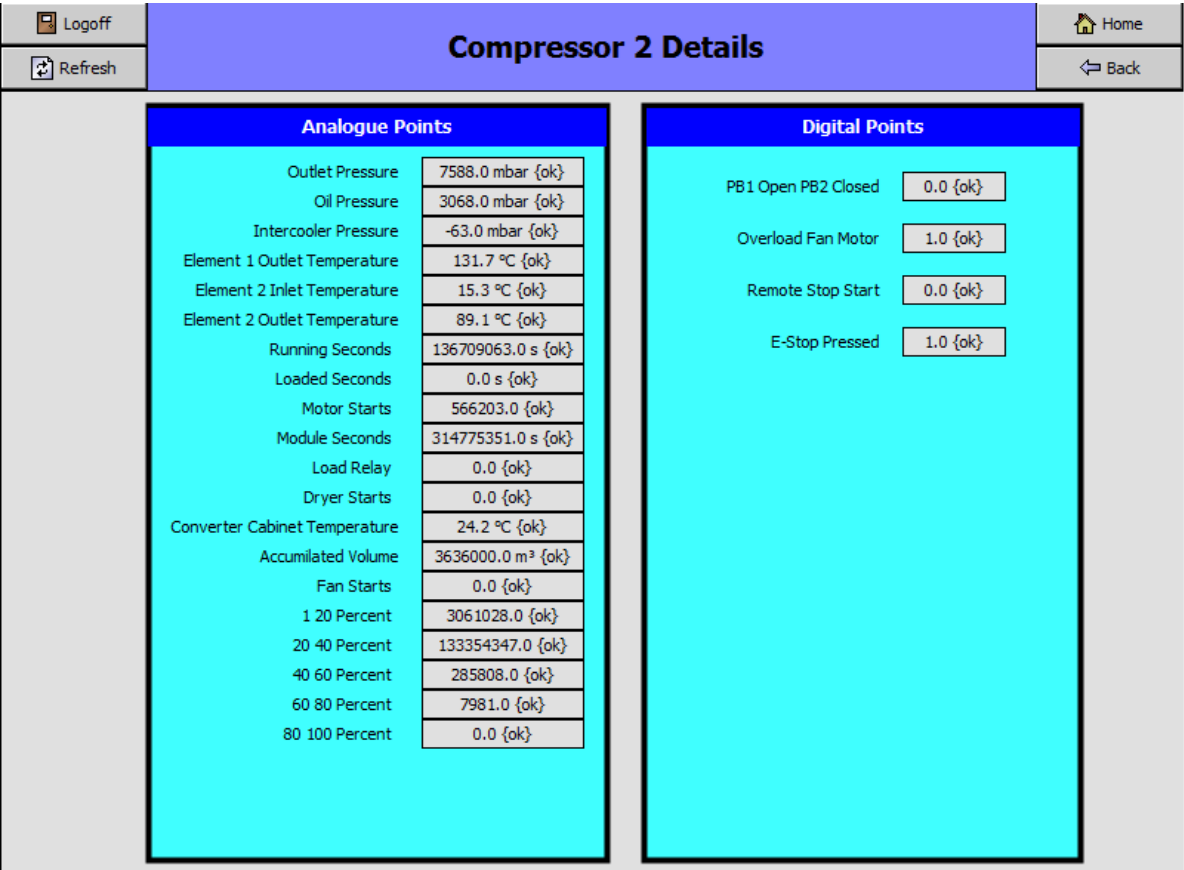


Fig. 14 Screenshot of compressed air monitoring system

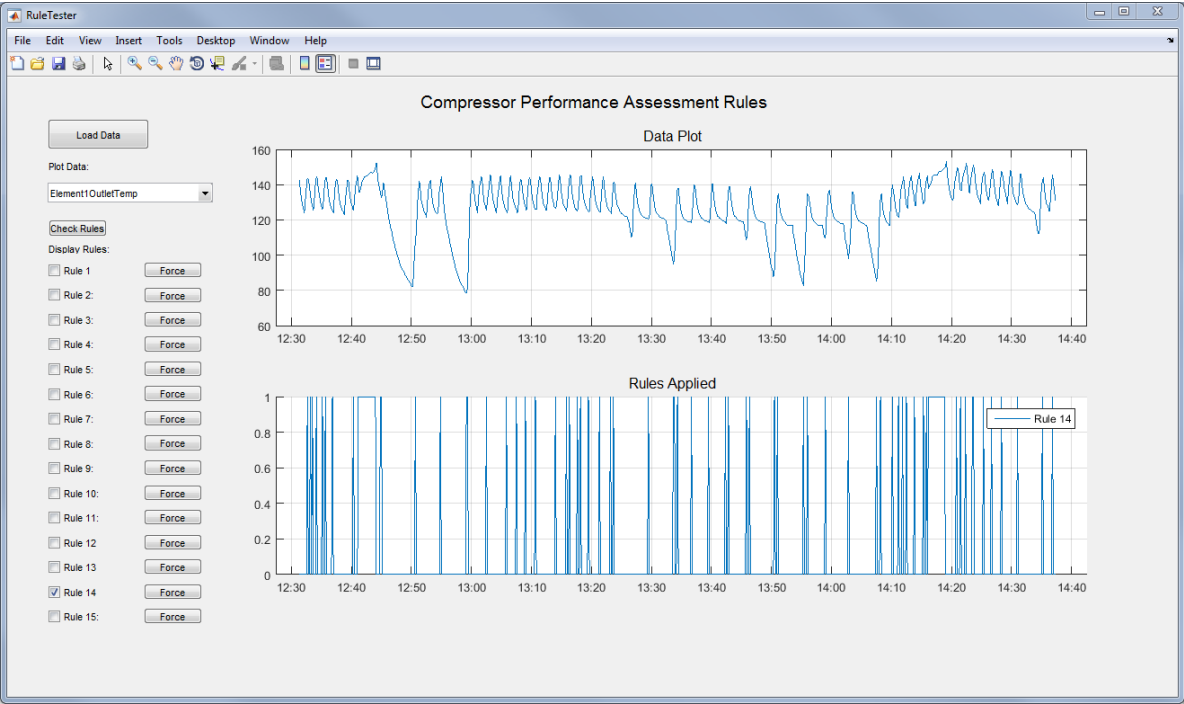


Fig. 15 Screenshot of compressor performance assessment GUI

tool's MySQL database. As more data is added to the system, an analysis of the energy efficiency performance will be carried out using real-time updates to the operational mode cluster centroids. To ensure that this work is scalable across multiple facilities a best-practice approach will be taken, applying the methodology of an industrial big data pipeline (ODonovan et al (2015a)). Quantification of the financial savings achieved by implementing recommendations made by the expert system will also be carried out, taking a cost-benefit approach toward analysis (Walsh et al (2013)).

Acknowledgements Thanks are extended to the School of Pharmacy at University College Cork for allowing the building compressed air system to be used for trial purposes. This work was funded by Marine Renewable Energy Ireland (MaREI) at University College Cork.

References

- Blum H (2014) The economic efficiency of energy-consuming equipment: a DEA approach. *Energy Efficiency* 8(2):281–298
- Bruton K, Raftery P, Kennedy B, Keane MM, OSullivan DTJ (2013) Review of automated fault detection and diagnostic tools in air handling units. *Energy Efficiency*
- Bruton K, Coakley D, Raftery P, Cusack DO, Keane MM, OSullivan DTJ (2014a) Comparative analysis of the AHU InFO fault detection and diagnostic expert tool for AHUs with APAR. *Energy Efficiency*
- Bruton K, Raftery P, O'Donovan P, Aughney N, Keane MM, O'Sullivan D (2014b) Development and alpha testing of a cloud based automated fault detection and diagnosis tool for Air Handling Units. *Automation in Construction* 39:70–83
- CAGI (2015) Performance Verification Data Sheets
- Catterson V, Costello J (2013) Increasing the Adoption of Prognostic Systems for Health Management in the Power Industry. *Chemical Engineering Transactions* 33:271–276
- Facchinetti T, Benetti G, Della Vedova ML (2014) Modeling and real-time control of an industrial air multi-compressor system. In: *Proceedings of the 9th IEEE International Symposium on Industrial Embedded Systems (SIES 2014)*, IEEE, pp 67–76, DOI 10.1109/SIES.2014.6871189
- Fleiter T, Gruber E, Eichhammer W, Worrell E (2012) The German energy audit program for firms: a cost-effective way to improve energy efficiency? *Energy Efficiency* 5(4):447–469
- Friden H, Bergfors L, Bjork A, Mazharsolook E (2012) Energy and LCC Optimised Design of Compressed Air Systems: A Mixed Integer Optimisation Approach with General Applicability. 2012 UKSim 14th International Conference on Computer Modelling and Simulation (Lcc):491–496
- Gao Z, Cecati C, Ding SX (2015a) A Survey of Fault Diagnosis and Fault-Tolerant Techniques Part I: Fault Diagnosis. *Industrial Electronics, IEEE Transactions on* PP(99):1
- Gao Z, Cecati C, Ding SX (2015b) A Survey of Fault Diagnosis and Fault-Tolerant Techniques Part II: Fault Diagnosis with Knowledge-Based and Hybrid/Active Approaches. *Industrial Electronics, IEEE Transactions on* PP(99):1
- House JM, Vaezi-Nejad H, Whitcomb JM (2001) An expert rule set for fault detection in air-handling units / Discussion. In: *ASHRAE Transactions, American Society of Heating, Refrigeration and Air Conditioning Engineers, Inc., Atlanta*, vol 107, p 858
- IEA (2012) International Energy Agency
- Katipamula S, Brambley M (2005) Review Article: Methods for Fault Detection, Diagnostics, and Prognostics for Building Systems A Review, Part I. *HVAC&R Research* 11(2):169–187
- Laurijssen J, Faaij A, Worrell E (2013) Benchmarking energy use in the paper industry: A benchmarking study on process unit level. *Energy Efficiency* 6(1):49–63
- Liu SYSC (2001) An Efficient Expert System for Air Compressor Troubleshooting. *Expert Systems* 18(4):203–214
- Mazid AM, Martin R (2008) Automation of compressor test procedure using advantech data acquisition module. In: *2008 10th International Conference on Control, Automation, Robotics and Vision, IEEE, December*, pp 2266–2271, DOI 10.1109/ICARCV.2008.4795885
- Mills E, Shamshoian G, Blazek M, Naughton P, Seese RS, Tschudi W, Sartor D (2007) The business case for energy management in high-tech industries. *Energy Efficiency* 1(1):5–20
- Murray SN, Rocher B, O'Sullivan D (2012) Static Simulation: A sufficient modelling technique for retrofit analysis. *Energy and Buildings* 47:113–121
- Murray SN, Walsh BP, Kelliher D, O'Sullivan D (2014) Multi-Variable Optimization of Thermal Energy Efficiency Retrofitting of Buildings using Static Modelling and Genetic Algorithms - A Case Study. *Building and Environment*
- ODonovan P, Leahy K, Bruton K, OSullivan DTJ (2015a) An industrial big data pipeline for data-driven analytics maintenance applications in large-scale smart manufacturing facilities. *Journal of Big Data* 2(1):25
- ODonovan P, Leahy K, Bruton K, OSullivan DTJ (2015b) Big data in manufacturing: a systematic mapping study. *Journal of Big Data* 2(1):20
- OSullivan D, Keane M, Kelliher D, Hitchcock R (2004) Improving building operation by tracking performance metrics throughout the building lifecycle (BLC). *Energy and Buildings* 36(11):1075–1090
- Pathak N, Khan M, Roy N (2015) Acoustic based appliance state identifications for fine-grained energy analyt-

- ics. IEEE International Conference on Pervasive Computing and Communications (PerCom) pp 63–70
- Radgen P (2006) Efficiency through compressed air energy audits. In: Energy Audit Conference, www.audit06.fi
- Saidur R, Rahim N, Hasanuzzaman M (2010) A review on compressed-air energy use and energy savings. *Renewable and Sustainable Energy Reviews* 14(4):1135–1153
- SEAI (2007) Special Working Group HVAC (SPIN I) 2007. Tech. Rep. Spin I
- Tran VT, Althobiani F, Ball A (2014) An approach to fault diagnosis of reciprocating compressor valves using Teager-Kaiser energy operator and deep belief networks. *Expert Systems with Applications* 41(9):4113–4122
- Vachtsevanos G, Lewis F, Roemer M, Hess A, Wu B (2006) *Intelligent Fault Diagnosis and Prognosis for Engineering Systems*. John Wiley & Sons, Inc., Hoboken, NJ, USA
- Venkatasubramanian V (2003) A review of process fault detection and diagnosis: Part III: Process history based methods. *Computers & chemical ...* 27:293–311
- Venkatasubramanian V, Rengaswamy R, Kavuri SN (2003a) A review of process fault detection and diagnosis: Part II: Qualitative models and search strategies. *Computers & Chemical Engineering* 27(3):313–326
- Venkatasubramanian V, Rengaswamy R, Yin K, Kavuri SN (2003b) A review of process fault detection and diagnosis. *Computers & Chemical Engineering* 27(3):293–311
- Walsh BP, Murray SN, O'Sullivan D (2013) Free-cooling thermal energy storage using phase change materials in an evaporative cooling system. *Applied Thermal Engineering* 59(1-2):618–626
- Wang L (2008) *Energy efficiency and management in food processing facilities*. CRC Press
- Wang L (2014) Energy efficiency technologies for sustainable food processing. *Energy Efficiency* 7(5):791–810
- Wang Y, Brown Ma (2013) Policy drivers for improving electricity end-use efficiency in the USA: an economic-engineering analysis. *Energy Efficiency* 7(3):517–546