

A

B

C

D

E

F

G

1

2

3


4

5

6

7

8


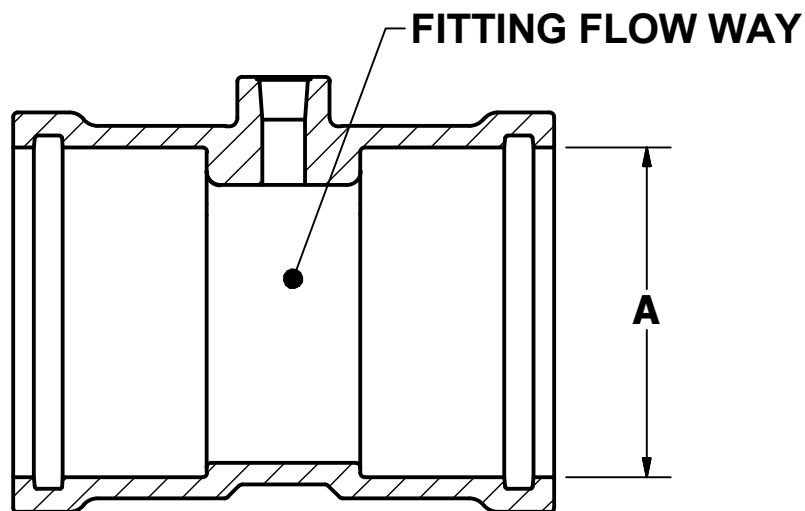


SECTION A-A

C907 SERVICE TEES				
SIZE	A	C	L	E
6	6.98 +/- 0.03	6.38 +/- 0.03	2.67 +/- 0.03	0.27

FLOW AREA	
6" DR18 PIPE FLOW AREA	6" SERVICE TEE FLOW WAY AREA
29.5in ²	30.7in ²

NOTE: ASSUMING PIPE MINIMUM WALL THICKNESS

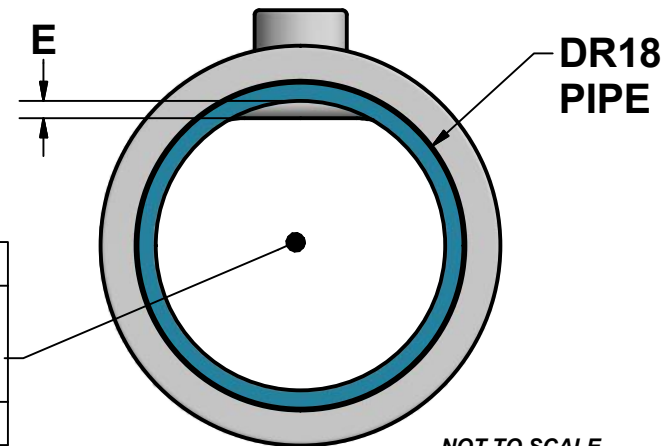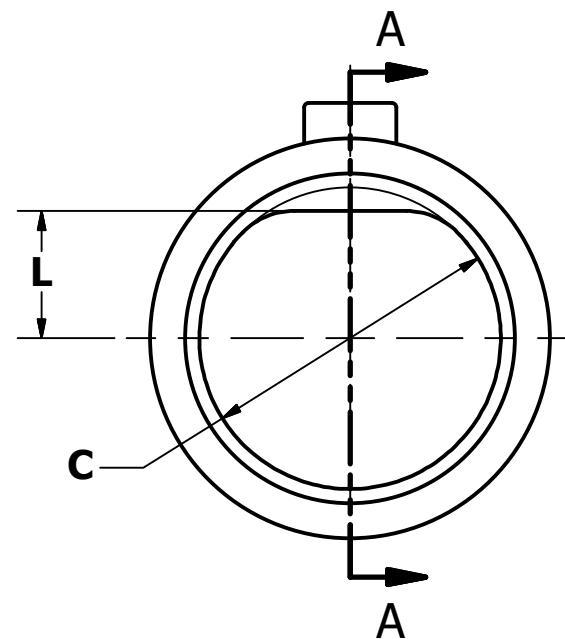

DRAWN BY: SRouton	DETAILED BY: SBR	REV: A	EFFECTIVE DATE: 5/5/2017
DWG DATE: 8/3/2012	REVIEWED BY: SBR		DRAWING NUMBER: 6in C907 Service Tee.idw
MATERIAL: PVC	SCALE: n/a	SHEET: 1 of 1	TITLE: 6" C907 SERVICE TEE


**THE HARRINGTON
CORPORATION**