

A

B

C

D

E

F

G

1

2

3

4


5

6


7

8

FITTING FLOW WAY

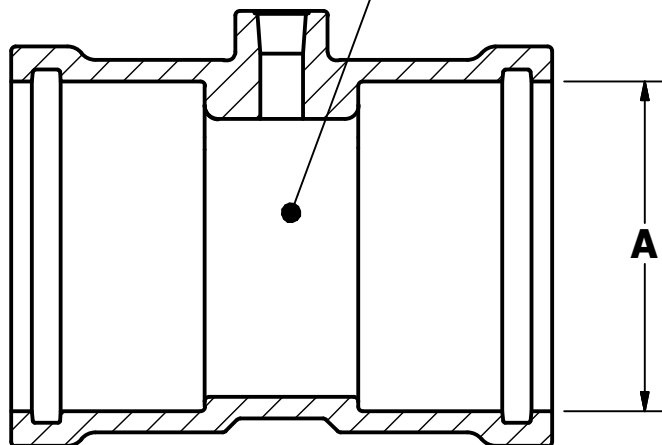


SECTION A-A

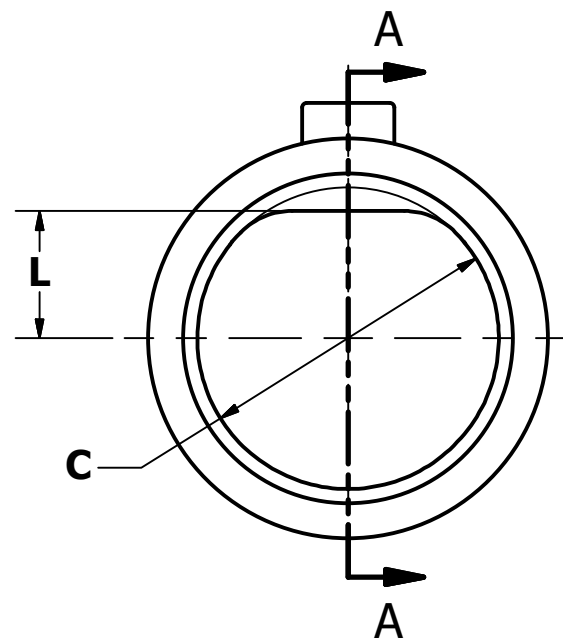

C907 SERVICE TEES				
SIZE	A	C	L	E
8	9.16 +/- 0.03	8.38 +/- 0.03	3.54 +/- 0.03	0.48

FLOW AREA	
8" DR18 PIPE FLOW AREA	8" SERVICE TEE FLOW WAY AREA
50.8in ²	53.1in ²

NOTE: ASSUMING PIPE MINIMUM WALL THICKNESS

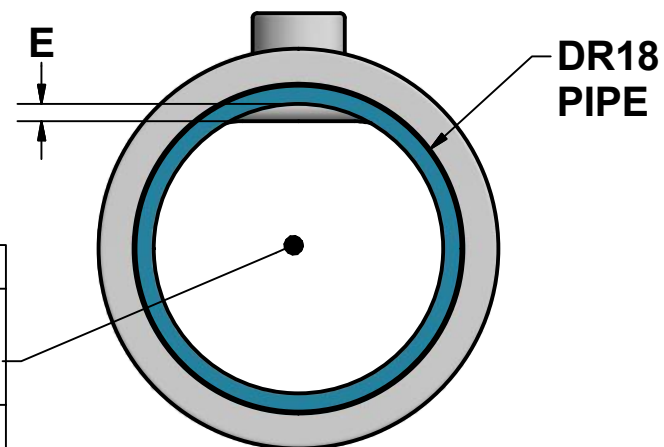DRAWN BY:
SRoutonDETAILED BY:
SBR

REV:

AEFFECTIVE DATE:
5/5/2017DWG DATE:
8/3/2012REVIEWED BY:
SBRDRAWING NUMBER:
8in C907 Service Tee.idw

MATERIAL:

PVC

SCALE:

n/a

SHEET:

1 of 1

TITLE:

8" C907 SERVICE TEE

**THE HARRINGTON
CORPORATION**