

Evidence and assumptions for California data center electricity use: differing years and coverage

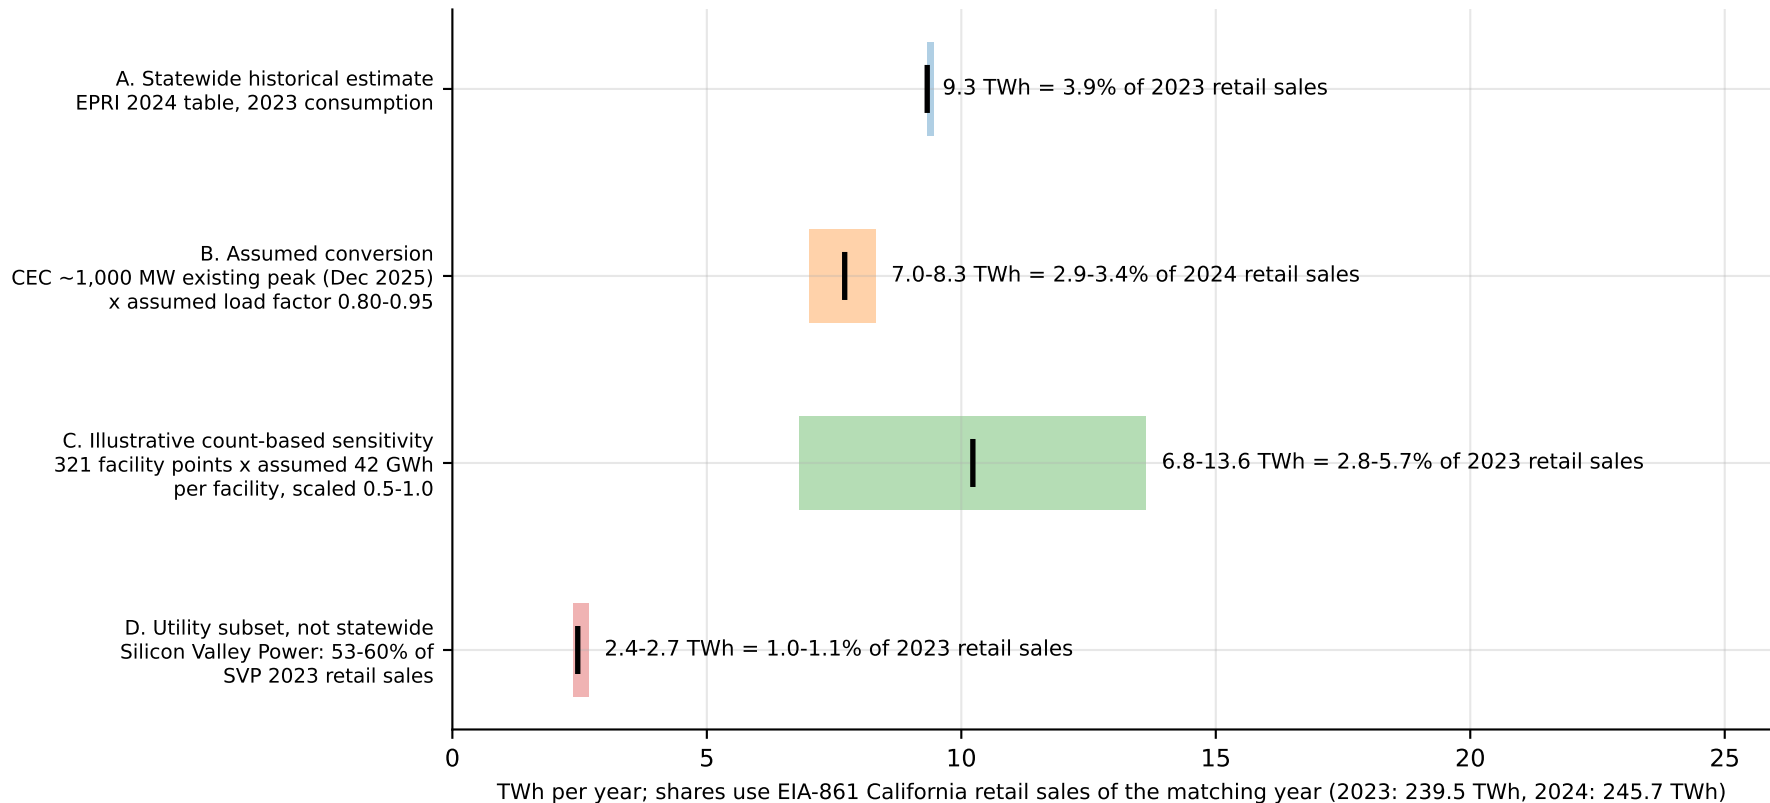


fig1_08. Data: ch1_dc_load_estimates.csv; ch1_ca_retail_sales_eia861.csv; ch1_svp_fact_sheets.csv; ch1_kollar_grady_points_california_flag.csv; ch1_bottom_up_inputs.json. Sources (manifest ids): epri_powering_intelligence_2024; cec_dc_methodology_memo_2026; eia861_2019 .. 2024; svp_fact_sheet_2017 .. 2023; kollar_grady_2025_zenodo; epoch_data_centers. Code: ch1_baseline.dc_load_estimates, bottom_up_estimate, ca_retail_sales_eia861, svp_fact_sheet_energy, kollar_grady_california; run_chapter1 step 4. Data frozen 2026-09-26; data/raw/manifest.csv holds URL, access date and SHA-256 for each id.