




Curtailment-enabled headroom on CAISO hourly demand (all years pooled)

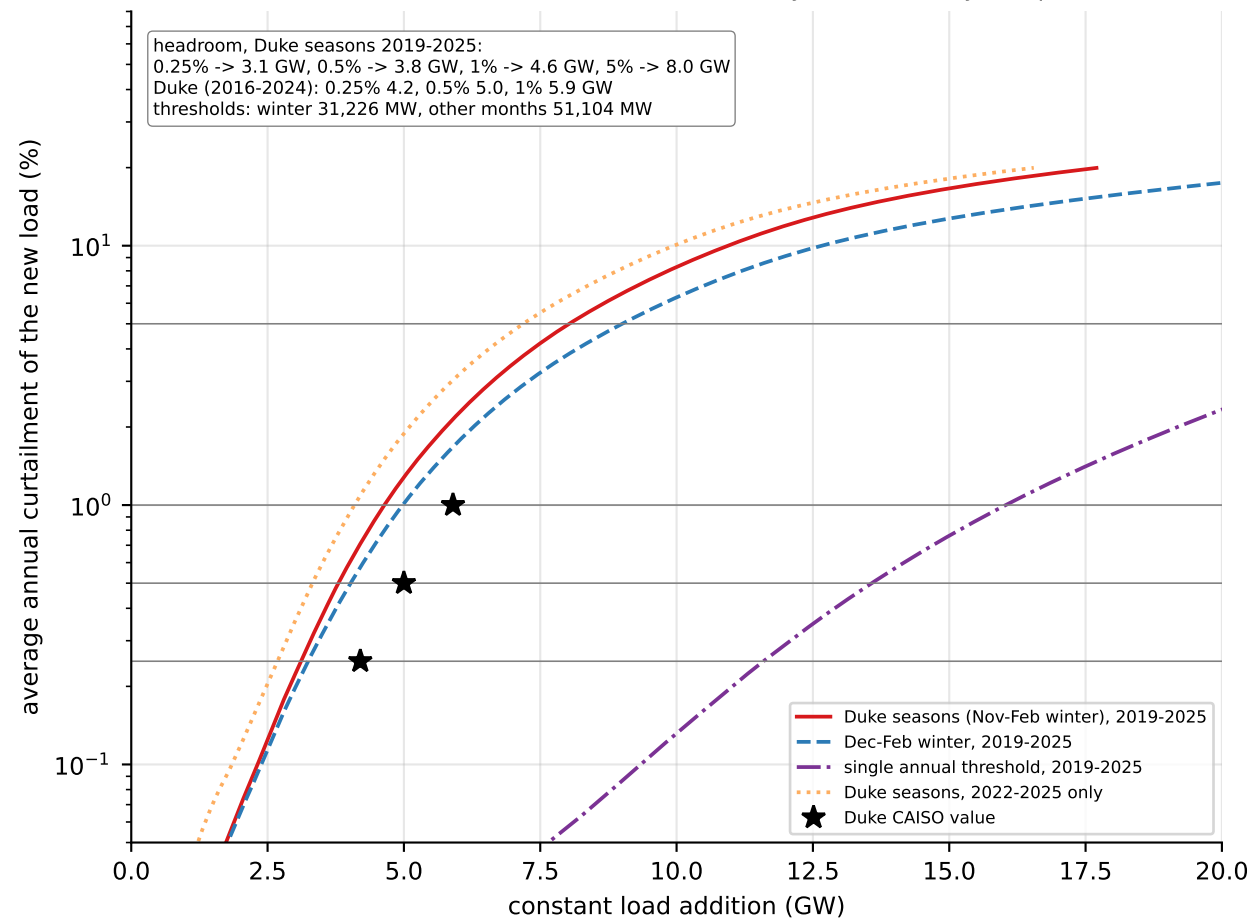

Headroom solved year by year, Duke seasonal thresholds

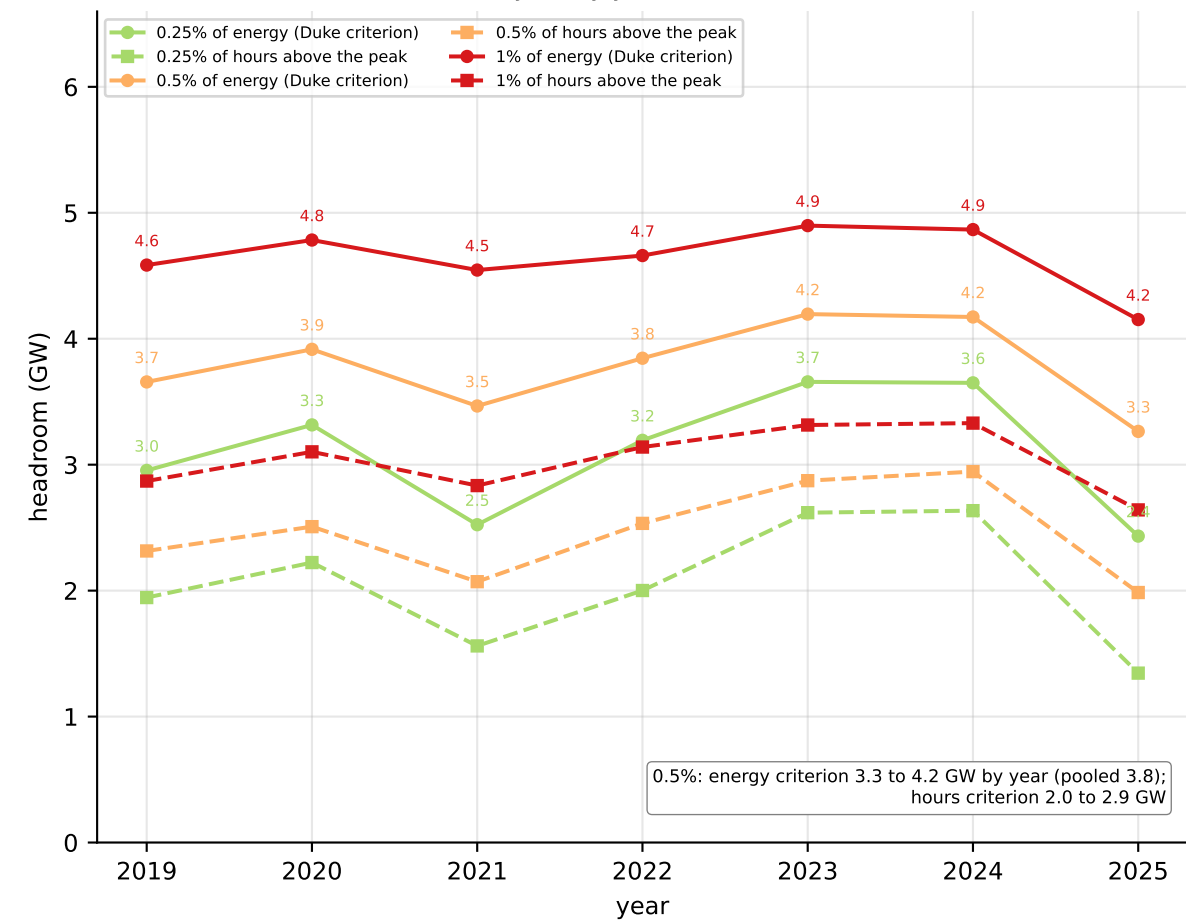

Hours curtailed at the 0.5% headroom (3.8 GW)

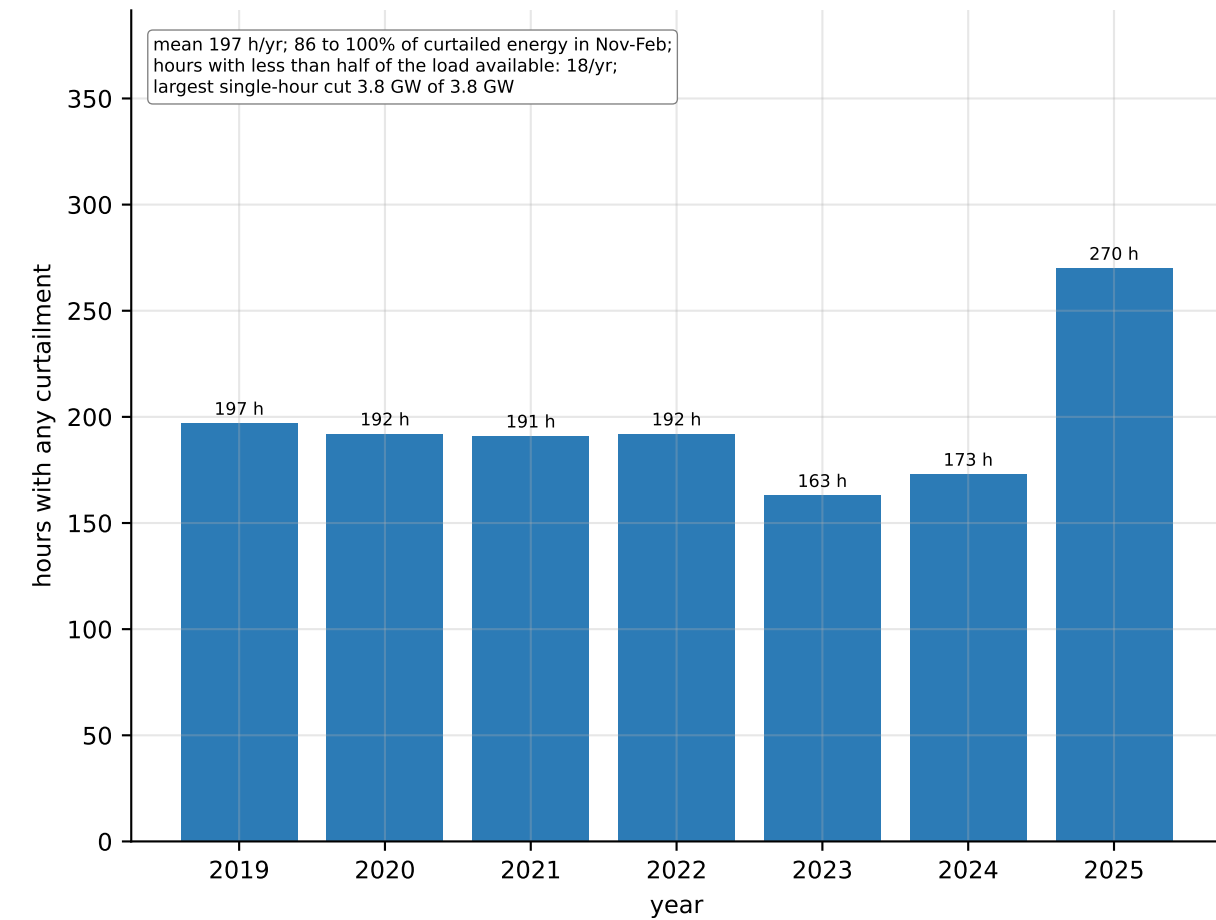

Headroom against the data center cases and the gap

