


Data center energization requests by vintage and tier, against CAISO's record peak and existing data center load Three source families with different utilities, stage definitions and dates: not one consistent growth series

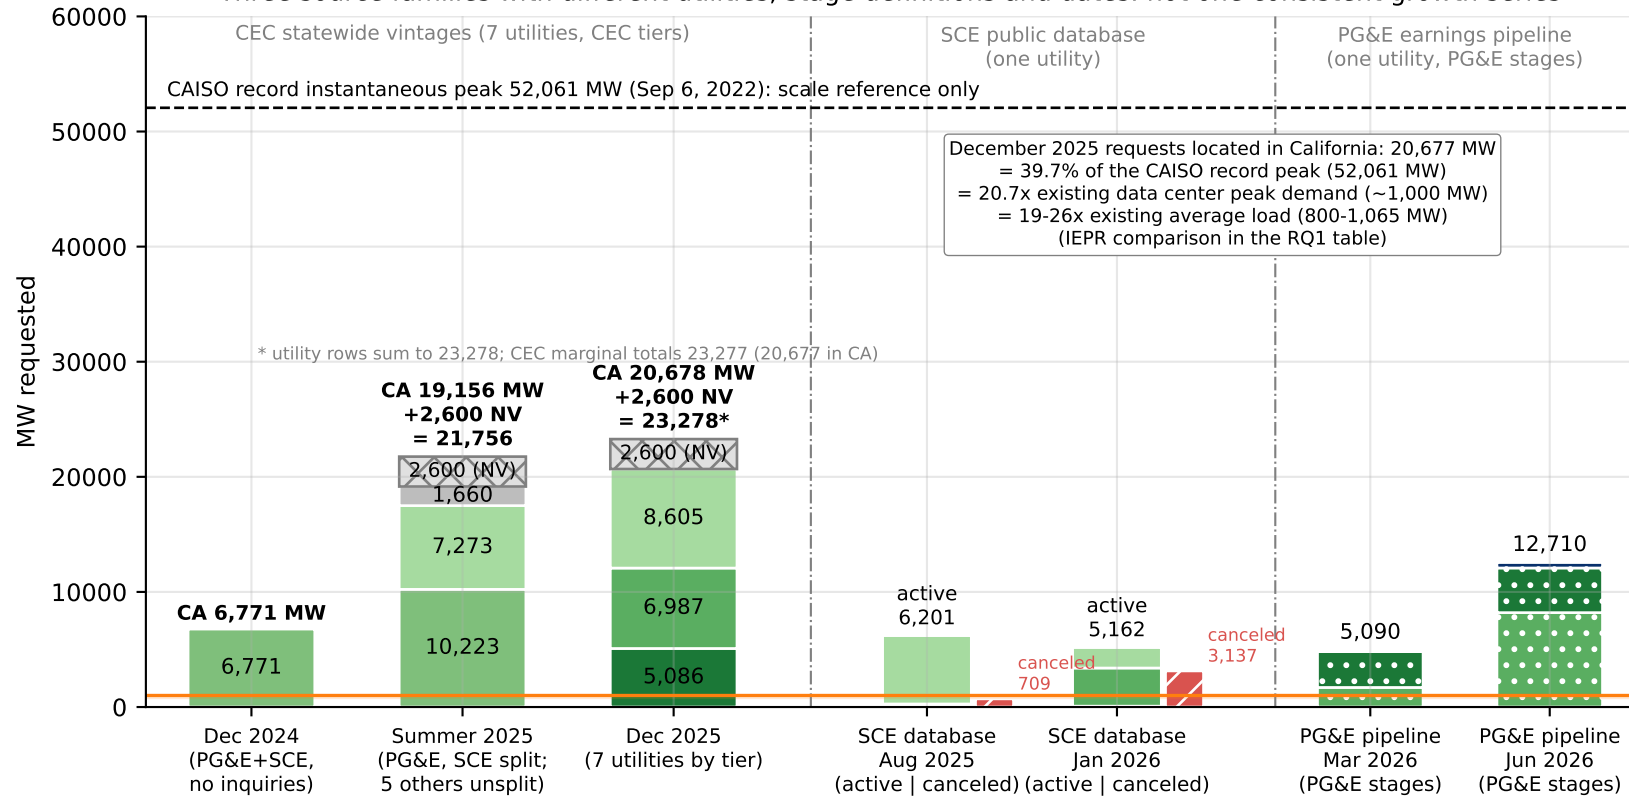

- existing data center average load, chapter 1 statewide estimate and conversion: 800-1,065 MW
- existing data center peak demand, CEC: ~1,000 MW (Dec 2025)
- Agreements + applications (no inquiries)
- Inquiry
- All tiers

- VEA requests located in Nevada (inside CAISO, outside California)
- Signed agreement
- Active application
- Canceled (drawn separately, not part of the active pipeline)

- PG&E: application + preliminary engineering (no inquiries)
- PG&E: final engineering (WPA signed) (no inquiries)
- PG&E: interconnection construction agreement (no inquiries)
- PG&E: construction (no inquiries)