

APP CRS

157°

Rwy Idg

9003

TDZE


167


Apt Elev

168

RNAV (RNP) Y RWY 16

RICHMOND INTL (RIC)

RNP AR APCH.				MALSR		MISSED APPROACH: Climb to 2500 on track 157° to HAGLI and hold.			
▼ For uncompensated Baro-VNAV systems, procedure NA below -11°C (13°F) or above 54°C (130°F). For inop ALS, increase RNP 0.11 all Cats visibility to RVR 5500 and RNP 0.30 all Cats visibility to 1½ SM.									
ATIS		POTOMAC APP CON		RICHMOND TOWER		GND CON		CLNC DEL	
119.15 263.025		126.4 282.375 (001°-185°)		121.1 257.8		121.9 348.6		127.55 348.6	
		126.75 307.2 (186°-360°)							

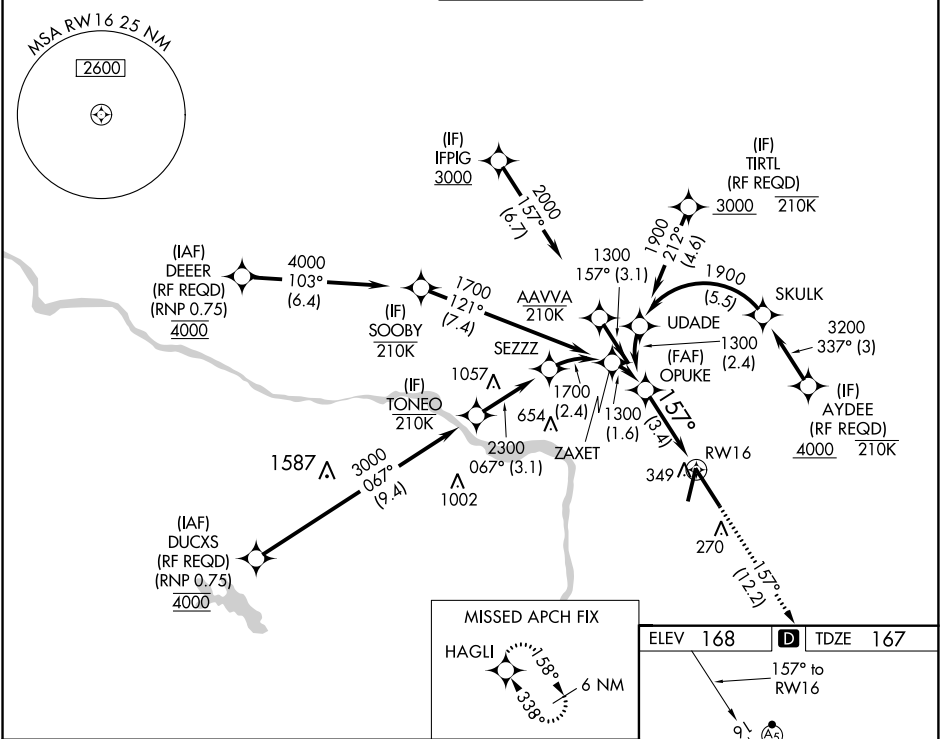

OPUKE

1300

VGSI and RNAV glidepath not coincident
(VGSI Angle 3.00/TCH 71°).

2500

HAGLI

GP 3.00°

TCH 54

See planview for multiple IF locations.

3.4 NM

→

CATEGORY

A

B

C

D

RNP 0.11 DA

506/40 339 (400-¾)

RNP 0.30 DA

606/50 439 (500-1)

AUTHORIZATION REQUIRED

TDZ/CL Rwy 34

HIRL Rwy 2-20 and 16-34

REIL Rwy 20