


LOC/DME I-MRZ 109.9 Chan 36	APP CRS 100°	Rwy Idg TDZE Apt Elev	9003 421 421
---	------------------------	-----------------------------	---

ILS or LOC RWY 10
SYRACUSE HANCOCK INTL (SYR)

DME or RADAR required.		MALSR	MISSED APPROACH: Climb to 900 then climbing left turn to 3000 on heading 081° and on SYR VORTAC R-111 to STODA INT/ SYR VORTAC 1.5 DME/RADAR and hold.
TANUE fix minimums, for inoperative ALS, increase S-LOC 10 Cats C and D visibility to RVR 5500. **RVR 1800 authorized with use of FD or AP or HUD to DA.			

ATIS 124.225	SYRACUSE APP CON 126.125 269.125	SYRACUSE TOWER 120.3 239.0	GND CON 121.7 348.6	CLNC DEL 125.05 257.775
------------------------	--	--------------------------------------	-------------------------------	-----------------------------------

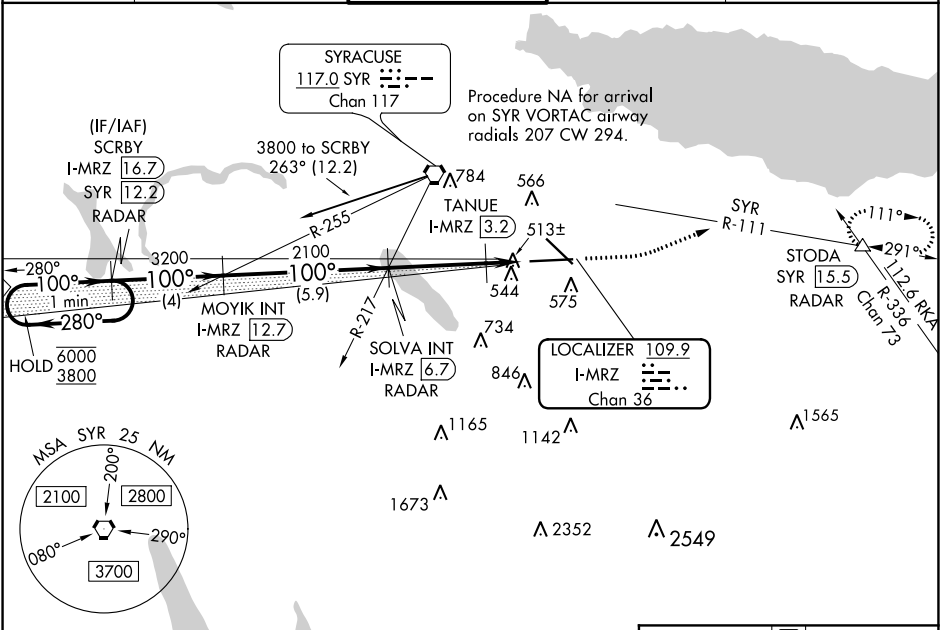

One Minute Holding Pattern		SCRBY I-MRZ <u>16.7</u> SYR <u>12.2</u> RADAR		MOYIK INT I-MRZ <u>12.7</u> RADAR		SOLVA INT I-MRZ <u>6.7</u> RADAR		TANUE I-MRZ <u>3.2</u> I-MRZ <u>2.6</u> I-MRZ <u>1.6</u>		900 ↑ 3000 hdg 081°		SYR R-111		STODA △	
		6000 ← 280° 3800 ← 100°		3200		2100		2100		*980					
GS 3.00° TCH 55		4 NM		5.9 NM		3.5 NM		0.6		1 NM					
CATEGORY		A		B		C		D							
S-ILS 10**				621/24		200 (200-½)									
S-LOC 10		980/24		559 (600-½)		980/60		559 (600-1¼)							
CIRCLING		980-1		559 (600-1)		1020-1½ 599 (600-1½)		1180-2½ 759 (800-2½)							
TANUE FIX MINIMUMS (DME REQUIRED)															
S-LOC 10		780/24		359 (400-½)		780/30		359 (400-¾)							
CIRCLING		900-1 479 (500-1)		920-1 499 (500-1)		1020-1½ 599 (600-½)		1180-2½ 759 (800-2½)							

