

APP CRS
233°

Rwy Idg
TDZE
Apt Elev

6215
931
947

RNAV (RNP) Z RWY 23

YEAGER (CRW)


RNP AR APCH.

For uncompensated Baro-VNAV systems, procedure NA below -15°C or above 54°C. For inop ALS, increase RNP 0.30 all Cats visibility to 1½ SM.

ALSF-1

MISSED APPROACH:
Climb to 4000 on track 233° to CITMA and hold.

ATIS 127.6	CHARLESTON APP CON 124.1 269.125	CHARLESTON TOWER 125.7 257.8	GND CON 121.8 348.6	CLNC DEL 118.55
---------------	-------------------------------------	---------------------------------	------------------------	--------------------

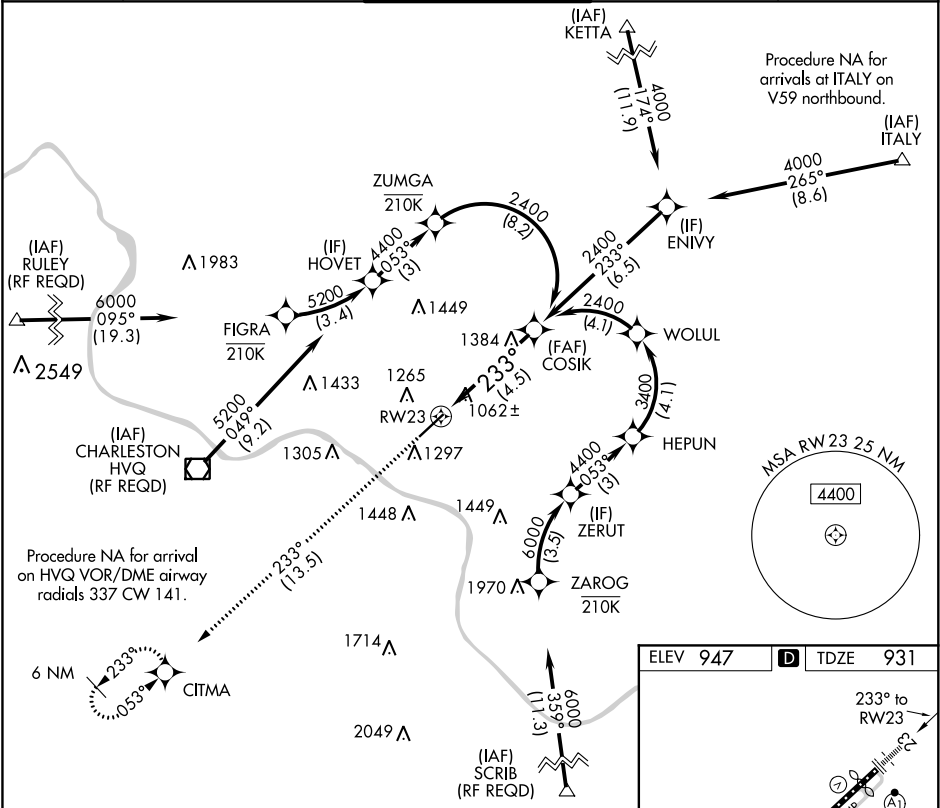

4000
fr 233°

CITMA

See planview for multiple IF locations.

RW23

233°

2400

GP 3.00°
TCH 56

CATEGORY

A

B

C

D

RNP 0.30 DA

1419/60

488 (500-1¼)

AUTHORIZATION REQUIRED

ELEV 947

TDZE 931

233° to RW23

671.5 X 150

0.8% UP

TWR 1037

HIRL Rwy 5-23
REIL Rwy 5