

APP CRS
031°

Rwy Idg
7000


TDZE
35

Apt Elev
46

RNAV (RNP) Z RWY 3

CHARLESTON AFB/INTL (CHS)

RNP AR APCH.		MISSED APPROACH: Climb to 3000 direct BAMDE and hold, continue to climb-in-hold to 3000.		
For uncompensated Baro-VNAV systems, procedure NA below -5°C or above 54°C.				
ATIS 124.75	CHARLESTON APP CON 120.7 306.925	CHARLESTON TOWER 126.0 239.0	GND CON 121.9 348.6	CLNC DEL 127.325 291.65
				CPDLC

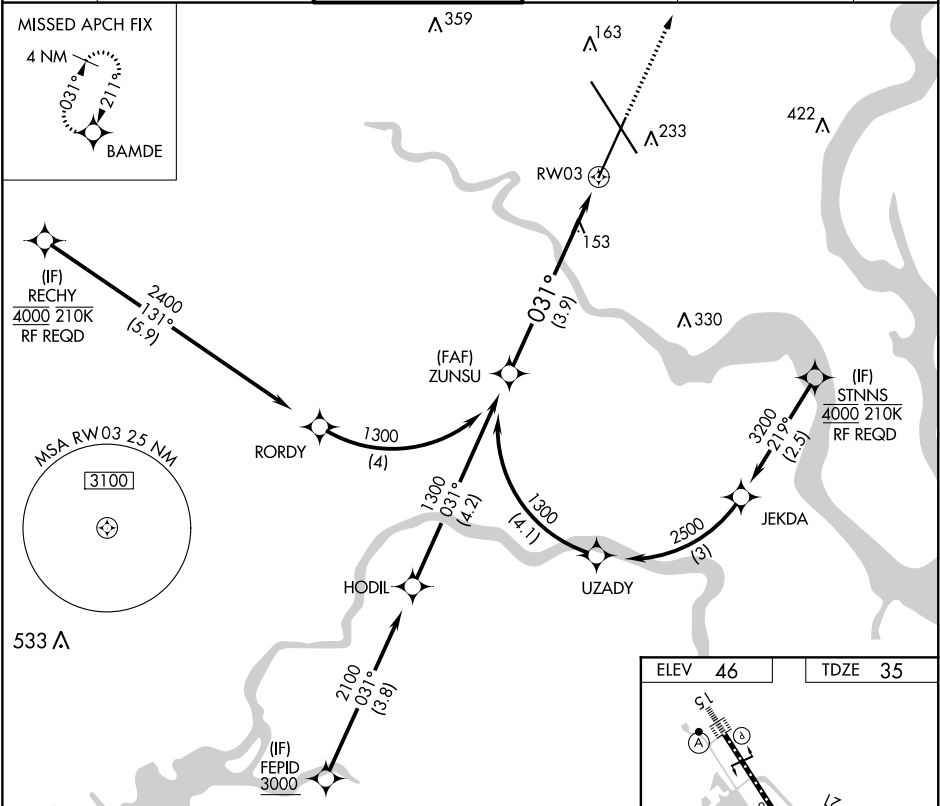

See planview for multiple IF locations.

3000 BAMDE

GP 3.00° TCH 50

1300

031°

RW03

3.9 NM

CATEGORY

A

B

C

D

RNP 0.20 DA

285-¾

250 (300-¾)

RNP 0.30 DA

429-1⅛

394 (400-1⅛)

AUTHORIZATION REQUIRED

ELEV 46

TDZE 35

031° to RW03

TDZ/CL Rwy 15

REIL Rwy 3 and 21

HIRL Rwy 3-21 and 15-33