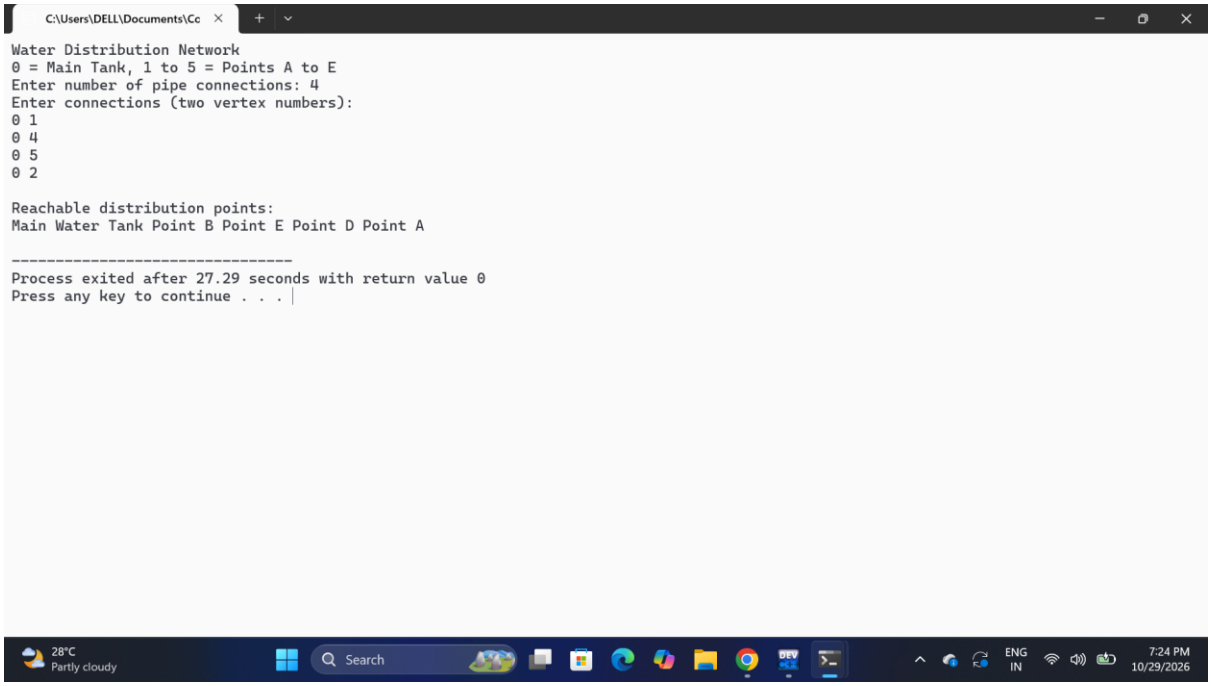
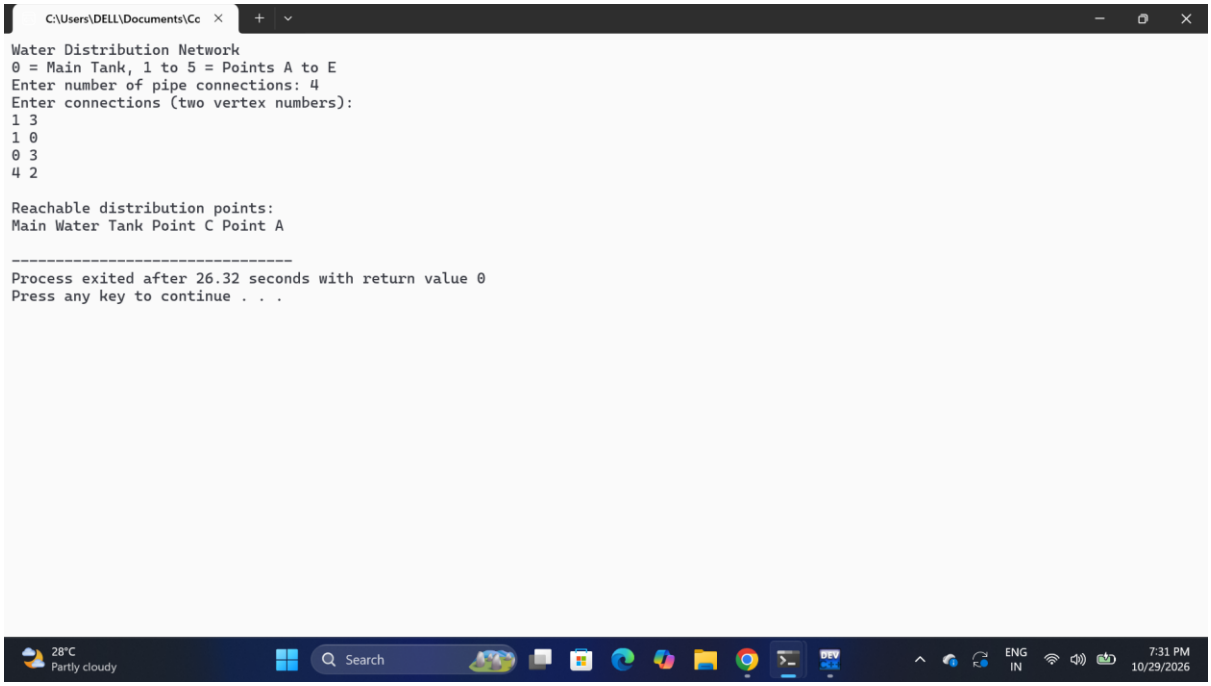
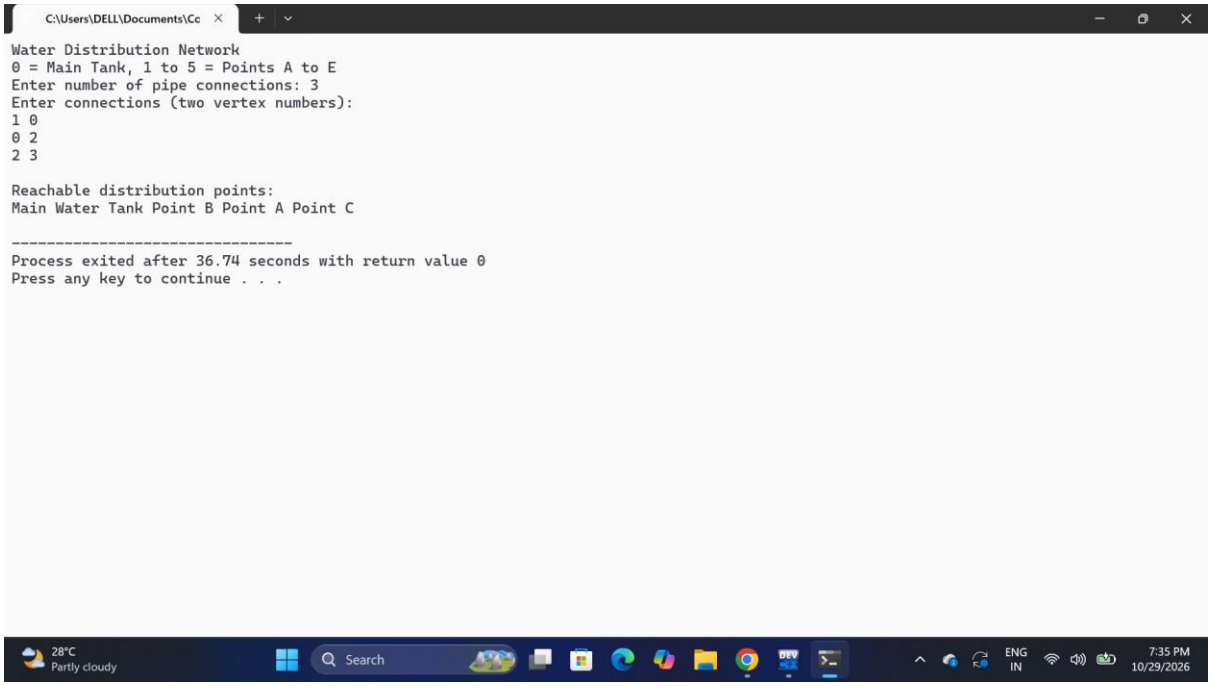
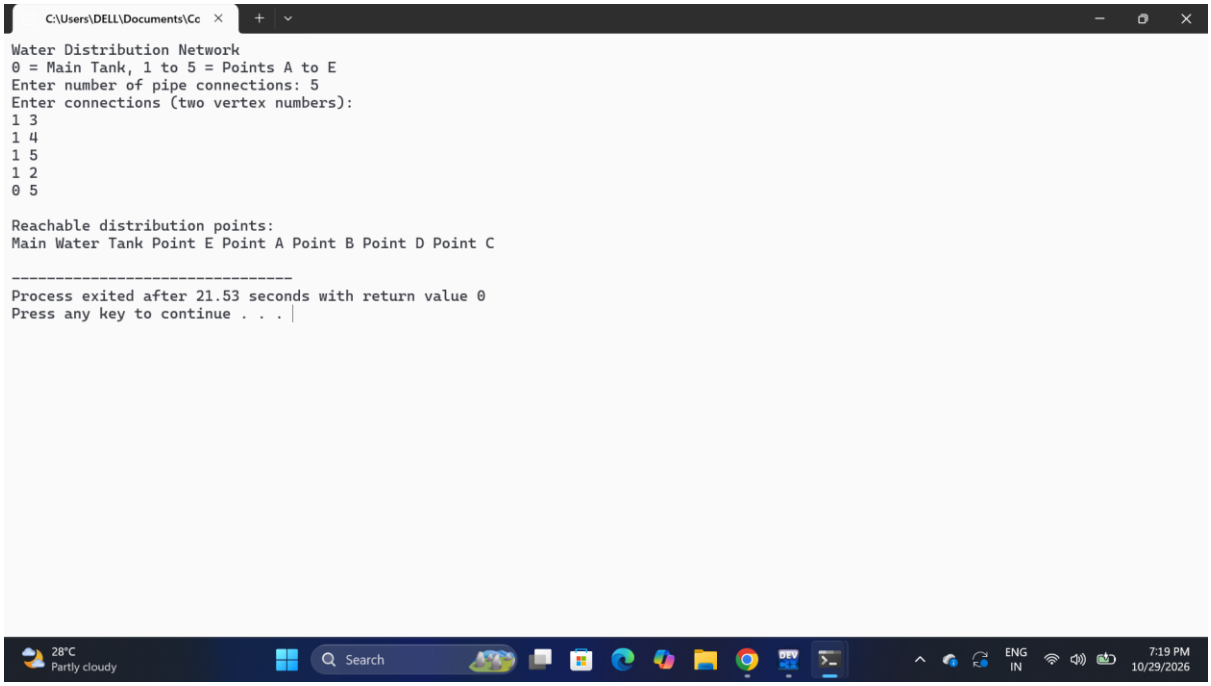

C:\Users\DELL\Documents\Cc
Water Distribution Network
0 = Main Tank, 1 to 5 = Points A to E
Enter number of pipe connections: 4
Enter connections (two vertex numbers):
0 1
0 4
0 5
0 2
Reachable distribution points:
Main Water Tank Point B Point E Point D Point A

Process exited after 27.29 seconds with return value 0
Press any key to continue . . .
28°C
Partly cloudy
Search
ENG
IN
7:24 PM
10/29/2026

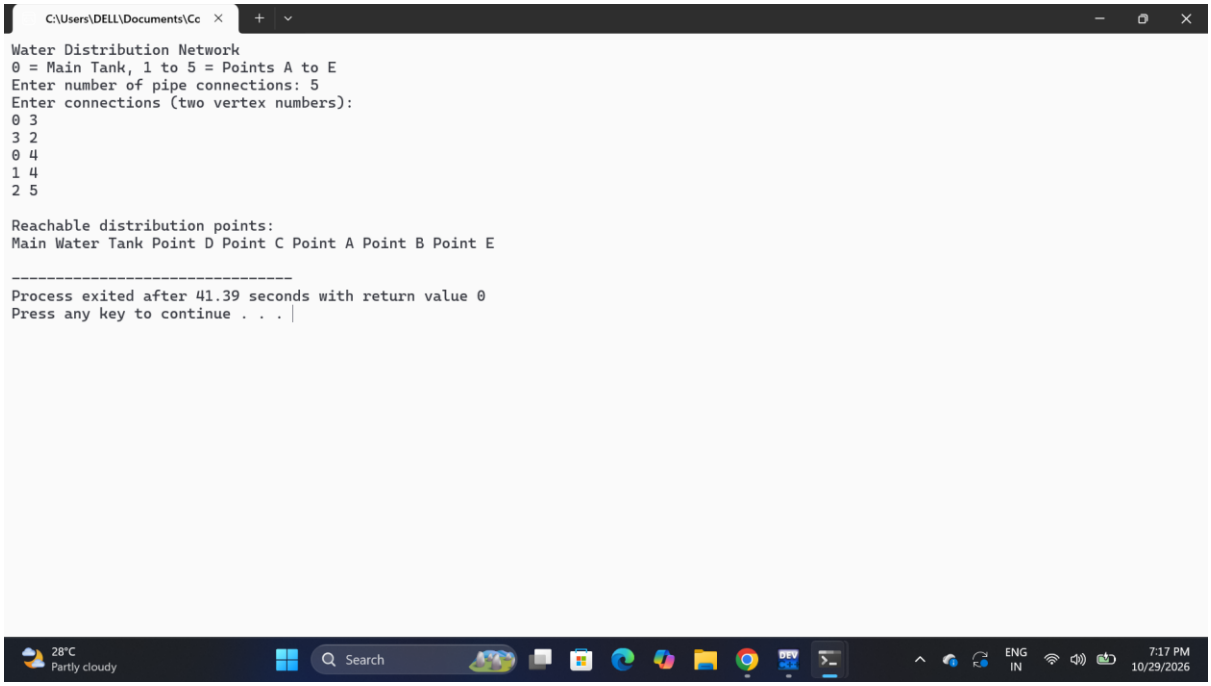

C:\Users\DELL\Documents\Cc
Water Distribution Network
0 = Main Tank, 1 to 5 = Points A to E
Enter number of pipe connections: 4
Enter connections (two vertex numbers):
1 3
1 0
0 3
4 2
Reachable distribution points:
Main Water Tank Point C Point A

Process exited after 26.32 seconds with return value 0
Press any key to continue . . .
28°C
Partly cloudy
Search
ENG
IN
7:31 PM
10/29/2026

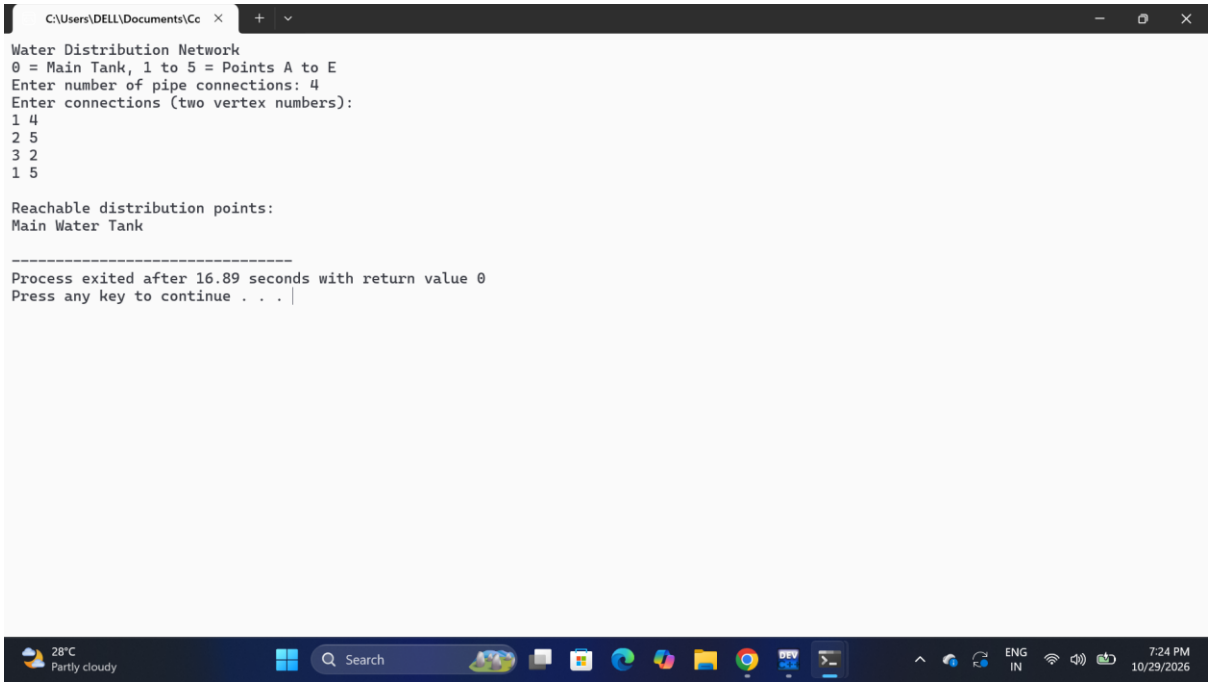

C:\Users\DELL\Documents\Cc
Water Distribution Network
0 = Main Tank, 1 to 5 = Points A to E
Enter number of pipe connections: 3
Enter connections (two vertex numbers):
1 0
0 2
2 3
Reachable distribution points:
Main Water Tank Point B Point A Point C
Process exited after 36.74 seconds with return value 0
Press any key to continue . . .
28°C
Partly cloudy
Search
ENG
IN
7:35 PM
10/29/2026


C:\Users\DELL\Documents\Cc
Water Distribution Network
0 = Main Tank, 1 to 5 = Points A to E
Enter number of pipe connections: 5
Enter connections (two vertex numbers):
1 3
1 4
1 5
1 2
0 5
Reachable distribution points:
Main Water Tank Point E Point A Point B Point D Point C

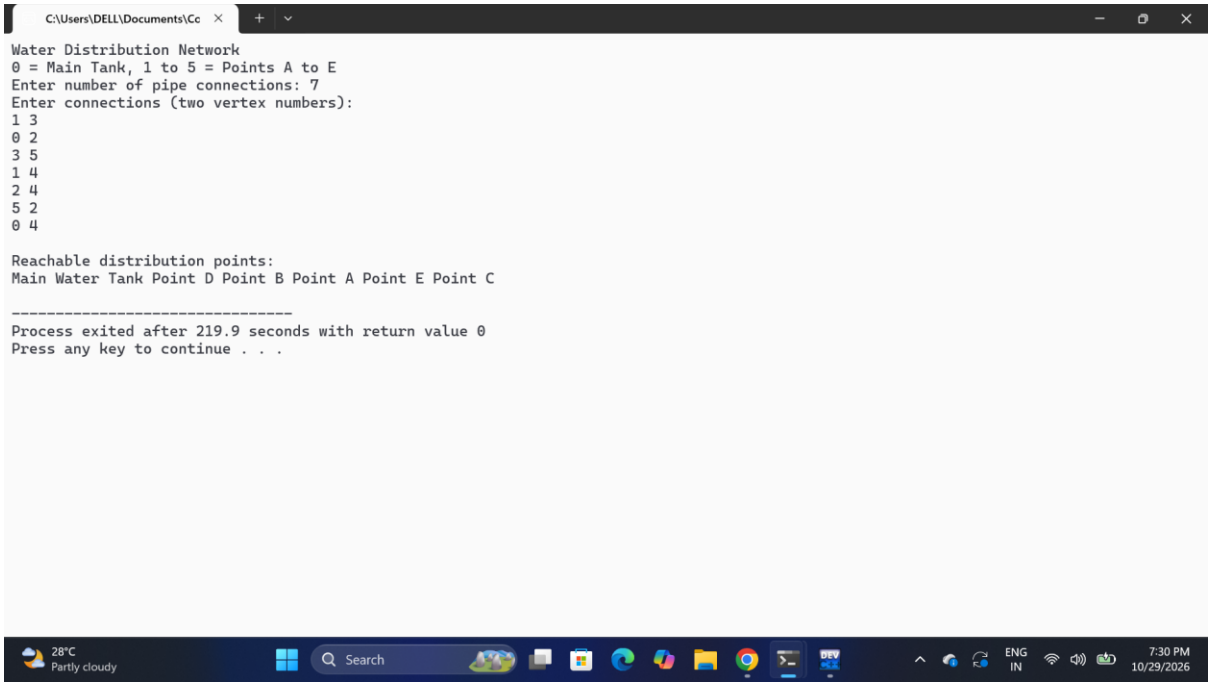
Process exited after 21.53 seconds with return value 0
Press any key to continue . . .
28°C
Partly cloudy
Search
ENG
IN
7:19 PM
10/29/2026


C:\Users\DELL\Documents\Cc
Water Distribution Network
0 = Main Tank, 1 to 5 = Points A to E
Enter number of pipe connections: 5
Enter connections (two vertex numbers):
0 3
3 2
0 4
1 4
2 5
Reachable distribution points:
Main Water Tank Point D Point C Point A Point B Point E

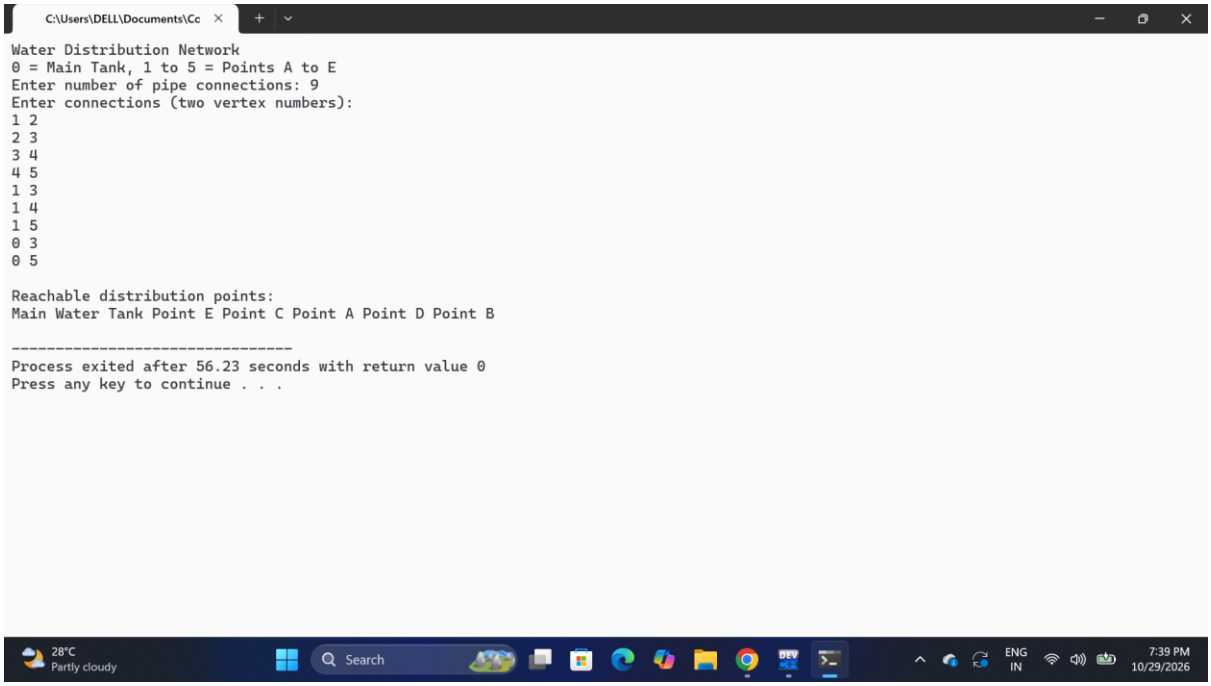
Process exited after 41.39 seconds with return value 0
Press any key to continue . . .
28°C
Partly cloudy
Search
ENG
IN
7:17 PM
10/29/2026


C:\Users\DELL\Documents\Cc
Water Distribution Network
0 = Main Tank, 1 to 5 = Points A to E
Enter number of pipe connections: 4
Enter connections (two vertex numbers):
1 4
2 5
3 2
1 5
Reachable distribution points:
Main Water Tank

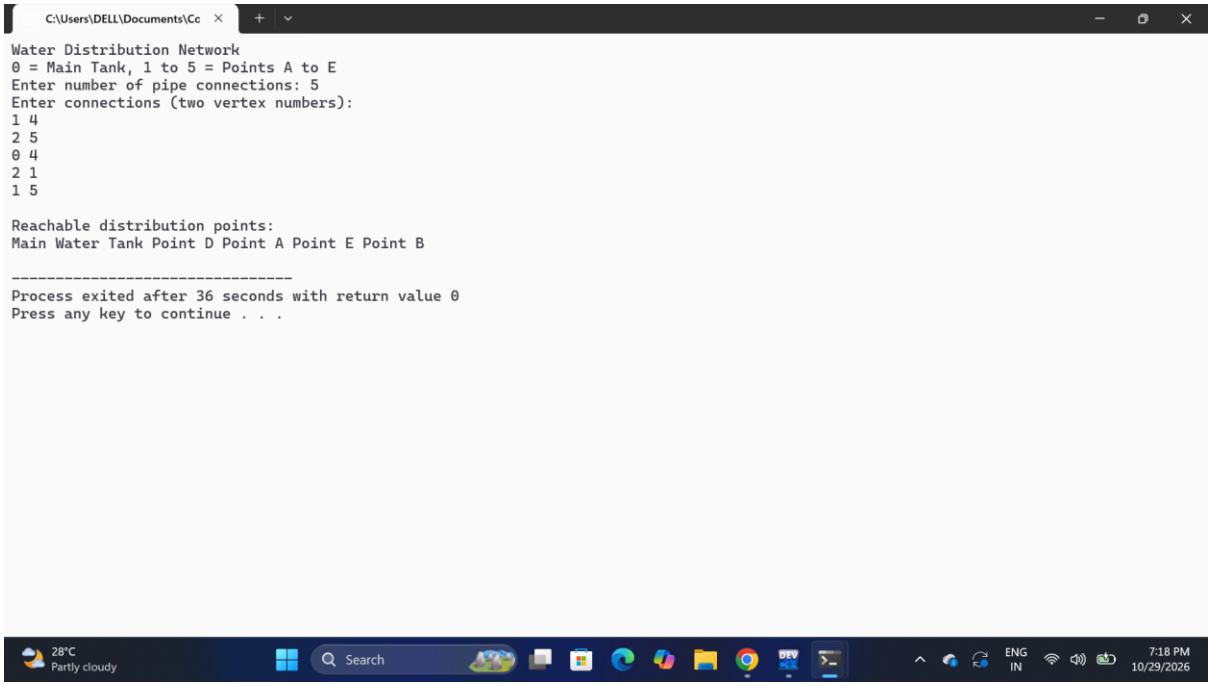
Process exited after 16.89 seconds with return value 0
Press any key to continue . . .
28°C
Partly cloudy
Search
ENG
IN
7:24 PM
10/29/2026


C:\Users\DELL\Documents\Cc
Water Distribution Network
0 = Main Tank, 1 to 5 = Points A to E
Enter number of pipe connections: 7
Enter connections (two vertex numbers):
1 3
0 2
3 5
1 4
2 4
5 2
0 4
Reachable distribution points:
Main Water Tank Point D Point B Point A Point E Point C

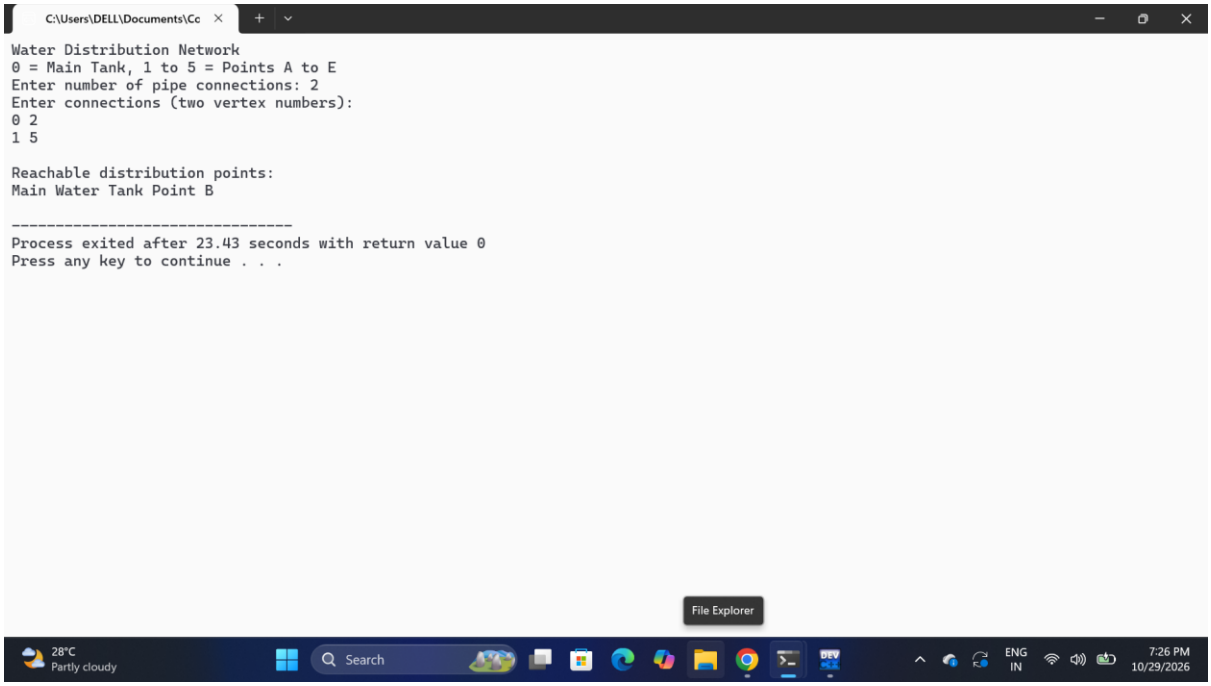
Process exited after 219.9 seconds with return value 0
Press any key to continue . . .
28°C
Partly cloudy
Search
ENG
IN
7:30 PM
10/29/2026


C:\Users\DELL\Documents\Cc
Water Distribution Network
0 = Main Tank, 1 to 5 = Points A to E
Enter number of pipe connections: 9
Enter connections (two vertex numbers):
1 2
2 3
3 4
4 5
1 3
1 4
1 5
0 3
0 5
Reachable distribution points:
Main Water Tank Point E Point C Point A Point D Point B

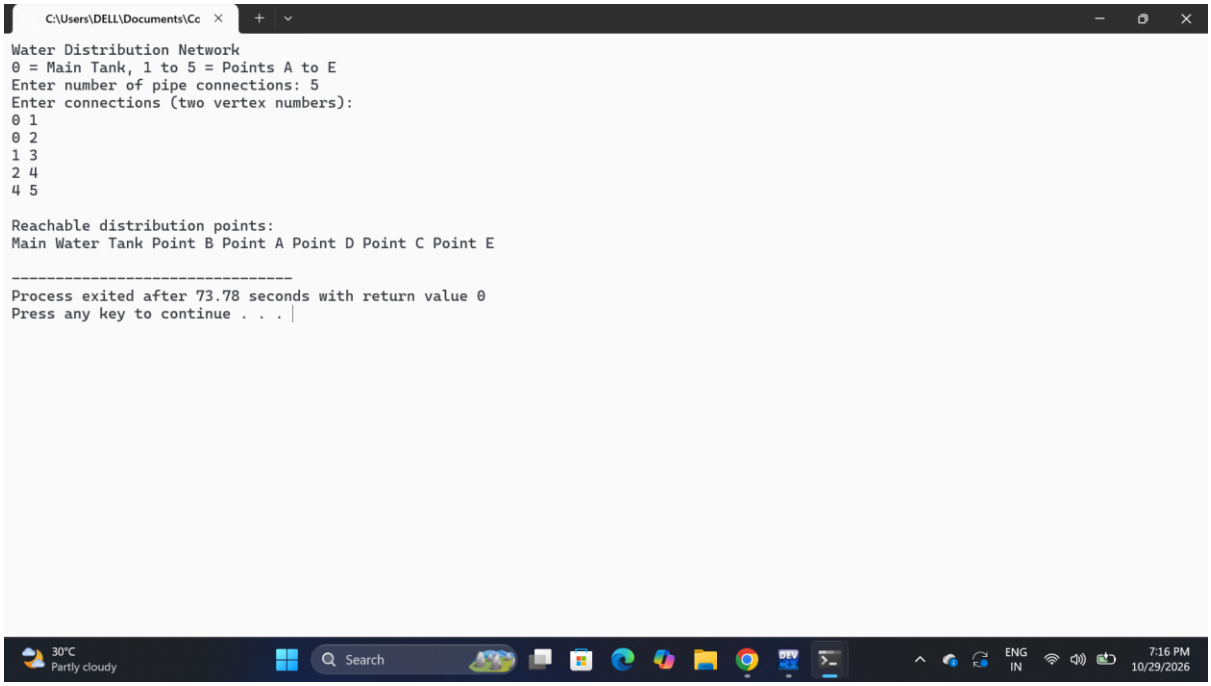
Process exited after 56.23 seconds with return value 0
Press any key to continue . . .
28°C
Partly cloudy
Search
ENG
IN
7:39 PM
10/29/2026


C:\Users\DELL\Documents\Cc
Water Distribution Network
0 = Main Tank, 1 to 5 = Points A to E
Enter number of pipe connections: 5
Enter connections (two vertex numbers):
1 4
2 5
0 4
2 1
1 5
Reachable distribution points:
Main Water Tank Point D Point A Point E Point B

Process exited after 36 seconds with return value 0
Press any key to continue . . .
28°C
Partly cloudy
Search
ENG
IN
7:18 PM
10/29/2026


C:\Users\DELL\Documents\Cc
Water Distribution Network
0 = Main Tank, 1 to 5 = Points A to E
Enter number of pipe connections: 2
Enter connections (two vertex numbers):
0 2
1 5
Reachable distribution points:
Main Water Tank Point B

Process exited after 23.43 seconds with return value 0
Press any key to continue . . .
File Explorer
28°C
Partly cloudy
Search
ENG
IN
7:26 PM
10/29/2026


C:\Users\DELL\Documents\Cc
Water Distribution Network
0 = Main Tank, 1 to 5 = Points A to E
Enter number of pipe connections: 5
Enter connections (two vertex numbers):
0 1
0 2
1 3
2 4
4 5
Reachable distribution points:
Main Water Tank Point B Point A Point D Point C Point E

Process exited after 73.78 seconds with return value 0
Press any key to continue . . .
30°C
Partly cloudy
Search
ENG
IN
7:16 PM
10/29/2026