FOUNDATION PLAN, DETAIL AND SECTION OF CLOSED DRAIN VESSEL SHELTER

TMBP–SP001–CS– BLD–D110

NOTES :

1. BEFORE STARTING CONSTRUCTION, CONTRACTOR SHALL VERIFY ACTUAL FIELD CONDITION AND DETERMINE LOCATION, ELEVATION OF EXISTING GRADING AND OTHER STRUCTURE. THE CONTRACTOR SHALL TAKE NECESSARY MEASURES TO HOLD SAFE AND PREVENT DAMAGE TO ANY EXISTING FACILITIES.

DRAWING REFERENCE	DESCRIPTION	REV	DATE	DESCRIPTION	PREPR'D	CHECK'D	APRV'D	CHECKED	APPROVED
		A	12–01–2026	ISSUED FOR REVIEW	NAS	AS	MR	YR	MRZ/RS

PT. PERTAMINA EP APPROVAL

PROCET :

JASA PEMBANGUNAN FASILITAS PRODUKSI STASIUN PENGUMPUL (SP) TANJUNG MIRING BARAT & KARANGAN TIMUR

OWNER :

skkmigas PERTAMINA EP

CONTRACTOR :

POG

SCALE :	DRAWING NO.	SHEET. NO.	REV
NTS	TMBP–SP001–CS–BLD–D110	1 OF 2	A

DRAWING TITLE :

FOUNDATION PLAN, DETAIL AND SECTION OF CLOSED DRAIN VESSEL

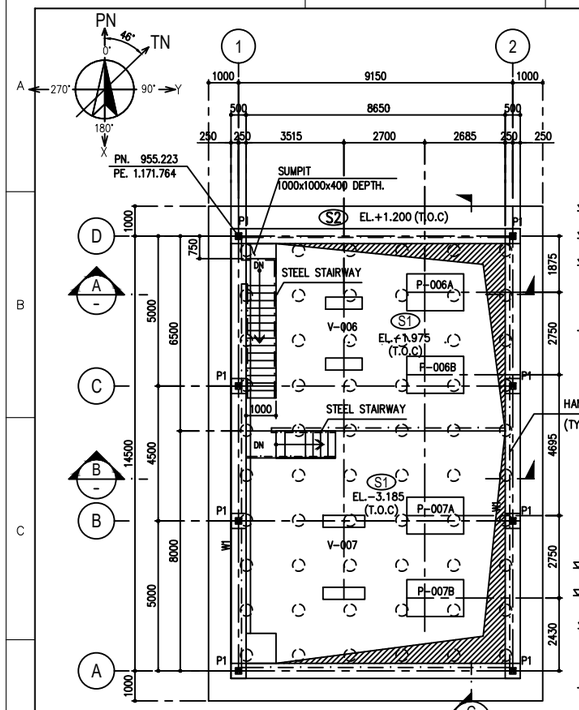

PLAN
SCALE 1 : 100

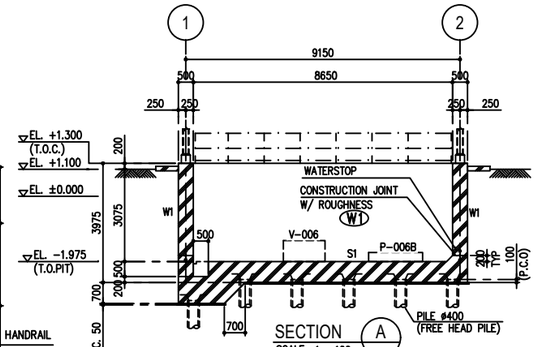

SECTION A
SCALE: 1 : 100

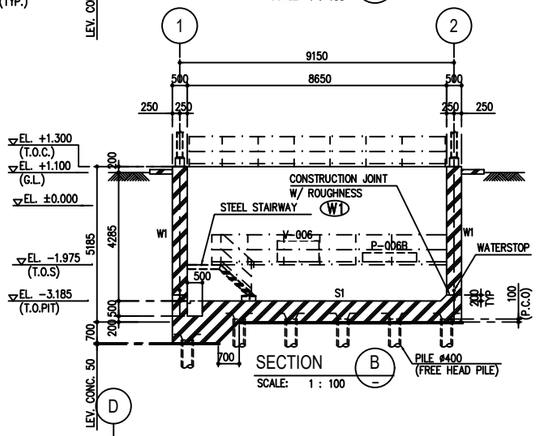

SECTION B
SCALE: 1 : 100

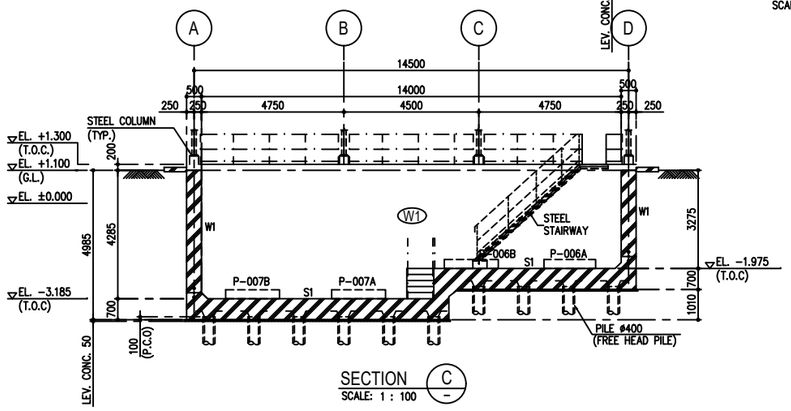

SECTION C
SCALE: 1 : 100

FOUNDATION P-006A/B & P-007A/B DETAIL (QTY = 4 NOS)

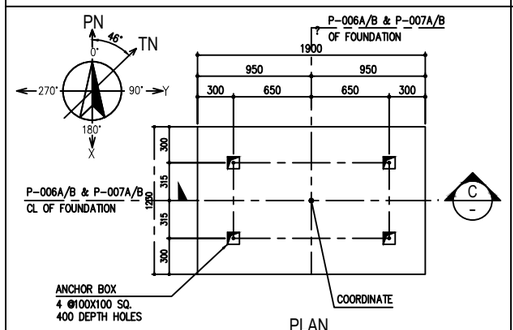

PLAN
SCALE 1 : 25

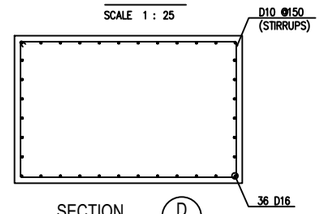

SECTION D
SCALE 1 : 25

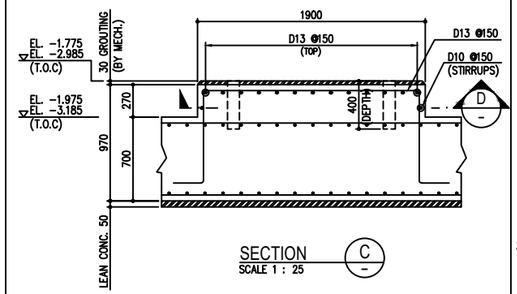

SECTION C
SCALE 1 : 25

FOUNDATION V-006 / V-007 DETAIL (QTY = 2 NOS)

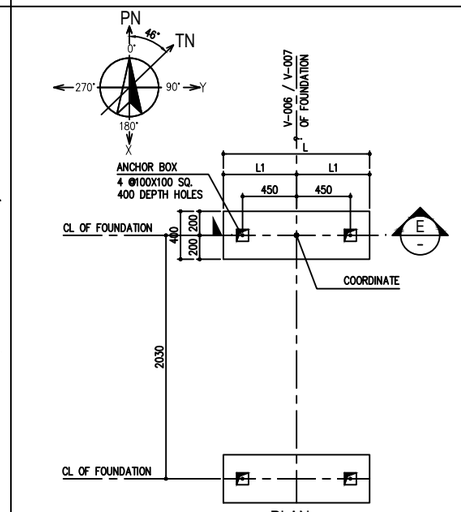

PLAN
SCALE 1 : 25



SECTION F
SCALE: 1 : 25

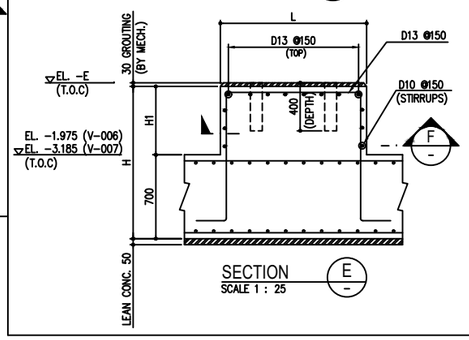

SECTION E
SCALE 1 : 25

KEY PLAN

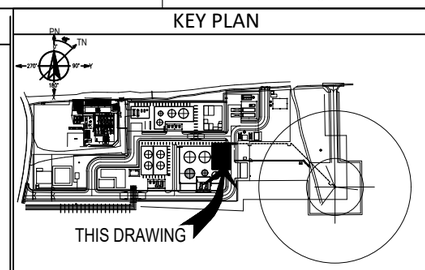

CATATAN

NOTE :

1. ALL DIMENSIONS ARE IN MILLIMETERS, ELEVATION AND COORDINATE ARE IN METERS UNLESS OTHERWISE NOTED.
2. REFERENCE OF ELEVATION AND COORDINATE
   GL. ± 0.000 = MSL+33.75 = E+1.100
   PE = 1.000.000 : E = 424962.745
   PN = 1.000.000 : N = 9607576.210
3. MATERIAL SPECIFICATION
   - LEVELING CONCRETE fc' = 15 MPa (CEMENT TYPE-I)
   - CONCRETE STRUCTURE fc' = 28 MPa (CEMENT TYPE-I)
   - DEFORMED BAR SNI 07-2052-2002, BJTP 40 MINIMUM YIELD STRENGTH 4000 Kg/cm²
   - PLAIN BAR SNI 07-2052-2002, BJTP 24 MINIMUM YIELD STRENGTH 2400 Kg/cm²
   - WIREMESH SHALL CONFORM TO ASTM A185 MIN. fy = 5000 Kg/cm²
   - GROUTING SHALL BE NON-SHRINK GROUT BASED WITH MINIMUM COMPRESSIVE STRENGTH 65 MPa
4. THIS SHELTER INCLUDE MANUAL HOIST 3 TON

DRAWING SCHEDULE

NO	FACILITY	NOS	LENGHT		HEIGHT		ELEVATION
			L	L1	H	H1	E
1	V-006	1	1300	650	1370	670	EL. -1.305
2	V-007	1	1400	700	1870	1170	EL. -2.015

P1 DETAIL (QTY = 8 NOS)

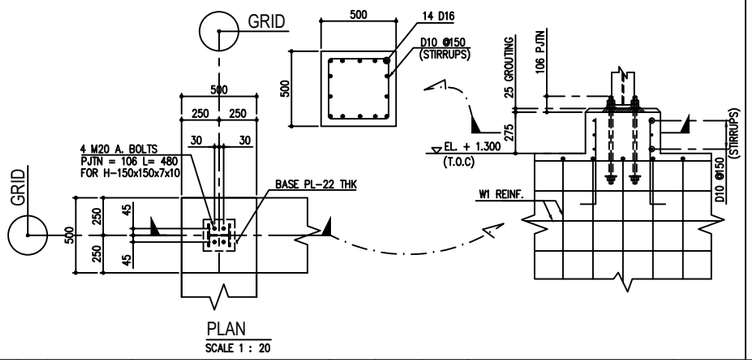

PLAN
SCALE 1 : 20

WALL & SLAB SCHEDULE

MARK	W1	S1	S2
THICKNESS	500	700	150
ELEVATION	–	EL. -1.975 (T.O.C) & EL. -3.185 (T.O.C)	EL.+1.200 (T.O.C)
SECTION			

NOTES :

1. BEFORE STARTING CONSTRUCTION, CONTRACTOR SHALL VERIFY ACTUAL FIELD CONDITION AND DETERMINE LOCATION, ELEVATION OF EXISTING GRADING AND OTHER STRUCTURE. THE CONTRACTOR SHALL TAKE NECESSARY MEASURES TO HOLD SAFE AND PREVENT DAMAGE TO ANY EXISTING FACILITIES.

DRAWING REFERENCE	DESCRIPTION	REV	DATE	DESCRIPTION	PREPR'D	CHECK'D	APRV'D	CHECKED	APPROVED
TMBP-SP001-CS-ARC-D112	ARCHITECTURE FLOOR PLAN, ROOF PLAN, & ELEVATION OF CLOSED DRAIN AND KNOCK OUT DRUM VESSEL SHELTER								
TMBP-SP001-CS-FRM-D111	FRAMING PLAN, ROOF PLAN, ELEVATION, SECTION & DETAIL OF CLOSED DRAIN VESSEL AND KNOCK OUT DRUM VESSEL SHELTER								
TMBP-SP001-CS-LAY-102	OVERALL FOUNDATION LAYOUT								
TMBP-SP001-PI-PLP-101	OVERALL PLOT PLAN DRAWING	A	12-01-2026	ISSUED FOR REVIEW	NAS	AS	MR	YR	MRZ/RS

PT. PERTAMINA EP APPROVAL

PROCET :
JASA PEMBANGUNAN FASILITAS PRODUKSI STASIUN PENGUMPUL (SP) TANJUNG MIRING BARAT & KARANGAN TIMUR

OWNER :
skkmigas PERTAMINA EP

CONTRACTOR :
POG

SCALE : 1 : 100, 1 : 25, 1 : 20

DRAWING NO. TMBP-SP001-CS-BLD-D110

SHEET. NO. 2 OF 2

REV A

DRAWING TITLE :
FOUNDATION PLAN, DETAIL AND SECTION OF CLOSED DRAIN VESSEL SHELTER