INSTRUMENT CABLING BLOCK DIAGRAM

OWNER	:	PT PERTAMINA EP ZONA 4
PROJECT TITLE	:	FEED PENGEMBANGAN FASILITAS PRODUKSI TANJUNG MIRING BARAT & KARANGAN TIMUR
LOCATION	:	TANJUNG MIRING BARAT
NO. PROJECT	:	SA02035383B

NOTES :

DRAWING REFERENCE	DESCRIPTION	REV	DATE	DESCRIPTION	PREPR'D	CHECK'D	APRV'D	CHECKED	APPROVED
TMBP-SP001-IN-BKD-D101	SYSTEM CONTROL ARCHITECTURE BLOCK DIAGRAM								
TMBP-SP001-IN-DNX-D102	INSTRUMENT I/O LIST	A	09/01/2026	ISSUED FOR REVIEW	MHP	AS	MR		

PT. PERTAMINA EP APPROVAL

PROJECT : JASA PEMBANGUNAN FASILITAS PRODUKSI STASIUN PENGUMPUL (SP) TANJUNG MIRING BARAT & KARANGAN TIMUR

OWNER : skkmigas PERTAMINA EP

CONTRACTOR : POG

SCALE :	DRAWING NO.	SHEET. NO.	REV
NTS	TMBP – SP001 – IN – BKD – D102	1 OF 6	A

DRAWING TITLE : INSTRUMENT CABLING BLOCK DIAGRAM

DRAWING INDEX

NO	DOCUMENT NUMBER	DESCRIPTION	REVISION A	B	C	D	0	1	
1	TMBP–SP001–IN–BKD–D102	INSTRUMENT CABLING BLOCK DIAGRAM – COVER	X						
2	TMBP–SP001–IN–BKD–D102	INSTRUMENT CABLING BLOCK DIAGRAM – INDEX	X						
3	TMBP–SP001–IN–BKD–D102	INSTRUMENT CABLING BLOCK DIAGRAM – SHEET 3	X						
4	TMBP–SP001–IN–BKD–D102	INSTRUMENT CABLING BLOCK DIAGRAM – SHEET 4	X						
5	TMBP–SP001–IN–BKD–D102	INSTRUMENT CABLING BLOCK DIAGRAM – SHEET 5	X						
6	TMBP–SP001–IN–BKD–D102	INSTRUMENT CABLING BLOCK DIAGRAM – SHEET 6	X						

● PREVIOUS REVISION

X LATEST REVISION

NOTES :

DRAWING REFERENCE	DESCRIPTION	REV	DATE	DESCRIPTION	PREPR'D	CHECK'D	APRV'D	CHECKED	APPROVED
TMBP–SP001–IN–BKD–D101	SYSTEM CONTROL ARCHITECTURE BLOCK DIAGRAM								
TMBP–SP001–IN–DNX–D102	INSTRUMENT I/O LIST	A	09/01/2026	ISSUED FOR REVIEW	MHP	AS	MR		

PT. PERTAMINA EP APPROVAL

PROJECT :

JASA PEMBANGUNAN FASILITAS PRODUKSI STASIUN PENGUMPUL (SP)
TANJUNG MIRING BARAT & KARANGAN TIMUR

OWNER :

skkmigas PERTAMINA EP

CONTRACTOR :

POG

SCALE : NTS

DRAWING NO. TMBP – SP001 – IN – BKD – D102

SHEET. NO. 2 OF 6

REV A

DRAWING TITLE :

INSTRUMENT CABLING BLOCK DIAGRAM

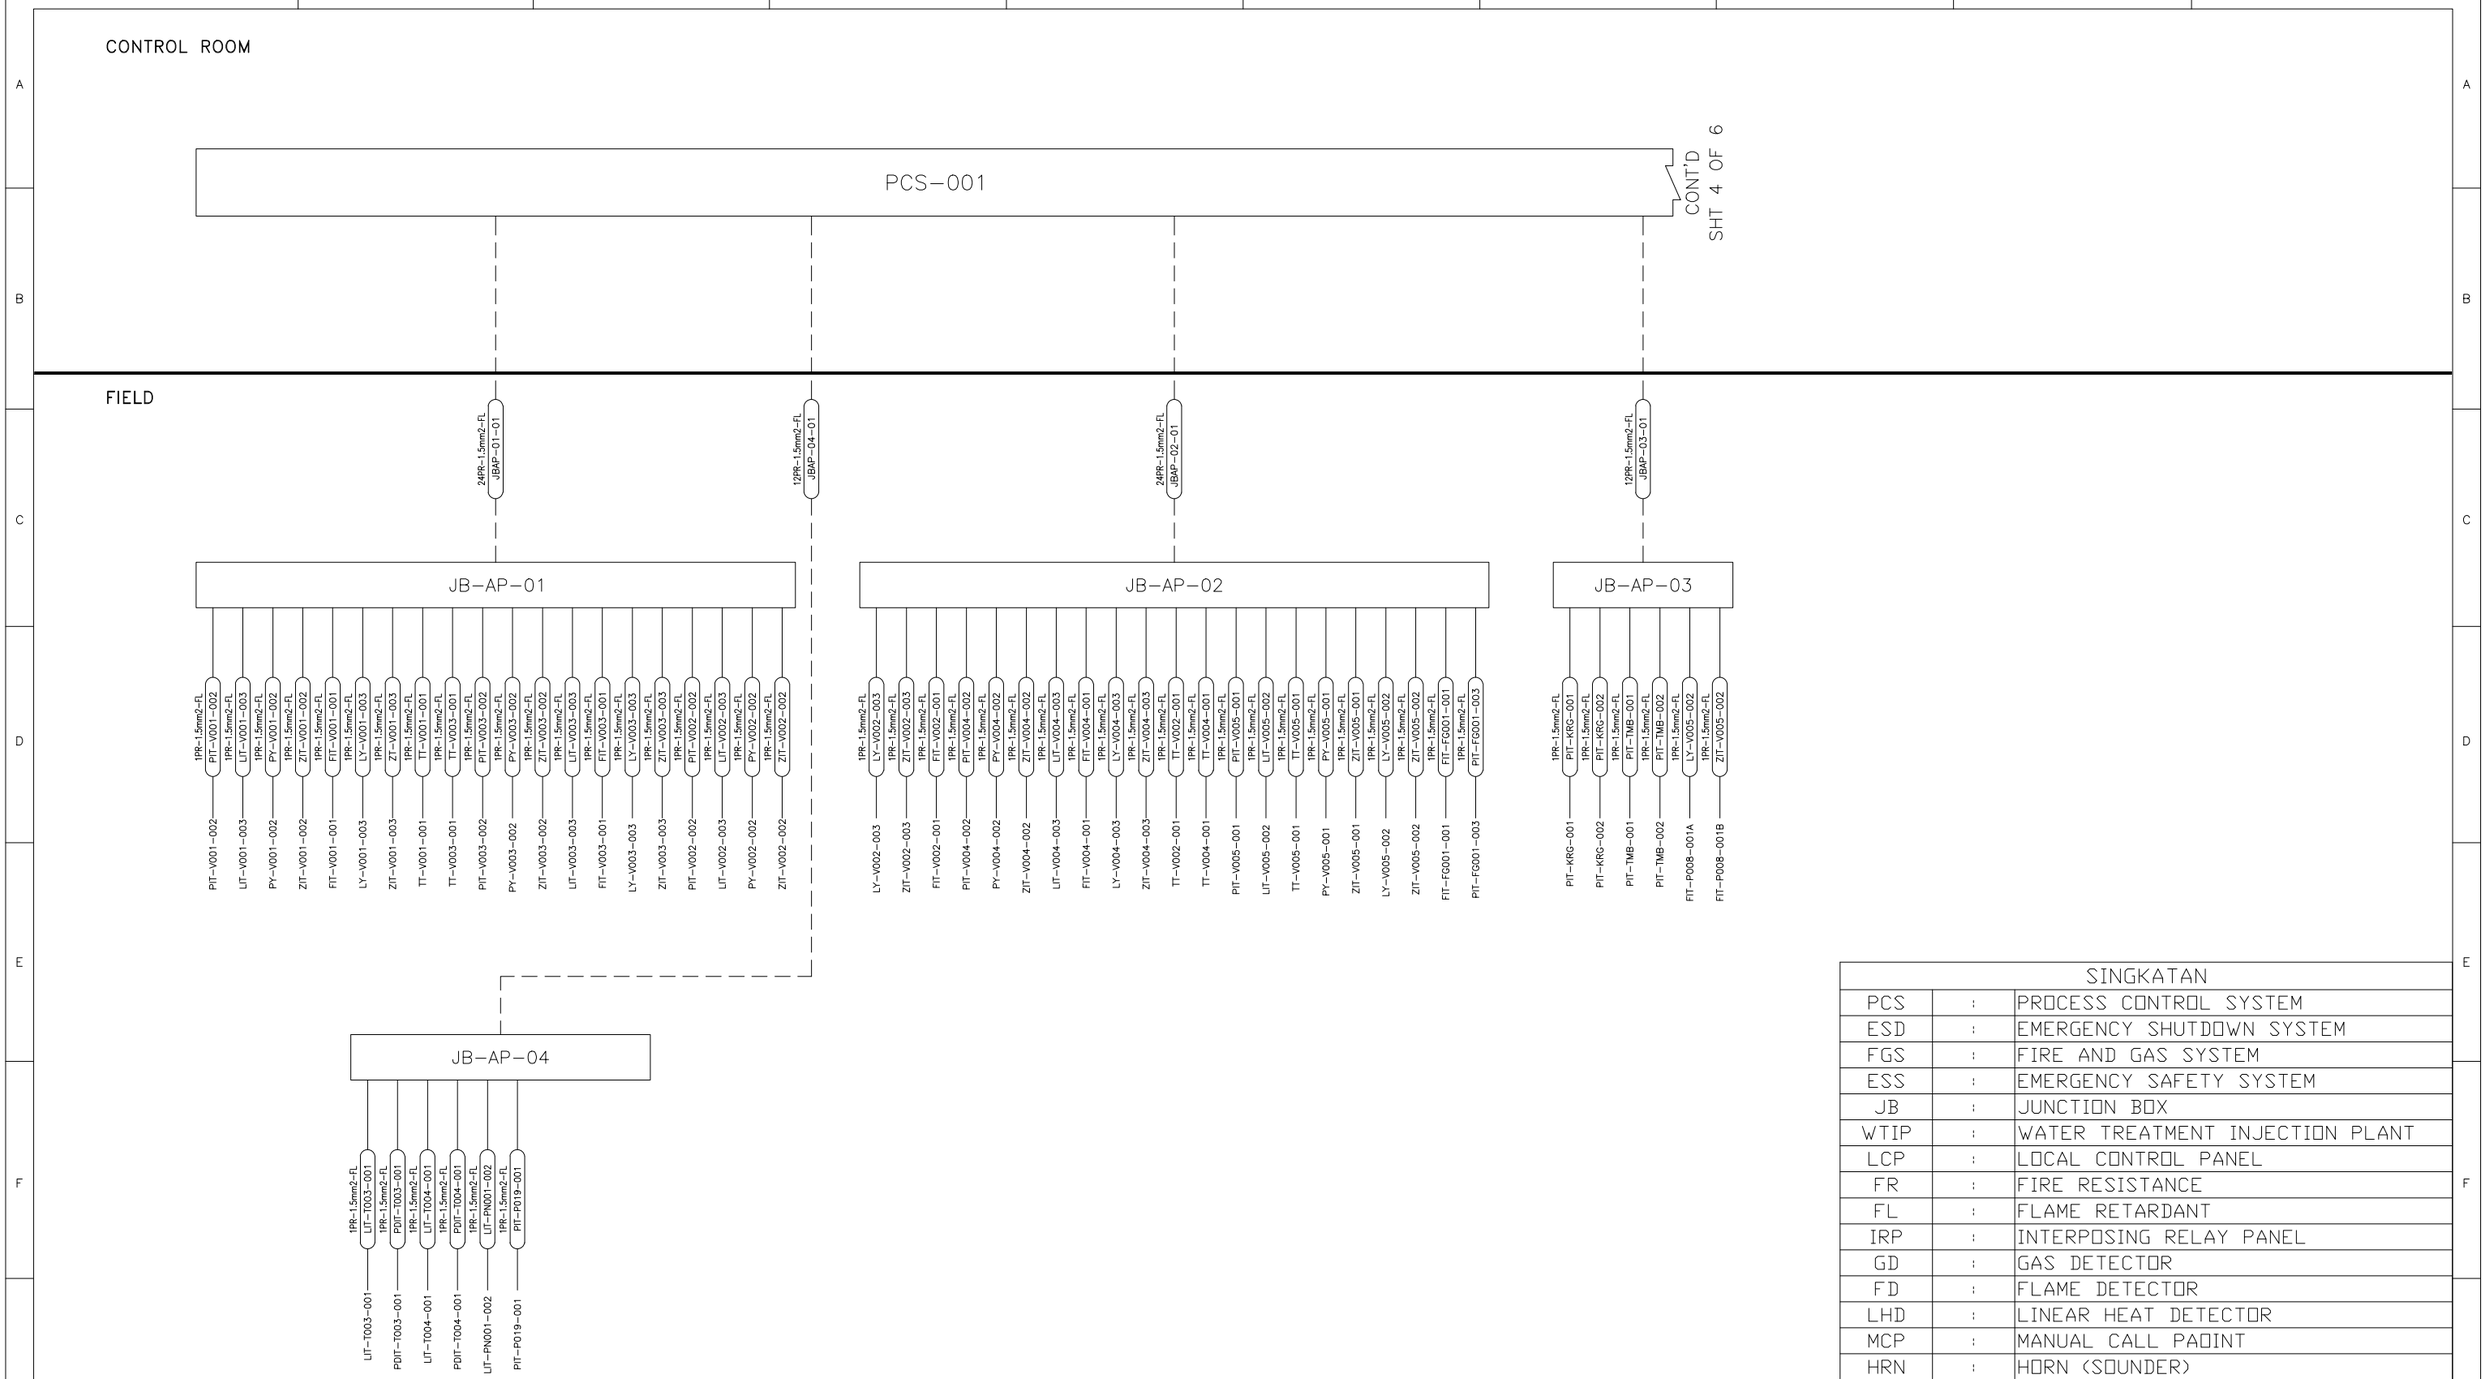

SINGKATAN		
PCS	:	PROCESS CONTROL SYSTEM
ESD	:	EMERGENCY SHUTDOWN SYSTEM
FGS	:	FIRE AND GAS SYSTEM
ESS	:	EMERGENCY SAFETY SYSTEM
JB	:	JUNCTION BOX
WTIP	:	WATER TREATMENT INJECTION PLANT
LCP	:	LOCAL CONTROL PANEL
FR	:	FIRE RESISTANCE
FL	:	FLAME RETARDANT
IRP	:	INTERPOSING RELAY PANEL
GD	:	GAS DETECTOR
FD	:	FLAME DETECTOR
LHD	:	LINEAR HEAT DETECTOR
MCP	:	MANUAL CALL PAOINT
HRN	:	HORN (SOUNDER)
BCN	:	BEACON (STROBE LIGHT)
-----	:	HARDWARE CABLE
—o—o—	:	SERIAL / RS-485

NOTES :

1. THIS DIAGRAM SHALL BE FURTHER UPDATE UPON DURING DESIGN ENGINEERING DETAIL
2. EPC CONTRACTOR IS REPONSIBLE FOR VERIFYING AND CLARIFYING AT THE TIME OF TENDER
3. THE SELECTED EPC CONTACTOR MUST DEVELOP A DRAWING DURING THE DED PHASE. THE IMPACT OF CHANGES IN THE DED PHASE IS THE RESPONSIBILITY OF THE EPC CONTACTOR
4. JUNCTION BOX NUMBER TAGGING:
   JB-A P-01
   - SQUENCE NUMBER
   - SERVICE TYPE
     P – PCS
     E – ESD
     F – FGS
   - SIGNAL TYPE
     A – ANALOG SIGNAL
     D – DIGITAL SIGNAL
5. CABLE NUMBER TAGGING:
   A. FIELD INSTRUMENT
      PIT-V001-002
      - INSTRUMENT TAG NUMBER
   B. JUNCTION BOX
      JBAP-06-01
      - SQUENCE NUMBER
      - JG TAG NUMBER

DRAWING REFERENCE	DESCRIPTION	REV	DATE	DESCRIPTION	PREPR'D	CHECK'D	APRV'D	CHECKED	APPROVED
TMBP-SP001-IN-BKD-D101	SYSTEM CONTROL ARCHITECTURE BLOCK DIAGRAM								
TMBP-SP001-IN-DNX-D102	INSTRUMENT I/O LIST	A	09/01/2026	ISSUED FOR REVIEW	MHP	AS	MR		

PT. PERTAMINA EP APPROVAL

PROJECT :
JASA PEMBANGUNAN FASILITAS PRODUKSI STASIUN PENGUMPUL (SP) TANJUNG MIRING BARAT & KARANGAN TIMUR

OWNER : skkmigas PERTAMINA EP

CONTRACTOR : PCG

SCALE :	DRAWING NO.	SHEET. NO.	REV
NTS	TMBP – SP001 – IN – BKD – D102	3 OF 6	A

DRAWING TITLE :
INSTRUMENT CABLING BLOCK DIAGRAM

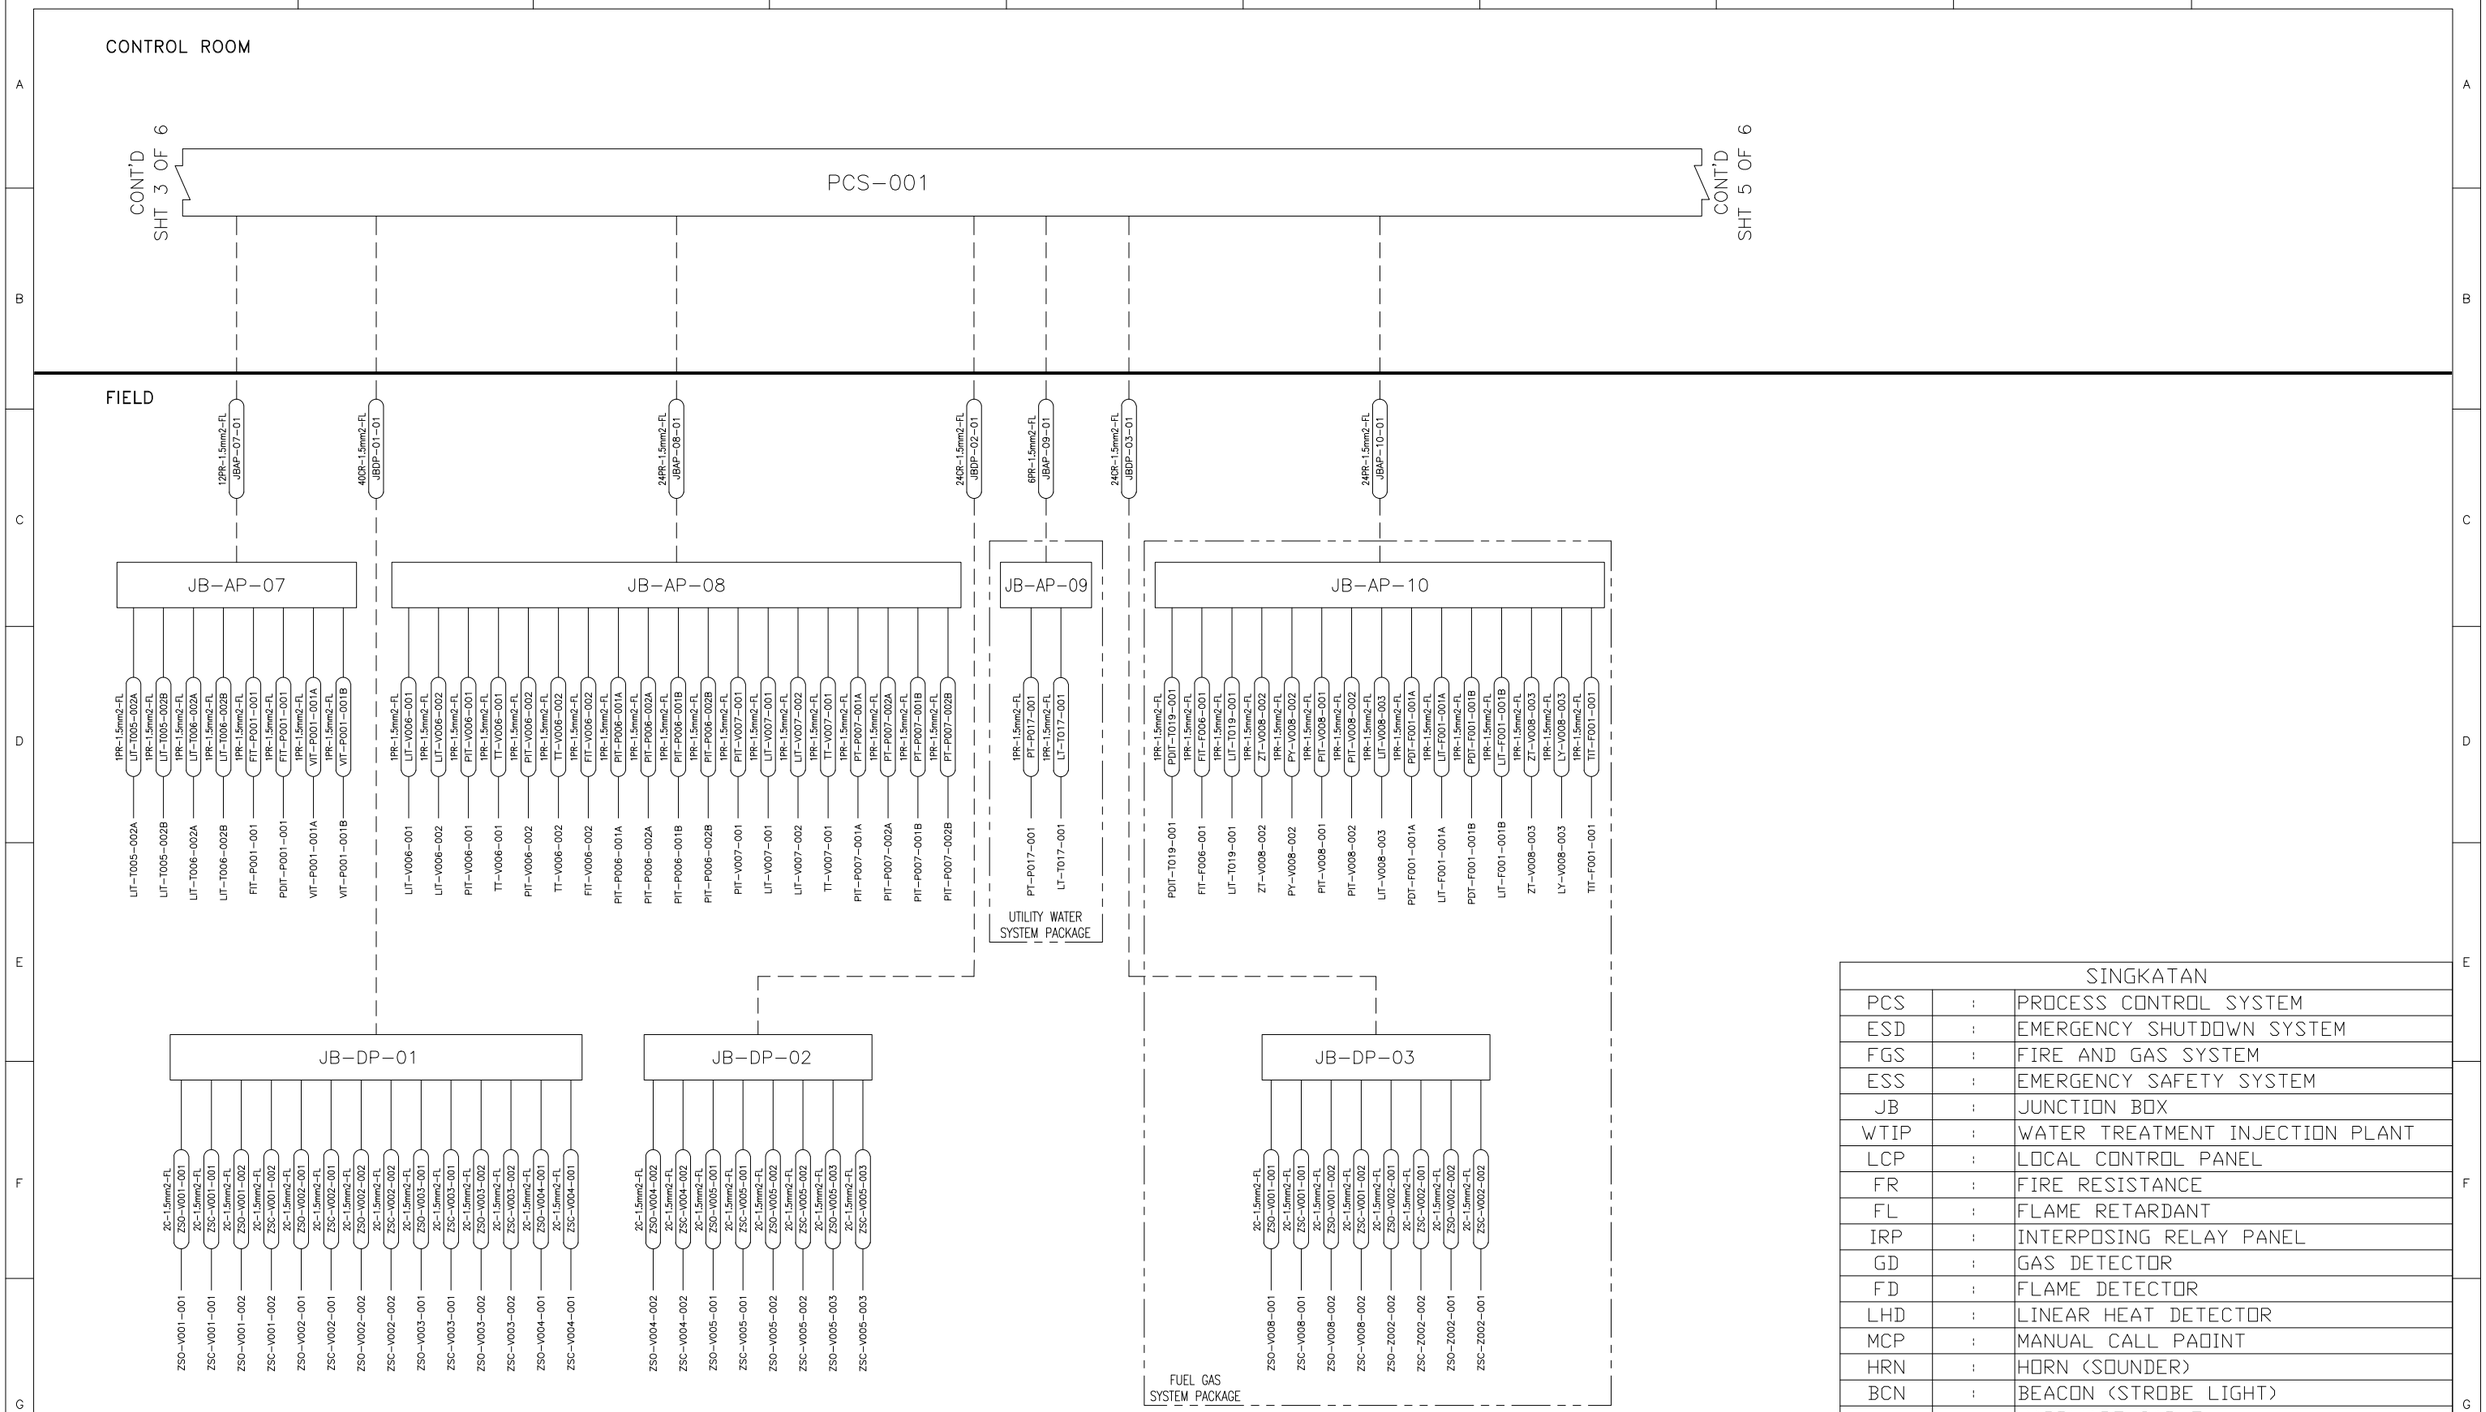

SINGKATAN		
PCS	:	PROCESS CONTROL SYSTEM
ESD	:	EMERGENCY SHUTDOWN SYSTEM
FGS	:	FIRE AND GAS SYSTEM
ESS	:	EMERGENCY SAFETY SYSTEM
JB	:	JUNCTION BOX
WTIP	:	WATER TREATMENT INJECTION PLANT
LCP	:	LOCAL CONTROL PANEL
FR	:	FIRE RESISTANCE
FL	:	FLAME RETARDANT
IRP	:	INTERPOSING RELAY PANEL
GD	:	GAS DETECTOR
FD	:	FLAME DETECTOR
LHD	:	LINEAR HEAT DETECTOR
MCP	:	MANUAL CALL PAOINT
HRN	:	HORN (SOUNDER)
BCN	:	BEACON (STROBE LIGHT)
-----	:	HARDWARE CABLE
—o—o—	:	SERIAL / RS-485

NOTES :

1. THIS DIAGRAM SHALL BE FURTHER UPDATE UPON DURING DESIGN ENGINEERING DETAIL
2. EPC CONTRACTOR IS REPONSIBLE FOR VERIFYING AND CLARIFYING AT THE TIME OF TENDER
3. THE SELECTED EPC CONTACTOR MUST DEVELOP A DRAWING DURING THE DED PHASE. THE IMPACT OF CHANGES IN THE DED PHASE IS THE RESPONSIBILITY OF THE EPC CONTACTOR
4. JUNCTION BOX NUMBER TAGGING:
   JB-A P-01
   - SQUENCE NUMBER
   - SERVICE TYPE
     - P – PCS
     - E – ESD
     - F – FGS
   - SIGNAL TYPE
     - A – ANALOG SIGNAL
     - D – DIGITAL SIGNAL
5. CABLE NUMBER TAGGING:
   A. FIELD INSTRUMENT
      PIT-V001-002
      - INSTRUMENT TAG NUMBER
   B. JUNCTION BOX
      JBAP-06-01
      - SQUENCE NUMBER
      - JG TAG NUMBER

DRAWING REFERENCE	DESCRIPTION	REV	DATE	DESCRIPTION	PREPR'D	CHECK'D	APRV'D	CHECKED	APPROVED
TMBP-SP001-IN-BKD-D101	SYSTEM CONTROL ARCHITECTURE BLOCK DIAGRAM								
TMBP-SP001-IN-DNX-D102	INSTRUMENT I/O LIST	A	09/01/2026	ISSUED FOR REVIEW	MHP	AS	MR		

PT. PERTAMINA EP APPROVAL

PROJECT : JASA PEMBANGUNAN FASILITAS PRODUKSI STASIUN PENGUMPUL (SP) TANJUNG MIRING BARAT & KARANGAN TIMUR

OWNER : skkmigas PERTAMINA EP

CONTRACTOR : POG

SCALE : NTS

DRAWING NO. TMBP – SP001 – IN – BKD – D102

SHEET. NO. 4 OF 6

REV A

DRAWING TITLE : INSTRUMENT CABLING BLOCK DIAGRAM

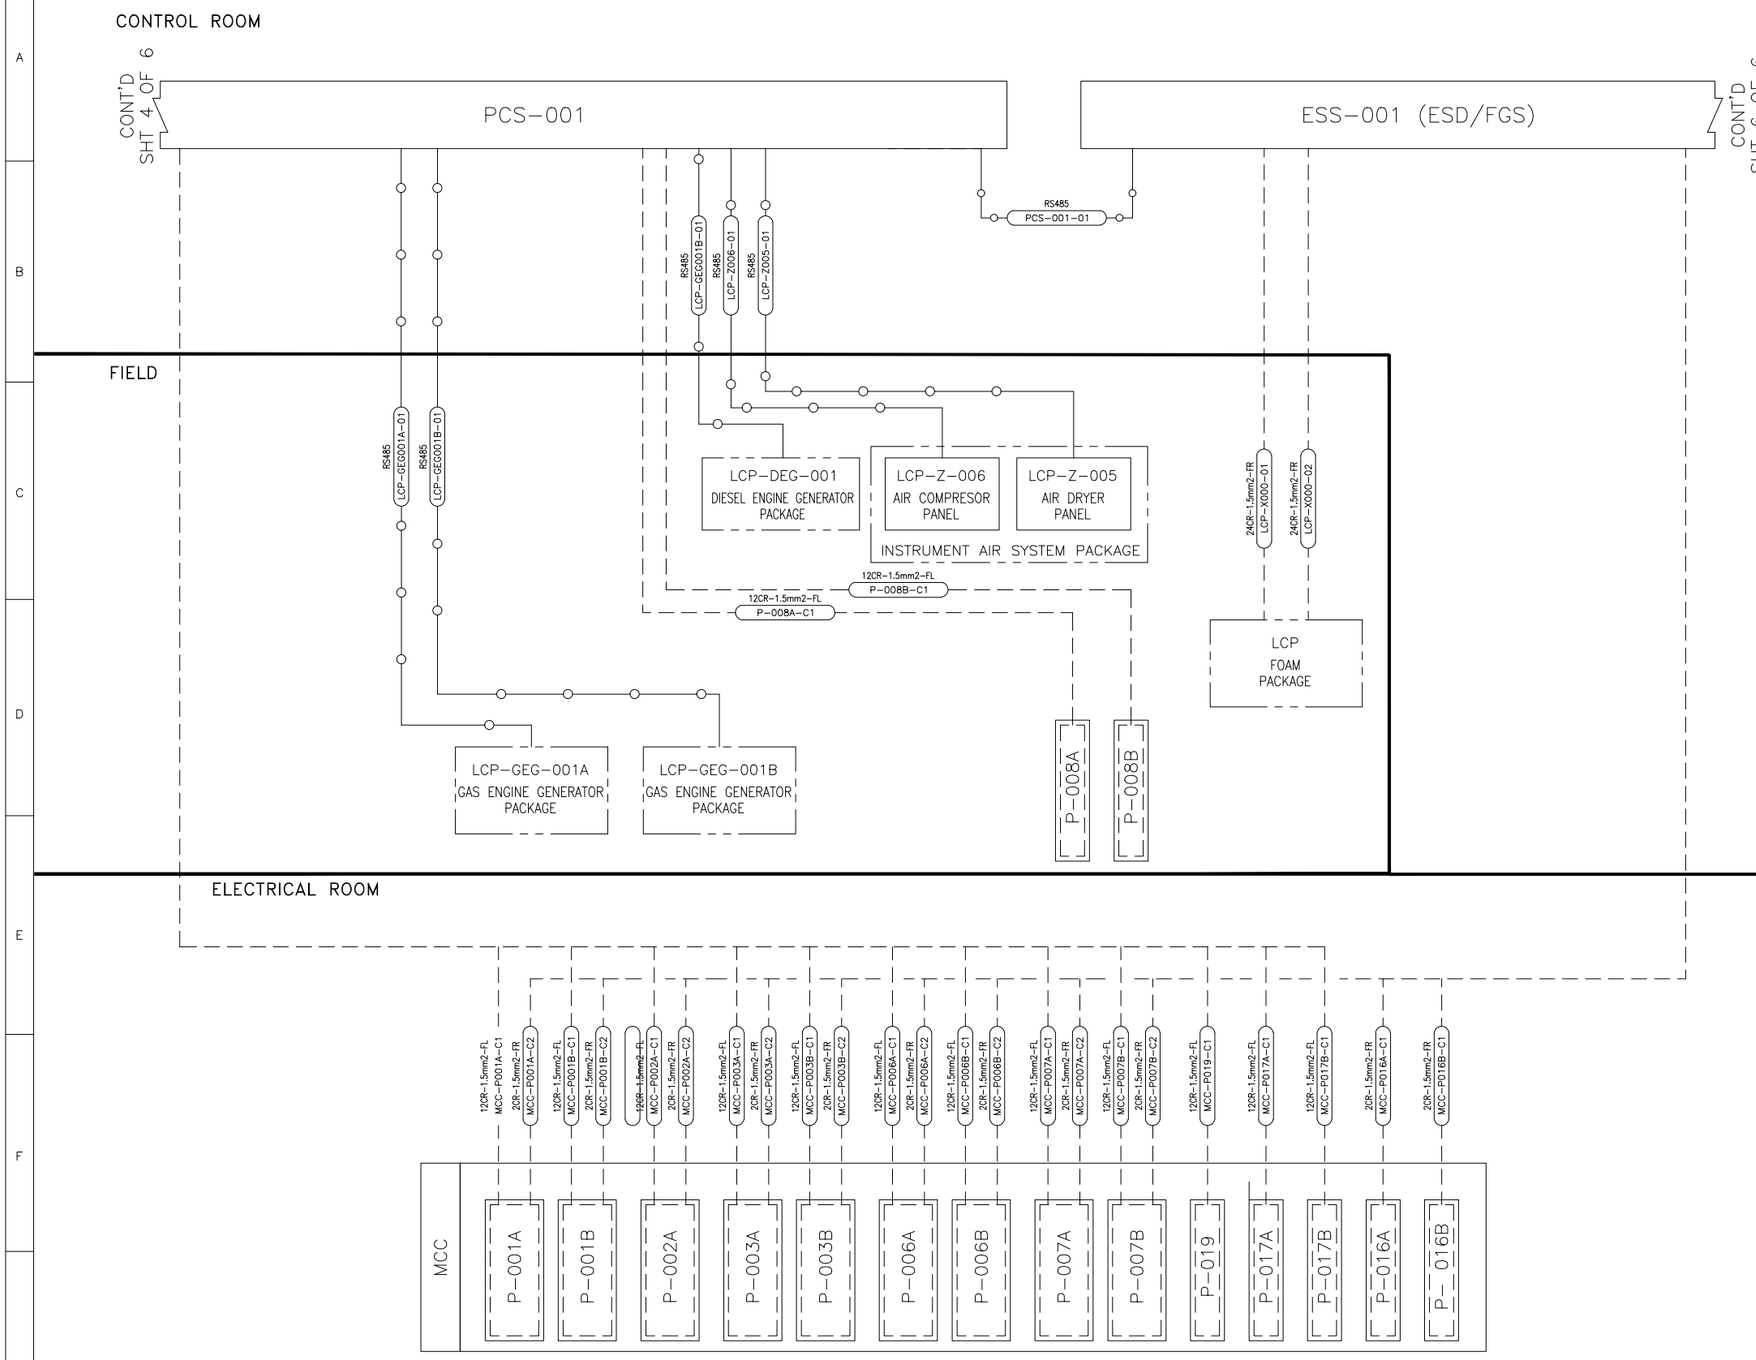

SINGKATAN		
PCS	:	PROCESS CONTROL SYSTEM
ESD	:	EMERGENCY SHUTDOWN SYSTEM
FGS	:	FIRE AND GAS SYSTEM
ESS	:	EMERGENCY SAFETY SYSTEM
JB	:	JUNCTION BOX
WTIP	:	WATER TREATMENT INJECTION PLANT
LCP	:	LOCAL CONTROL PANEL
FR	:	FIRE RESISTANCE
FL	:	FLAME RETARDANT
IRP	:	INTERPOSING RELAY PANEL
GD	:	GAS DETECTOR
FD	:	FLAME DETECTOR
LHD	:	LINEAR HEAT DETECTOR
MCP	:	MANUAL CALL PAOINT
HRN	:	HORN (SOUNDER)
BCN	:	BEACON (STROBE LIGHT)
-----	:	HARDWARE CABLE
—o—o—	:	SERIAL / RS-485

NOTES :

1. THIS DIAGRAM SHALL BE FURTHER UPDATE UPON DURING DESIGN ENGINEERING DETAIL
2. EPC CONTRACTOR IS REPONSIBLE FOR VERIFYING AND CLARIFYING AT THE TIME OF TENDER
3. THE SELECTED EPC CONTACTOR MUST DEVELOP A DRAWING DURING THE DED PHASE. THE IMPACT OF CHANGES IN THE DED PHASE IS THE RESPONSIBILITY OF THE EPC CONTACTOR
4. JUNCTION BOX NUMBER TAGGING:
   JB-A P-01
   - SQUENCE NUMBER
   - SERVICE TYPE
     - P – PCS
     - E – ESD
     - F – FGS
   - SIGNAL TYPE
     - A – ANALOG SIGNAL
     - D – DIGITAL SIGNAL
5. CABLE NUMBER TAGGING:
   A. FIELD INSTRUMENT
      PIT-V001-002
      - INSTRUMENT TAG NUMBER
   B. JUNCTION BOX
      JBAP-06-01
      - SQUENCE NUMBER
      - JG TAG NUMBER

DRAWING REFERENCE	DESCRIPTION	REV	DATE	DESCRIPTION	PREPR'D	CHECK'D	APRV'D	CHECKED	APPROVED
TMBP-SP001-IN-BKD-D101	SYSTEM CONTROL ARCHITECTURE BLOCK DIAGRAM								
TMBP-SP001-IN-DNX-D102	INSTRUMENT I/O LIST	A	09/01/2026	ISSUED FOR REVIEW	MHP	AS	MR		

PT. PERTAMINA EP APPROVAL

PROJECT : JASA PEMBANGUNAN FASILITAS PRODUKSI STASIUN PENGUMPUL (SP) TANJUNG MIRING BARAT & KARANGAN TIMUR

OWNER : skkmigas PERTAMINA EP

CONTRACTOR : POG

SCALE :	DRAWING NO.	SHEET. NO.	REV
NTS	TMBP – SP001 – IN – BKD – D102	5 OF 6	A

DRAWING TITLE : INSTRUMENT CABLING BLOCK DIAGRAM

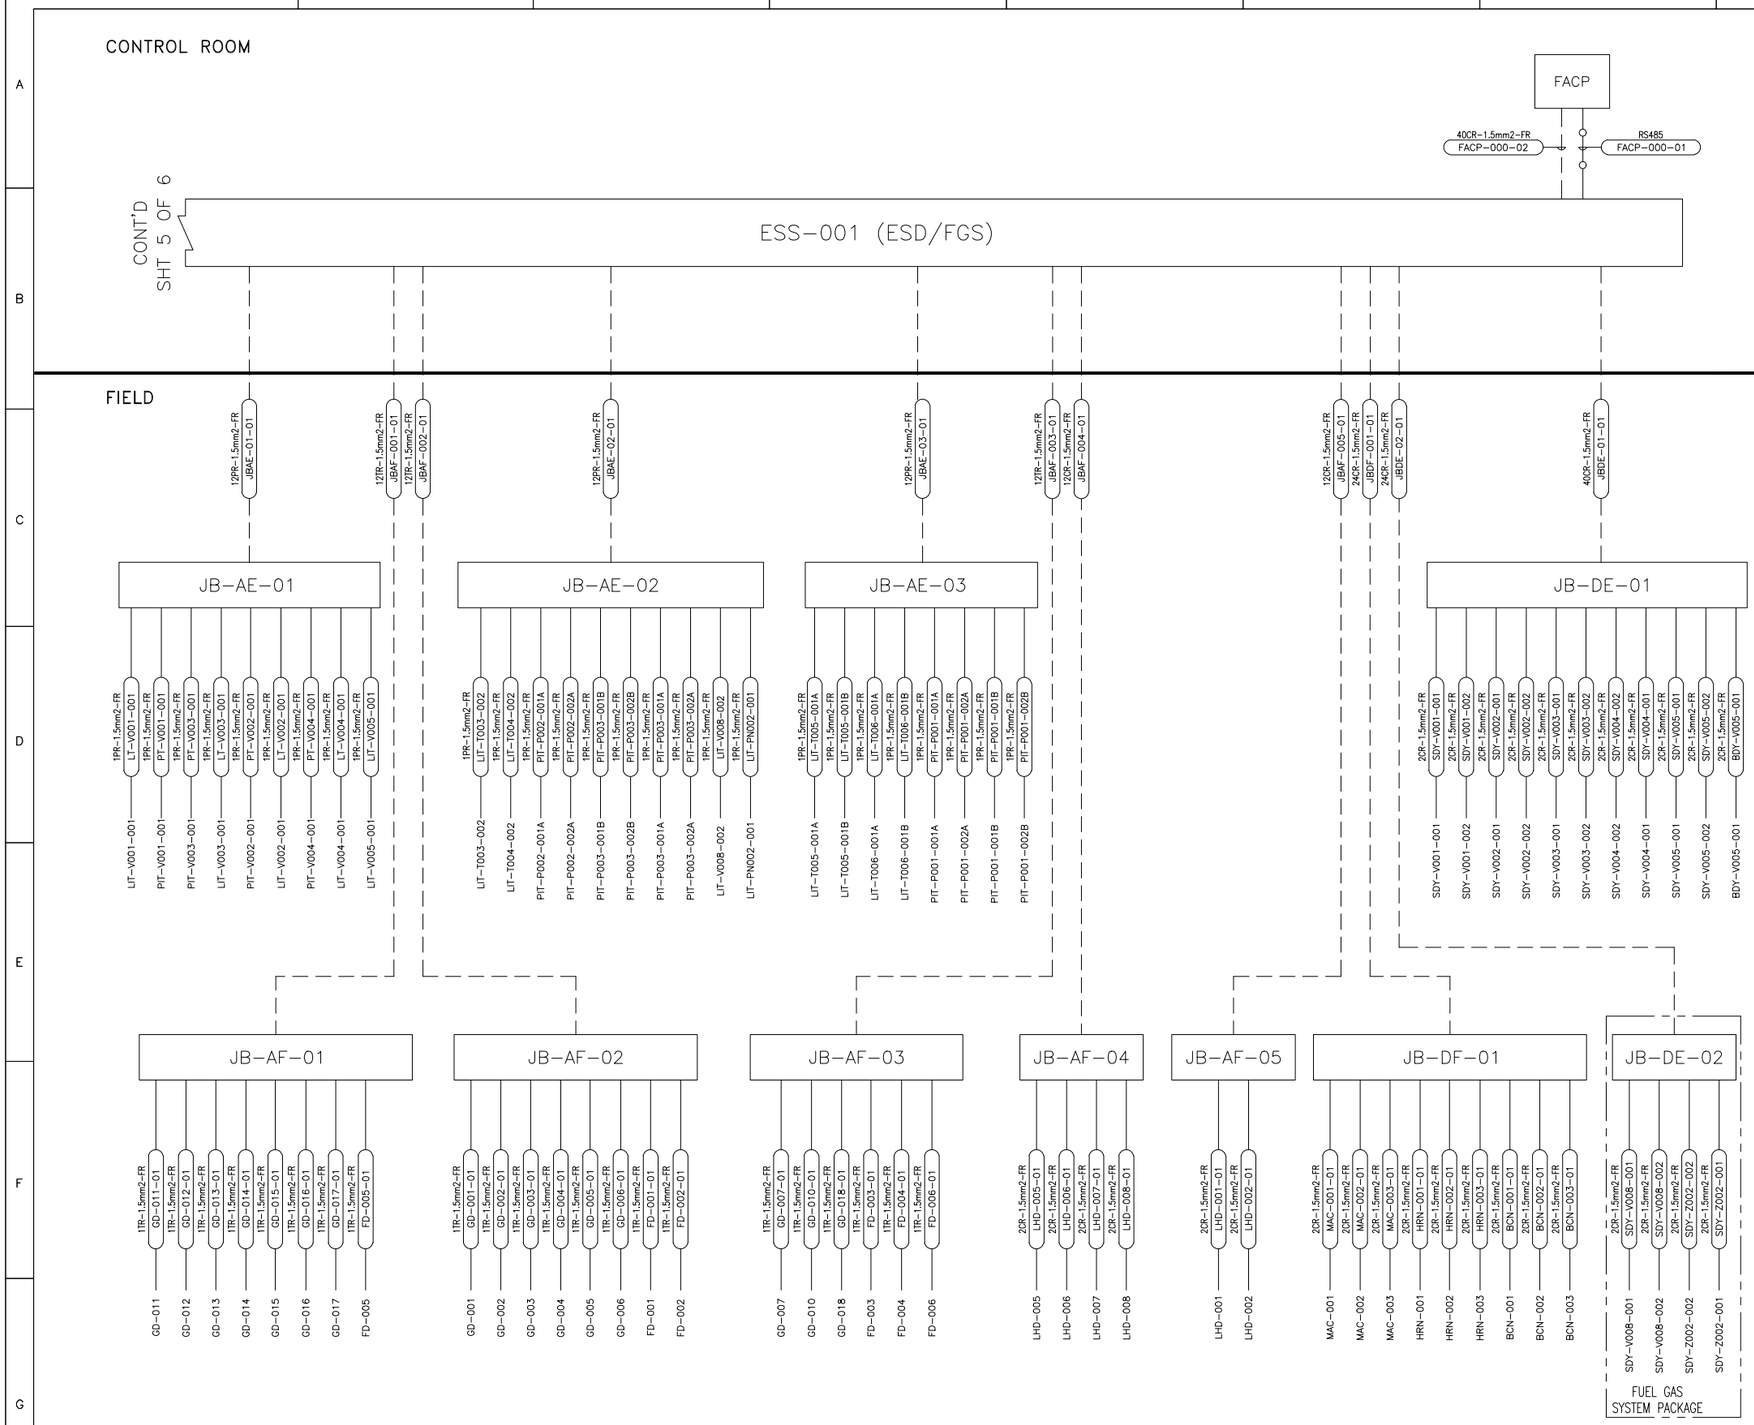

SINGKATAN		
PCS	:	PROCESS CONTROL SYSTEM
ESD	:	EMERGENCY SHUTDOWN SYSTEM
FGS	:	FIRE AND GAS SYSTEM
ESS	:	EMERGENCY SAFETY SYSTEM
JB	:	JUNCTION BOX
WTIP	:	WATER TREATMENT INJECTION PLANT
LCP	:	LOCAL CONTROL PANEL
FR	:	FIRE RESISTANCE
FL	:	FLAME RETARDANT
IRP	:	INTERPOSING RELAY PANEL
GD	:	GAS DETECTOR
FD	:	FLAME DETECTOR
LHD	:	LINEAR HEAT DETECTOR
MCP	:	MANUAL CALL PAOINT
HRN	:	HORN (SOUNDER)
BCN	:	BEACON (STROBE LIGHT)
-----	:	HARDWARE CABLE
—o—o—	:	SERIAL / RS-485

NOTES :

1. THIS DIAGRAM SHALL BE FURTHER UPDATE UPON DURING DESIGN ENGINEERING DETAIL
2. EPC CONTRACTOR IS REPONSIBLE FOR VERIFYING AND CLARIFYING AT THE TIME OF TENDER
3. THE SELECTED EPC CONTACTOR MUST DEVELOP A DRAWING DURING THE DED PHASE. THE IMPACT OF CHANGES IN THE DED PHASE IS THE RESPONSIBILITY OF THE EPC CONTACTOR
4. JUNCTION BOX NUMBER TAGGING:
   JB-A P-01
   - SQUENCE NUMBER
   - SERVICE TYPE
     - P – PCS
     - E – ESD
     - F – FGS
   - SIGNAL TYPE
     - A – ANALOG SIGNAL
     - D – DIGITAL SIGNAL
5. CABLE NUMBER TAGGING:
   A. FIELD INSTRUMENT
      PIT-V001-002
      - INSTRUMENT TAG NUMBER
   B. JUNCTION BOX
      JBAF-06-01
      - SQUENCE NUMBER
      - JG TAG NUMBER

DRAWING REFERENCE	DESCRIPTION	REV	DATE	DESCRIPTION	PREPR'D	CHECK'D	APRV'D	CHECKED	APPROVED
TMBP-SP001-IN-BKD-D101	SYSTEM CONTROL ARCHITECTURE BLOCK DIAGRAM							PT. PERTAMINA EP APPROVAL	
TMBP-SP001-IN-DNX-D102	INSTRUMENT I/O LIST	A	09/01/2026	ISSUED FOR REVIEW	MHP	AS	MR		

PROJECT :
JASA PEMBANGUNAN FASILITAS PRODUKSI STASIUN PENGUMPUL (SP)
TANJUNG MIRING BARAT & KARANGAN TIMUR

OWNER : skkmigas PERTAMINA EP

CONTRACTOR : POG

SCALE : NTS

DRAWING NO. TMBP – SP001 – IN – BKD – D102

SHEET. NO. 6 OF 6

REV A

DRAWING TITLE :
INSTRUMENT CABLING BLOCK DIAGRAM