**NAMA PEMILIK PROYEK** : **PT PERTAMINA EP**

**NAMA PROYEK** : **JASA PEMBANGUNAN FASILITAS PRODUKSI STASIUN PENGUMPUL (SP) TANJUNG MIRING BARAT & KARANGAN TIMUR**

**LOKASI** : **SP TANJUNG MIRING BARAT & KARANGAN TIMUR - FIELD LIMAU**

**NO. KONTRAK** : **4710002197**

| REV. | TGL. | DESKRIPSI | DISIAPKAN | DIPERIKSA | DISETUJUI | DIPERIKSA | DISETUJUI |
|---|---|---|---|---|---|---|---|
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| A | 12/01/2026 | Issued For Review | MI | AS | MR | | |
| | | | PT. PROSYMPAC OIL & GAS | | | PT. PERTAMINA EP | |

**TABEL REVISI**

| Rev. | Tanggal | Deskripsi |
|---|---|---|
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |

## COMMENT RESPONSE SHEET

| No. | Page | Company's Comment | Contractor's Response | Remarks |
|---|---|---|---|---|
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |
| | | | | |

## DAFTAR ISI

TABEL REVISI ..... 2
COMMENT RESPONSE SHEET ..... 3
DAFTAR ISI ..... 4
1. GENERAL ..... 5
1.1 Latar Belakang ..... 5
1.2 Tujuan ..... 7
1.3 Ruang Lingkup ..... 7
1.4 Istilah ..... 7
2. KODE, STANDAR, DAN REFERENSI ..... 8
3. Daftar Singkatan ..... 8
LAMPIRAN (MECHANICAL DATASHEET) ..... 10

# 1. GENERAL

## 1.1 Latar Belakang

Struktur Tanjung Miring Barat (TMB) terletak di Kabupaten Muara Enim dan Kota Prabumulih, sekitar 20 kilometer di sebelah tenggara Kota Prabumulih, dengan luas daerah sekitar 8 km². Struktur Karangan (KRG) terletak di Kabupaten Muara Enim dan Kota Prabumulih, sekitar 15 kilometer di sebelah selatan Kota Prabumulih, dengan luas daerah sekitar 45 km².

| ID | Easting (Meter) | Northing (Meter) | Elevation (Meter) | Feature Code |
|---|---|---|---|---|
| PN-1531 | 424962,745 | 967376,210 | 10,414 | |
| PM-8593 | 425000,093 | 907528,777 | 19,046 | |

**Gambar 1. Lokasi Rencana SP Tanjung Miring Barat - Karangan Timur**

Lapangan Tanjung Miring Barat telah diproduksi sejak tahun 1938 dan terus beroperasi hingga tahun 2003 dengan produksi terakhir dari sumur TMB-11. Sejak dinonaktifkannya lapangan ini, fasilitas produksi yang terdiri dari flowline, stasiun pengumpul, serta jalur pengiriman pipa minyak ke custody transfer (PPP Prabumulih) sudah tidak layak operasi. Apabila akan dilakukan pengembangan lapangan, diperlukan pembangunan fasilitas produksi baru yang dapat menampung produksi hidrokarbon dari lapangan Tanjung Miring Baral serta memprosesnya agar sesuai dengan spesifikasi yang dipersyaratkan di titik serah. Saat ini status SP TMB adalah idle atau tidak beroperasi, sehingga produksi sumuran menggunakan Tank On-Site (TOS) dan dikirim secara gross ke SP-II TMT menggunakan trucking. Dikarenakan tidak adanya line gas ke sumur-sumur struktur TMB, supply Listrik untuk pumping unit menggunakan solar (diesel engine). Lapangan Karangan Timur hanya diproduksikan dari 2 sumur yaitu KRG-9 dan KRG-10 beroperasi mulai tahun 1984, dimana kondisi eksisting jalur pengiriman minyak dari sumur menggunakan trucking. Apabila akan dilakukan

pengembangan lapangan, diperlukan pembangunan fasilitas produksi baru yang dapat menampung produksi hidrokarbon dari lapangan Tanjung Miring Barat serta memprosesnya agar sesuai dengan spesifikasi yang dipersyaratkan di titik serah.

Dalam rencana jangka panjang sebagai upaya peningkatan produksi, PT Pertamina EP berencana akan mengembangkan Lapangan Tanjung Miring Barat dan Karangan Timur melalui pengembangan fasilitas produksi dimana rencana kerja pengembangan fasilitas akan dibagi ke dalam dua fase.

Pada fase pertama, produksi dari pengembangan awal TMB -KRG Timur akan dikirimkan menuju fasilitas sewa Early Production Facility (EPF) untuk selanjutnya dikirimkan menuju SP-1 TLJ melalui trunkline baru. Pada fase ini lingkup fasilitas produksi yang akan dibangun adalah flow/ine dari sumuran, sewa EPF dan trunkline dari EPF sampai dengan SP-1 TLJ.

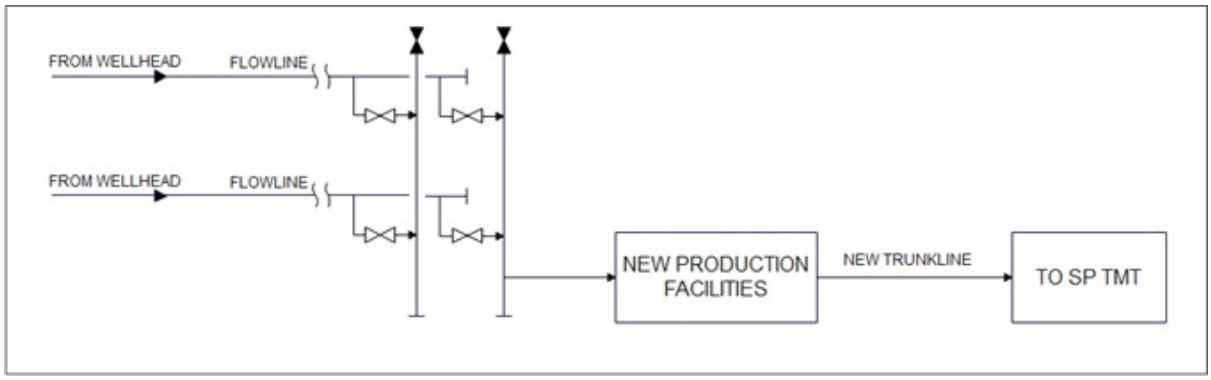


**Gambar 2. Rencana Pola Operasi Fase**

Pada fase kedua, akan dilakukan pengembangan tambahan dari sumur-sumur TMB-KRG Timur. Pada fase ini, lingkup fasilitas produksi yang akan dibangun meliputi pembangunan flowline dari sumuran pengembangan lanjutan serta peningkatan fasilitas SP TMB untuk menggantikan sewa EPF.

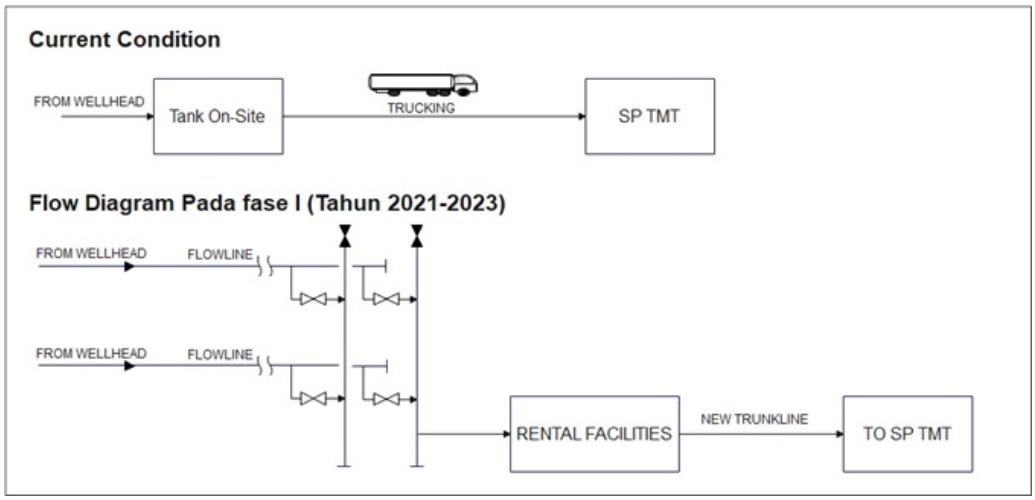


**Gambar 3. Rencana Pola Operasi Fase**

## 1.2 Tujuan

Dokumen ini menjelaskan dipersiapkan sebagai Mechanical Datasheet for Production Separator TMB (V-001) sebagai bagian dari desain yang harus diikuti oieh KONTRAKTOR dan VENDOR untuk proyek Pembangunan Fasilitas Stasiun Pengumpul Lapangan Tanjung Miring Barat- Karangan Timur, Field Prabumulih.

## 1.3 Ruang Lingkup

Mechanical Datasheet ini meliputi ketentuan minimal dalam mengatur desain. material,pabrikasi, pemeriksaan, pengujian, persiapan, pengecatan dan persiapan untuk pengiriman Production Separator TMB (V-001) untuk dipasang di proyek Pembangunan Fasilitas Stasiun Pengumpul Lapangan Tanjung Miring Barat — Karangan Timur, Field Prabumulih.

## 1.4 Istilah

Dokumen ini berisi istilah-istilah yang memiliki definisi tercantum sebagai berikut:

| | |
|---|---|
| Perusahaan | Perusahaan yang dimaksud adalah PT PERTAMINA HULU ROKAN selaku Pemilik dan Pengguna Fasilitas akhir. |
| Kontraktor | Pihak yang dipilih oleh PERUSAHAAN sebagai pelaksana pekerjaan pengadaan dan konstruksi yang akan bertanggung jawab kepada PERUSAHAAN. |
| Vendor | Pihak lain yang akan menyediakan sesuatu untuk kebutuhan proyek, selain yang disediakan oleh PERUSAHAAN dan KONTRAKTOR, disebut VENDOR. Tanggung jawabnya langsung kepada KONTRAKTOR baik terhadap PO maupun bentuk perjanjian lain antara VENDOR dan |

| | |
|---|---|
| | KONTRAKTOR. |
| SKK MIGAS | Suatu badan dari Pemerintah Indonesia yang bertanggung jawab terhadap proses persetujuan dan izin untuk semua fasilitas di lingkungan minyak dan gas. |
| Perencana | Pihak yang dipilih oleh PERUSAHAAN sebagai pelaksana pekerjaan Jasa FEED Engineering Services. Dalam hal ini disebut PERENCANA, yang akan bertanggung jawab kepada PERUSAHAAN sebagaimana dirinci dalam kontrak, scope of work, atau work order. |
| Inspektor | Perwakilan dari PERUSAHAAN dan/atau seseorang yang ditunjuk oleh PERUSAHAAN, yang bertanggung jawab sebagai INSPEKTOR atas pekerjaan yang dilakukan oleh KONTRAKTOR.SINGKATAN |

## 2. KODE, STANDAR, DAN REFERENSI

DOKUMEN PROYEK

1. TMBP-SP001-ME-DBS-D101 - Mechanical Design Basis
2. TMBP-SP001-PR-PID-D101 - PID Production Separator TMB (V-001) and Test Separator TMB (V-003)
3. TMBP-SP001-ME-SPE-D101 - Specification - Pressure Vessel (ASME)
4. TMBP-SP001-PR-DST-D101 - Process Data Sheet - Production Separator TMB V-001 and Production Separator KRG V-002
5. TMBP-02-PR-CAL-201 - Process Calculation - Production Separator TMB V-001

## 3. Daftar Singkatan

Beberapa singkatan yang paling umum digunakan tercantum dalam daftar berikut:

| | |
|---|---|
| **BOPD** | *Barrel Oil Per Day* |
| **BPD** | *Barrel Per Day* |
| **BWPD** | *Barrel Water Per Day* |
| **EOR** | *Enhanced Oil Recovery* |
| **FEED** | *Front End Engineering Design* |
| **KRG** | *Karangan* |
| **MMSCFD** | *Million Standard Cubic Feet per Day* |

| | |
|---|---|
| **NPS** | *Nominal Pipe Size* |
| **PB** | *Production Battery* |
| **PHR** | *Pertamina Hulu Rokan* |
| **PT** | *Perseroan Terbatas* |
| **SP** | *Stasiun Pengumpul* |
| **SCH** | *Schedule* |
| **TMB** | *Tanjung Miring Barat* |
| **TMT** | *Tanjung Miring Timur* |
| **WK** | *Wilayah Kerja* |

# MECHANICAL DATASHEET FOR PRODUCTION SEPARATOR TMB (V-001)

| Judul Proyek | Nomor Dokumen | Rev. | Date | Page |
|---|---|---|---|---|
| JASA PEMBANGUNAN FASILITAS PRODUKSI STASIUN PENGUMPUL (SP) TANJUNG MIRING BARAT & KARANGAN TIMUR | TMBP-SP001-ME-DST-D102 | A | 8-Jan-26 | 10 of 12 |

| | | | |
|---|---|---|---|
| Tag No. | : V-001 | Client | : PT. PERTAMINA EP |
| Service | : PRODUCTION SEPARATOR TMB | Plant Location | : SP TANJUNG MIRING |
| P & ID No. | : TMBP-SP001-PR-PID-D101 | No. of Unit | : 1 (ONE) |
| Eq. Layout No. | : TMBP-SP001-PI-PLP-D102 | | |

REVISION

| | | | |
|---|---|---|---|
| 1 | **OPERATING DATA** | | |
| 2 | Fluid Content | | **Hydrocarbon** |
| 3 | Special Service (Sour/Cyclic/Amine/Lethal) | | **-** |
| 4 | Operating Temperature (Min/Norm/Max) | °F | **113,60** |
| 5 | Operating Pressure (Min/Norm/Max) | psig | **44,95** |
| 6 | Liquid - Mass Flowrate | lb/hr | **12488** |
| 7 | - Density | $lb/ft^3$ | **60,30** |
| 8 | - Viscosity | cP | **1,43** |
| 9 | - Capacity | BPD | **885** |
| 10 | Gas - Mass Flowrate | lb/hr | **3720** |
| 11 | - Density | $lb/ft^3$ | **0,24** |
| 12 | - Viscocity | cP | **0,01** |
| 13 | - Capacity | mmscfd | **0,40** |
| 14 | | | |
| 15 | | | |
| 16 | | | |
| 17 | **DESIGN DATA** | | |
| 18 | Vessel Orientation | | **Horizontal** |
| 19 | Code & Standard | | **ASME Sec VIII Div 1 Latest Ed.** |
| 20 | ASME Stamp | | **Yes** |
| 21 | Regulation | | **MIGAS** |
| 22 | Design Pressure (Int./Ext.) | psig | **65,0** |
| 23 | Design Temperature | °F | **163,6** |
| 24 | Minimum Design Metal Temperature | °F | **-20** |
| 25 | Diameter (I.D.) | ft (mm) | **5,38 (1639,8)** |
| 26 | Length (TL / TL) | ft (mm) | **17,39 (5300,5)** |
| 27 | Corrosion Allowance | ft (mm) | **0,118 (3)** |
| 28 | Cladding / Lining | ft (mm) | **-** |
| 29 | | | |
| 30 | Joint Efficiency (Shell / Head) | | **1.0 / 1.0** |
| 31 | Head Design Type (Left / Right) | | **2:1 Ellipsoidal / 2:1 Ellipsoidal** |
| 32 | Thickness : | | |
| 33 | Shell Thickness (Nominal) - **(Note 4)** | in (mm) | **0,606 (15) (VTA)** |
| 34 | Head Thickness (Min. After Forming) - **(Note 4)** | in (mm) | **0,72 (18) (VTA)** |
| 35 | MAWP - **(Note 4)** | psig | **60,00** |
| 36 | | | |
| 37 | Hydrotest Pressure | psig | **78,00** |
| 38 | Support Type | | **Saddle** |
| 39 | Seismic Design | | |
| 40 | Standard Code | | **ASCE 7-16** |
| 41 | Risk Category | | **III** |
| 42 | Site Class | | **D** |
| 43 | Importance Factor ( Ie ) | | **1,50** |
| 44 | Spectral Resp. Acc. at Short Period (Ss) | (g) | **0,0422** |
| 45 | Spectral Resp. Acc. at 1 Sec Period (S1) | (g) | **0,0627** |
| 46 | Wind Design | | |
| 47 | Standard Code | | **ASCE 7-10** |
| 48 | Design Wind Speed | mph | **64,44** |
| 49 | Exposure ( E ) | | **C** |
| 50 | Importance Factor ( I ) | | **1.25** |
| 51 | Insulation | | **N/A** |
| 52 | Insulation Thickness | in | **N/A** |
| 53 | Fire Protection (by Others) | | **N/A** |
| 54 | External Painting | | **Yes, As per Spec [3]** |
| 55 | Internal Coating | | **Yes, As per Spec [3]** |

| | | | |
|---|---|---|---|
| 56 | **MOMENT AND SHEAR FORCE AT BASE (AT OPERATING CONDITION)** | | |
| 57 | | **MOMENT (lbf-ft)** | **SHEAR (lbf)** |
| 58 | WIND | **VTA** | **VTA** |
| 59 | SEISMIC | **VTA** | **VTA** |
| 60 | | | |

| | | |
|---|---|---|
| **CONSTRUCTION MATERIAL** | | |
| **PART** | | **MATERIAL SPECIFICATION** |
| Shell | | **SA-516 Gr. 70** |
| Head | | **SA-516 Gr. 70** |
| Nozzle Neck (Pipe / Plate) | | **SA-106 Gr.B / SA516 Gr .70** |
| Nozzle Flange / Forged Flange | | **SA-105** |
| Fitting | | **SA-234 WPB** |
| Support : | | |
| Saddle / Wear Plate | | **SA-36 / SA 516 Gr. 70** |
| Web & Rib | | **SA-36** |
| Base Plate | | **SA-36** |
| Internal Parts - Fixed | | **SS304** |
| - Removable | | **SA 240 Gr. 316L** |
| External Attachment (Weld to Shell/Head) | | **SA-106 Gr.B** |
| Bolts/Nuts - Internal | | **SA 193 Gr. B8 M / SA 194 Gr. B8 M** |
| - External | **Note 7** | **ASTM A193Gr. B7/ASTM A 194 Gr. 2H (HDG)** |
| Gaskets - Internal | | **N/A** |
| - External | **Note 8** | **GRAPHIT FILLER, SS304L SW W/ INNER OUTER RING** |
| Reinforcement Pad | | **SA 516 Gr. 70** |
| Stiffener Ring | | **SA 516 Gr. 70** |
| Lifting Lug / Tailing Lug | | **SA 516 Gr. 70 / SA 36** |
| Name Plate / Bracket | | **SA 240 TP316L/ SA 516 Gr.70** |
| Earthing Lug | | **SS316L** |
| Anchor Bolt (by others) | | **ASTM A193Gr. B7/ASTM A 194 Gr. 2H (HDG)** |
| | | |
| **CONSTRUCTION** | | |
| Platform & Ladder | | **YES** |
| Platform & Ladder Clip | | **YES** |
| Insulation Support Clip | | **NO** |
| Personnel Protection Clip | | **NO** |
| Fire Proofing Clip | | **NO** |
| Pipe Support Clip | | **NO** |
| Lifting Lug | | **YES** |
| Earthing Lug | | **YES, MIN. OF 2 (TWO)** |
| Manhole Davit | | **YES** |
| Internal Parts | | |
| - Vortex Breaker | | **YES** |
| - Extended Internal Pipe | | **NO** |
| - Ladder Rung | | **YES** |
| - Cathodic Protection | | **YES (SACRIFICIAL ANODE)** |
| | | |
| | | |
| **INSPECTON & TESTING (AS PER CODE & SPECS.)** | | |
| Non Destructive Test | | |
| Radiography | | **100%** |
| Ultrasonic | | **As per Code & Spec** |
| Magnetic Particle | | **As per Code & Spec** |
| Dye Penetrant | | **As per Code & Spec** |
| Positive Material Identification | | **As per Code & Spec** |
| Impact Test | | **As per Code & Spec** |
| Post Weld Heat Treatment (PWHT) | | **As per Code & Spec** |
| Certification | | **MIGAS** |
| PMI | | **Yes (for Alloy and Stainless Steel)** |
| Pneumatic Test for Reinforcement Pad | | **Note 9** |
| Hydrotest | | **As per Code & Spec** |
| **ESTIMATED WEIGHTS (Note 4)** | | |
| FABRICATION | lb | **11850 (VTA)** |
| EMPTY | lb | **11850 (VTA)** |
| OPERATING | lb | **37692 (VTA)** |
| TESTING | lb | **39630 (VTA)** |

| | | |
|---|---|---|
| 61 | **REFERENCE - PROJECT DOCUMENTS** | |
| 62 | [1] TMBP-SP001-PR-PID-D101 | P&ID PRODUCTION SEPARATOR TMB (V-001) & TEST SEPARATOR KRG (V-004) |
| 63 | [2] TMBP-SP001-ME-SPE-D101 | SPECIFICATION FOR PRESSURE VESSEL (ASME) |
| 64 | [3] TMBP-SP001-PI-SPE-D503 | PIPING PAINTING & LETTERING SPECIFICATION |
| 65 | [4] TMBP-SP001-ME-DBS-D101 | MECHANICAL DESIGN BASIS |
| 66 | [5] TMBP-SP001-CS-DBS-D101 | CIVIL, STRUCTURE AND BUILDING DESIGN BASIS |
| 67 | [6] TMBP-SP001-PI-SPE-D501 | PIPING MATERIAL SPECIFICATION |
| 68 | [7] TMBP-SP001-IN-DBS-D101 | INSTRUMENT AND CONTROL SYSTEM DESIGN BASIS |
| 69 | [8] PEP-10-D0-SP-0001 | SPECIFICATION FOR PRESSURE VESSEL DESIGN & FABRICATION |
| 70 | [9] PEP-10-D9-SP-0001 | SPECIFICATION FOR VESSEL INTERNAL |
| 71 | | |
| 72 | | |
| 73 | | |
| 74 | | |
| 75 | | |
| 76 | | |
| 77 | | |
| 78 | | |

Any controlled copies may be superseded. Refer to COMPANY Server for controlled version.

REVISION

## NOZZLE SCHEDULE (Note 14)

| Mark | Qty | Size (NPS) | Rating (Note 18) | Flange Type | SCH / Thk | Nozzle Proj. (in / mm) | Service | Remarks |
|---|---|---|---|---|---|---|---|---|
| N1 | 1 | 3 | 150# | WNRF | 80 | 8 / 200 | Level Transmitter | |
| N2 | 1 | 2 | 150# | WNRF | 80 | 8 / 200 | Level Transmitter | |
| N3 | 1 | 2 | 150# | WNRF | 80 | 8 / 200 | Temperature Transmitter | |
| N4 | 1 | 2 | 150# | WNRF | 80 | 8 / 200 | Level Indicator / Transmitter | |
| N5 | 1 | 2 | 150# | WNRF | 80 | 8 / 200 | Drain | |
| N6 | 1 | 2 | 150# | WNRF | 80 | 8 / 200 | Drain | |
| N7 | 1 | 2 | 150# | WNRF | 80 | 8 / 200 | Level Indicator / Transmitter | |
| N8 | 1 | 12 | 150# | WNRF | 80 | 8 / 200 | Feed Inlet | C/W Inlet Diverter |
| N9 | 1 | 4 | 150# | WNRF | 80 | 8 / 200 | PSV | |
| N10 | 1 | 4 | 150# | WNRF | 80 | 8 / 200 | Spare Nozzle | C/W Valve & Blind Flange |
| N11 | 1 | 2 | 150# | WNRF | 80 | 8 / 200 | Spare Nozzle | C/W Valve & Blind Flange |
| N12 | 1 | 2 | 150# | WNRF | 80 | 8 / 200 | Pressure Transmitter | |
| N13 | 1 | 4 | 150# | WNRF | 80 | 8 / 200 | Pressure Indicator | |
| N14 | 1 | 2 | 150# | WNRF | 80 | 8 / 200 | Pressure Transmitter | |
| N15 | 1 | 3 | 150# | WNRF | 80 | 8 / 200 | Liquid Outlet | C/W Vortex Breaker |
| N16 | 1 | 2 | 150# | WNRF | 80 | 8 / 200 | Vapor Outlet | C/W Mist Extractor |
| N17 | 1 | 2 | 150# | WNRF | 80 | 8 / 200 | Spare Nozzle | |
| M2 | 1 | 24 | 150# | WNRF | 13 mm | 10 / 250 | Manhole | |

## EQUIPMENT SKETCH (Note 10)

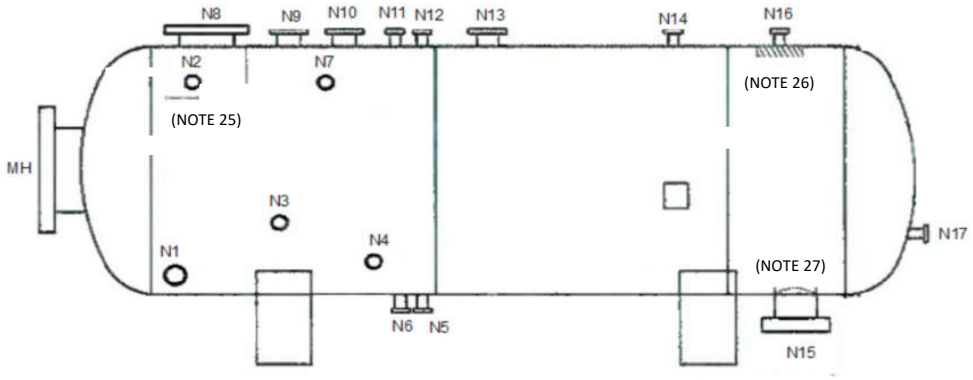


| LIQUID LEVEL | | |
|---|---|---|
| VESSEL (from Bottom Inner Surface) | | |
| HLSD | in | 30 |
| HLL | in | 24 |
| NLL | in | 18 |
| LLL | in | 12 |
| LLSD | in | 6 |

REVISION

## NOTES

1. All dimensions are in inch, unless otherwise noted.
2. This datasheet shall be read together with P&ID No.: TMBP-SP001-PR-PID-D101 and Specification for Pressure Vessel (ASME) : TMBP-SP001-ME-SPE-D101
3. The design life of equipment shall be minimum 20 years
4. All thickness shown in this mechanical data sheet shall be cosidered as a minimum after forming and rolling/machining. Thickness, weight, MAWP/MAP, test pressure and loads are indicated for estimation purpose only. Vessel Vendor shall be responsible for the full mechanical design and shall confirm all material chosen, thickness, weight, volume and loading.
5. MIGAS certificate is required. VENDOR is responsible to provide all required assistance and documentation to obtain MIGAS approval and certificate.
6. Certification shall include material certificate as per EN.10204 3.1 for pressure retaining parts and EN.10204 2.2 for non pressure parts.
7. External Bolts and Nuts shall be HDG coated, minimum thickness 35 micron.
8. Gasket shall be 0.175" thick, spiral wound, 304L SS Windings, Flexible graphite filler SS304L inner & outer ring, ASME B16.20
9. All reinforcing pads shall be pneumatically tested at gauge pressure of 25 psi.
10. Nozzle locations are indicative only. Vendor shall indicate the nozzle location for details.
11. All flange bolt hole shall be straddle to center line.
12. Flanges shall be in accordance with ASME B16.5 latest edition.
13. Gasket used in hydrostatic test should be replaced after testing.
14. VENDOR to calculate/specify thickness, nozzle reinforcement, lifting lugs, support, etc. including external nozzles locallized stress analysis as per WRC 107/537 & 297 Bulletin.
15. External Coating and Painting shall in accordance with TMBP-SP001-PI-SPE-D503, Specification for Piping Painting & Lettering
16. All external nozzles locallized stress analysis to be performed by VENDOR as per WRC 537 Bulletin. Nozzle flange ratings are based on process design condition only. Vendor shall accordingly increase the flange (if required), as per Code requirement, considering the minimum external loads requested by the project specifications.
17. Except for Instrument, utility, open drain & vent nozzle, All Nozzle shall be designed to withstand the Moment and Force in accordance with ANNEX VIII on PEP-10-D0-SP-0001. VENDOR shall make calculations in accordance with WRC 107/WRC 297 procedure. MAWP shall not be limited on the nozzle neck, reinforcement pad, and Flange.
18. VENDOR shall responsible to verify the Flange Rating required for the nozzle after reduced by equivalent pressure from moment and force in ANNEX VIII on PEP-10-D0-SP-0001, in accordance with ASME Interpretation BPV VIII-1-16-85. VENDOR shall inform during bidding stage whether it is required to increase the flange rating. If there is a change in the flange rating after the Purchase Order, it is the responsibility of the VENDOR and there shall be no change order to the CONTRACTOR/COMPANY.
19. Where blind flanges are specified, they shall be completed with bolts/nuts, gaskets and spares :
    - Gasket : 200% spares each size and type for blind flange nozzle and manhole
    - Bolt and Nuts : 10% spare or min 2 set (each set consist 2 nut and 1 bolt) whichever is higher for each blinded flange nozzle
20. The lifting lugs / trunnions and the attachment points to the pressure vessel shall be designed to a minimum load factors equal to 2.0 x lifted weight and shall be attached by full penetration welds.
21. VENDOR to submit ASME Code calculations, lifting calculation, transportation calculation and saddle design calculations for approval
22. VENDOR shall consider all loading data (including wind and seismic moment) for saddle support design.
23. VTA : Vendor to Advice , TBC = To be confirmed
24. Internal Painting & CP (Cathodic Protection) is required due to stagnant fluid condition (fluid carryover process fluid, condensing etc.).
25. Inlet nozzle completed with inlet diverter
26. Gas outlet nozzle completed with Vane Pack Mist Extractor
27. Liquid outlet nozzle completed with vortex breaker