SenNet IoT Easy Meter Sigfox

Energy Meter 3PH CT/Rogowski

8

Gateway for remote nodes

General description

SenNet IoT Easy Meter Sigfox is a device that monitors 3PH energy electrical circuits, with two options of current transformer, 0.33Vac or flexible Rogowski. This device has the possibility to create a local RF Network with remote nodes with different features: Pulse Counter / Temperature-Humidity / CO2 / Particulate Matter etc.., and send all this information in one Sigfox message.

The configuration of all these features is possible by three ways:


- Trough APP SenNet IoT (IOS or Android).
- Downlink message on sigfox backend.
- Micro-usb connection and console/terminal.

The end-user can select what kind of energy data and remote device wants to upload to the cloud, must select the type of message (see in the next section).

Power supply

The device uses voltage reference as the power supply (100-265VAC @ 50HZ), <u>it's important just to use Neutral</u> Line Vn and V1. There is an internal fuse to protect the device against surge damages.

Voltage power supply	100-265VAC @ 50HZ
Power	<1W

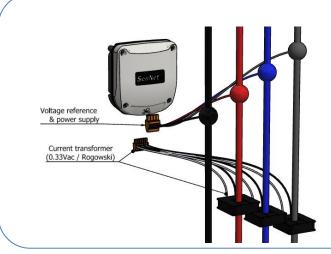

Basic steps to intall:

- Set the type Current Transformer: CT-0.33Vac: 50A, 100A, 150A, 400A, 800A Flexible-Rogowski: 3500A, 3700A, 5000A
- 2. Set the type of message to use and take note to parse this data on your preferred platform.
- 3. Take note ID / PAC to sign the device on Sigfox Cloud.
- Connect voltage reference (feed internal power supply) and current reference.

Additional steps:

- Define and install remotes devices that will join to Local Network
- Set an univoque ID at each remote device throught SenNet IoT APP.

Easy to set with **SenNet IoT** APP iOS & Android (phones with NFC)








SenNet IoT (Android version) Link

SenNet ion











Power Meter 3 Phase Class 1 (CT's 0.33v -Rogowski)



Local RF Network

868.224MHz (EU) 2FSK / 300bps / 6.25Khz (by default)






Type Message

SenNet IoT Easy Meter is a powerful Energy Meter, the client must select what kind of data will be uploaded to the platform. For that reason, the devices have been defined by default several types of message what includes the main information from each electricity measurement.

The main interest always is the total Energy accumulated, if your interest is on another parameter you can contact with our technical department to ask for it.

Depending on the type of load to be monitored (triphasic or monofasic) you may choose these types of uplink messages:

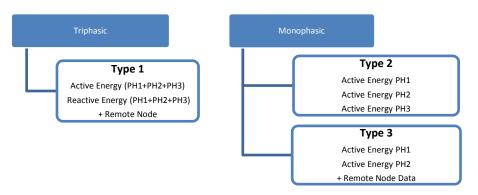

A common point in all types of messages is the head (defined with <u>2 bytes</u>) that includes important information embedded in the message (type device/type message/errors.. etc). In the next table are defined the mean of these info-fields.

								Fie	Field Info								
Byte				Byte	1				Byte 2								
	Туре	Master I	Device	Type Message		Type Message				Туре	Remote	Nodes	ID R	ID Remote Nodes			
					type 0 (info)		generation e	error	- i								
	01 - E	asy Mete	er	type 1		type 1			SAG / error	0x00 – No local Network			No Rei	No Remote = 000			
	02 – F	ulse Cou	nter		type 2		type 2		in gel	secnence	Overvoltage / S	0x01 - PC LongNet			Remot	e ID = 00	1 _b = 01 _d
	03 – 1	H (Temp	/Hum)		type 3		se in g mode		Tag Lag	0x02 - TH LongNet				= 010 _b = 0			
	04 - C	O2-TH			type 4		Phase	ge s	Overvoltage Internal met	0x03 -	CO2 Long	Net		$= 011_b = 03_d$			
	05 - P	M		typ	e 5 (no	ot defi	ned)	Some	Voltage	ng &	0x04 -	PM LongN	Net		= 10	$0_b = 04_d$	
	06 – 0	W Modb	ous	typ	e 6 (no	ot defi	ned)	S	>		0x05 – GW Modbus LN				= 10	1 _b = 05 _d	
	07 – 1	Not defin	ed						0x06 – Analog Input			= 110 _b = 06 _d					
				type	type 15 (not defined)		Feed	lback Er	ror	0x07 -	Not defin	ied	(6 nd	des maxi	imum)		
Bit	7	6	5	4	4 3 2 1		0	7	6	5	4	3	2	1	0		
		Byte1			Ву	te1		Byte1	Ву	te2		Byte2			Byte2		
		Bit 7-6-5	5		Bit 4	-3-2-1		Bit 0	Bit	7-6		Bit 5-4-3			Bit 2-1-0		

Table 1

	Type 1 : Active + Reactive Energy + Remote Node													
Field	In	Info		Active Energy				activ	e En	ergy	Data from Remote node			
rieiu	""	10	PH1+PH2+PH3 PH1+PH2+PH3			Data from Remote node								
Type data	See To	ahlo 1	Float 32 bits				F	Float 32 bits			Depending on Remote node type			
Type data	366 7	IDIC I		unit	kWh	1		unit kvArh		h	Depending on K	emote node type		
Byte	1	2	3	4	5	6	7 8 9 10		7 8 9 10		11	12		

		Туре	2: Active	Energy P	H1 + Activ	e Energy	PH2 + Act	ive Energy	/ PH3			
Field	In	fo	Acti	ve Energy	PH1	Activ	ve Energy	PH2	Active Energy PH3			
Type data	Se Tab			resolution=100wh Max. 1.6Mwh			lution=10 ax. 1.6Mv		resolution=100wh Max. 1.6Mwh			
Byte	1	2	3 4 5			6	7	8	9	10	11	

	Type 3: Active Energy PH1 + Active Energy PH2 + Remote Node Data												
Field	In	fo	Ac	tive En	ergy P	H1	Α	ctive E	nergy	PH2	Data from Remote Node		
Type data		ee le 1	Float 32 hits				Float	32 bit	s	Depending on Remote node type			
Byte	1	2	3	4	5	6	7	8	9	10 11 12		12	




Local RF Network & types of Remotes Nodes

SenNet IoT Easy Meter can works like sigfox gateway for up to 6 remotes nodes.

Remote Node Data:

Remote Noue Data.																
Type of Remote Node																
			1 by	te tei	mpe	ratur	e Pay	/load			1 byte humidity Payload					oad
TH LongNet – 868		[-1	0ºC	.60ºC	[] cc	nver	sion	funct	ion		[0-100%]					
	Temperature=Payload*0.2745-10									Hur	nidity	y=Pa	yloa	b		
Pulsa Countar LangNat - 969	2 bytes (integer type) - maximum value 65535															
Pulse Counter LongNet – 868	Only is enabled input 1 "C1"															
	2 bytes (integer type)															
	byte 2 -High part-						byte 1 -Low part-									
CO2 LongNet - 868	7	6	5	4	3	2	1	0	7	6	5	4	3	2	1	0
			CO2 P (± 12	ayloa ppm)				Tempe		ıre Pa LºC)	yload	I	F		n. Payload (± 6%)	
	CO2=Payload*12.6984+400 T=Payload*1.111-10 H= Payload*6.0						5.66									
Particulate Matter - 868	2 bytes (integer type) - under development															
Gateway Modbus – 868	2 bytes (custom) – under development															
Gateway Custom Protocol – 868	2 bytes (custom) - <i>under development</i>															

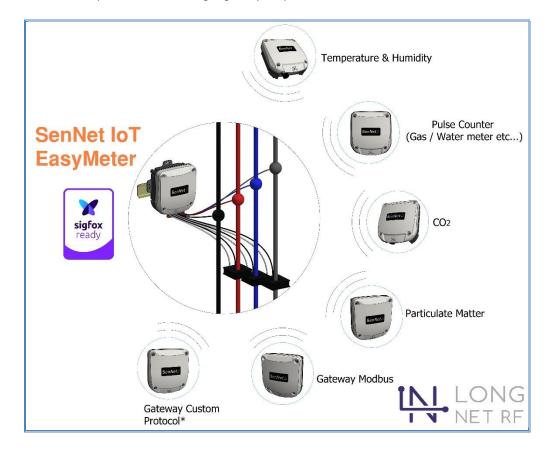



Debug option

It's possible debug on remote this device to enable with downlink message this feature. There are tree types of debug message, Debug 1 (version HW/FW), Debug 2 (internals errors), Debug 3 (instant power meter values). If this feature is enabled one time per day will be update these messages, with this secuence:



	Type 0 : Debug 1 (9 bytes)											
Field	Ir	Info HW device Version FW Revision FW Not used										
Type data	See Table 1					-						
Byte	1 2		1 2		3	4	5	6-9				

					Туре	0 : Deb	ug 2 (11 l	oytes)																	
Field	Inf	fo	Reset event	Internal error	Wrong voltage frequency	Error PH1	Error PH2	Error PH3	Voltage event 1		Voltage event 2		Gen.												
									Bit0	SAG- PH1	Bit0	PH1<50v													
									Bit1	SAG- PH2	Bit1	PH2<50v													
								Bit2	SAG- PH3	Bit2	PH3<50v														
Type data			-	-	Freq =!50Hz	-	-	-	Bit3 OVER- PH1		Bit3	Voltage secuence	-												
aaca																					Bit4	OVER- PH2	Bit4	-	
											Bit5	OVER- PH3	Bit5	-											
								Bit6	-	Bit6	-														
									Bit7	-	Bit7	-													
Byte	1	2	3	4	5	6	7	8		9 10		11													

For normal function all fields must be 0.

	Type 0 : Debug 3 (8 bytes)										
Field	Ir	nfo	Active Power PH3								
Type data	See Ta	ble 1	Signed int (Value*100)Watt	Signed int (Value*100)Watt	Signed int (Value*100)Watt						
Byte	1	2	3 - 4	5 - 6	7 - 8						

With this last one debug message is possible detect wrong installation issues, for example CT with wrong orientation. Use this extra feature to analisys or debug installation.

Downlink Message

It's possible to set the device in the cloud without interacting with it locally, defining this type of downlink message and CT value on the sigfox backend or in your platform. That method is optional but it's not necessary.


Byte		1	2 - 5	6	7	8
Field		Easy Meter Setup byte (1byte)	Set time (4bytes)	Type uplink Message (1 byte)	(2 b	alue yte) value)
	Bit 7	1 (by default)				
	Bit 6	1/0 enable/disable set Time				
	Bit 5	1/0 enable/disable set Type uplink Messsage		01		
Value	Bit 4	1/0 enable/disable set value CT	{Time-Epox}	02	High	Low
value	Bit 3	1 (by default)	(Time-Epox)	03	Part	Part
	Bit 2	1/0 enable/disable Debug 1 (versión HW/FW)				
	Bit 1	1/0 enable/disable Debug 2 (internals errors)				
	Bit 0	1/0 enable/disable Debug 3 (instant power value)				

Example for downlink message:

F8 {time} 01 00 32 → With this downlink message set the remote device on time, with type of message 01 and CT value 50 Amps, all debug messages disables.

SenNet Easy Meter Sigfox



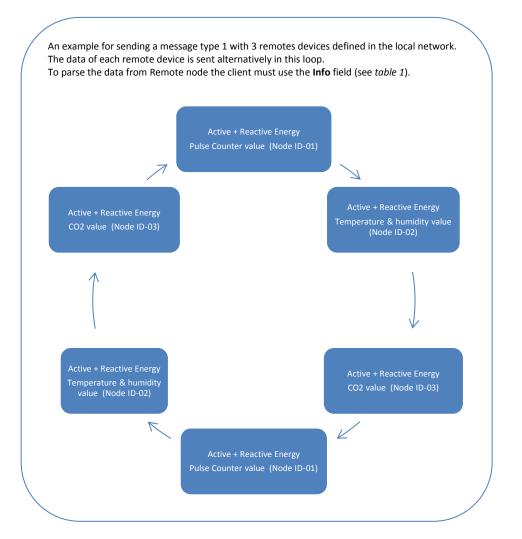





Set ID of each remote device, taking note of LongNet ID on the label and assigning it through APP phone (Android or iOS version).

For previous example, it's defined <u>Number of remotes=3</u>, and assigned each position (ID-01 / ID-02 / ID-03) at LongNet ID from label of each device, in this particulate example:

Sent	Net IoT
Back Basic Sets	Help
CT Value	50
type uplink Message	1
Advances Sets	
Interval to send(min.)	11 🗸
Number of Remotes	3
ID Modbus	1
ID-01 5236	ID-02 1529
ID-03 8552	
Save on D	Device


Steps for install Easy Meter with remotes nodes, first must be installed Easy Meter and power supply. Later install one by one each remote device, to analyzed if link coverage is fine, set each remote device on 'RF_prog' mode '1', sliding the switch to mini-usb connector side.

Remote device enter in beacon send mode each 5 seconds, if Easy Meter receive this beacon sound 5 beeps on Easy Meter side. After check that coverage is enough return switch of remote device to `RF_prog' mode 0, and reset it.

By this way you check that link between remote device and Easy Meter works fine.

SenNet IoT APP - Android and iOS (only phones with NFC feature)


Use APP of freely download to set and read measurement from Easy Meter.

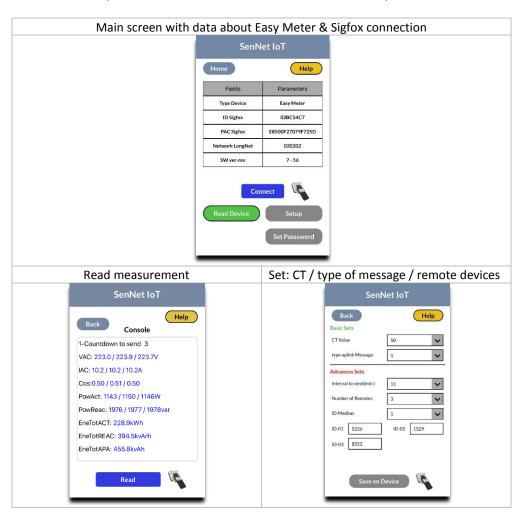





Power Meter features

These devices include advanced technology for metering power electricity loads, using a current reference and voltage reference. It's possible to use this device like a 3 single-phase meter or 1 three-phase meter, it depends on the client's goal to monitor.

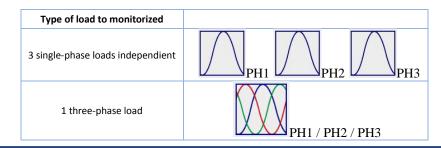

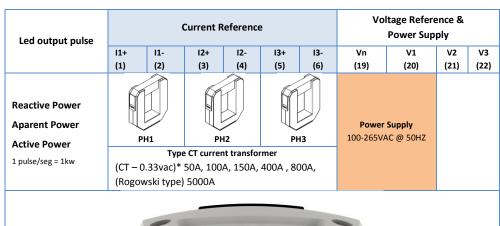









Voltage reference

Range	110-220/240VAC (CAT III – 400V)
Frequency	50-60Hz
Electrical isolation	2.5Kv @ 60second
Power supply requirement	0.1 VA per phase
Accuracy	Class 0.2 (+/-0.2%)
4	Recommend using electrical protection before connecting this reference.

Current reference

This device can use current transformers (CT) of two types 0.33Vac and flexible type (Rogowski), depending on each type has a different type of accuracy.

Types	Range of measureament	Output type	Accuracy
	measureament	type	
CT 50 A	150 A	0.33VAC	+/-1% (5%100% In)
CT 100 A	1100 A	0.33VAC	+/-1% (5%100% In)
CT 150 A	1150 A	0.33VAC	+/-1% (5%100% In)
CT 400 A	1400 A	0.33VAC	+/-1% (5%100% ln)
CT 800 A	1800 A	0.33VAC	+/-1% (5%100% ln)
Flexible 5000 A (7cm Ø) (*)	105000 A	Rogowski	+/-1% (centered)
Flexible 5000 A (12cm Ø) (*)	105000 A	Rogowski	+/-1% (centered)
Flexible 5000 A (20cm Ø) (*)	105000 A	Rogowski	+/-1% (centered)

(*)Must use flexible SenNet Rogowski model to certificate Class 1. (Factory Calibrated)

Accuracy on current measurement
Form Motor I Comblet CT 0 221/00

Easy Meter + SenNet CT 0.33Vac	Class 1	(Class 0.5 under requeriment)
Easy Meter + Flexible SenNet Rogowski	Class 1	Factory Calibrated


Electric	al iso	lation

Licotifical isolation	
SenNet CT 0.33Vac	2.5KV / 0.5mA / 3second
Flexible SenNet Rogowski	600V CAT IV



Holding case

IP Grade	IP-60
Temperature details	
Working temperature	-20ºC+70ºC
Store temperature	-20ºC+75ºC
Holding	
Dimensions	119 x 111 x 53 mm
Type mount	Wall or din rail
Plastic Material	ABS – V0

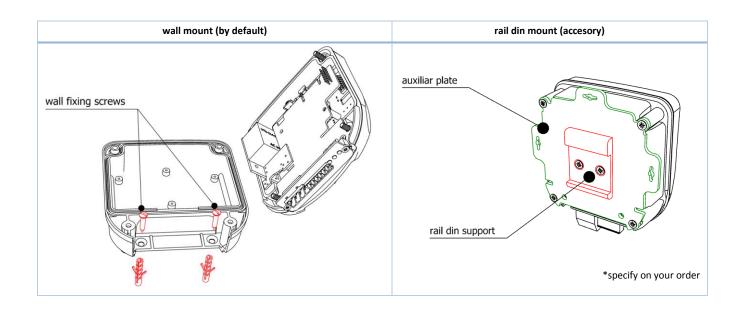



Warranty

Satel Spain guarantees its products against all manufacturing defects for a period of 1 year.

No return of material will be accepted, nor will any equipment be repaired if it is not accompanied by a report (RMA) indicating the defect observed or the reasons for the return.

The warranty will be void if the equipment has suffered "misuse" or the storage, installation or maintenance instructions in this manual have not been followed. "Misuse" is defined as any use or storage situation contrary to the National Electrical Code or that exceeds the limits indicated in this manual.



Satel Spain declines all responsibility for possible damage to the equipment or to other parts of the installations and will not cover possible penalties derived from a possible breakdown, poor installation or "misuse" of the equipment. Consequently, the guarantee is not applicable to breakdowns produced in the following cases.

- Due to overvoltage and/or electrical disturbances in the supply.
- By water, if the product does not have the appropriate IP rating.
- For exposing the equipment to extreme temperatures, which exceed the operating or storage temperature limit.
- Due to a modification of the product by the client without prior notice to Satel Spain.

Faced with possible errors in this technical sheet, keep it updated in our website.