# **SenNet IoT Easy Meter**

Energy Meter 3PH CT/Rogowski

&

Gateway for remote nodes

# **General description**

SenNet IoT Easy Meter is a device that monitors 3PH energy electrical circuits, with two options of current transformer, 0.33Vac or flexible Rogowski. This device has the possibility to create a local RF Network with remote nodes with different features: Pulse Counter / Temperature-Humidity / CO2 / Particulate Matter etc.., and send all this information in one Sigfox message.

The configuration of all these features is possible by three ways:


- Trough APP SenNet IoT (IOS or Android).
- Downlink message on sigfox backend.
- Micro-usb connection and console/terminal.

The end-user can select what kind of energy data and remote device wants to upload to the cloud, must select the type of message (see in the next section).

# **Power supply**

The device uses voltage reference as the power supply (100-265VAC @ 50HZ), <u>it's important just to use Neutral</u> Line Vn and V1. There is an internal fuse to protect the device against surge damages.

Voltage power supply	100-265VAC @ 50HZ
Power	<1W

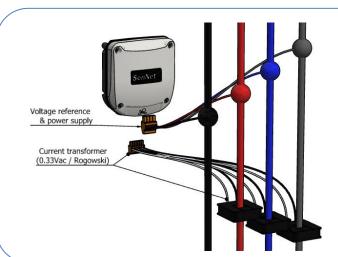

# Basic steps to intall:

- Set the type Current Transformer: CT-0.33Vac: 50A, 100A, 150A, 400A, 800A Flexible-Rogowski: 3500A, 3700A, 5000A
- Set the type of message to use and take note to parse this data on your preferred platform.

Easy to set with **SenNet IoT** APP iOS & Android (phones with NFC)

SenNet IoT (iOS version) Link

VAC: 220.4 / 220.5 / 220.5V

EneTotREAC: 1813.5kvArh EneTotAPA: 2088.1kvAh

- 3. Take note ID / PAC to sign the device on Sigfox Cloud.
- Connect voltage reference (feed internal power supply) and current reference.

### Additional steps:

- Define and install remotes devices that will join to Local Network
- Set an univoque ID at each remote device

# **SenNet** ion











Power Meter 3 Phase Class 1 (CT's 0.33v -Rogowski)







Local RF Network
Remotes Nodes






# **Type Message**

SenNet IoT Easy Meter is a powerful Energy Meter, the client must select what kind of data will be uploaded to the platform. For that reason, the devices have been defined by default several types of message what includes the main information from each electricity measurement.

The main interest always is the total Energy accumulated, if your interest is on another parameter you can contact with our technical department to ask for it.

Depending on the type of load to be monitored (triphasic or monofasic) you may choose these types of uplink messages:

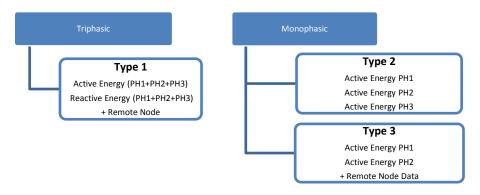

A common point in all types of messages is the head (defined with <u>2 bytes</u>) that includes important information embedded in the message (type device/type message/errors.. etc). In the next table are defined the mean of these info-fields.

								Fie	ld <b>Info</b>								
Byte		Byte 1								Byte 2							
	Туре	Type Master Device Type Message type 0 (info)						_			Туре	Remote I	Nodes	ID R	emote No	des	
					type 0	(info)		ţi	error	<u>~</u> ъ							
	01 - Easy Meter type 1					ner		SAG /	0x00 -	No local N	letwork	No Rer	note = 000	0			
	02 - PC LongNet type 2					ge a	enc	_ =	0x01 -	PC LongNe	et	Remot	e ID = 001	<sub>b</sub> = 01 <sub>d</sub>			
	03 - TH LongNet type 3				se in g mode	secnence	Tag I me	0x02 -	TH LongNo	et		= 010	$_{\rm b} = 02_{\rm d}$				
	04 - CO2 LongNet type 4			Phase in generation mode	ge	Overvoltage / !	0x03 -	CO2 Longl	Net		= 011	$_{\rm b} = 03_{\rm d}$					
	05 - P	M LongN	let	typ	e 5 (no	t defin	ned)	Some	Voltage	F &	0x04 -	PM LongN	let		= 100	$_{b} = 04_{d}$	
	06 – 6	W Mod	bus LN	typ	e 6 (no	t defin	ned)	Š	>		0x05 -	GW Mod	ous LN		= 101	$_{\rm b} = 05_{\rm d}$	
	07 – N	lot defin	ed								0x06 – Analog Input			= 110 <sub>b</sub> = 06 <sub>d</sub>		$_{\rm b} = 06_{\rm d}$	
				type	15 (no	ot defi	ned)	Feed	dback En	ror	0x07 -	Not defin	ed	(6 no	des maxir	num)	
Bit	7	6	5	4 3 2 1		0	7	6	5	4	3	2	1	0			
		Byte1			Byt	te1		Byte1	Ву	te2		Byte2			Byte2		
	Bit 7-6-5			Bit 4-3-2-1			Bit 0	Bit	7-6		Bit 5-4-3		Bit 2-1-0				

Table 1

	<b>Type 1</b> : Active + Reactive Energy + Remote Node													
Field	Info Active Energy Reactive Energy Data from Remote node PH1+PH2+PH3 PH1+PH2+PH3										emote node			
Type data	See To	able 1		oat 3 unit		-	-		32 b kvAr		Depending on Remote node type			
Byte	1	2	3	4	5	6	7	8	9	10	11 12			

	Type 2: Active Energy PH1 + Active Energy PH2 + Active Energy PH3												
Field	In	fo	Acti	ve Energy	PH1	Activ	ve Energy	PH2	Active Energy PH3				
Type data	Se Tab	-		lution=10 ax. 1.6Mv			lution=10 ax. 1.6Mv		resolution=100wh Max. 1.6Mwh				
Byte	1	2	3	4	5	6	7	8	9	10	11		

			Тур	<b>e 3</b> : A	ctive E	nergy I	PH1 + /	Active	Energy	/ PH2 + R	emote Node Data		
Field	Field Info Active Energy PH1 Active Energy PH2 Data from Remote Node												
Type data	Se Tab	ee le 1		Float	32 bits			Float	32 bit	s	Depending on R	emote node type	
Byte	1	2	3	4	5	6	6 7 8 9 10 11 12						



### Remote Node Data:

Remote Node Data.																
Type of Remote Node																
			1 by	te te	mpei	atur	e Pa	yload			11	oyte	hum	idity	Payl	oad
TH LongNet – 868	[-10ºC60ºC] conversion function												[0-1	00%	]	
	Temperature=Payload*0.2745-10										Hun	nidity	/=Pa	yload	b	
Pulse Counter LongNet – 868				2 by	tes (	integ	er ty	ype) -	max	dimu	m va	lue 6	5535	5		
Pulse Counter LongiNet - 808	Only is enabled input 1 "C1"															
	2 bytes (integer type									r typ	ne)					
	byte 2 -High part-										byte	e 1 -l	ow	oart-		
CO2 LongNet - 868	7	6	5	4	3	2	1	0	7	6	5	4	3	2	1	0
3		(	CO2 P					Temp			yload		Hum. Payload			ad
			(± 12	ppm)					(± 1	.ºC)				(±	6%)	
	СО	2=Pa	yload	*12.6	984+	400		T=Pa	yload	*1.11	1-10		H=	Payle	oad*(	5.66
Particulate Matter - 868	2 bytes (integer type) - under development															
Gateway Modbus – 868	2 bytes (custom) – under development															
Gateway Custom Protocol – 868	2 k	ytes	(cus	tom)	- un	der d	leve	lopm	ent							

### **Downlink Message**

It's possible to set the device in the cloud without interacting with it locally, defining this type of downlink message and CT value on the sigfox backend or in your platform. That method is optional but it's not necessary.


Byte		1	2 - 5	6	7	8
Field		Easy Meter Setup byte (1byte)	Set time (4bytes)	Type uplink Message (1 byte)	(2 b) (hex. v	yte)
	Bit 7	1 (by default)				
	Bit 6	1/0 enable/disable set Time				
	Bit 5	1/0 enable/disable set Type uplink Messsage		01		
Value	Bit 4	1/0 enable/disable set value CT	{Time-Epox}	02	High	Low
value	Bit 3	1 (by default)	{IIIIIe-Lpox}	03	Part	Part
	Bit 2	1/0 enable/disable Debug 1 (versión HW/FW)				
	Bit 1	1/0 enable/disable Debug 2 (internals errors)				
	Bit 0	1/0 enable/disable Debug 3 (instant power value)				

# Example for downlink message:

**F8 {time} 01 00 32** → With this downlink message set the remote device on time, with type of message 01 and CT value 50 Amps.

# Local RF Network & types of Remotes Nodes

SenNet IoT Easy Meter can works like sigfox gateway for up to 6 remotes nodes.

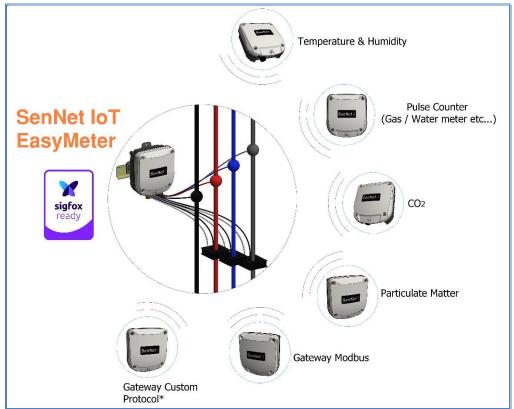



An example for sending a message type 1 with 3 remotes devices defined in the local network. The data of each remote device is sent alternatively in this loop. To parse the data from Remote node the client must use the **Info** field (see *table 1*). Pulse Counter value (Node ID=1) Temperature & humidity value CO2 value (Node ID=3) (Node ID=2) CO2 value (Node ID=3) value (Node ID=2)





# **Power Meter features**

These devices include advanced technology for metering power electricity loads, using a current reference and voltage reference. It's possible to use this device like a 3 single-phase meter or 1 three-phase meter, it depends on the client's goal to monitor.

Type of load to monitorized	
3 single-phase loads independient	PH1 PH2 PH3
1 three-phase load	PH1 / PH2 / PH3

Led output pulse		Current F	Referenc	e		Vo	ltage Refer Power Sup						
	11+	12+ (3)	12- (4)	13+ (5)	13- (6)	Vn (19)	V1 (20)	V2 (21)	V3 (22)				
Reactive Power  Aparent Power	PH1	P	H3	Power Supply 100-265VAC @ 50HZ									
Active Power 1 pulse/seg = 1kw	Type CT current transformer						100 203 VAC @ 30112						
	ENERGY CURRENT REF. VOLTAG REF. &												



# Voltage reference

Range	110-220/240VAC (CAT III – 400V)
Frequency	50-60Hz
Electrical isolation	2.5Kv @ 60second
Power supply requirement	0.1 VA per phase
Accuracy	Class 0.2 (+/-0.2%)
4	Recommend using electrical protection before connecting this reference.

# **Current reference**

This device can use current transformers (CT) of two types 0.33Vac and flexible type (Rogowski), depending on each type has a different type of accuracy.

Types	Range of measureament	Output type	Accuracy
	measureament	type	
CT 50 A	150 A	0.33VAC	+/-1% (5%100% In)
CT 100 A	1100 A	0.33VAC	+/-1% (5%100% In)
CT 150 A	1150 A	0.33VAC	+/-1% (5%100% In)
CT 400 A	1400 A	0.33VAC	+/-1% (5%100% ln)
CT 800 A	1800 A	0.33VAC	+/-1% (5%100% ln)
Flexible 5000 A (7cm Ø) (*)	105000 A	Rogowski	+/-1% (centered)
Flexible 5000 A (12cm Ø) (*)	105000 A	Rogowski	+/-1% (centered)
Flexible 5000 A (20cm Ø) (*)	105000 A	Rogowski	+/-1% (centered)

(\*)Must use flexible SenNet Rogowski model to certificate Class 1. (Factory Calibrated)

Accuracy on current measurement	
Easy Meter + SenNet CT 0.33Vac	Class 1


Easy Meter + SenNet CT 0.33Vac	Class 1	(Class 0.5 under requeriment)
Easy Meter + Flexible SenNet Rogowski	Class 1	Factory Calibrated

Electrical isolation	
SenNet CT 0.33Vac	2.5KV / 0.5mA / 3second
Flexible SenNet Rogowski	600V CAT IV



# **Holding case**

IP Grade	IP-60	
Temperature details		
Working temperature	-20ºC+70ºC	
Store temperature	-20ºC+75ºC	
Holding		
Dimensions	119 x 111 x 53 mm	
Type mount	Wall or din rail	
Plastic Material	ABS – V0	

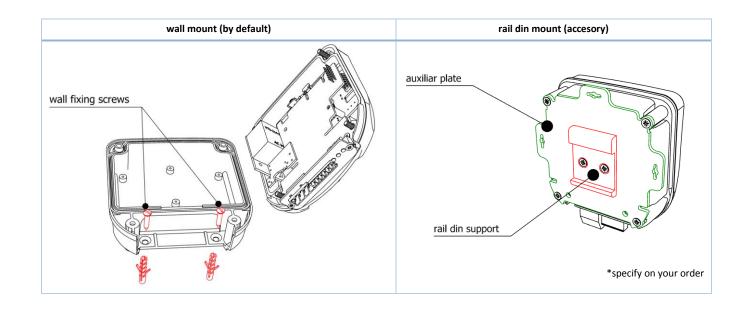



### Warranty

Satel Spain guarantees its products against all manufacturing defects for a period of 1 year.

No return of material will be accepted, nor will any equipment be repaired if it is not accompanied by a report (RMA) indicating the defect observed or the reasons for the return.

The warranty will be void if the equipment has suffered "misuse" or the storage, installation or maintenance instructions in this manual have not been followed. "Misuse" is defined as any use or storage situation contrary to the National Electrical Code or that exceeds the limits indicated in this manual.



Satel Spain declines all responsibility for possible damage to the equipment or to other parts of the installations and will not cover possible penalties derived from a possible breakdown, poor installation or "misuse" of the equipment. Consequently, the guarantee is not applicable to breakdowns produced in the following cases.

- Due to overvoltage and/or electrical disturbances in the supply.
- By water, if the product does not have the appropriate IP rating.
- For exposing the equipment to extreme temperatures, which exceed the operating or storage temperature limit.
- Due to a modification of the product by the client without prior notice to Satel Spain.

Faced with possible errors in this technical sheet, keep it updated in our website.