



# **Infrared CO2 Sensor Module**

## **(Model: MH-Z19B)**

### **User's Manual**

**(Version: 1.6)**

**Issue Date. 2020.04.23**

**Zhengzhou Winsen Electronics Technology Co., Ltd**

**ISO9001 certificated company**

## Statement

This manual's copyright belongs to Zhengzhou Winsen Electronics Technology Co., LTD. Without the written permission, any part of this manual shall not be copied, translated, stored in database or retrieval system, also can't spread through electronic, copying, record ways.

Thanks for purchasing our product. In order to let customers use it better and reduce the faults caused by misuse, please read the manual carefully and operate it correctly in accordance with the instructions. If users disobey the terms or remove, disassemble, change the components inside of the sensor, we shall not be responsible for the loss.

The specific such as color, appearance, sizes &etc., please in kind prevail.

We are devoting ourselves to products development and technical innovation, so we reserve the right to improve the products without notice. Please confirm it is the valid version before using this manual. At the same time, users' comments on optimized using way are welcome.

Please keep the manual properly, in order to get help if you have questions during the usage in the future.

**Zhengzhou Winsen Electronics Technology CO., LTD.**

## MH-Z19B NDIR CO2 Module

### 1. Profile

MH-Z19B NDIR infrared gas module is a common type, small size sensor, using non-dispersive infrared (NDIR) principle to detect the existence of CO<sub>2</sub> in the air, with good selectivity, non-oxygen dependent and long life. Built-in temperature compensation; and it has UART output and PWM output. It is developed by the tight integration of mature infrared absorbing gas detection technology, precision optical circuit design and superior circuit design.

### 2. Applications

\*HVAC refrigeration

\*Air cleaner device

\*Indoor air quality monitoring

\*Smart home

\*Ventilation system

\*School

### 3. Main Features

Chamber is gold plated, water-proof and anti-corrosion

High sensitivity, low power consumption

Good stability






Temperature compensation, excellent linear output



Multiple output modes: **UART, PWM**

Long lifespan



Anti-water vapor interference, anti-poisoning

### 4. Structure

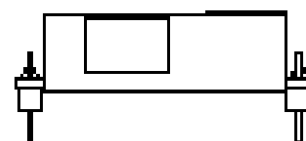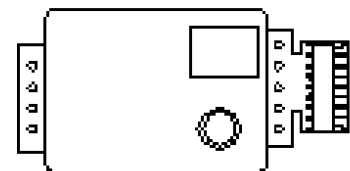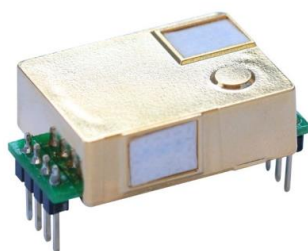

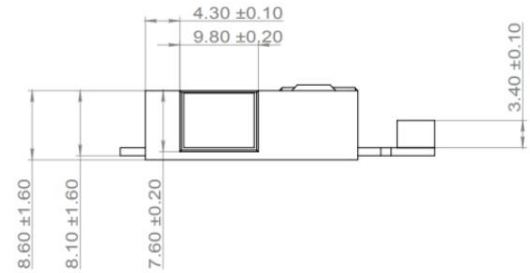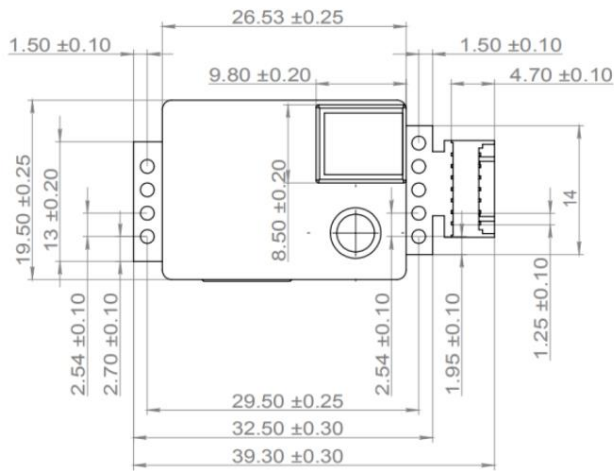**Terminal connection type:**


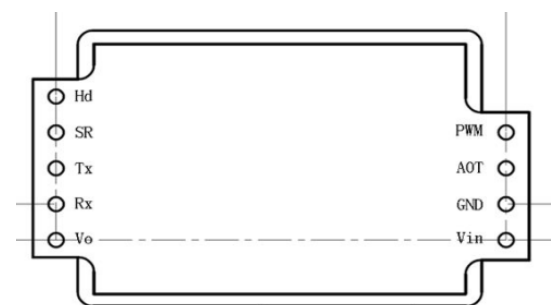
Unit: mm

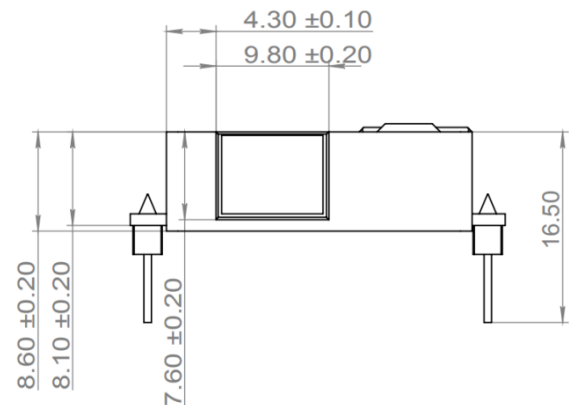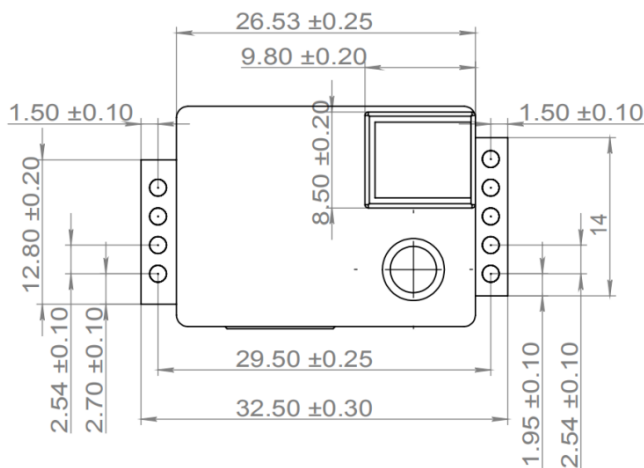**Pins connection type:**


Pin is the common standard type with square cross section.


**Pins connection type:**

Pin	Pin Definition
Vin	Positive pole of power (Vin)
GND	Negative pole of power (GND)
PWM	<b>PWM</b>
Hd	HD(zero point calibration, low level lasting for over 7s is effective)
Rx	<b>UART(RXD)TTL Level data input</b>
Tx	<b>UART(TXD)TTL Level data output</b>
Vo	reserved
SR	reserved
AOT	reserved



## Terminal connection type:

Pin	Terminal pin Definition
Pin 1	reserved
Pin 2	reserved
Pin 3	Negative Pole of power (GND)
Pin 4	Positive Pole of power(Vin)
Pin 5	UART(RXD)TTL Level data input
Pin 6	UART(TXD)TTL Level data output
Pin 7	reserved

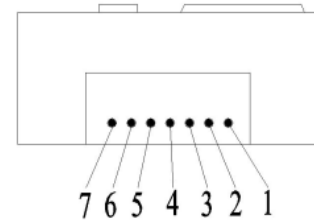

**Note:** All the pins for reserved must be vacant while the sensor is working.

## 5. Detection range and accuracy

Detection Gas	Formula	Detection Range	Accuracy
Carbon Dioxide	CO <sub>2</sub>	0~2000ppm	± (50ppm+5% reading value)
		0~5000ppm	
		0~10000ppm	

## 6. Main parameters

Model No.	MH-Z19B
Detection Gas	CO <sub>2</sub>
Working voltage	4.5 ~ 5.5 V DC
Average current	< 20mA (@5V power supply)
Peak current	150mA (@5V power supply)
Interface level	3.3 V (Compatible with 5V)
Detection Range	0~2000/5000/10000ppm(optional)
Output signal	Serial Port (UART) (TTL level 3.3V)
	PWM
Preheat time	3 min
Response Time	T <sub>90</sub> < 120 s
Working temperature	-10 ~ 50 °C
Working humidity	0 ~ 95% RH (No condensation)
Weight	5 g
Lifespan	> 5 years

## 7. Output

PWM output																
Take 0~2000ppm for example																
CO2 output range	0~2000ppm															
Cycle	1004ms±5%															
Cycle start high level output	2ms(theoretical value)															
The middle cycle	1000ms±5%															
cycle end low level output	2ms(theoretical value)															
CO2 concentration: $C_{ppm}=2000\times (TH-2ms)/(TH+TL-4ms)$																
$C_{ppm}$ : CO2 concentration could be calculated by PWM output																
TH high level output time during cycle																
TL low level output time during cycle																
<p>The diagram illustrates the PWM output for CO2 concentrations ranging from 400 ppm to 2000 ppm. Each concentration level is associated with a specific high-level pulse width (TH) and a low-level pulse width (TL). The total cycle time is 1004ms ± 5%.</p> <table><thead><tr><th>CO2 Concentration (ppm)</th><th>High Level Output Time (TH) (ms)</th><th>Low Level Output Time (TL) (ms)</th></tr></thead><tbody><tr><td>400</td><td>202</td><td>~798</td></tr><tr><td>1000</td><td>502</td><td>~502</td></tr><tr><td>1500</td><td>752</td><td>~252</td></tr><tr><td>2000</td><td>1002</td><td>~2</td></tr></tbody></table>		CO2 Concentration (ppm)	High Level Output Time (TH) (ms)	Low Level Output Time (TL) (ms)	400	202	~798	1000	502	~502	1500	752	~252	2000	1002	~2
CO2 Concentration (ppm)	High Level Output Time (TH) (ms)	Low Level Output Time (TL) (ms)														
400	202	~798														
1000	502	~502														
1500	752	~252														
2000	1002	~2														

## Serial port output (UART)

### Hardware connection

Connect module's Vin-GND-RXD-TXD to users' 5V-GND-TXD-RXD.

(Users must use TTL level. If RS232 level, it must be converted.)

### Software setting

Set serial port baud rate be 9600, data bytes have 8 bytes, stop byte has 1 byte, parity byte is null.

Commands	
0x86	Read CO2 concentration
0x87	Calibrate Zero Point (ZERO)
0x88	Calibrate Span Point (SPAN)

<b>0x86- Read CO2 concentration</b>								
Sending command								
Byte0	Byte1	Byte2	Byte3	Byte4	Byte5	Byte6	Byte7	Byte8
Start Byte	Reserved	Command	-	-	-	-	-	Checksum
0xFF	0x01	0x86	0x00	0x00	0x00	0x00	0x00	0x79
Return value								
Byte0	Byte1	Byte2	Byte3	Byte4	Byte5	Byte6	Byte7	Byte8
Start Byte	Command	Concentration (High 8 Byte)	Concentration (Low 8 Byte)	-	-	-	-	Checksum
0xFF	0x86	HIGH	LOW	-	-	-	-	Checksum
CO2 concentration = HIGH * 256 + LOW								
For <b>example</b> : Send command FF 01 86 00 00 00 00 00 79, Return value FF 86 <b>01 F4</b> 00 00 00 00 85								
How to calculate concentration: <b>convert hexadecimal 01 into decimal 1</b> , hexadecimal F4 into decimal 254, then 1*256+254=500ppm								

<b>1. Checksum calculation method</b>								
Checksum = (Negative (Byte1+Byte2+Byte3+Byte4+Byte5+Byte6+Byte7))+1								
For example:								
Byte0	Byte1	Byte2	Byte3	Byte4	Byte5	Byte6	Byte7	Byte8
Start Byte	Reserved	Command	-	-	-	-	-	Checksum
0xFF	0x01	0x86	0x00	0x00	0x00	0x00	0x00	Checksum
Calculating Checksum:								
1、Add Byte 1 to Byte 7: 0x01 + 0x86 + 0x00 + 0x00 + 0x00 + 0x00 + 0x00 = 0x87								
2、Negative: 0xFF - 0x87 = 0x78								
3、Then+1: 0x78 + 0x01 = 0x79								
C language								
<pre> char getChecksum(char *packet) {     char i, checksum;     for( i = 1; i &lt; 8; i++)     {         checksum += packet[i];     }     checksum = 0xff - checksum;     checksum += 1;     return checksum; }                     </pre>								

## 8.Zero Point Calibration

### About zero point calibration:

This module has three methods for zero point calibration: hand-operated method, sending command method and self-calibration. All the zero point is at 400ppm CO2 level.

**A). Hand-operated method:** Connect module's HD pin to low level(0V), lasting for 7 seconds at least. Before calibrating the zero point, please ensure that the sensor is stable for more than 20 minutes at 400ppm ambient environment.

### B). To send command method:

Zero and Span point calibration can be achieved by sending a calibration command to the sensor via the serial port (URAT). Zero and SPAN point calibration commands are as follows:

0x87-To calibrate zero point								
Send command								
Byte0	Byte1	Byte2	Byte3	Byte4	Byte5	Byte6	Byte7	Byte8
Start Byte	reserved	Command	-	-	-	-	-	Checksum
0xFF	0x01	0x87	0x00	0x00	0x00	0x00	0x00	Checksum
No returned value								
<b>Caution:</b> zero-point means 400ppm, please ensure the module works in 400ppm CO2 gas stably for 20 min at least before send the command								

0x88- To calibrate span point								
Send command								
Byte0	Byte1	Byte2	Byte3	Byte4	Byte5	Byte6	Byte7	Byte8
Start Byte	No.	Command	Span (High 8 bits)	Span (low 8 bits)	-	-	-	Checksum
0xFF	0x01	0x88	HIGH	LOW	0x00	0x00	0x00	Checksum
No returned value. If SPAN value is 2000ppm, HIGH=2000/256; LOW=2000%256								
<b>Caution:</b>								
* Please do Zero calibration before SPAN calibration.								
*Before sending the SPAN calibration command, please ensure that the sensor is stable for more than 20 minutes at the corresponding concentration.								
Suggest to take 2000ppm as SPAN calibration point, if need lower concentration, it should be higher than 1000ppm.								

### C).Self-calibration:

After the module works for some time, it can judge the zero point intelligently and do the zero calibration automatically. The calibration cycle is every 24 hours since the module is power on. The zero point is 400ppm. This method is suitable for office and home environment, not suitable for agriculture greenhouse, farm, refrigerator, etc.. If the module is used in latter environment, please turn off this function.



## 9. Notes

- 9.1 Please avoid the pressure of its gilded plastic chamber from any direction, during welding, installation, and use.
- 9.2 When placed in small space, the space should be well ventilated, especially for diffusion window.
- 9.3 The module should be away from heat, and avoid direct sunlight or other heat radiation.
- 9.4 The module should be calibrated termly, the suggested period is not longer than 6 months.
- 9.5 Do not use the sensor in the high dusty environment for long time.
- 9.6 To ensure the normal work, the power supply must be among 4.5V~5.5V DC rang, the power current must be not less than 150mA. Out of this range, it will result in the failure of the sensor. (The concentration output is low, or the sensor can not work normally.)
- 9.7 During the zero point calibration procedure by manual, the sensor must work in stable gas environment (400ppm) for over 20 minutes. Connect the HD pin to low level (0V) for over 7 seconds.
- 9.8 Forbid using wave soldering for the sensor.
- 9.9 When soldering with soldering iron, set the temperature to be  $(350 \pm 5) ^\circ \text{C}$ , and soldering time must be within 3 seconds.
- 9.0 As for pin version sensor, it is recommended to use soldering socket to directly insert or remove sensors for convenient maintenance.

**Zhengzhou Winsen Electronics Technology Co., Ltd**

**Add:** No.299, Jinsuo Road, National Hi-Tech Zone,  
Zhengzhou 450001 China

**Tel:** +86-371-67169097/67169670

**Fax:** +86-371-60932988

**E-mail:** [sales@winsensor.com](mailto:sales@winsensor.com)

**Website:** [www.winsen-sensor.com](http://www.winsen-sensor.com)