


DI Wiring 001-020


PLC Package Viewer / TURN118_ENGINEERING_CLOSEOUT_CHECKLIST_REVIEW_ONLY_V1

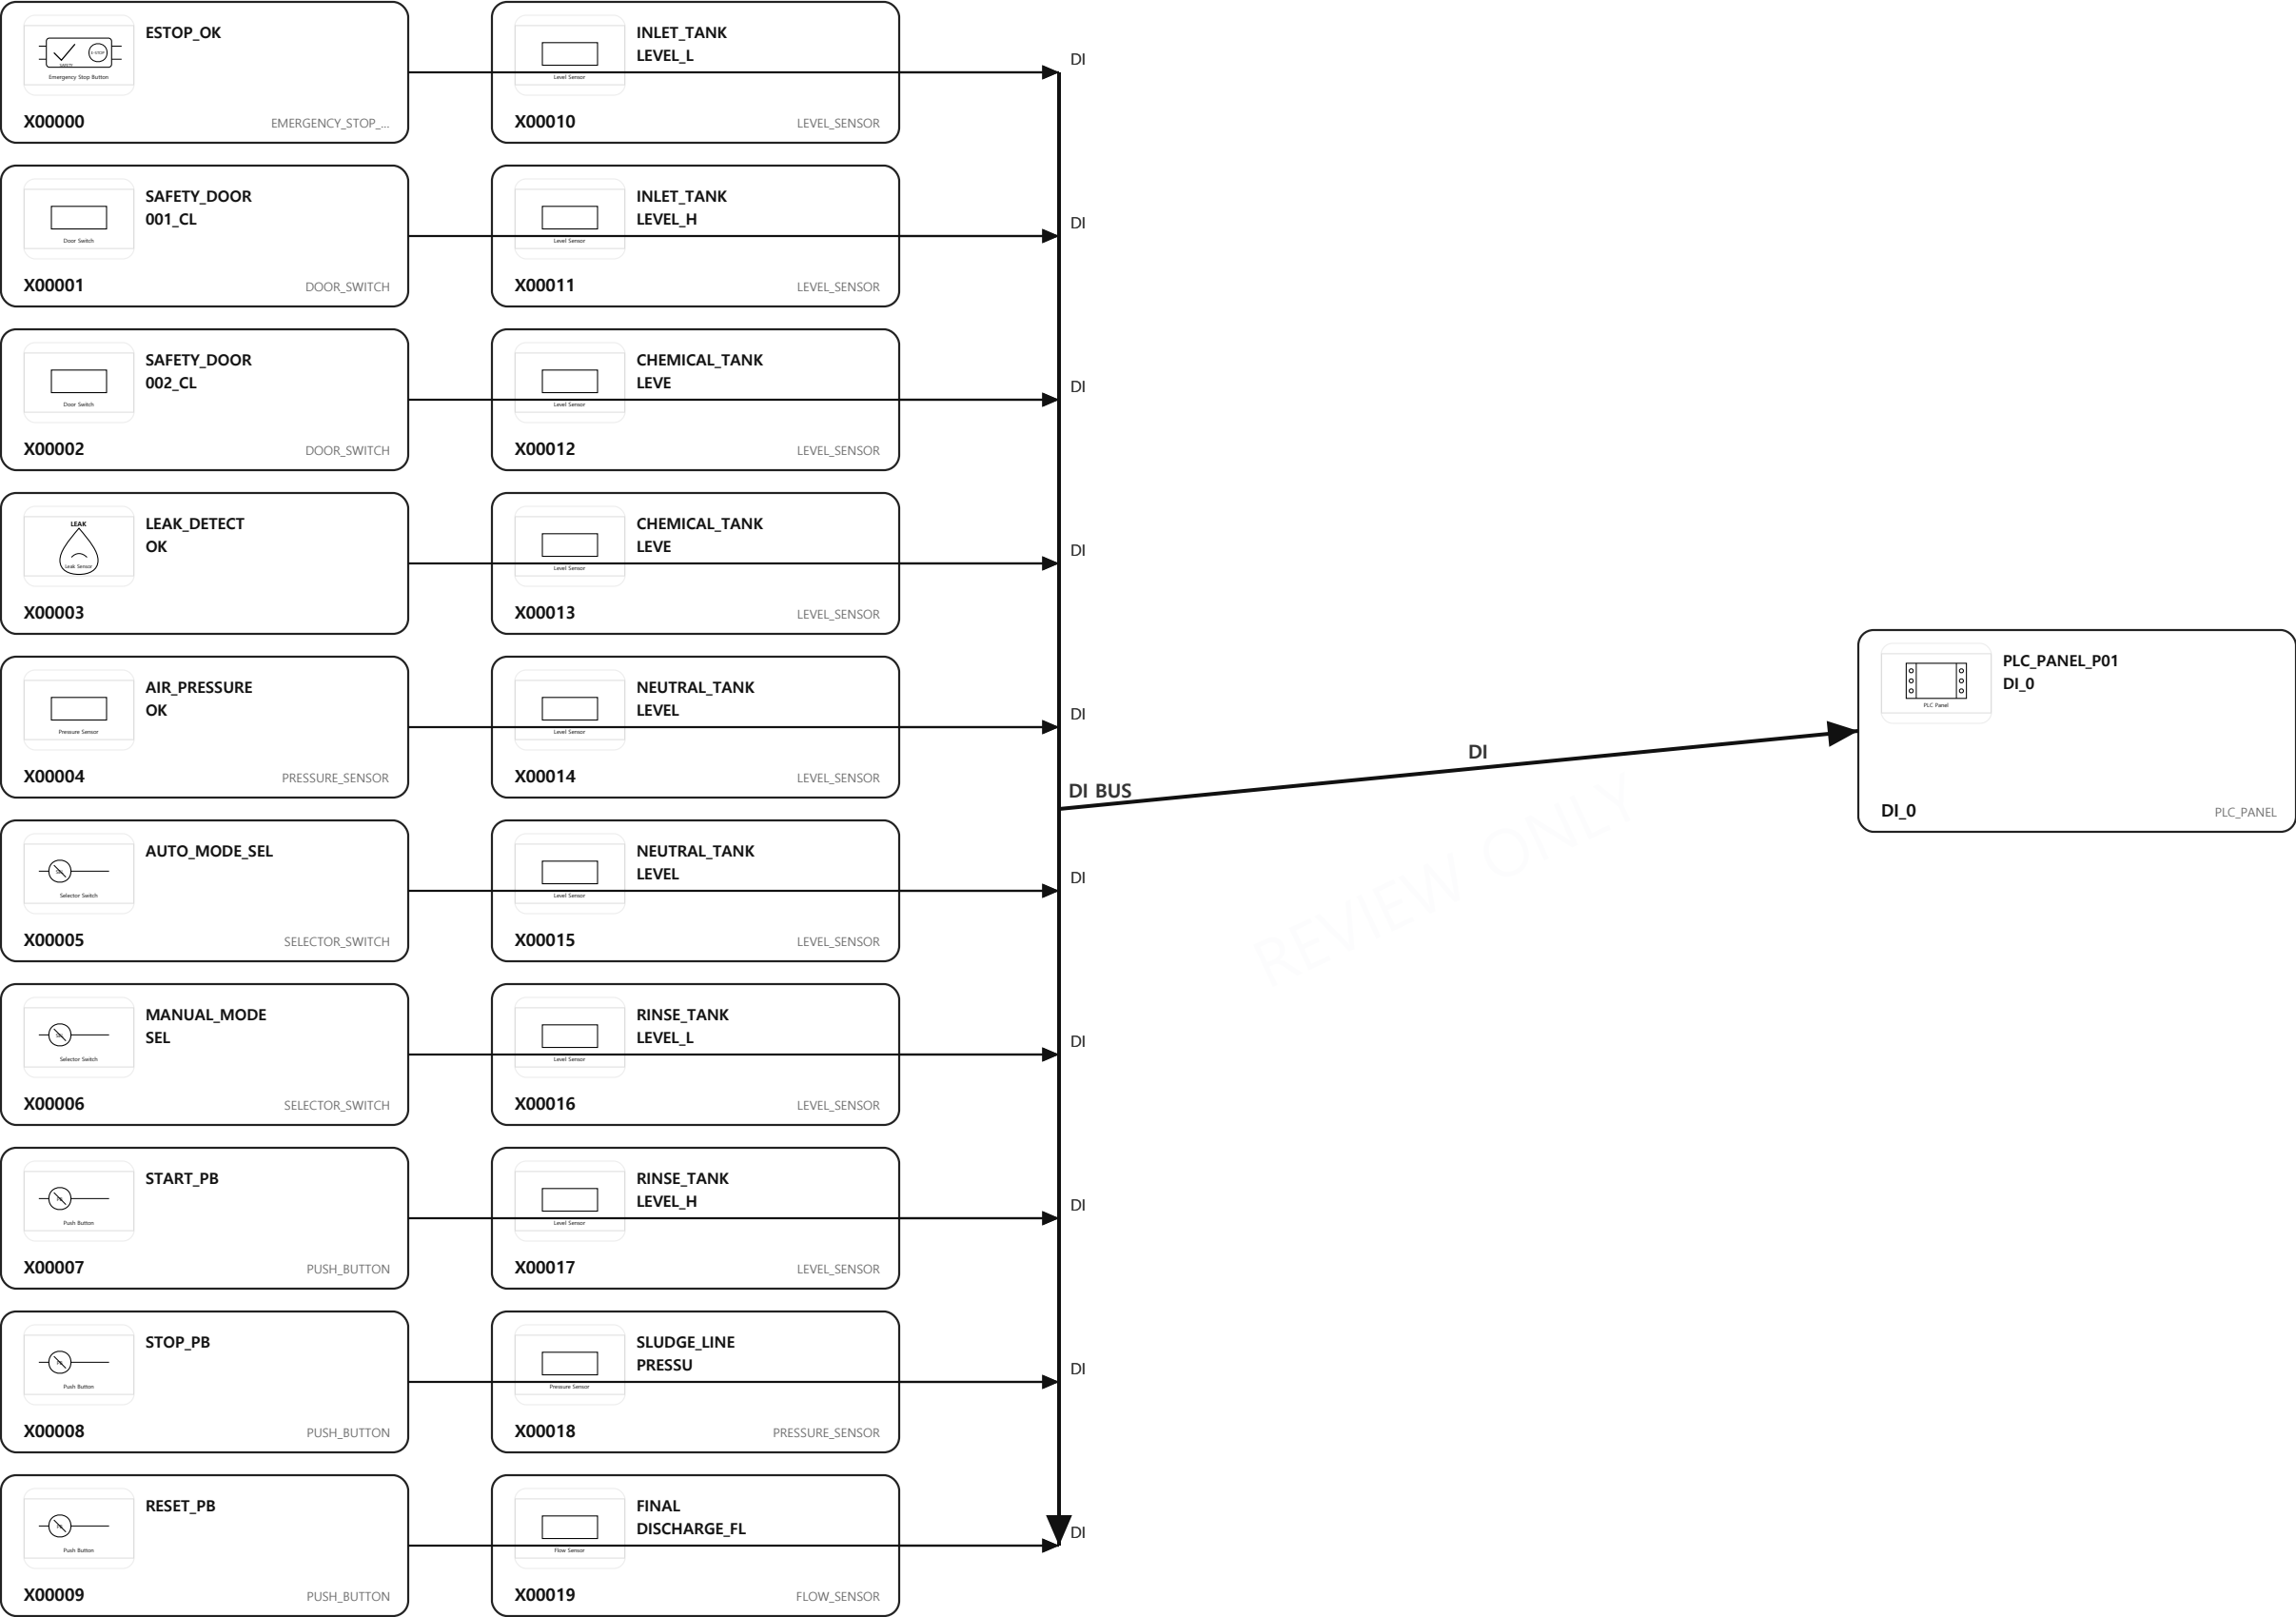

TITLE	DI Wiring 001-020
DRAWING NO	P01_DI_001_020
CASE	PLC-20260512-TYPE4-IO500-WW-001
REV / STATUS	A / REVIEW ONLY
GENERATED	2026-05-14 14:20

DI Wiring 021-040


PLC Package Viewer / TURN118_ENGINEERING_CLOSEOUT_CHECKLIST_REVIEW_ONLY_V1

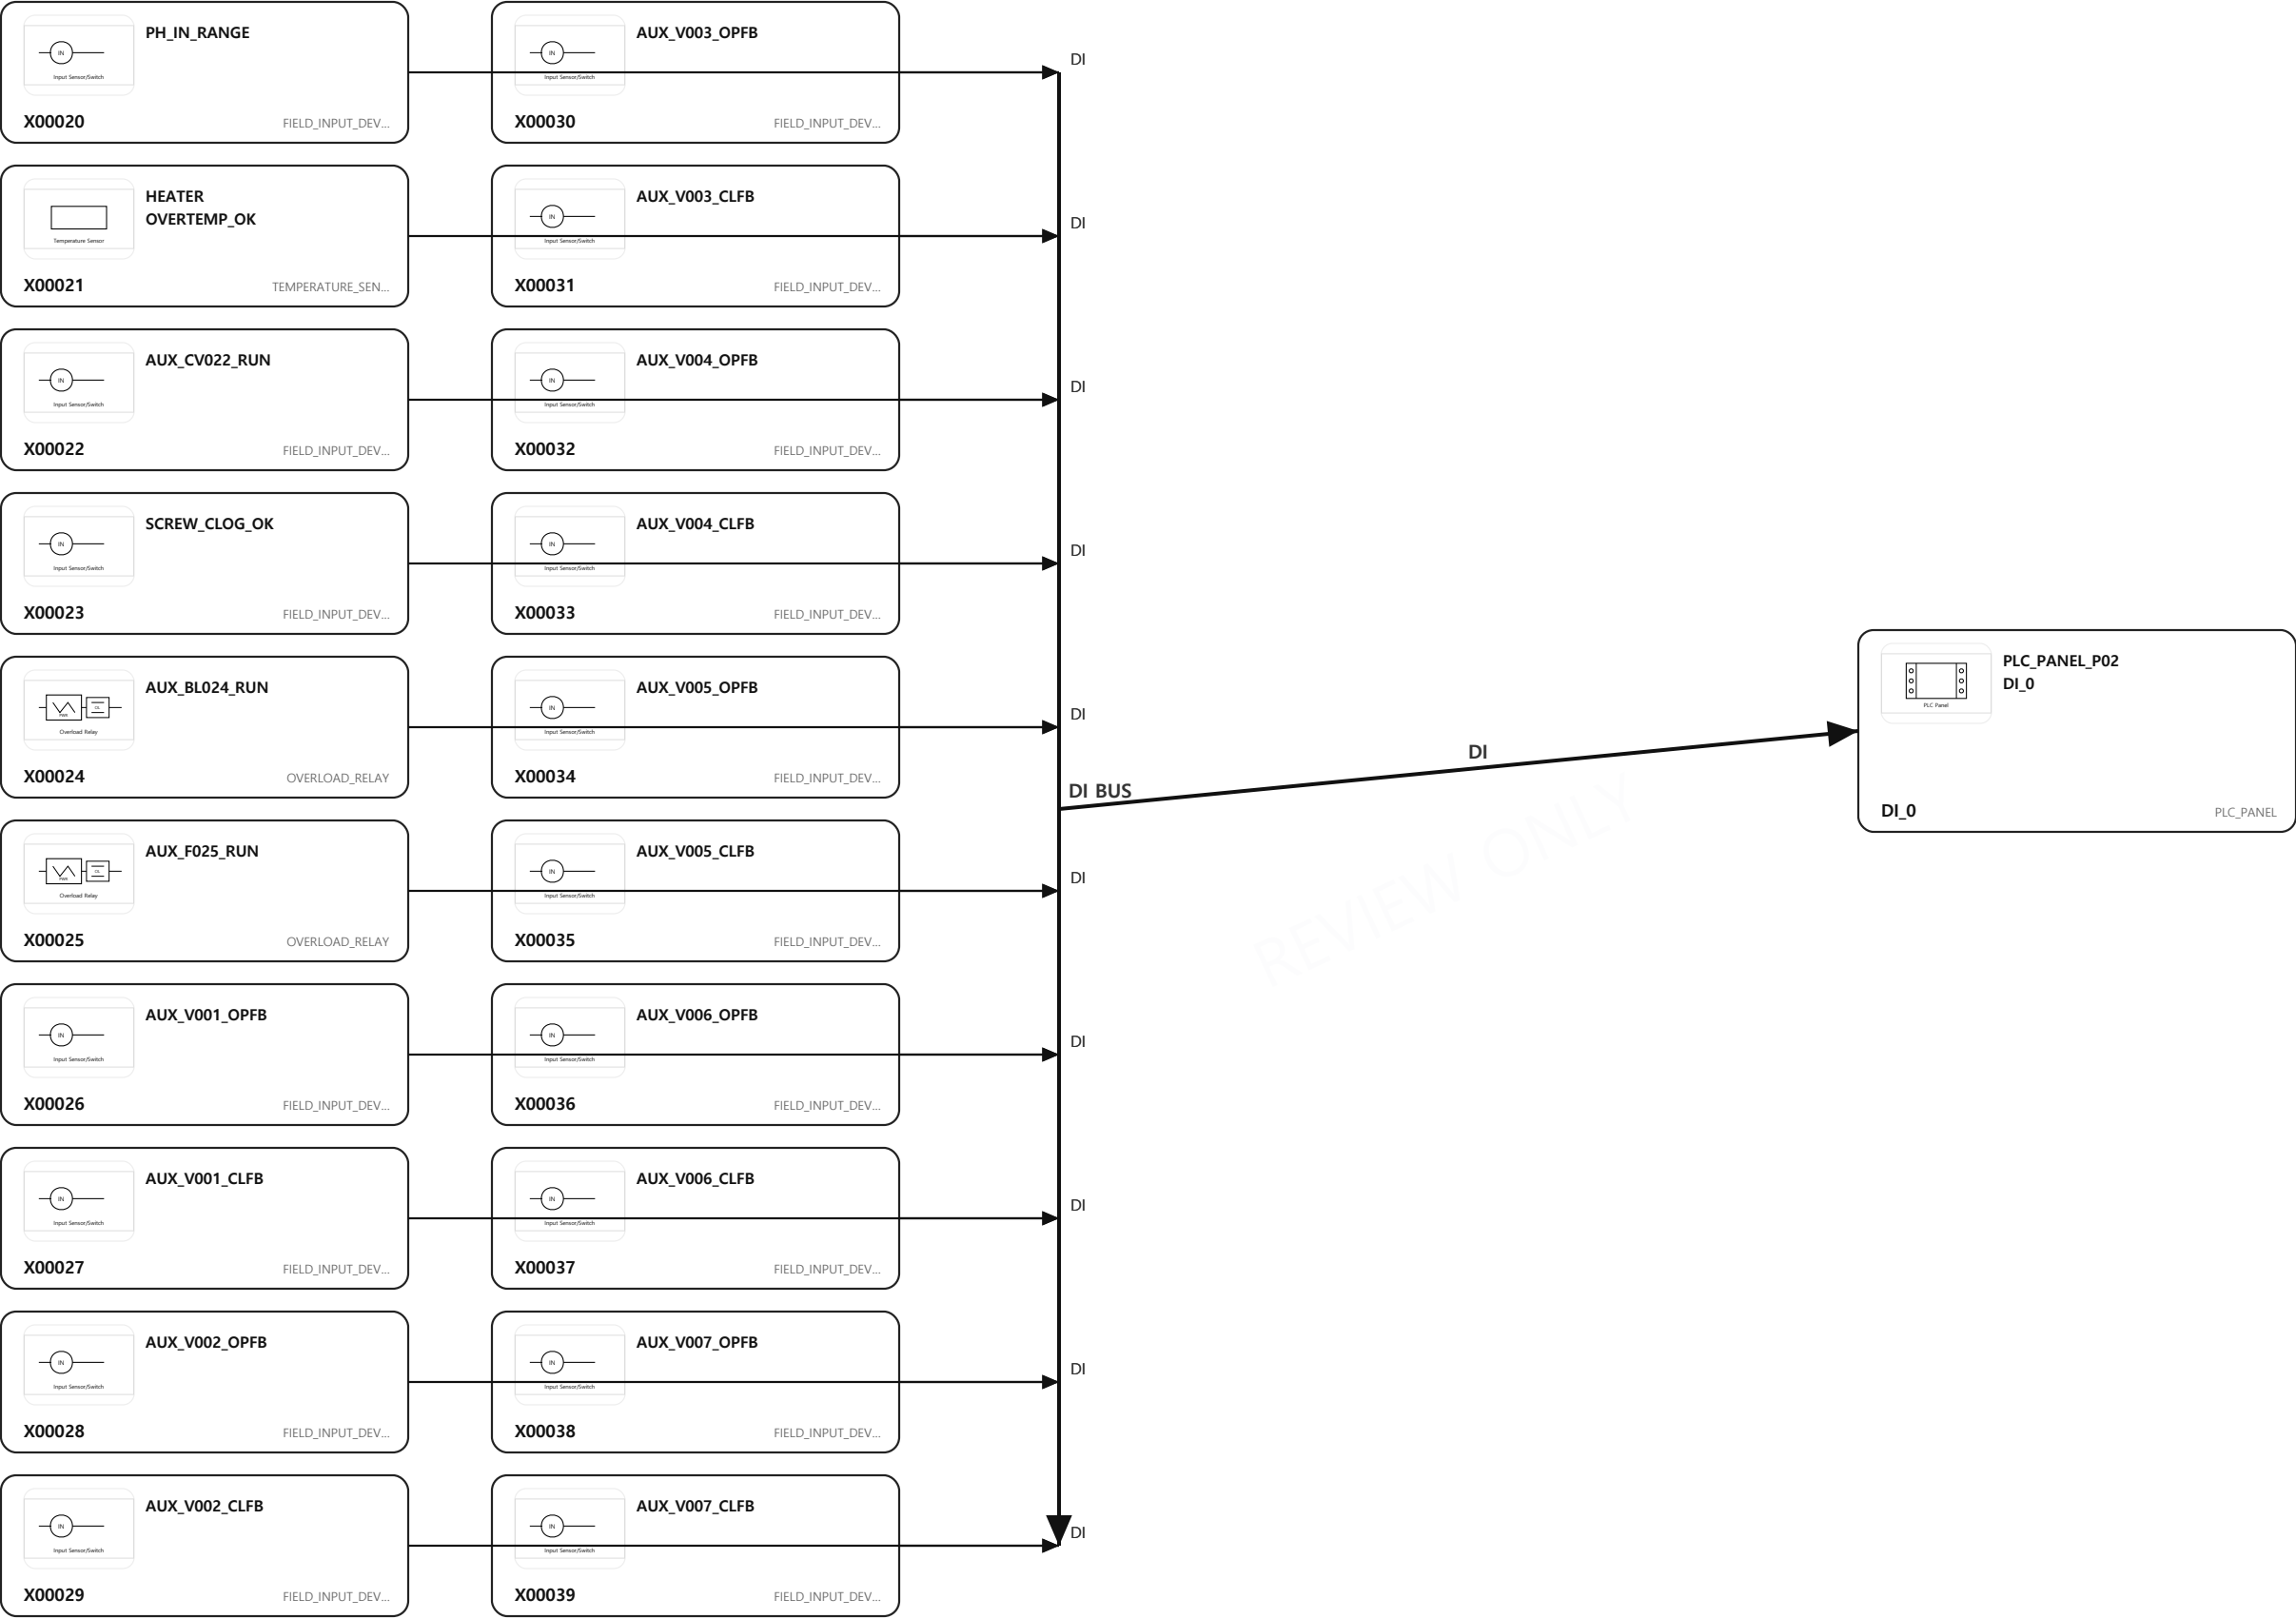

TITLE	DI Wiring 021-040
DRAWING NO	P02_DI_021_040
CASE	PLC-20260512-TYPE4-IO500-WW-001
REV / STATUS	A / REVIEW ONLY
GENERATED	2026-05-14 14:20

DI Wiring 041-060


PLC Package Viewer / TURN118_ENGINEERING_CLOSEOUT_CHECKLIST_REVIEW_ONLY_V1

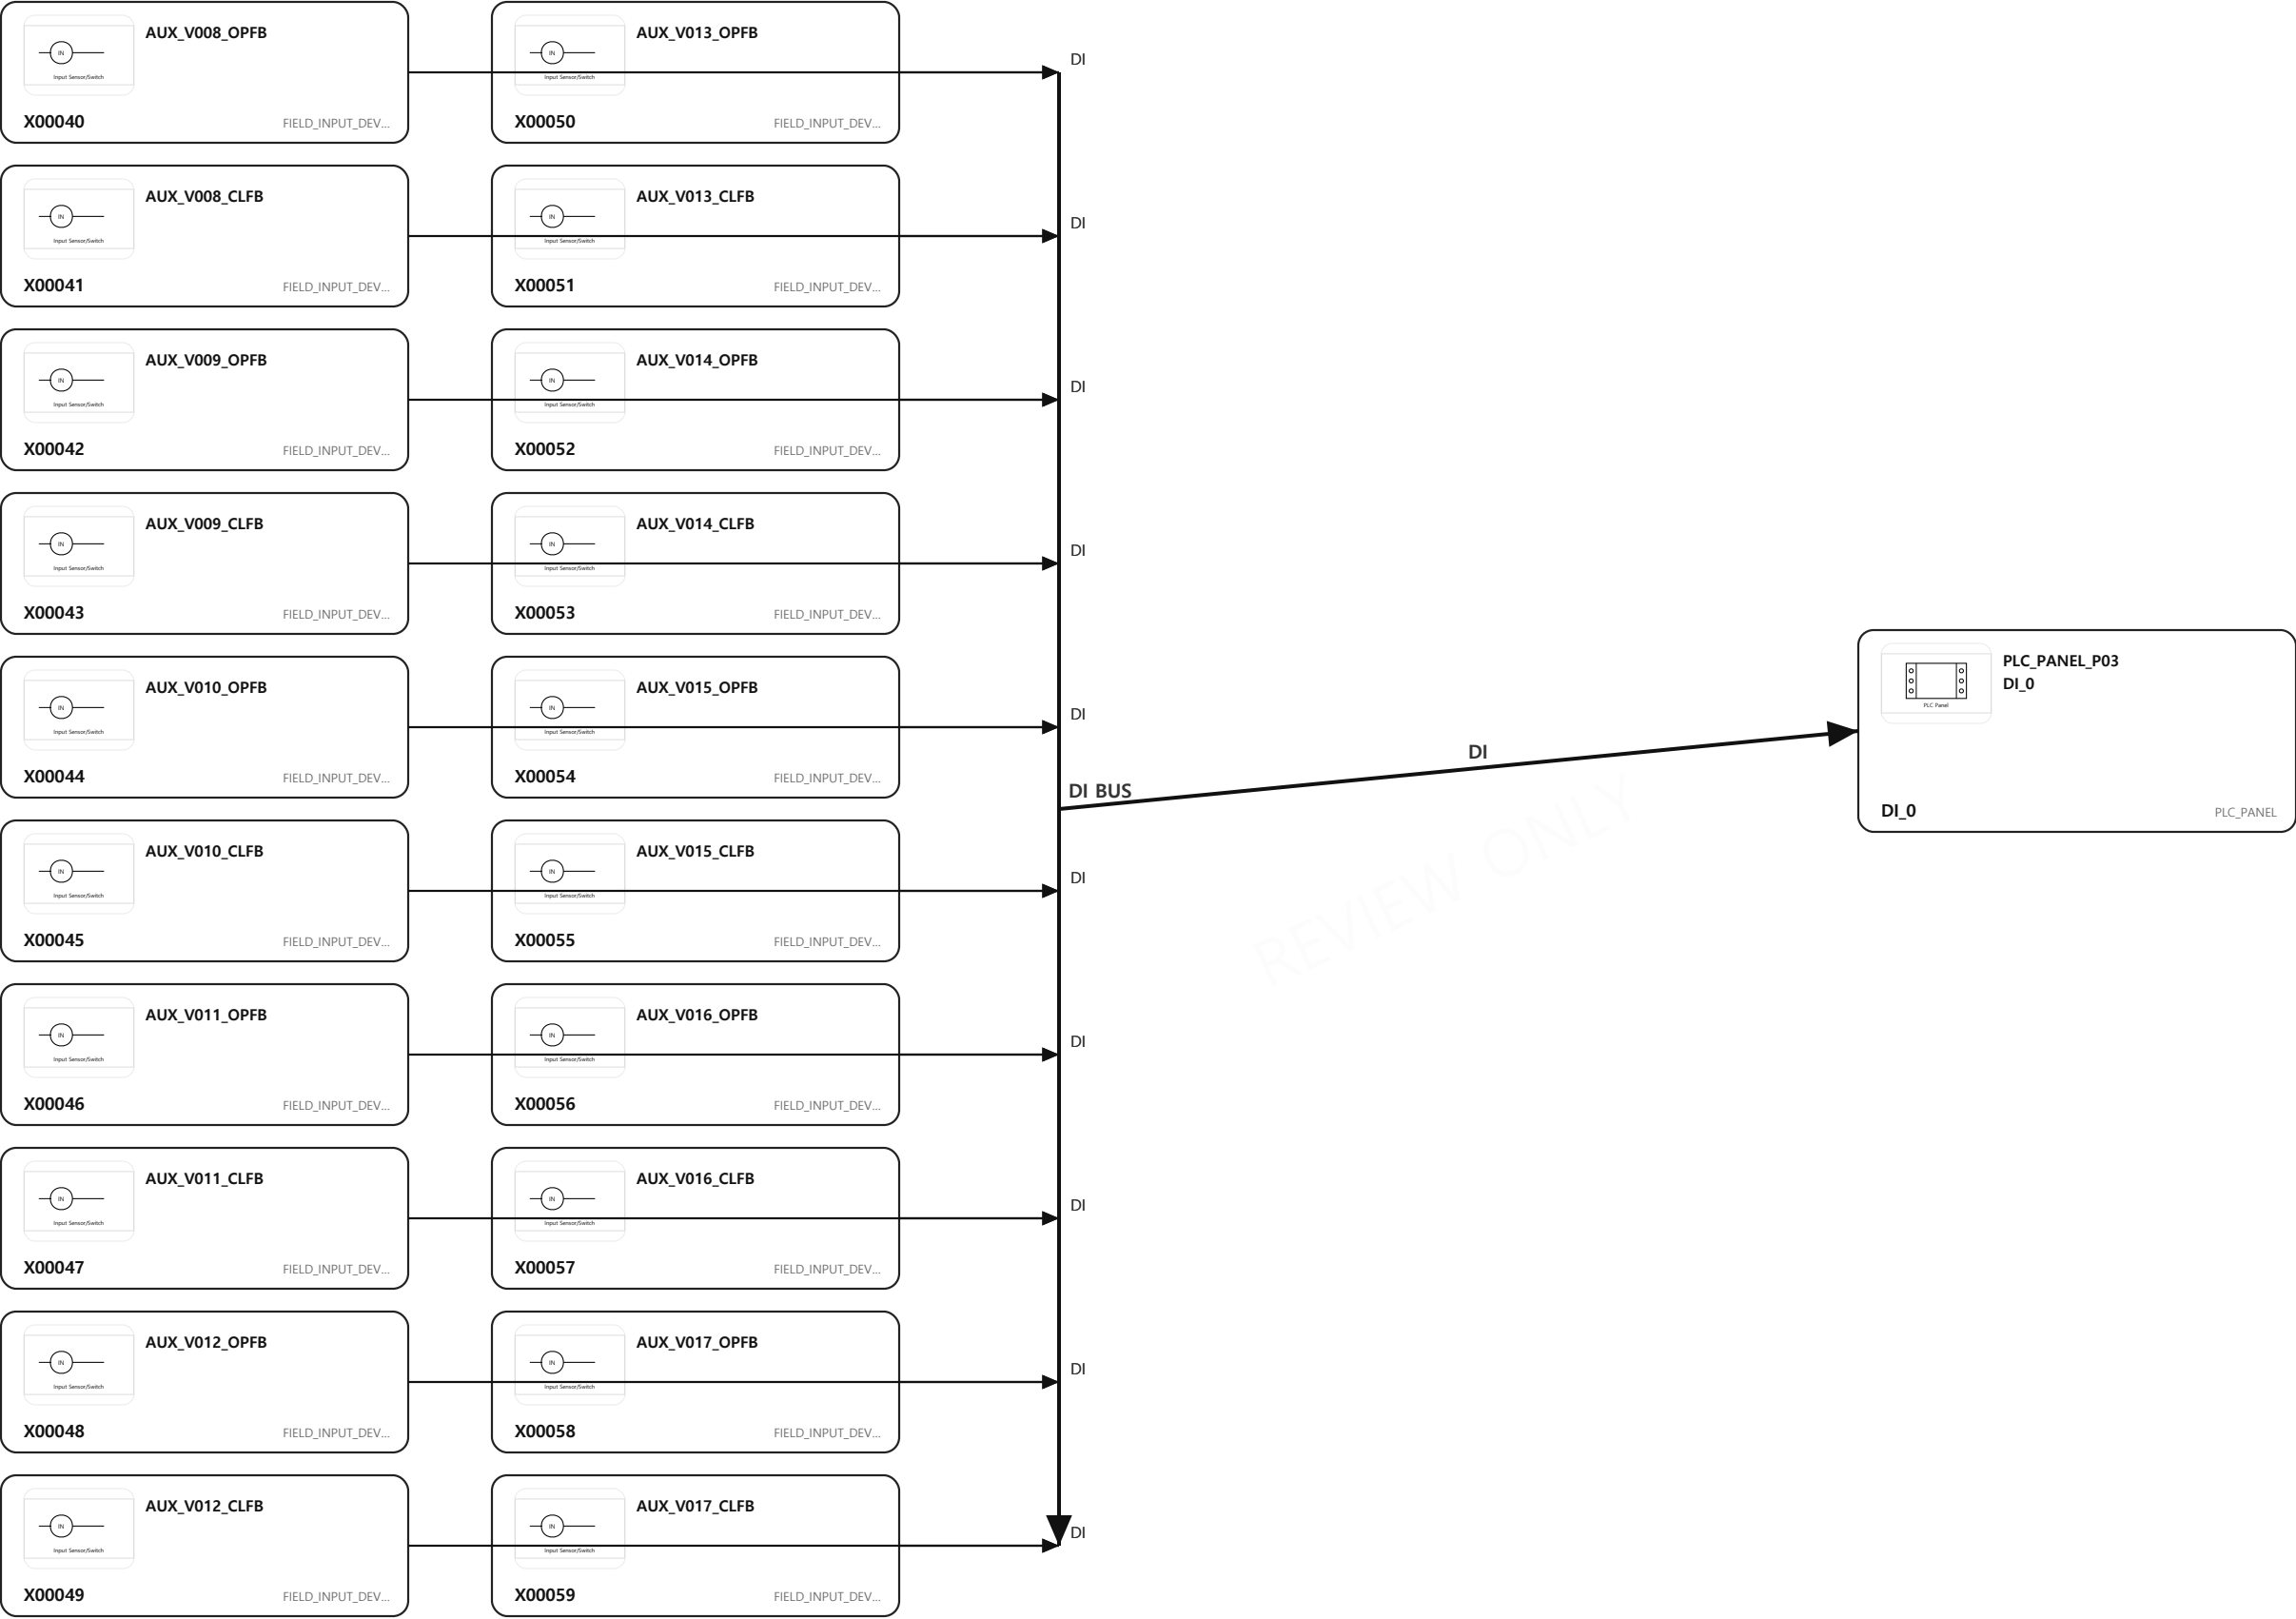

TITLE	DI Wiring 041-060
DRAWING NO	P03_DI_041_060
CASE	PLC-20260512-TYPE4-IO500-WW-001
REV / STATUS	A / REVIEW ONLY
GENERATED	2026-05-14 14:20

DI Wiring 061-080


PLC Package Viewer / TURN118_ENGINEERING_CLOSEOUT_CHECKLIST_REVIEW_ONLY_V1

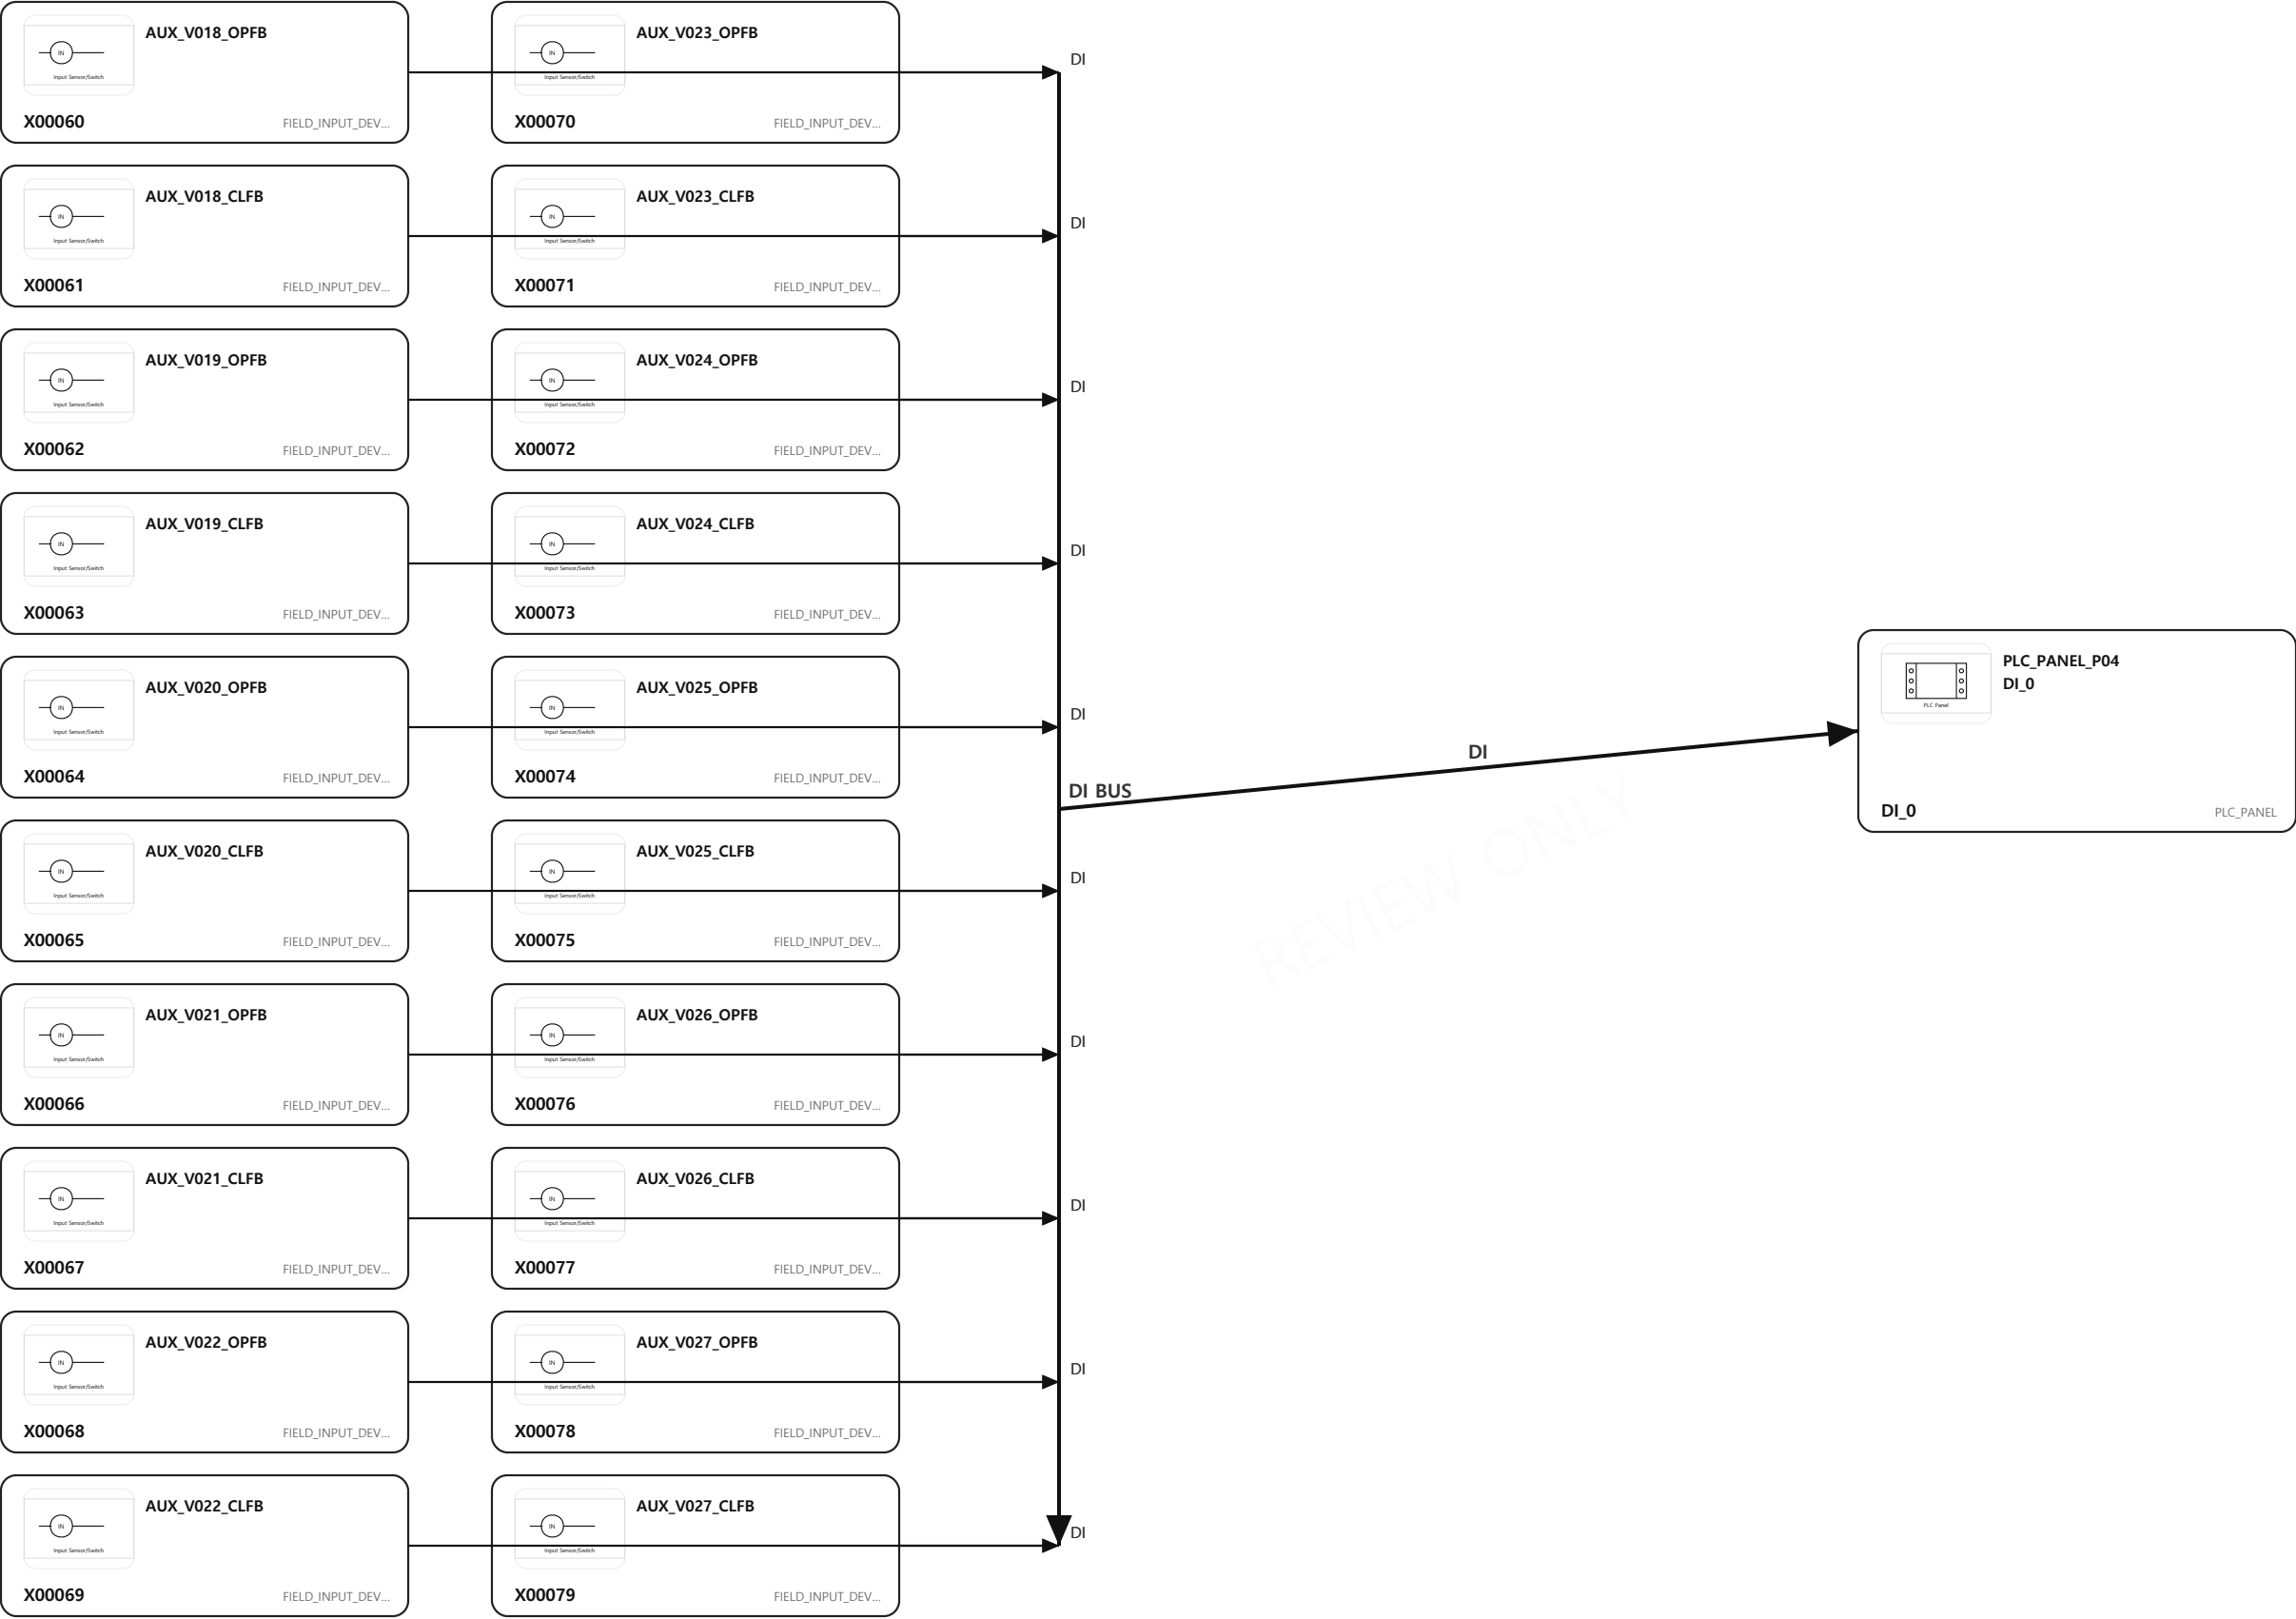

TITLE	DI Wiring 061-080
DRAWING NO	P04_DI_061_080
CASE	PLC-20260512-TYPE4-IO500-WW-001
REV / STATUS	A / REVIEW ONLY
GENERATED	2026-05-14 14:20

DI Wiring 081-100


PLC Package Viewer / TURN118_ENGINEERING_CLOSEOUT_CHECKLIST_REVIEW_ONLY_V1

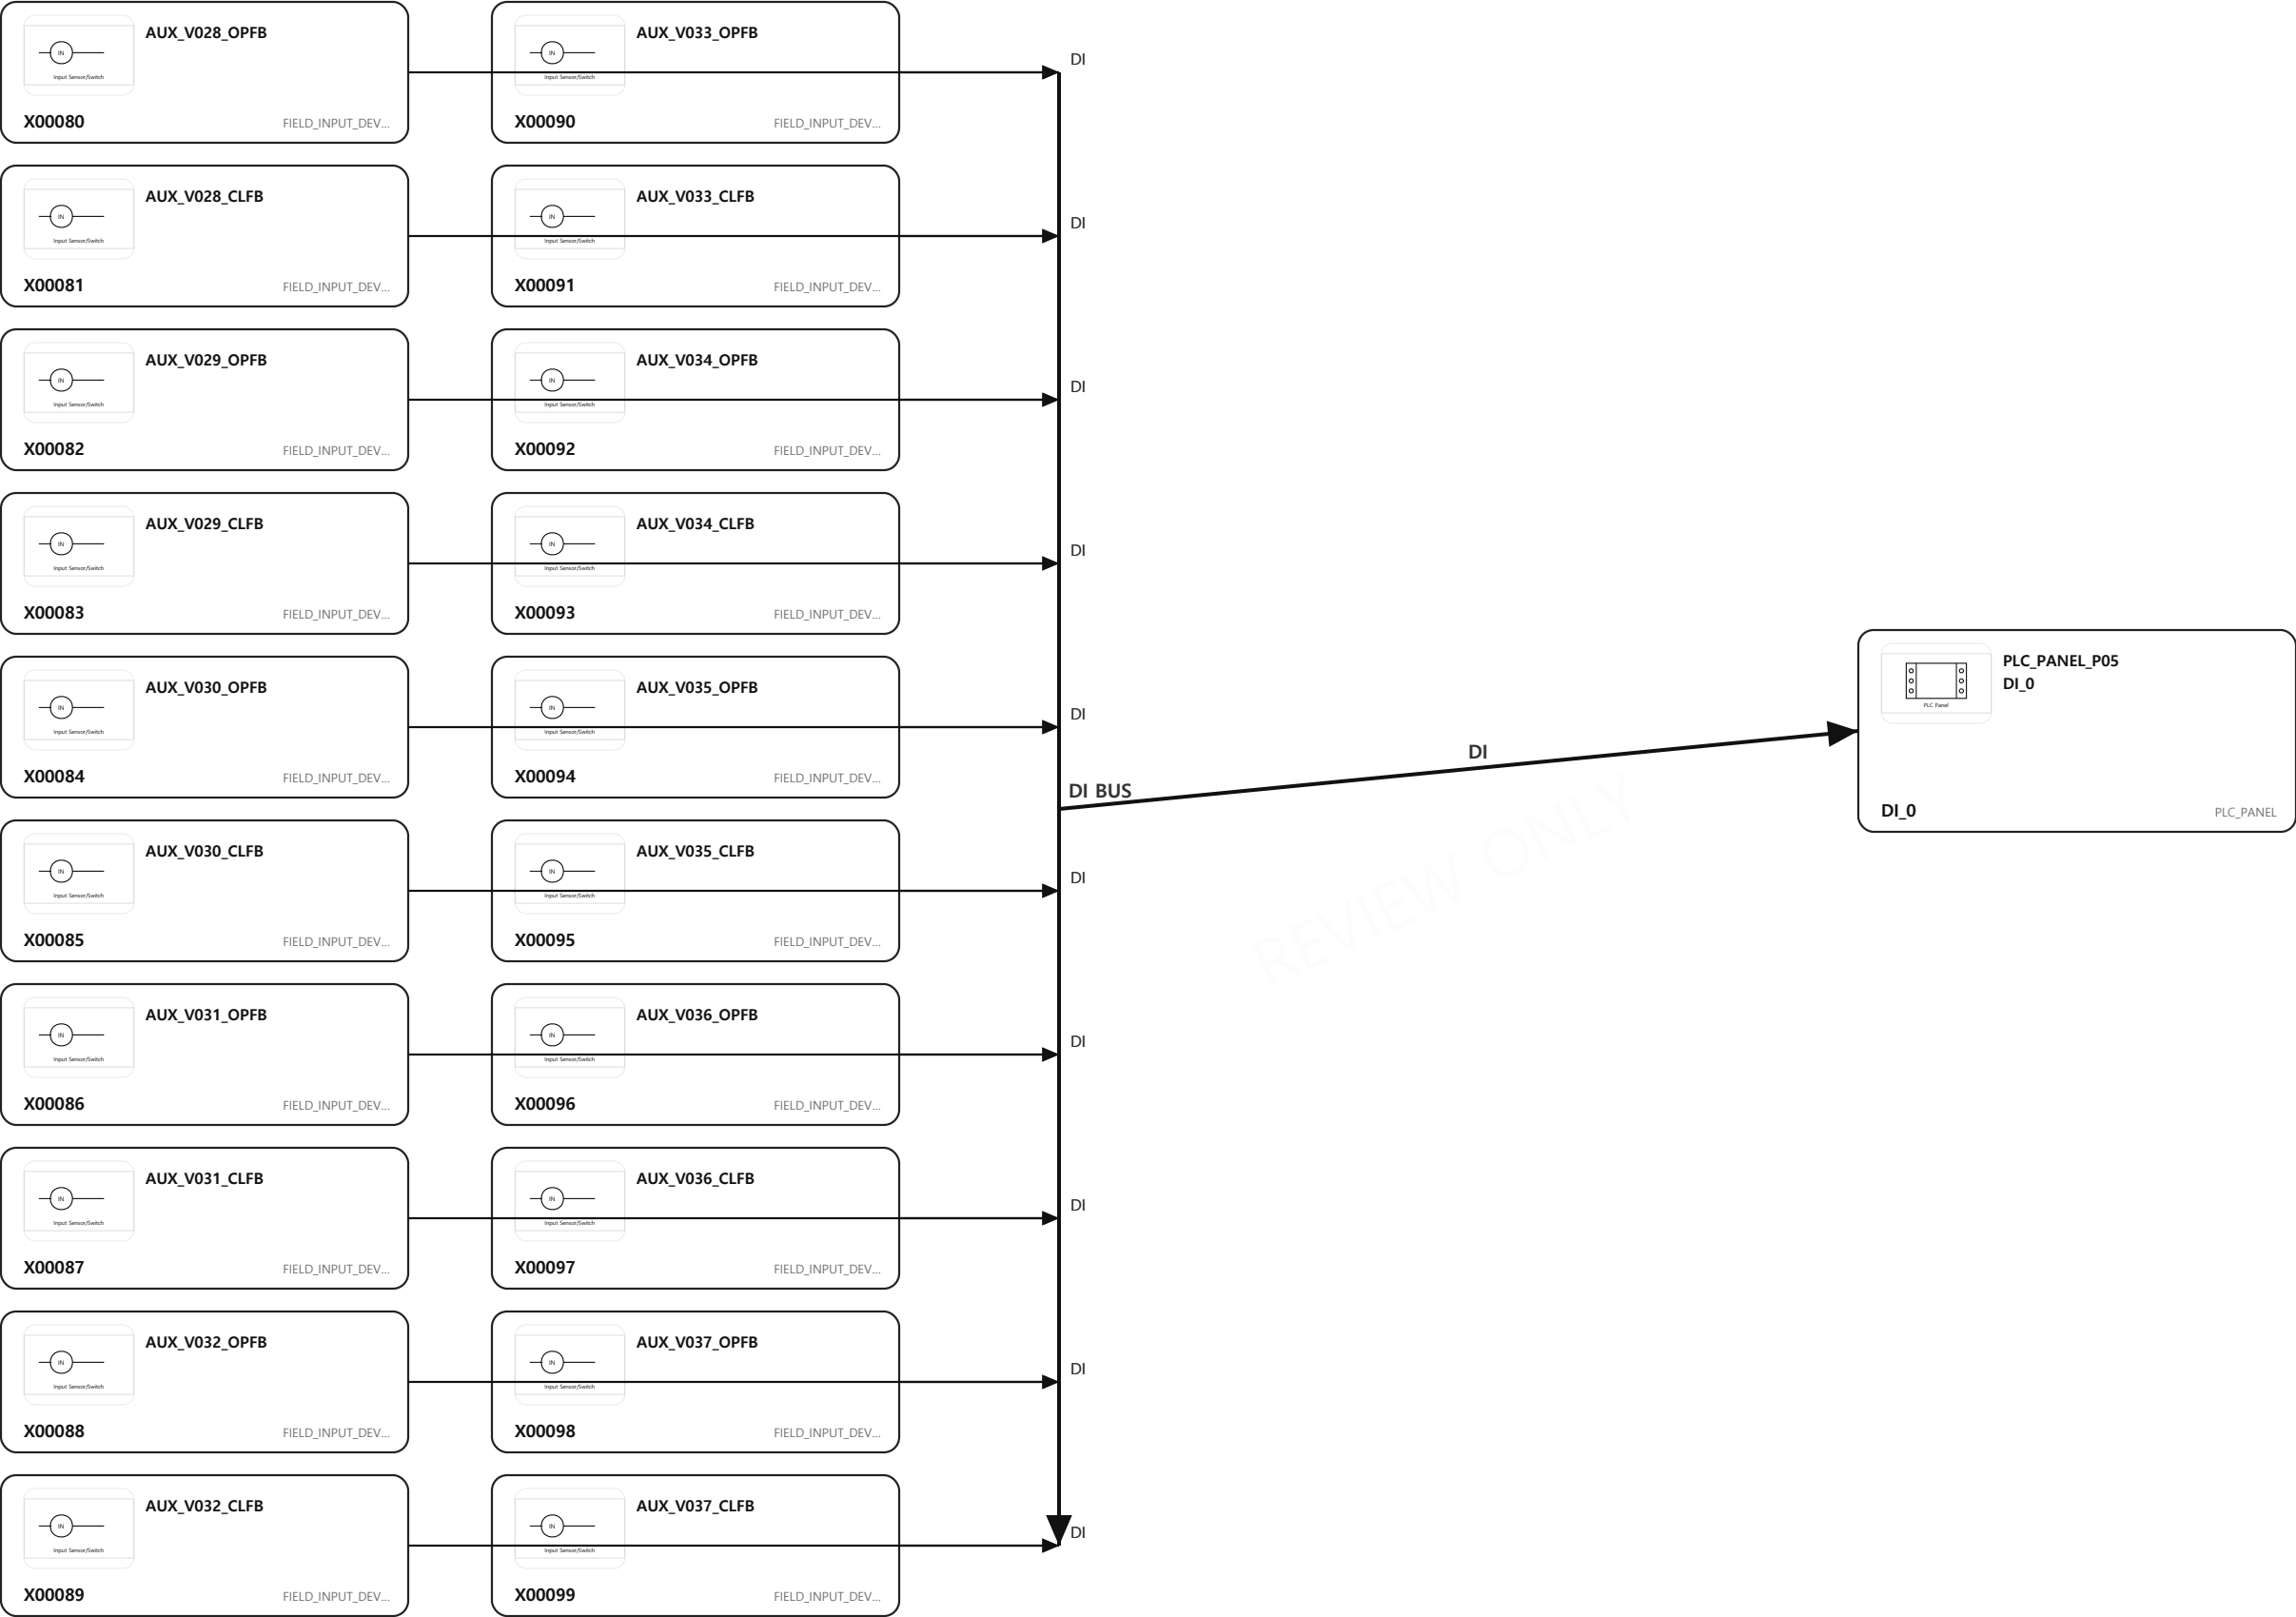

TITLE	DI Wiring 081-100
DRAWING NO	P05_DI_081_100
CASE	PLC-20260512-TYPE4-IO500-WW-001
REV / STATUS	A / REVIEW ONLY
GENERATED	2026-05-14 14:21

DI Wiring 101-120


PLC Package Viewer / TURN118_ENGINEERING_CLOSEOUT_CHECKLIST_REVIEW_ONLY_V1

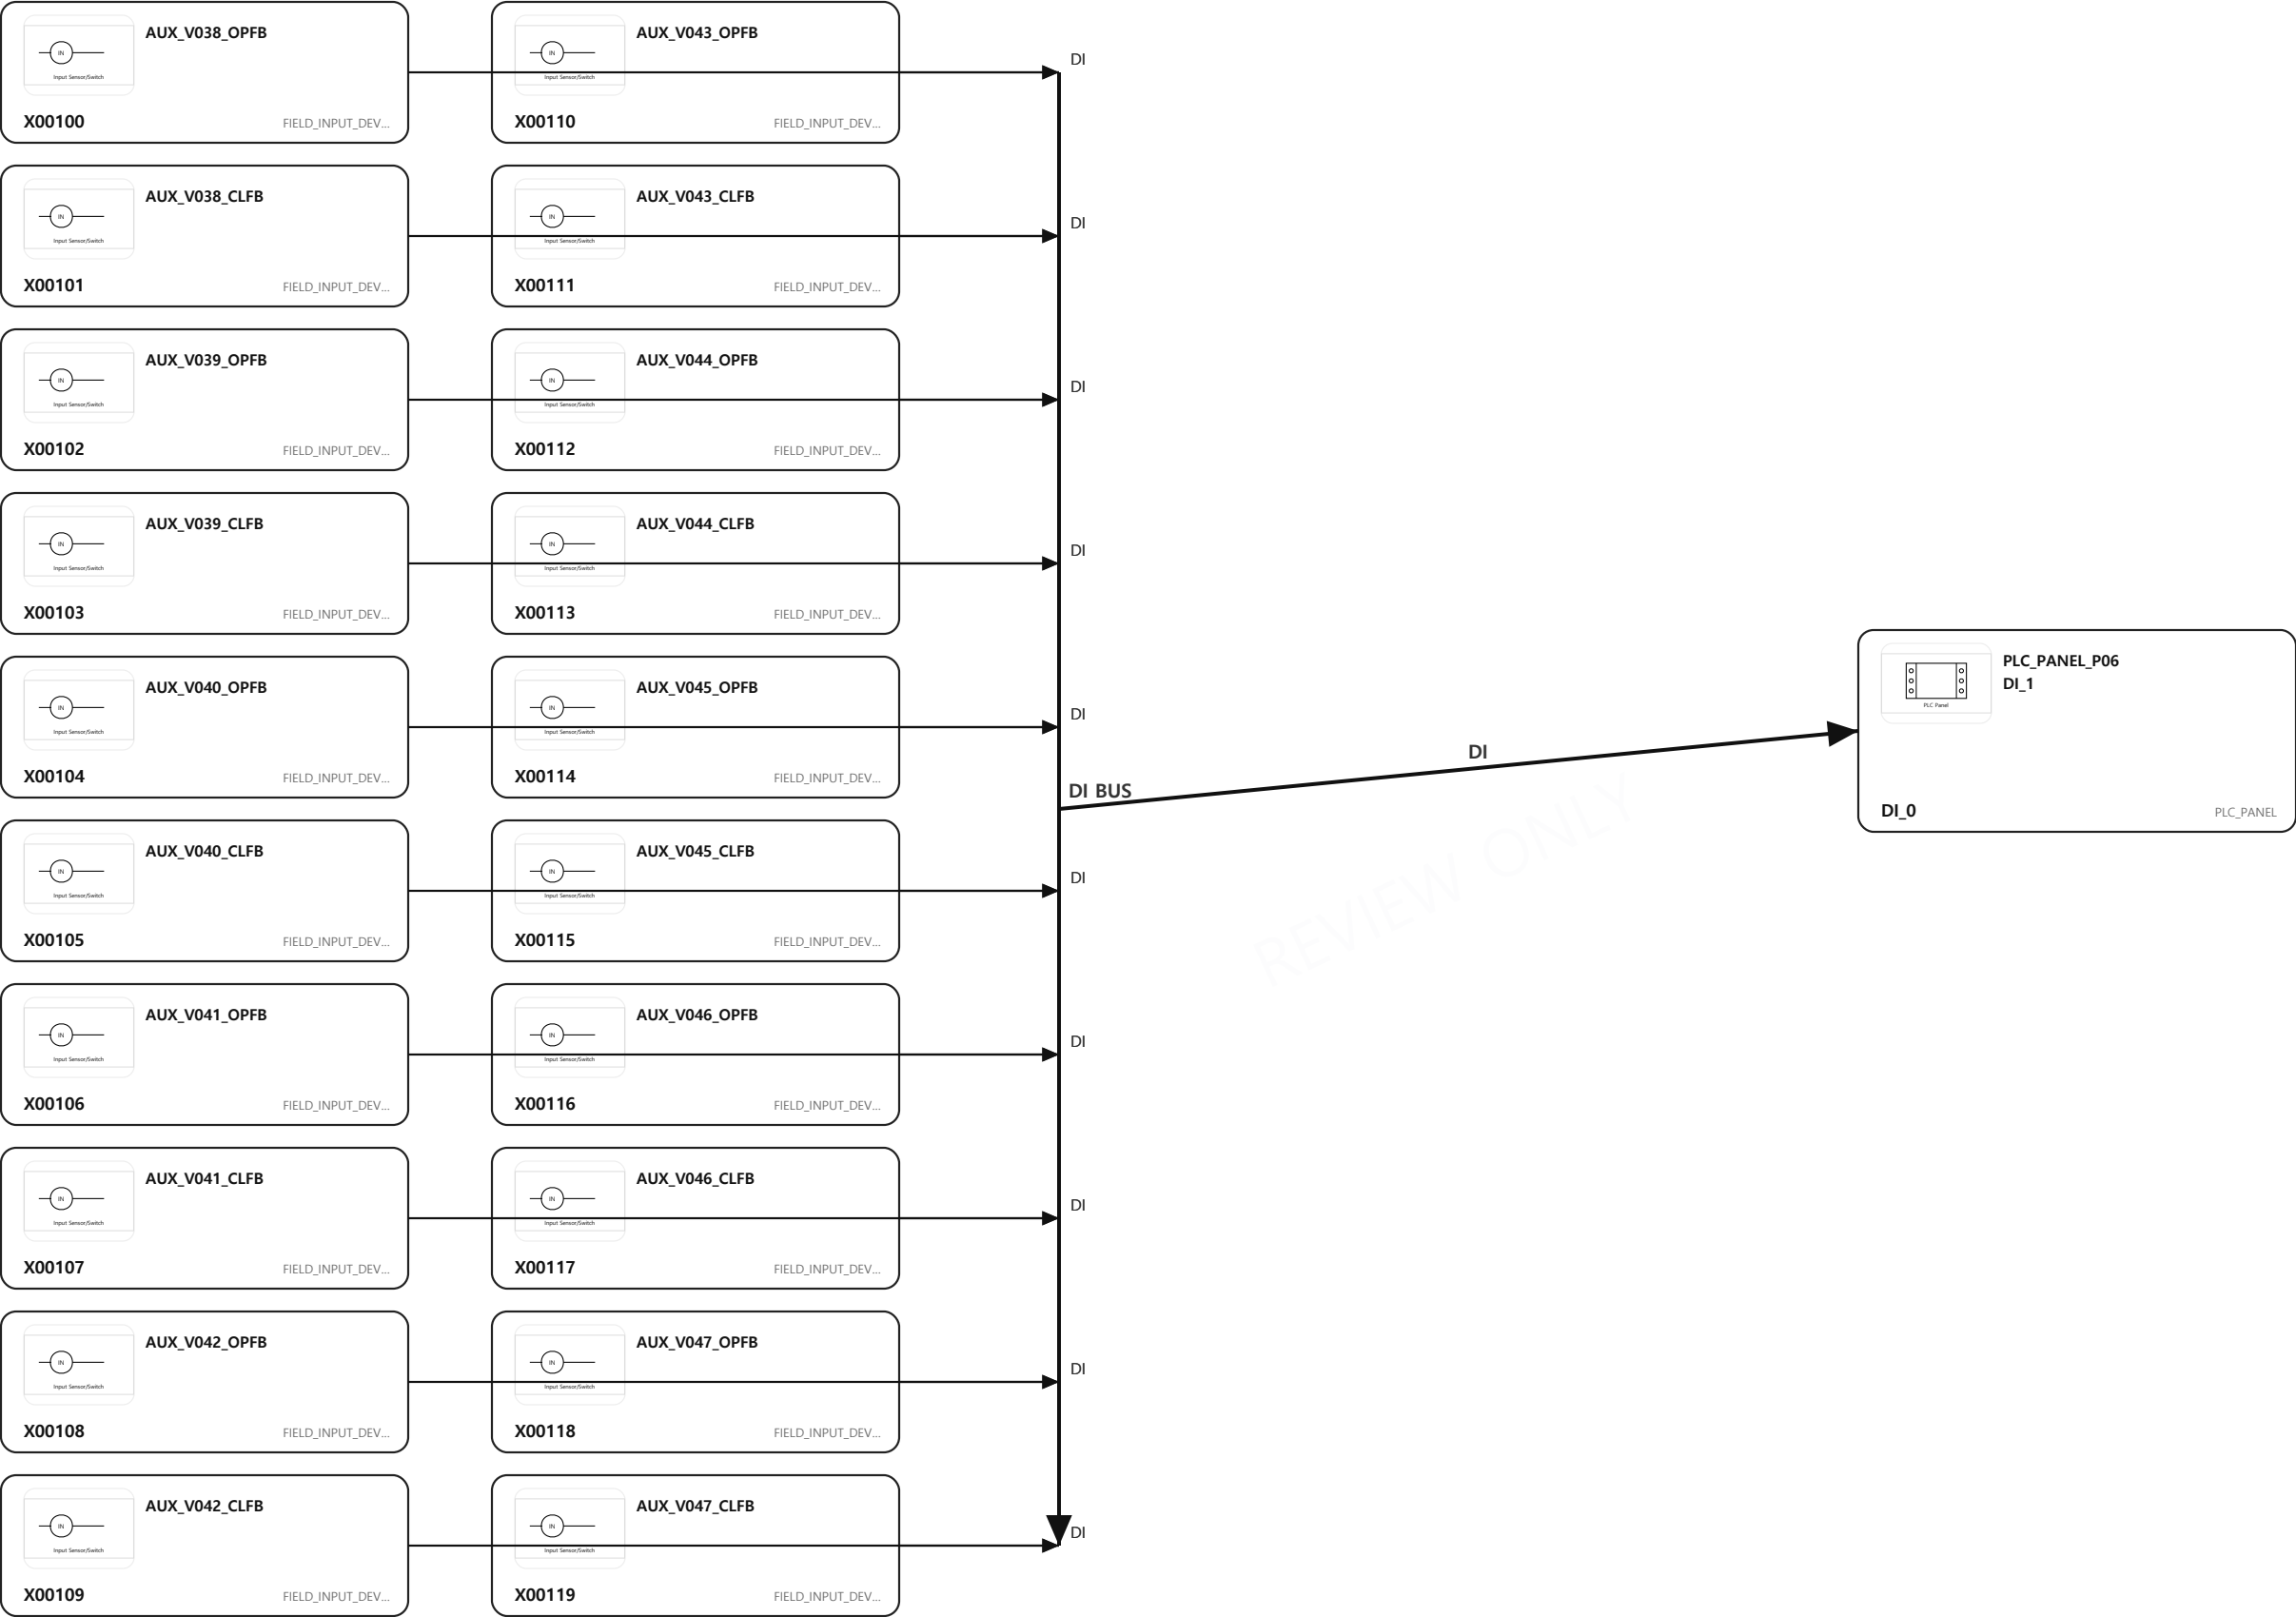

TITLE	DI Wiring 101-120
DRAWING NO	P06_DI_101_120
CASE	PLC-20260512-TYPE4-IO500-WW-001
REV / STATUS	A / REVIEW ONLY
GENERATED	2026-05-14 14:21

DI Wiring 121-140


PLC Package Viewer / TURN118_ENGINEERING_CLOSEOUT_CHECKLIST_REVIEW_ONLY_V1

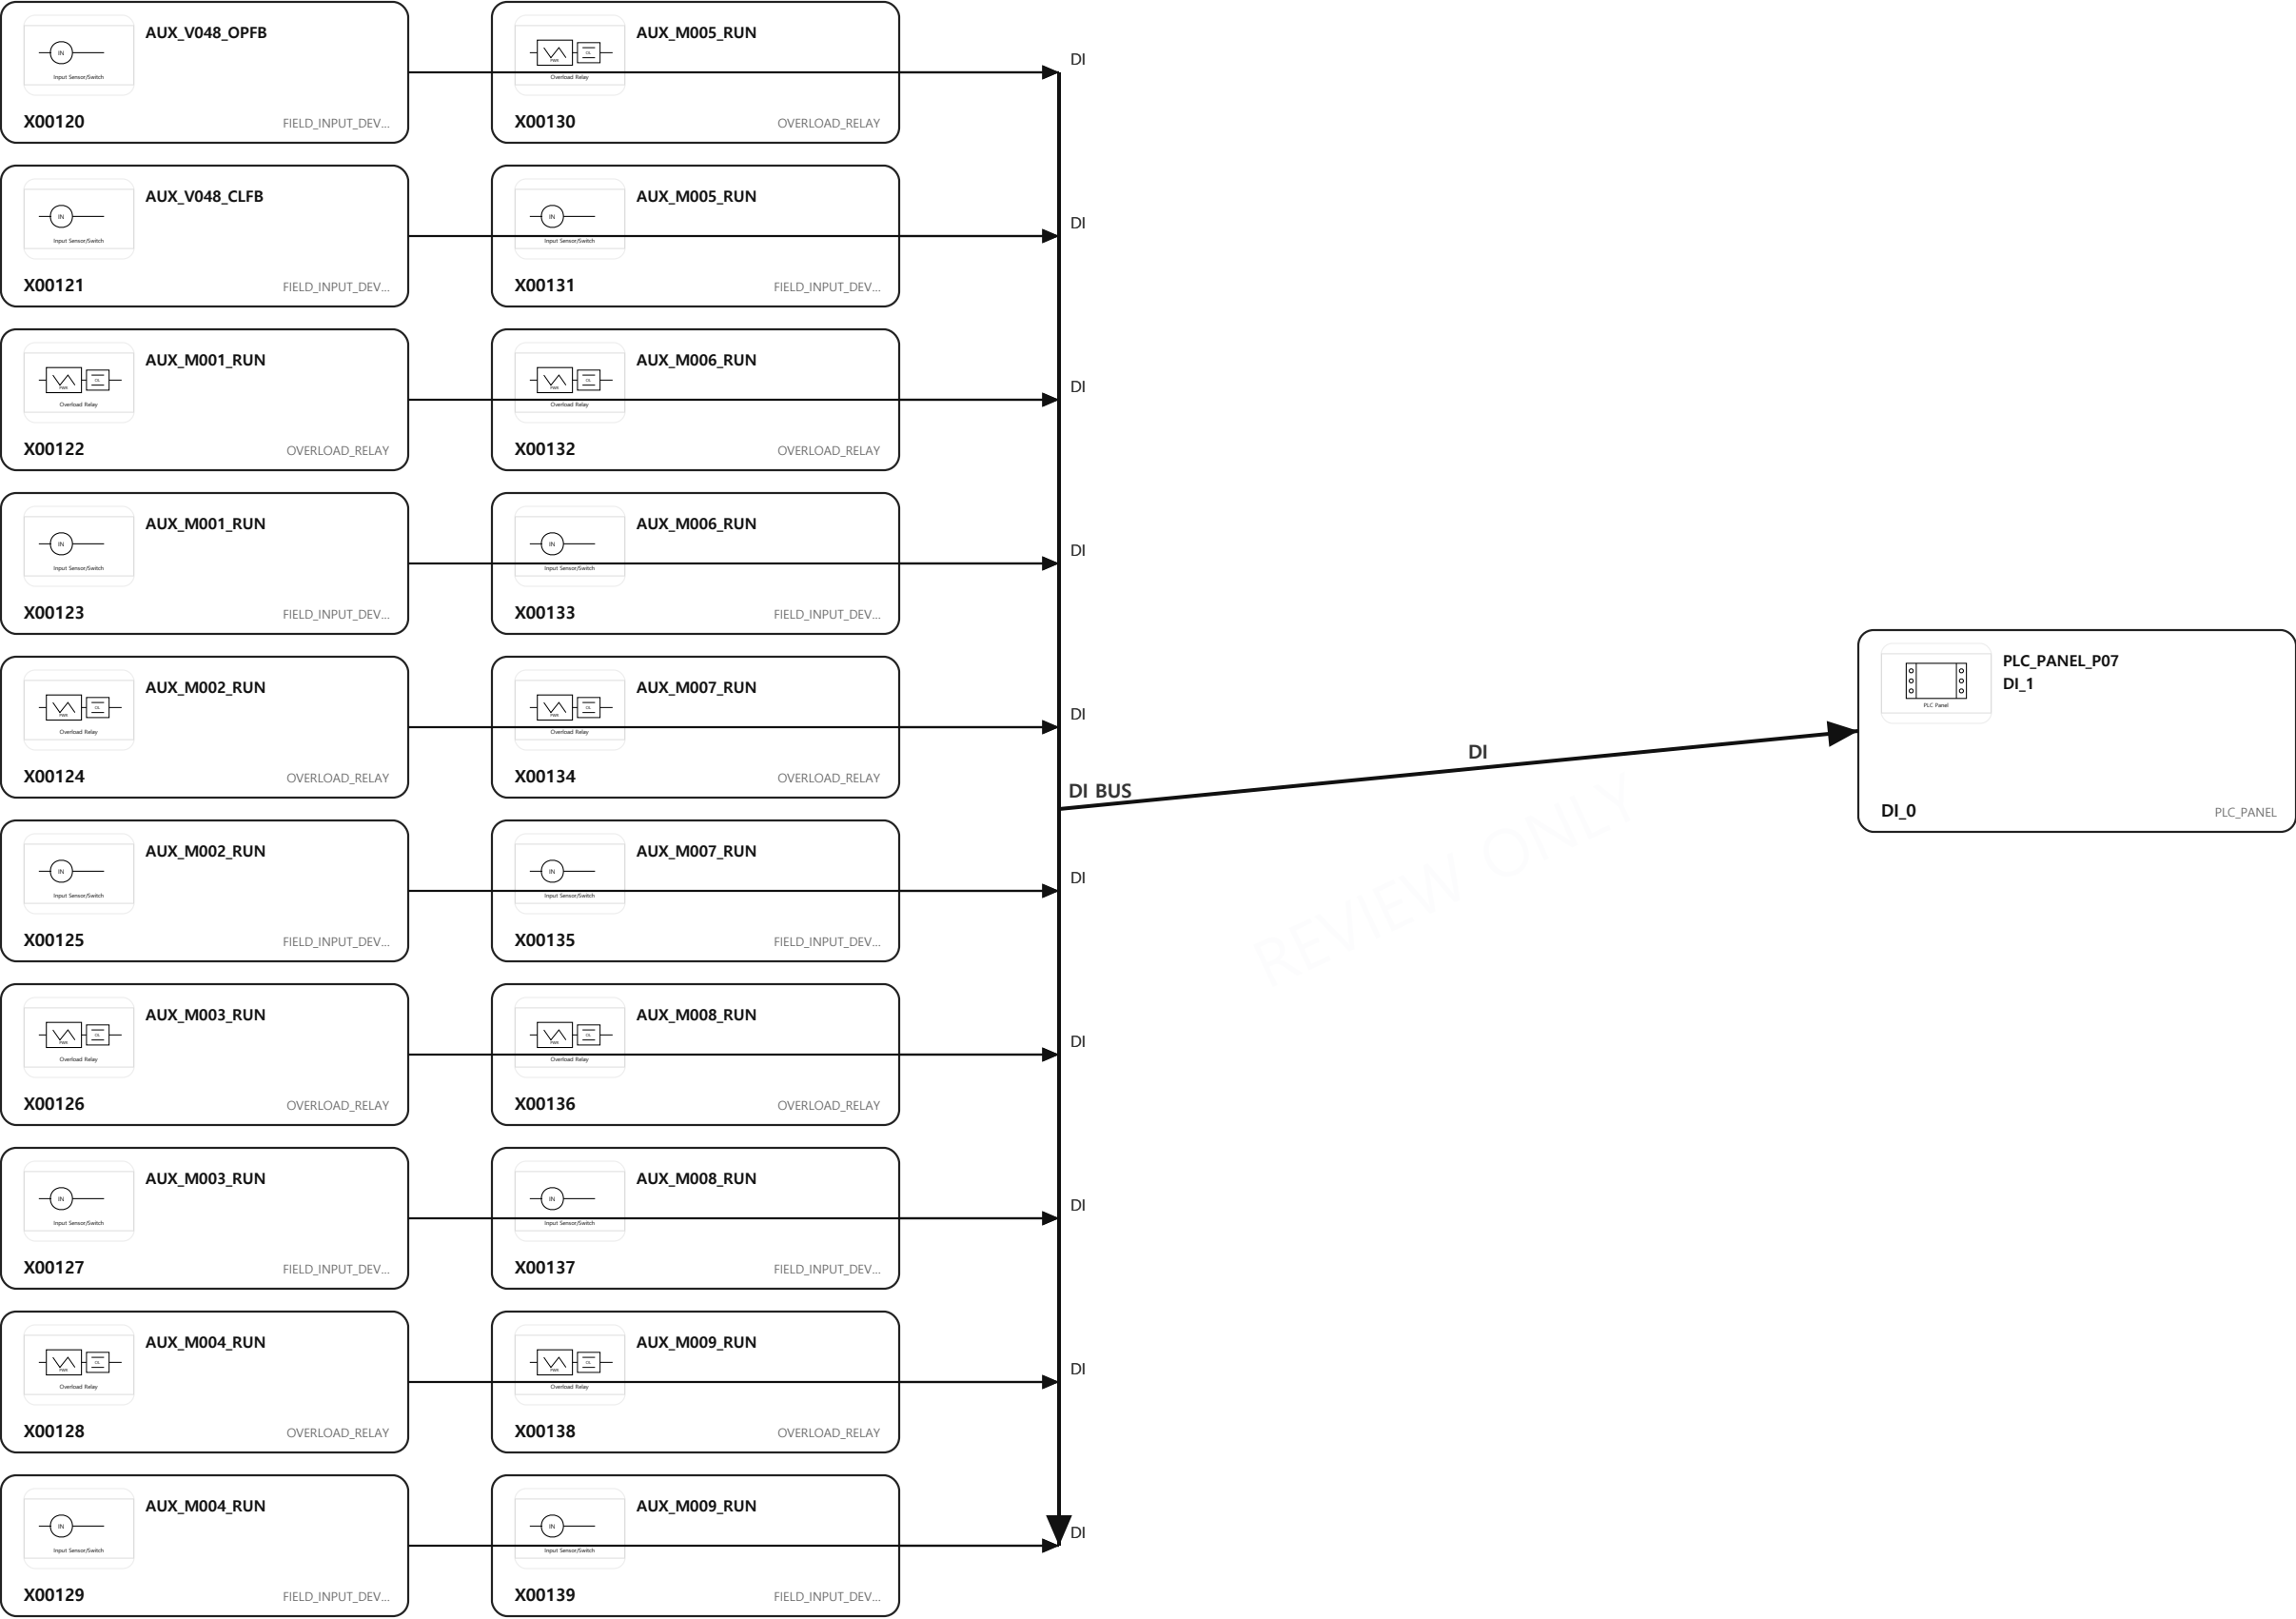

TITLE	DI Wiring 121-140
DRAWING NO	P07_DI_121_140
CASE	PLC-20260512-TYPE4-IO500-WW-001
REV / STATUS	A / REVIEW ONLY
GENERATED	2026-05-14 14:21

DI Wiring 141-160


PLC Package Viewer / TURN118_ENGINEERING_CLOSEOUT_CHECKLIST_REVIEW_ONLY_V1

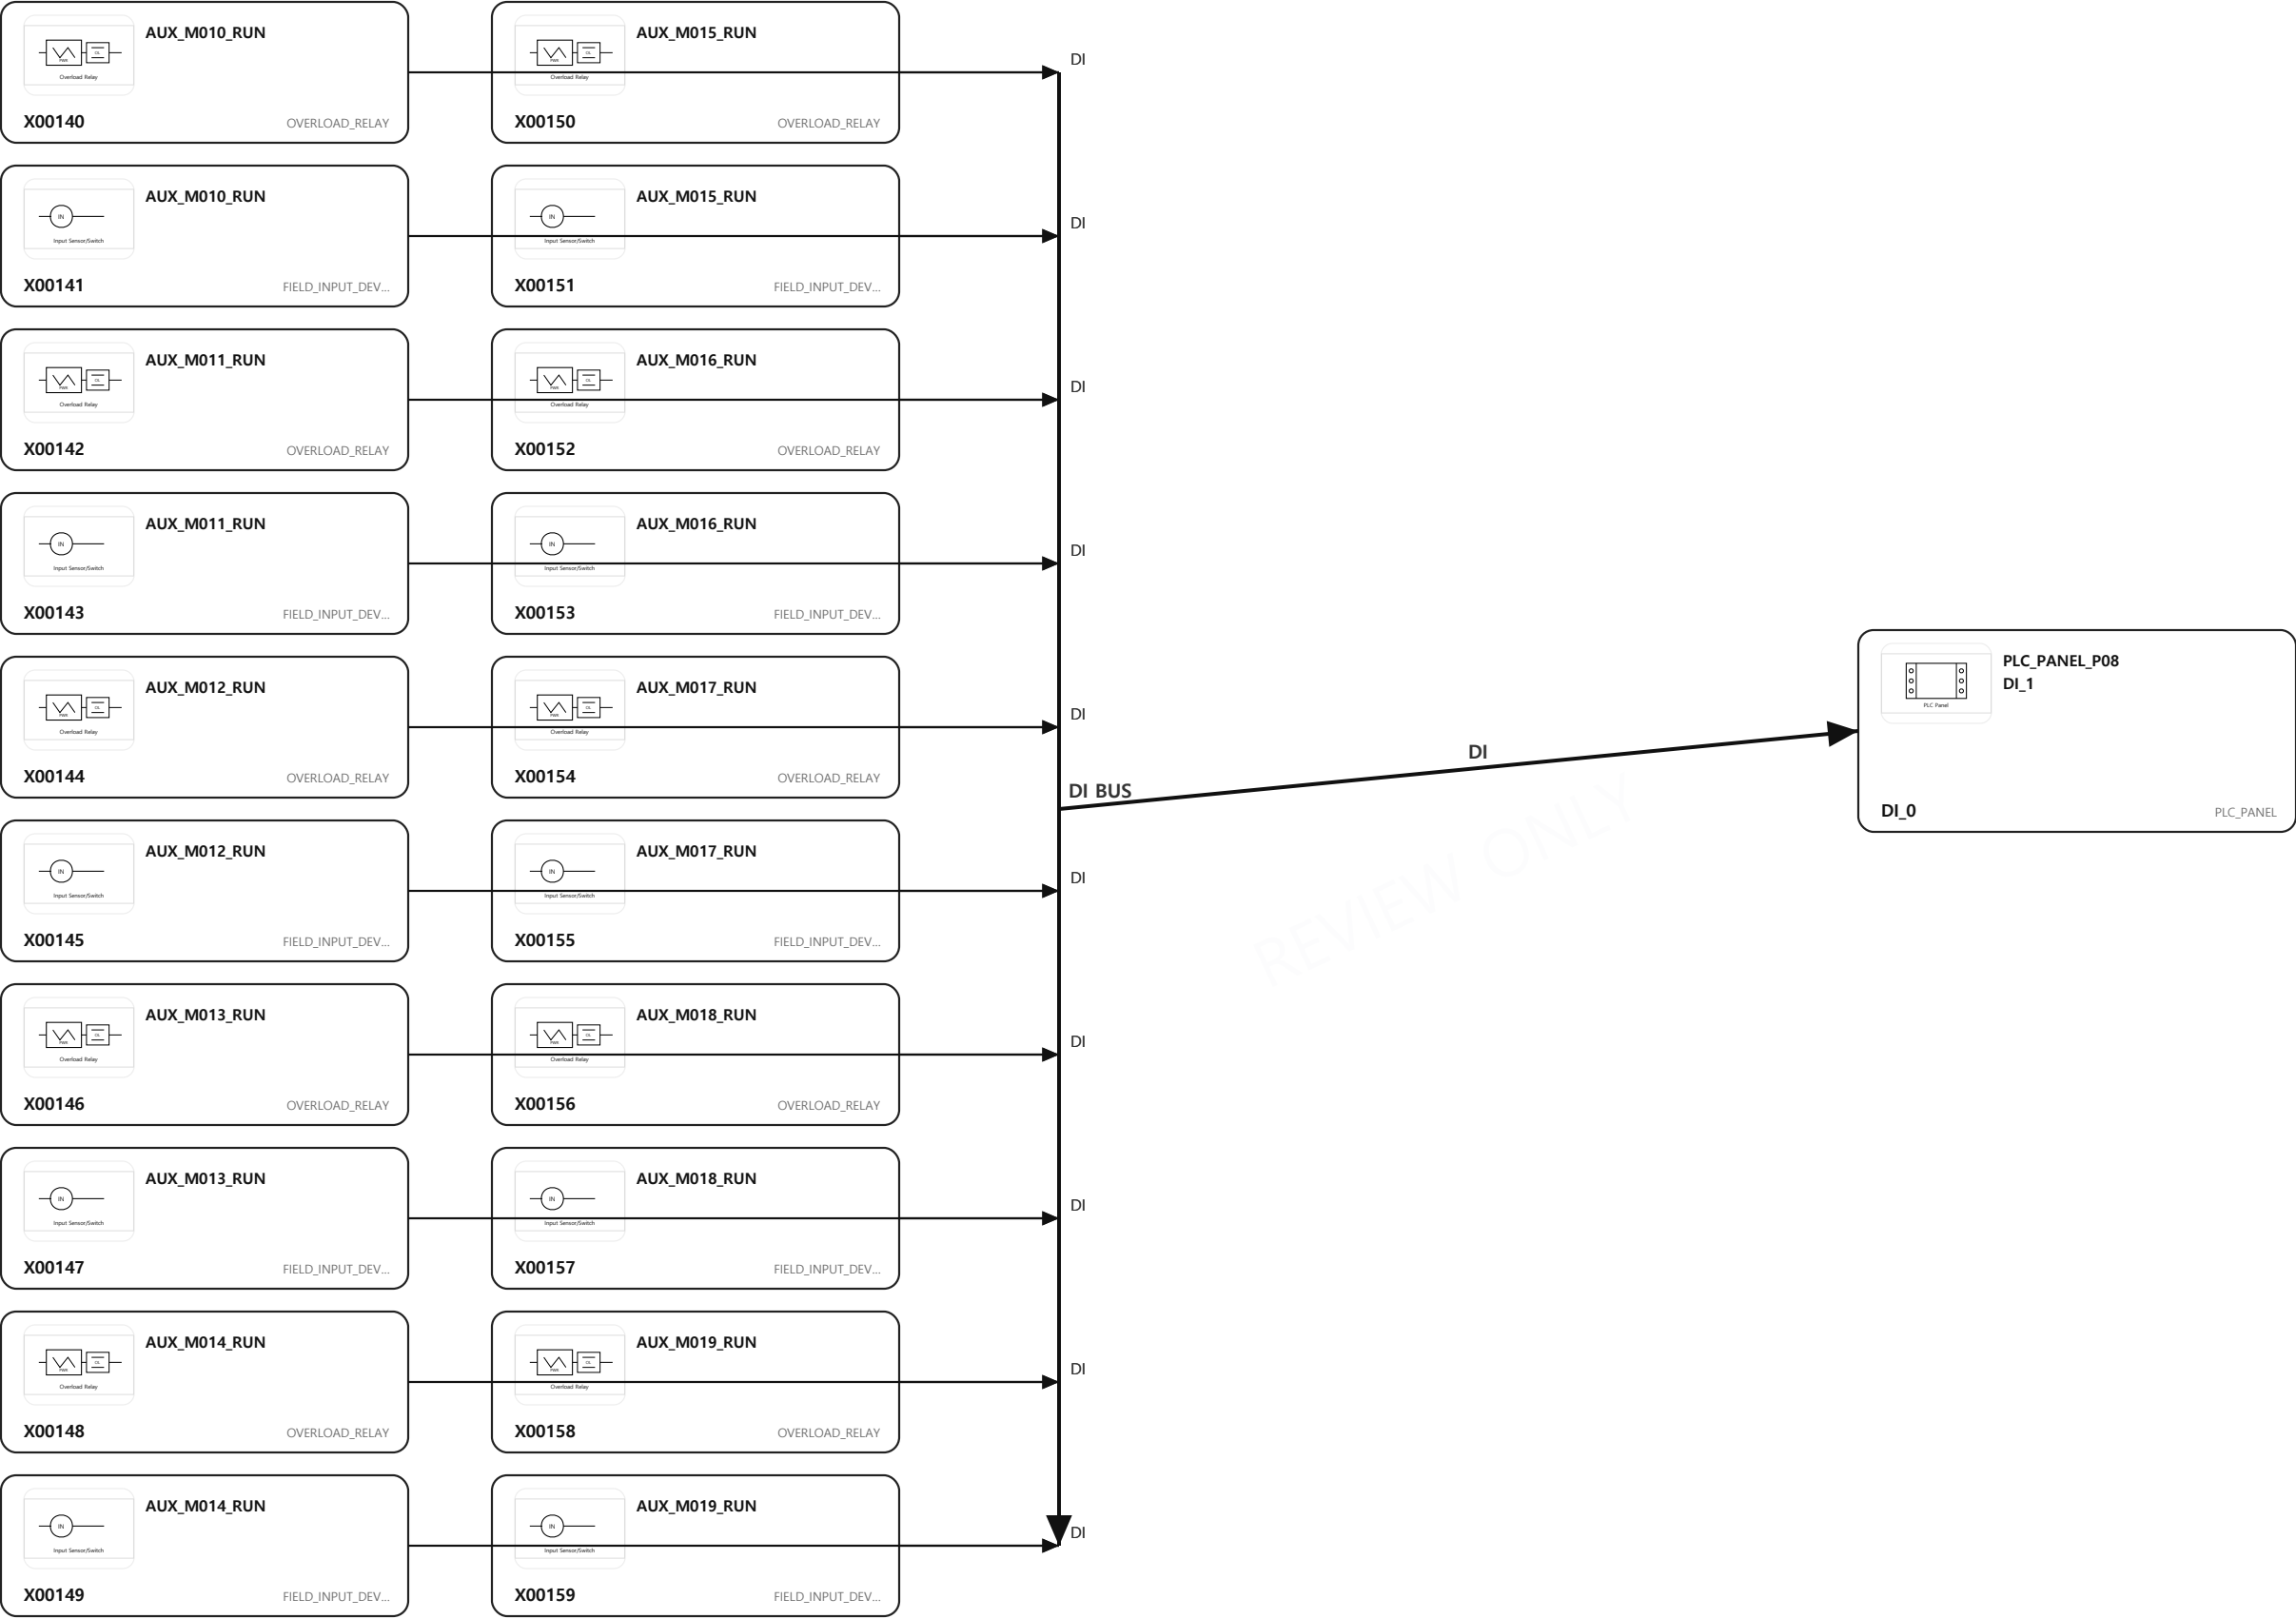

TITLE	DI Wiring 141-160
DRAWING NO	P08_DI_141_160
CASE	PLC-20260512-TYPE4-IO500-WW-001
REV / STATUS	A / REVIEW ONLY
GENERATED	2026-05-14 14:21

DI Wiring 161-180


PLC Package Viewer / TURN118_ENGINEERING_CLOSEOUT_CHECKLIST_REVIEW_ONLY_V1

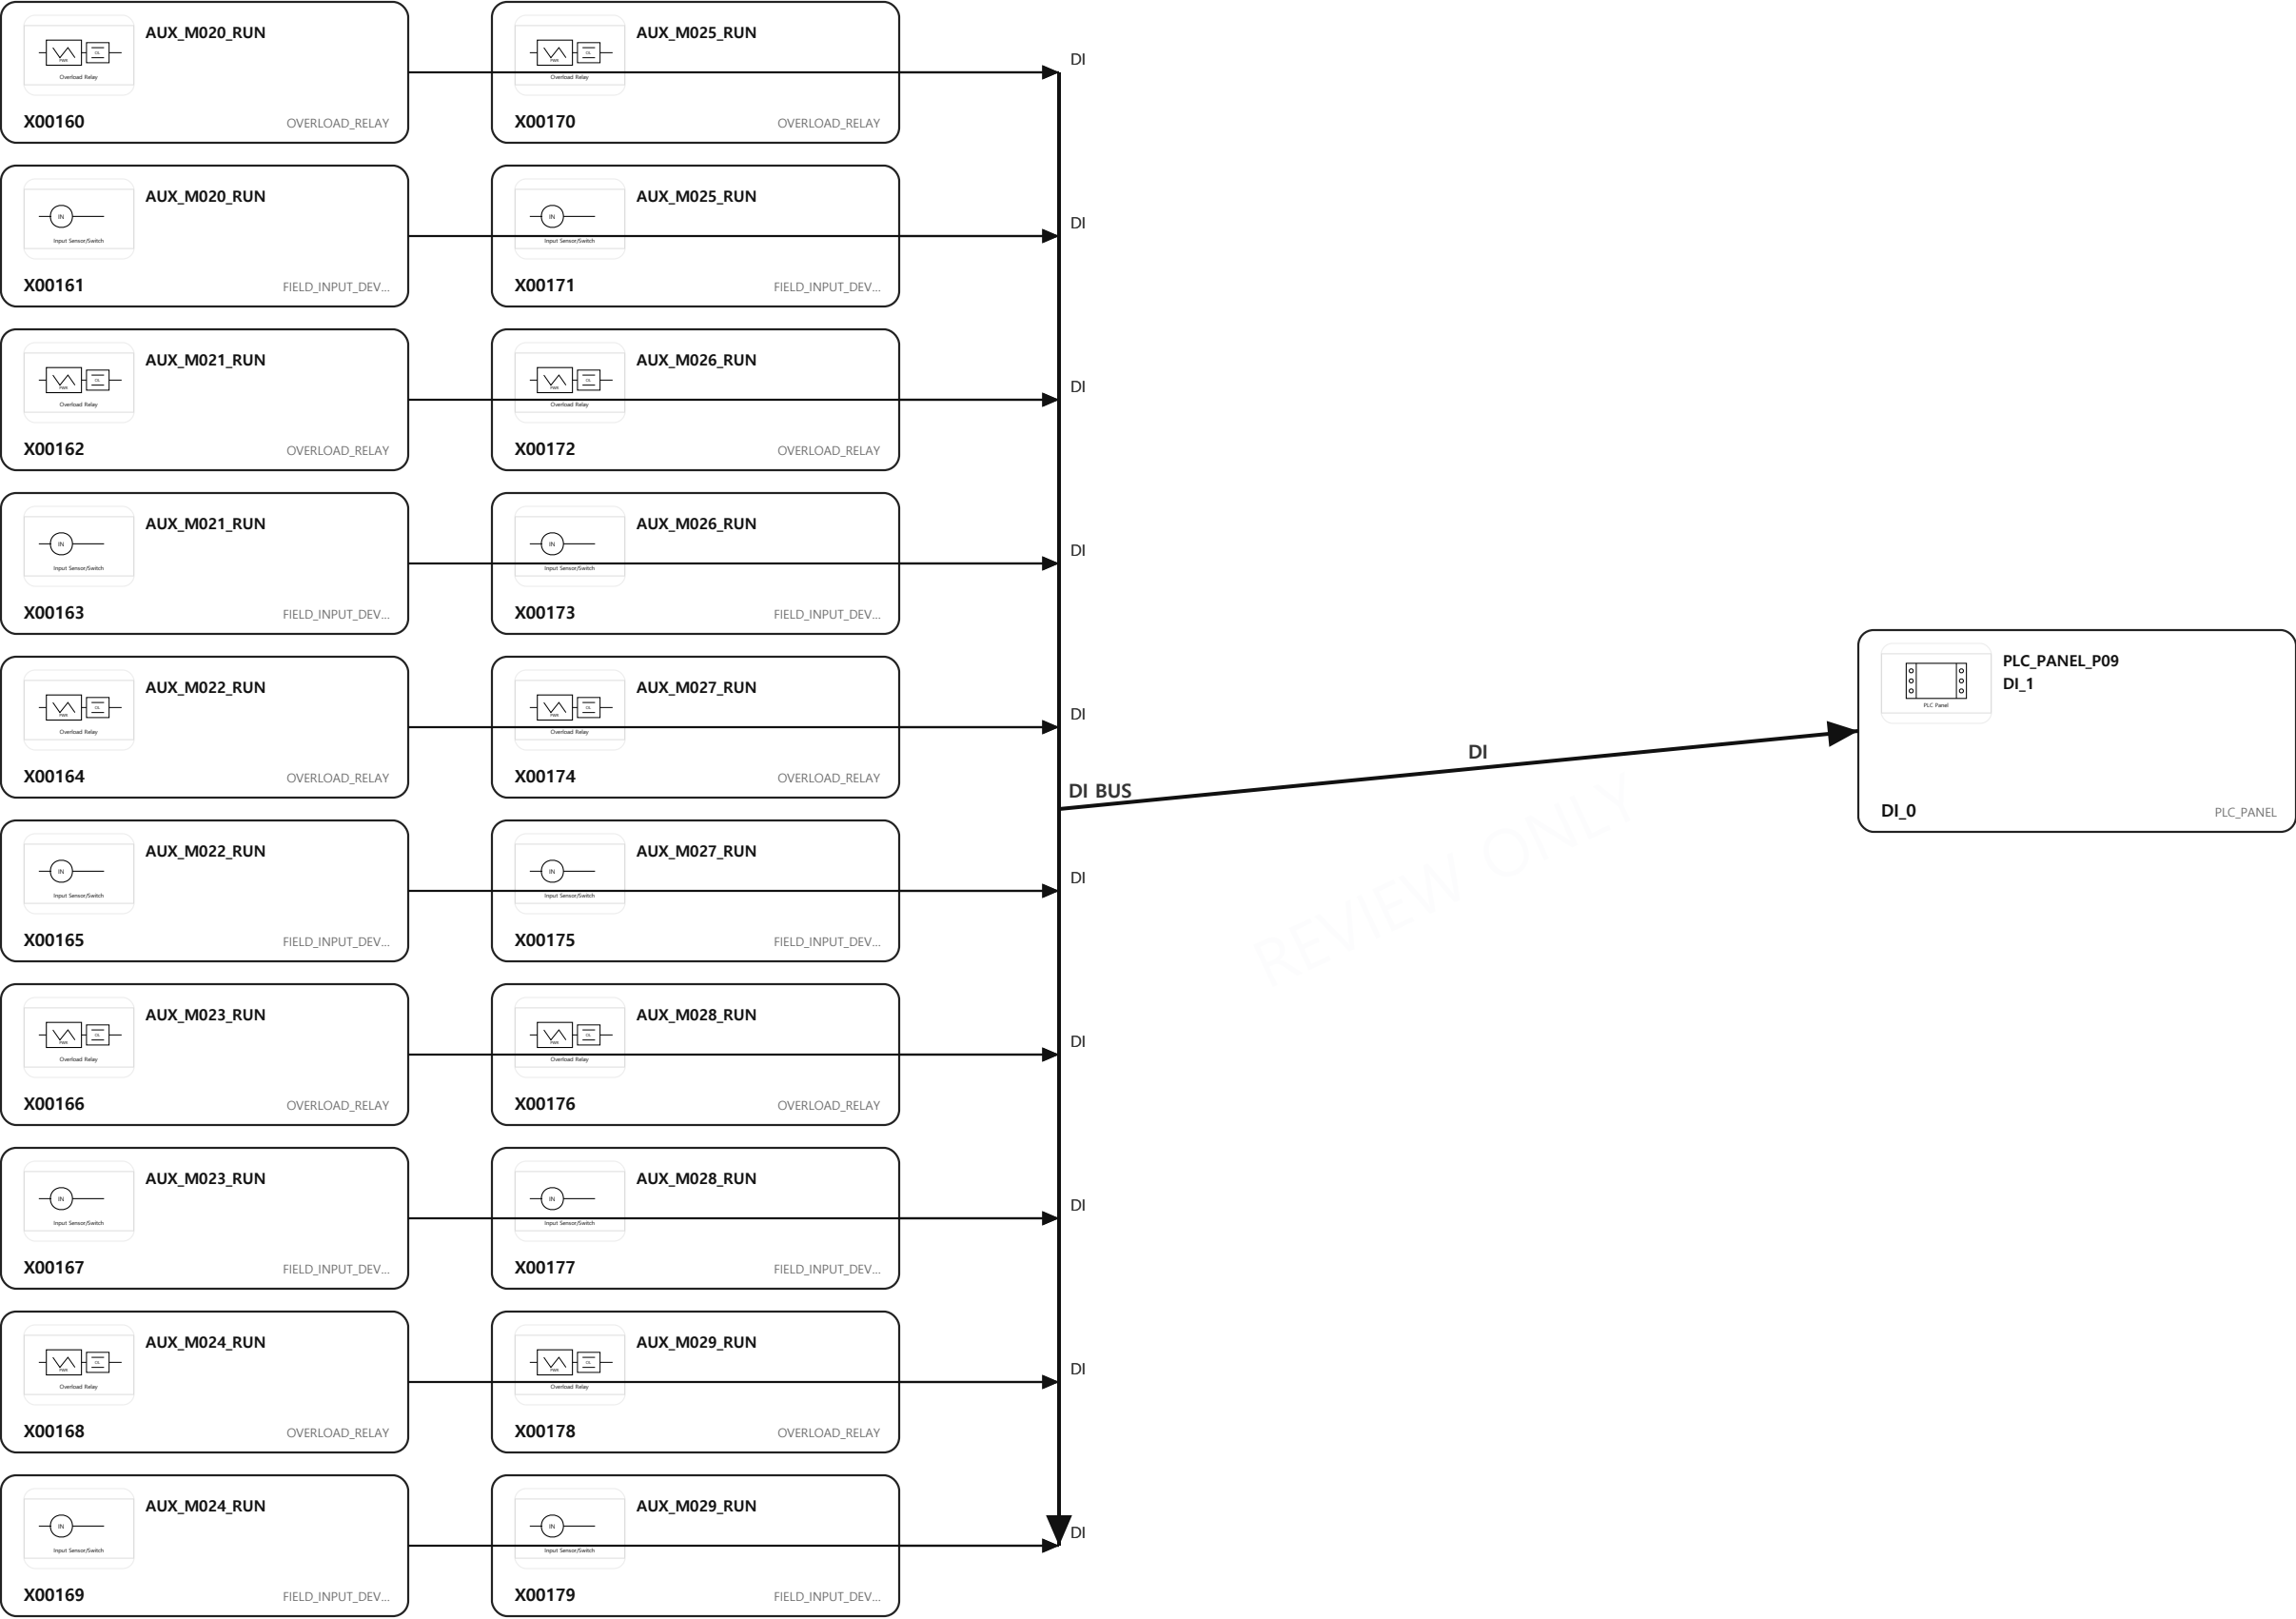

TITLE	DI Wiring 161-180
DRAWING NO	P09_DI_161_180
CASE	PLC-20260512-TYPE4-IO500-WW-001
REV / STATUS	A / REVIEW ONLY
GENERATED	2026-05-14 14:21

DI Wiring 181-200


PLC Package Viewer / TURN118_ENGINEERING_CLOSEOUT_CHECKLIST_REVIEW_ONLY_V1

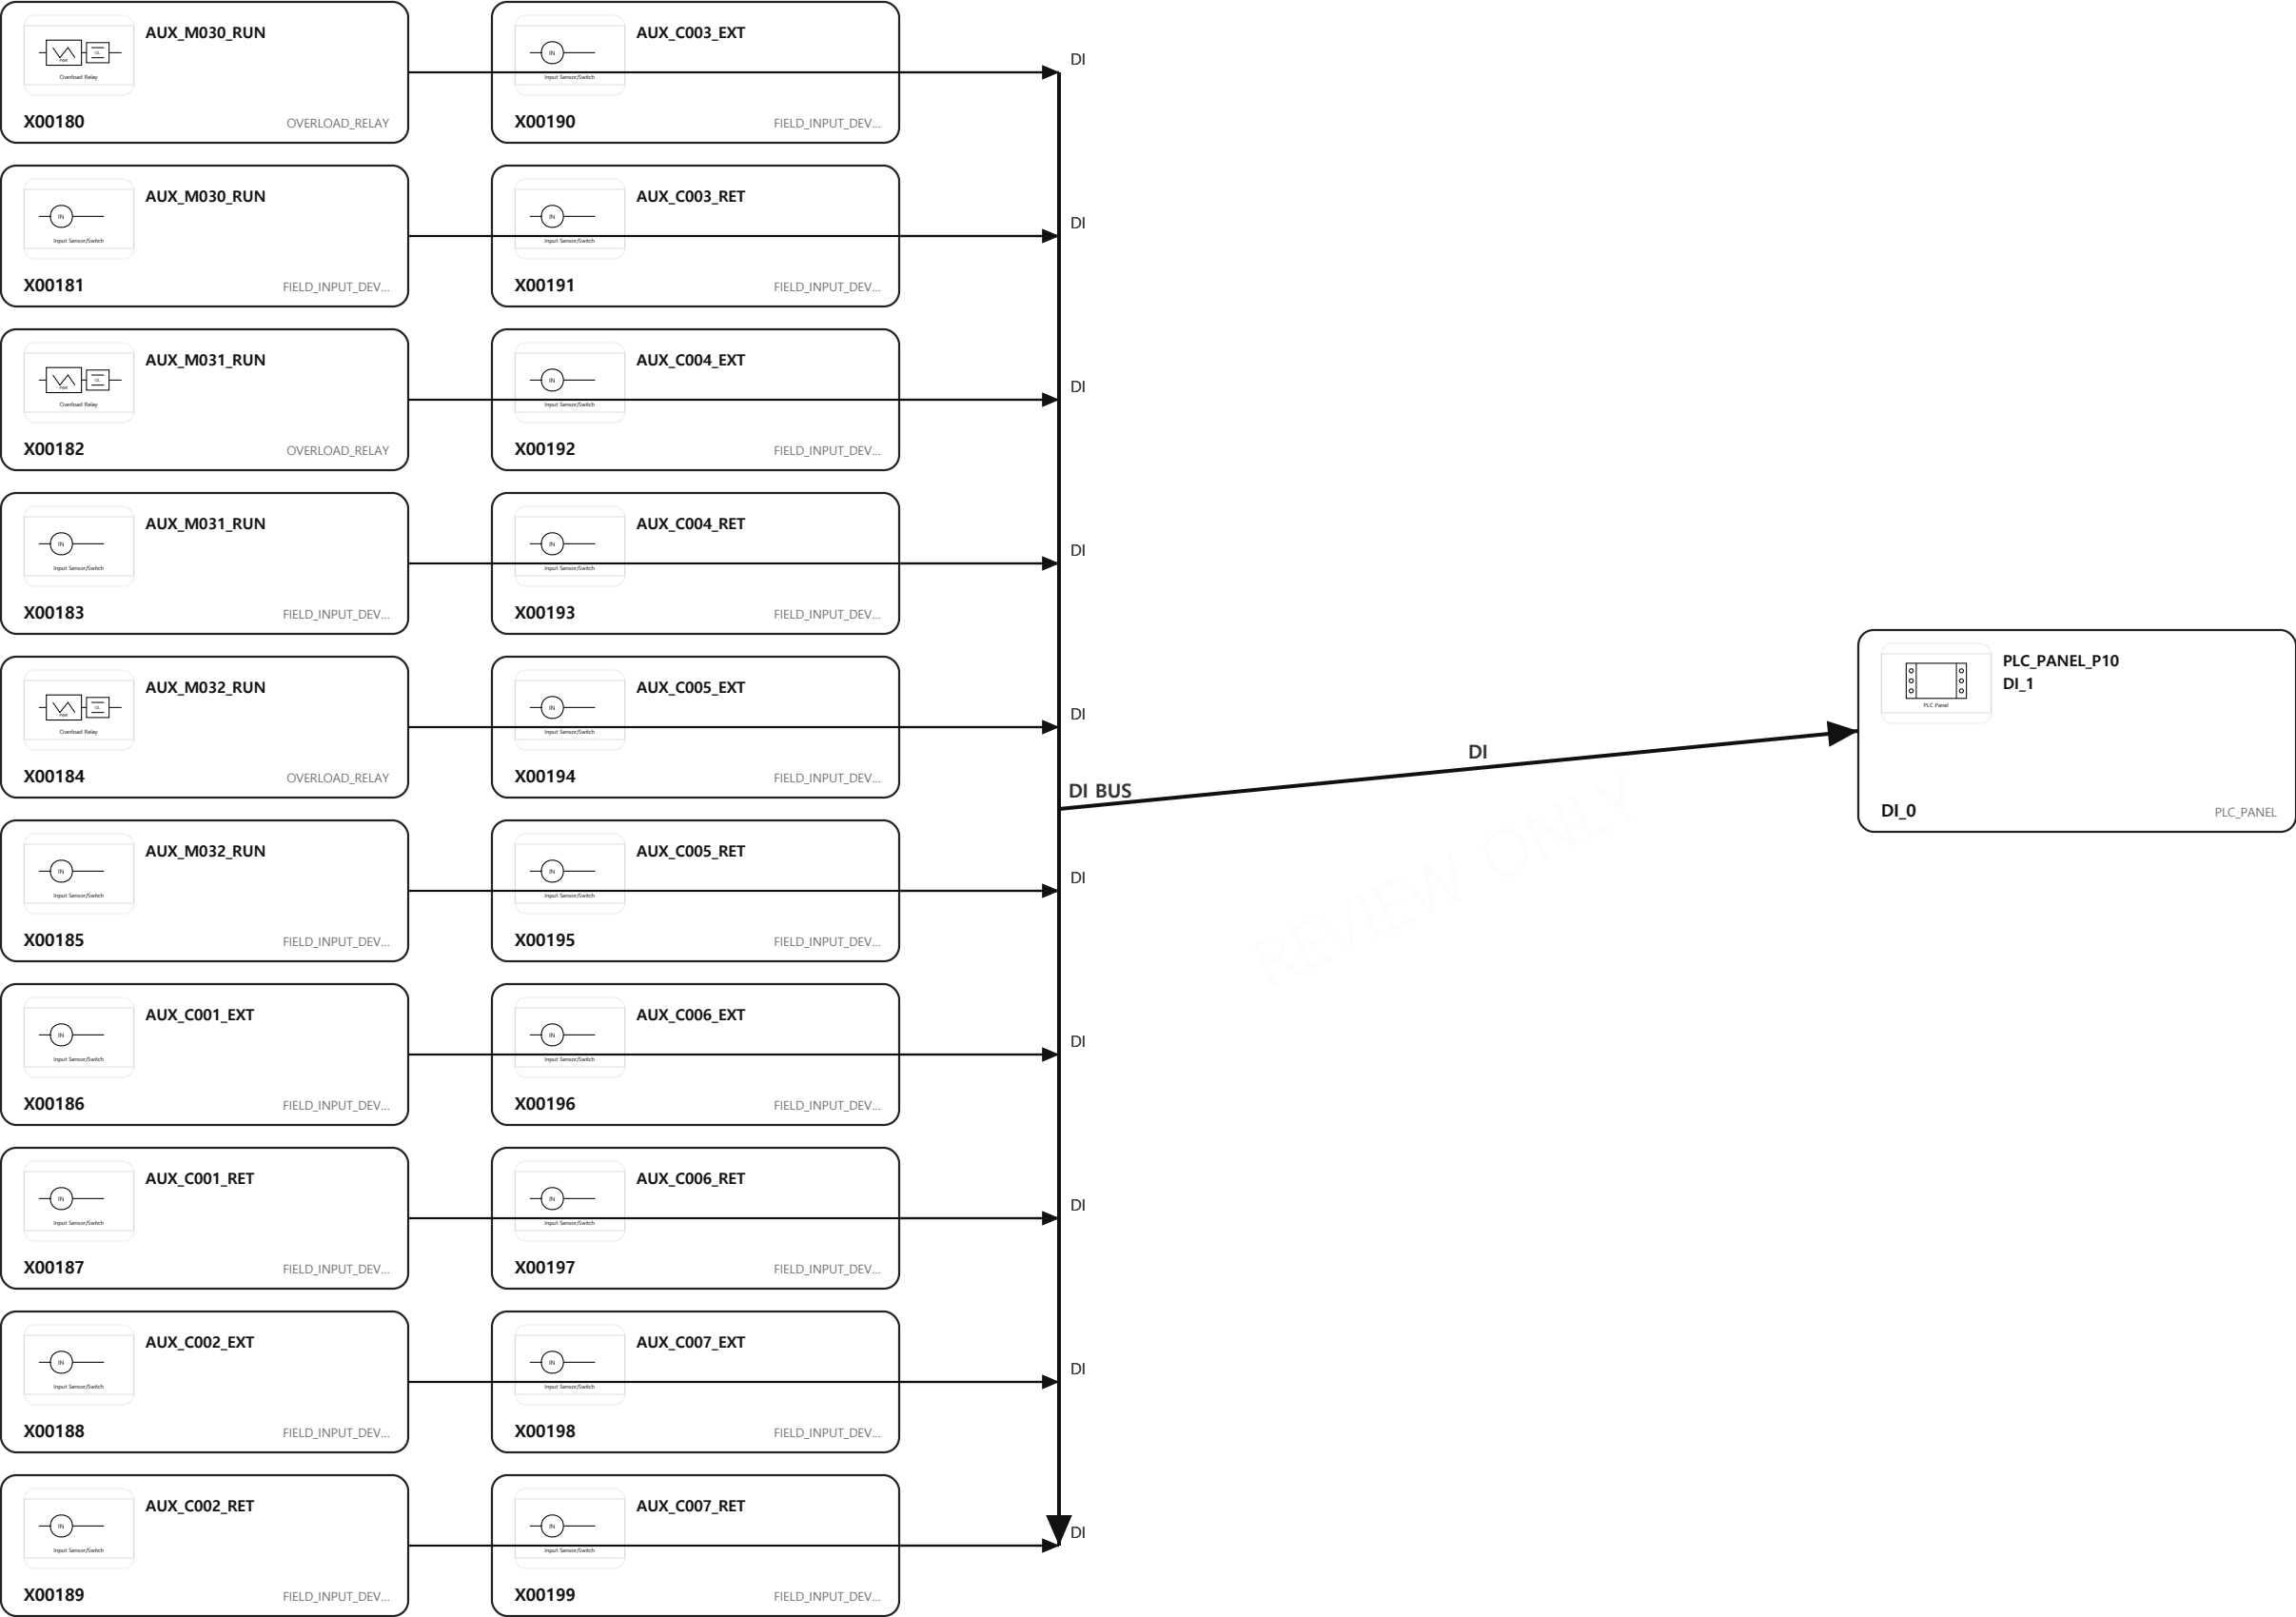

TITLE	DI Wiring 181-200
DRAWING NO	P10_DI_181_200
CASE	PLC-20260512-TYPE4-IO500-WW-001
REV / STATUS	A / REVIEW ONLY
GENERATED	2026-05-14 14:21

DI Wiring 201-220


PLC Package Viewer / TURN118_ENGINEERING_CLOSEOUT_CHECKLIST_REVIEW_ONLY_V1

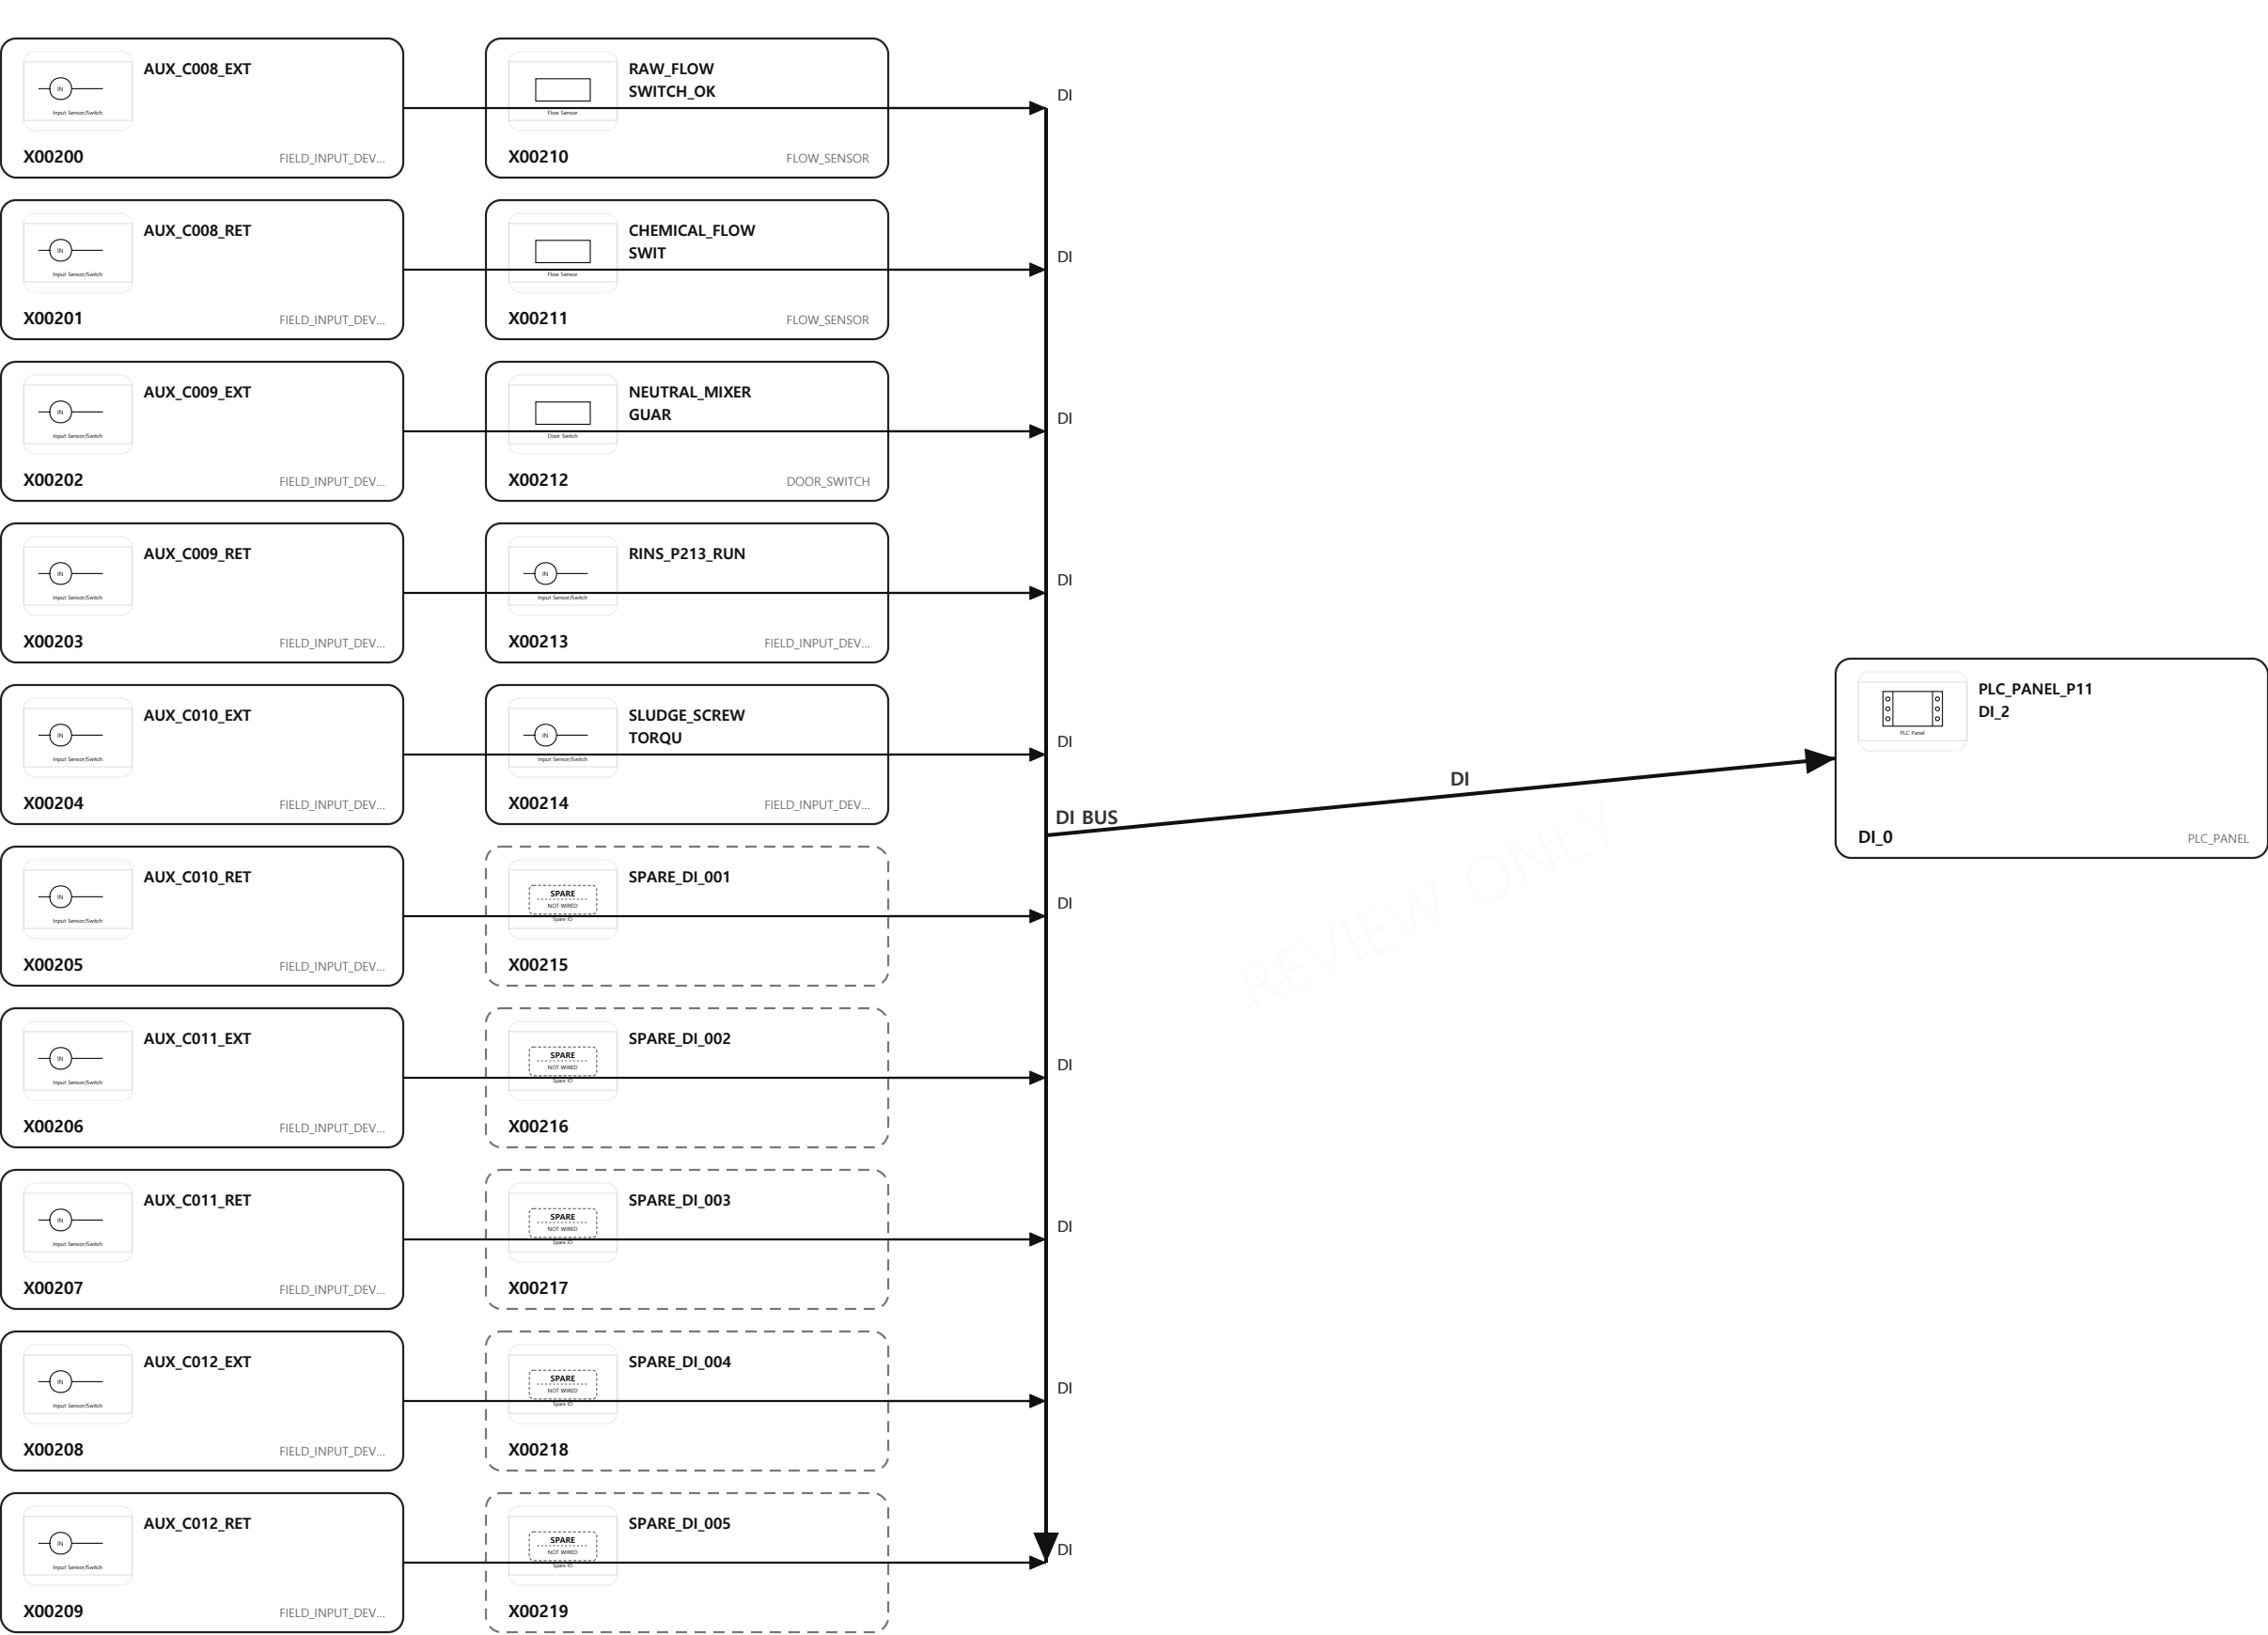

TITLE	DI Wiring 201-220
DRAWING NO	P11_DI_201_220
CASE	PLC-20260512-TYPE4-IO500-WW-001
REV / STATUS	A / REVIEW ONLY
GENERATED	2026-05-14 14:21

DI Wiring 221-240

PLC Package Viewer / TURN118_ENGINEERING_CLOSEOUT_CHECKLIST_REVIEW_ONLY_V1

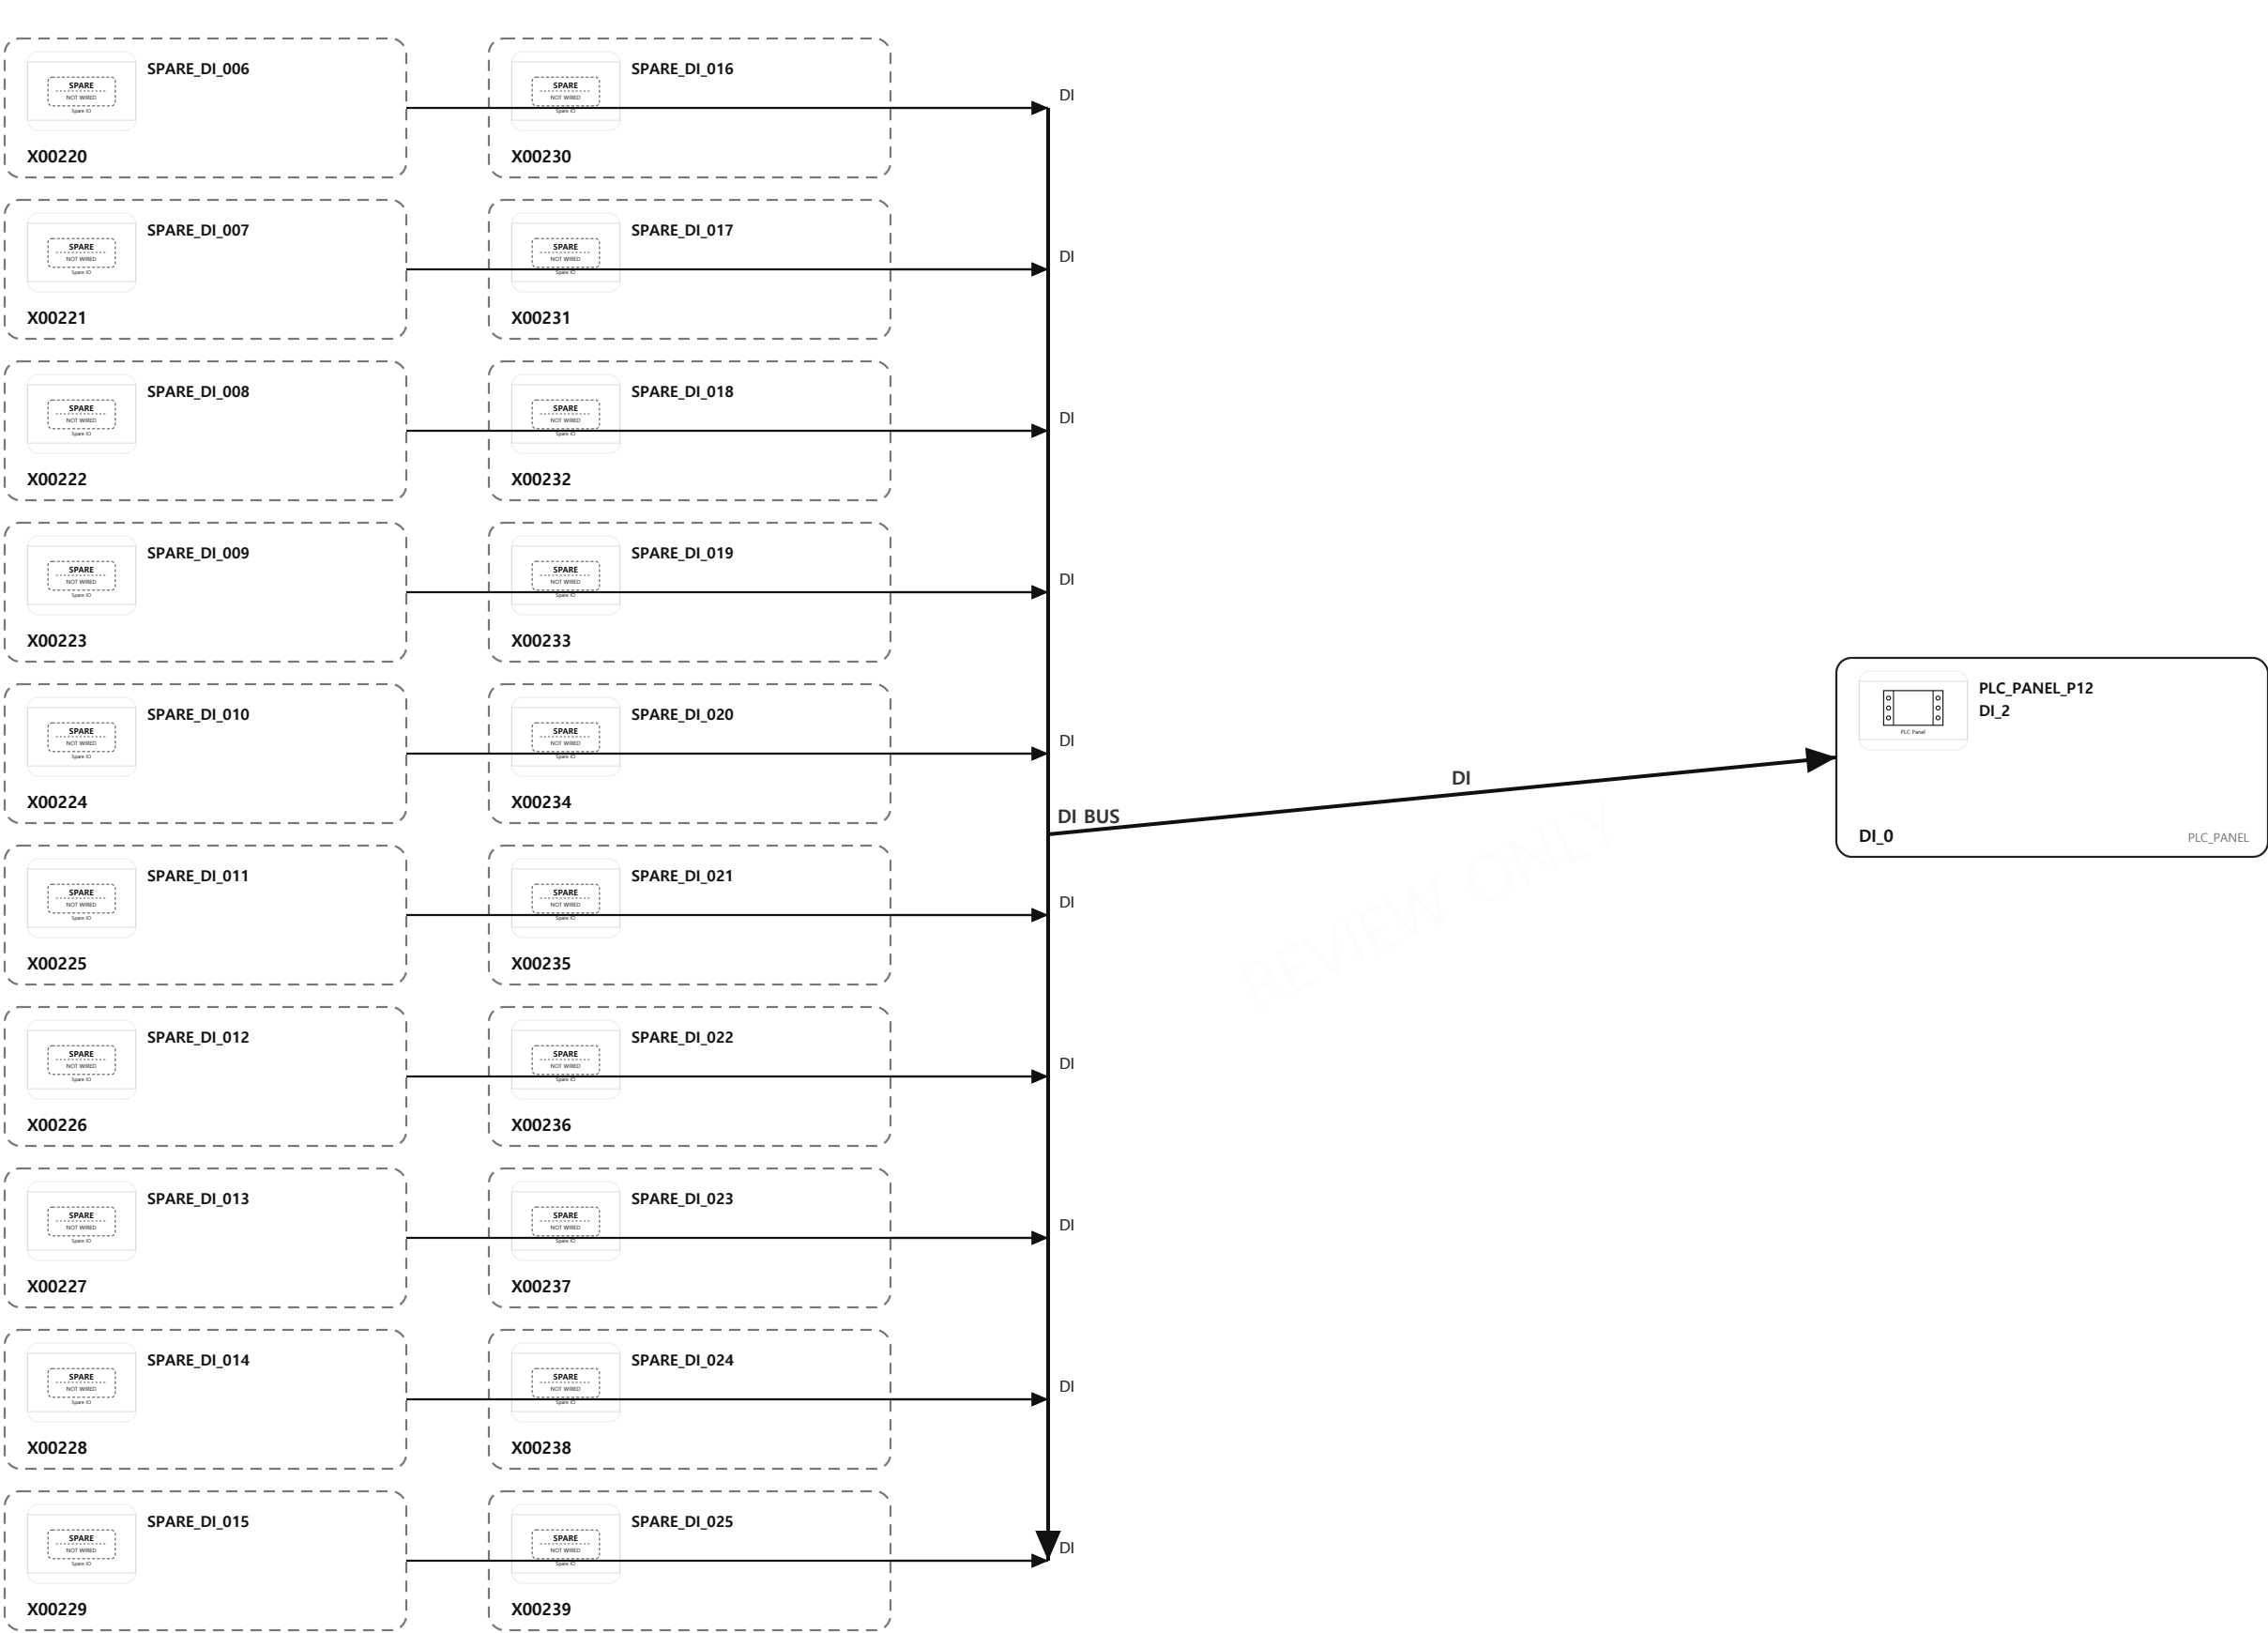


SPARE / NOT WIRED
spare_count=20 / review only

TITLE	DI Wiring 221-240
DRAWING NO	P12_DI_221_240
CASE	PLC-20260512-TYPE4-IO500-WW-001
REV / STATUS	A / REVIEW ONLY
GENERATED	2026-05-14 14:21

DI Wiring 241-260

PLC Package Viewer / TURN118_ENGINEERING_CLOSEOUT_CHECKLIST_REVIEW_ONLY_V1

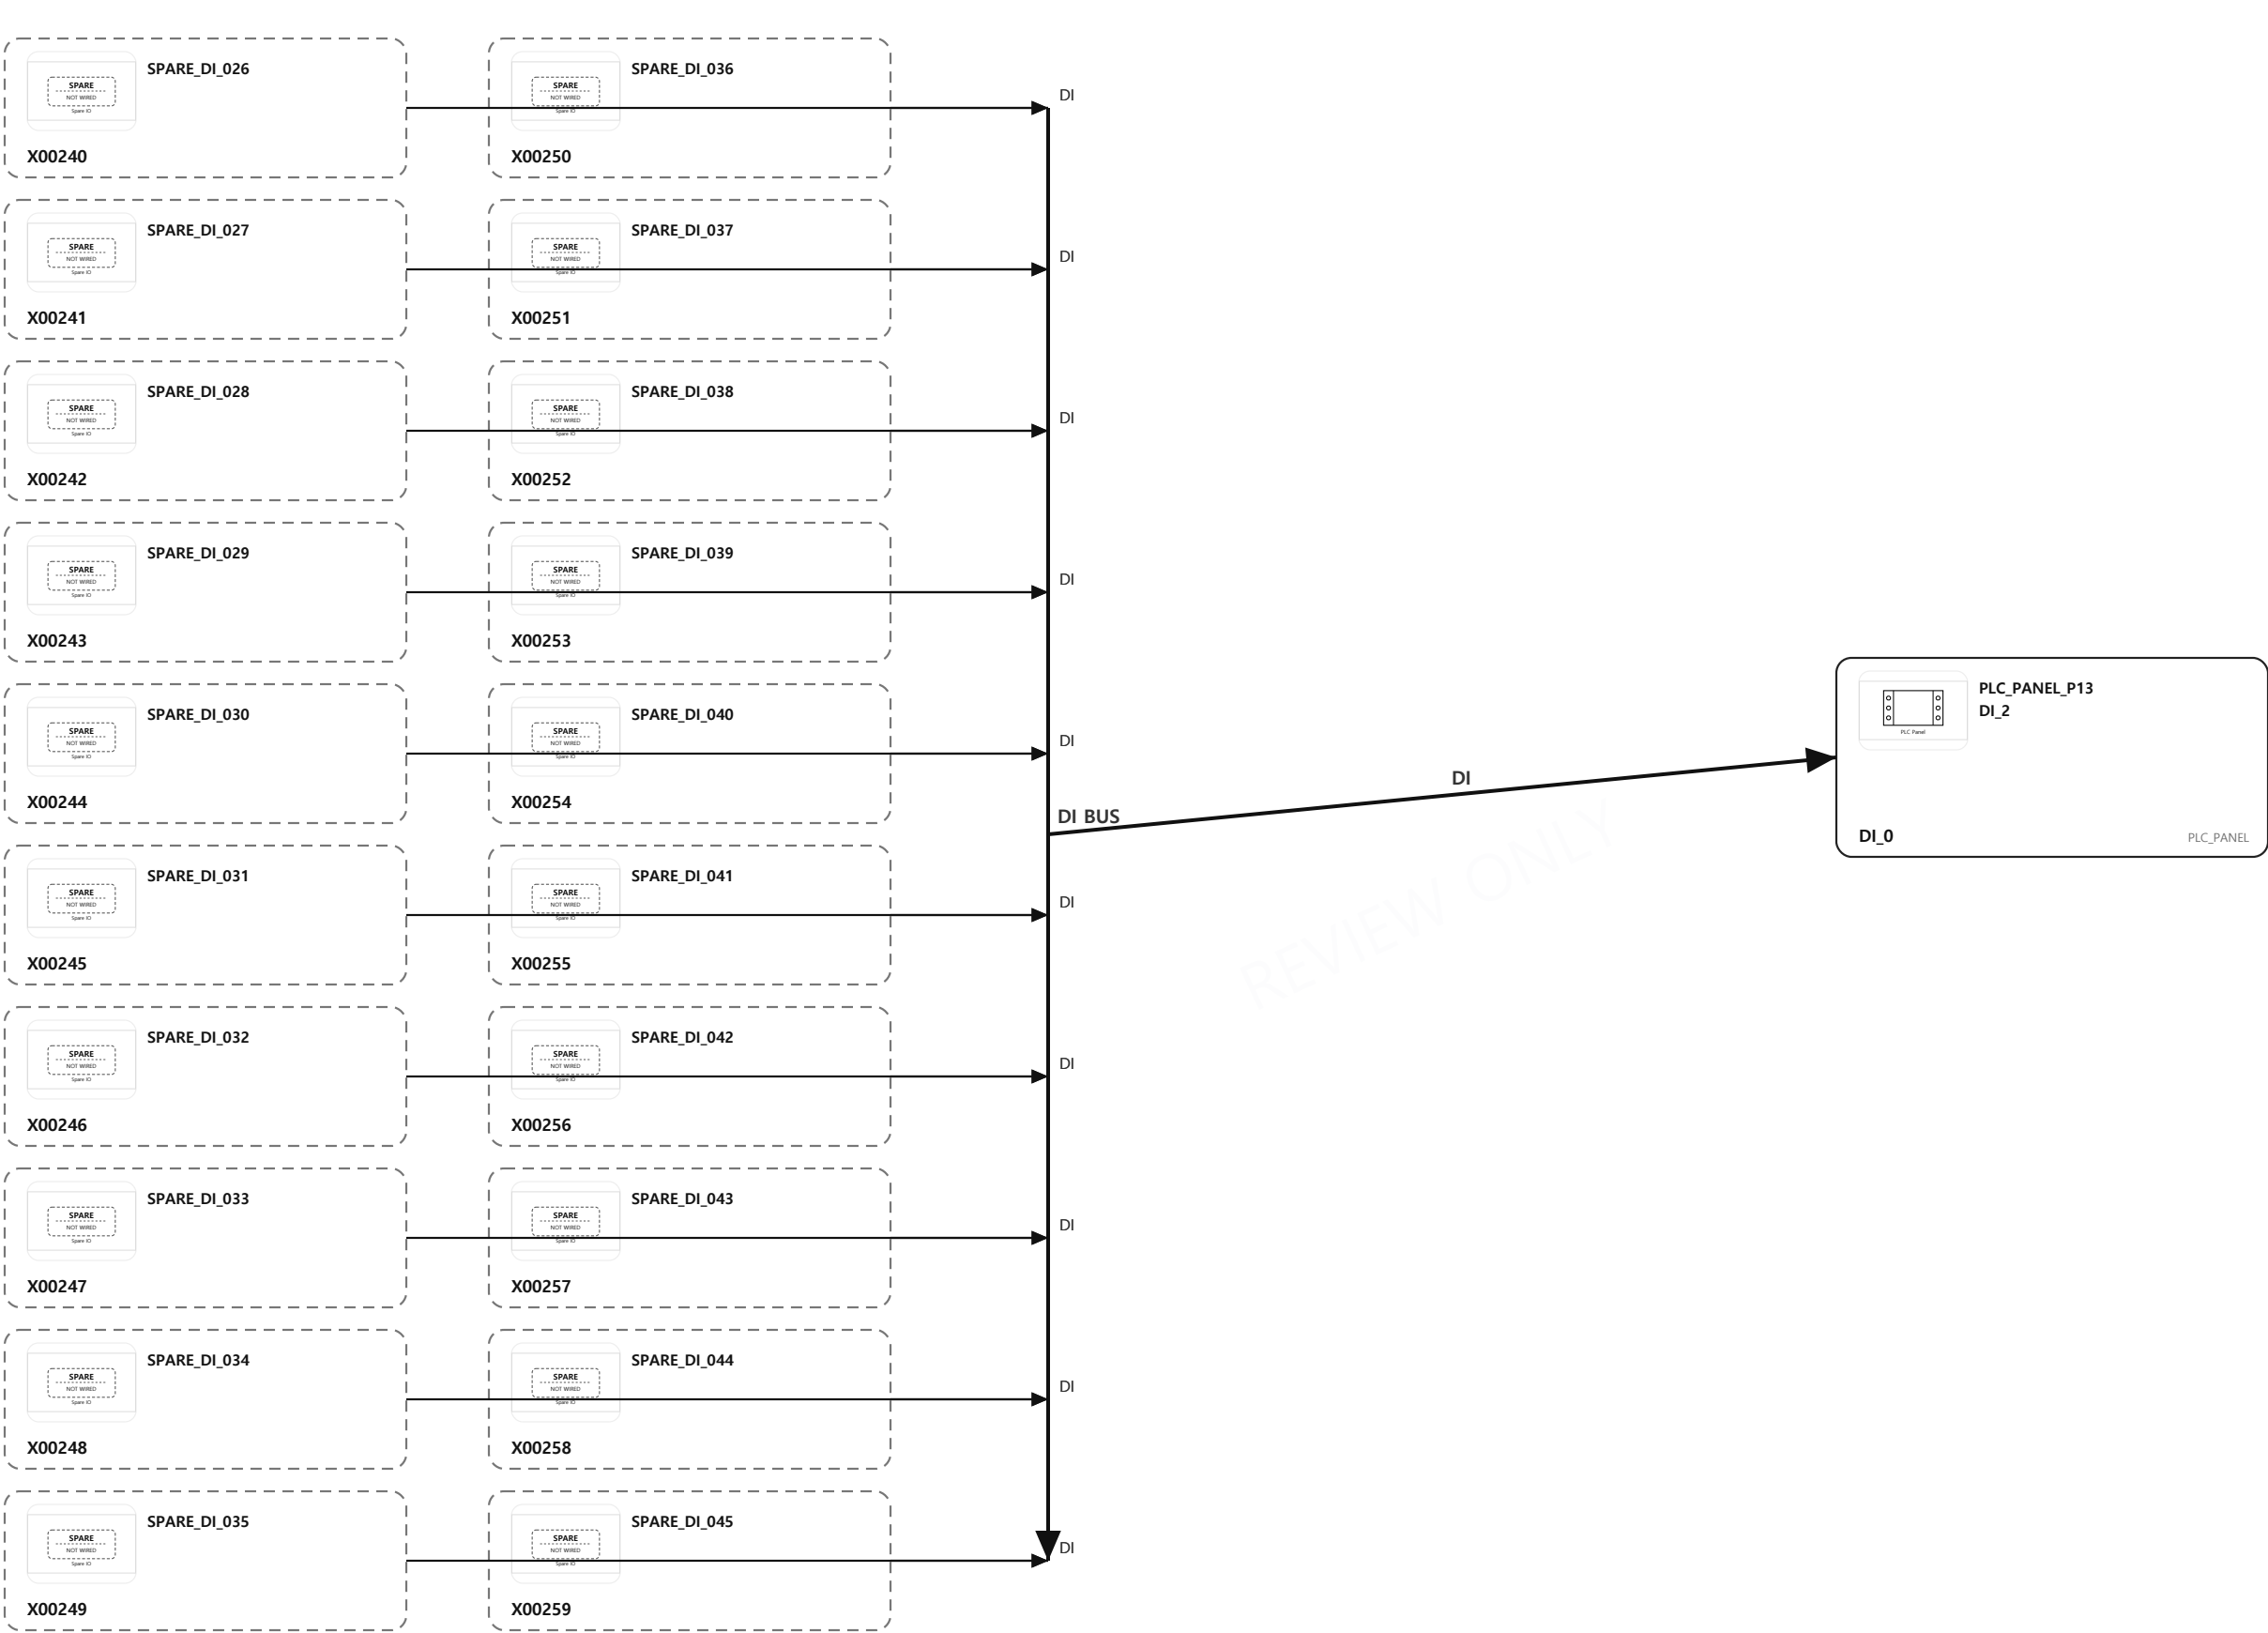


SPARE / NOT WIRED
spare_count=20 / review only

TITLE	DI Wiring 241-260
DRAWING NO	P13_DI_241_260
CASE	PLC-20260512-TYPE4-IO500-WW-001
REV / STATUS	A / REVIEW ONLY
GENERATED	2026-05-14 14:21

DO Wiring 001-020


PLC Package Viewer / TURN118_ENGINEERING_CLOSEOUT_CHECKLIST_REVIEW_ONLY_V1

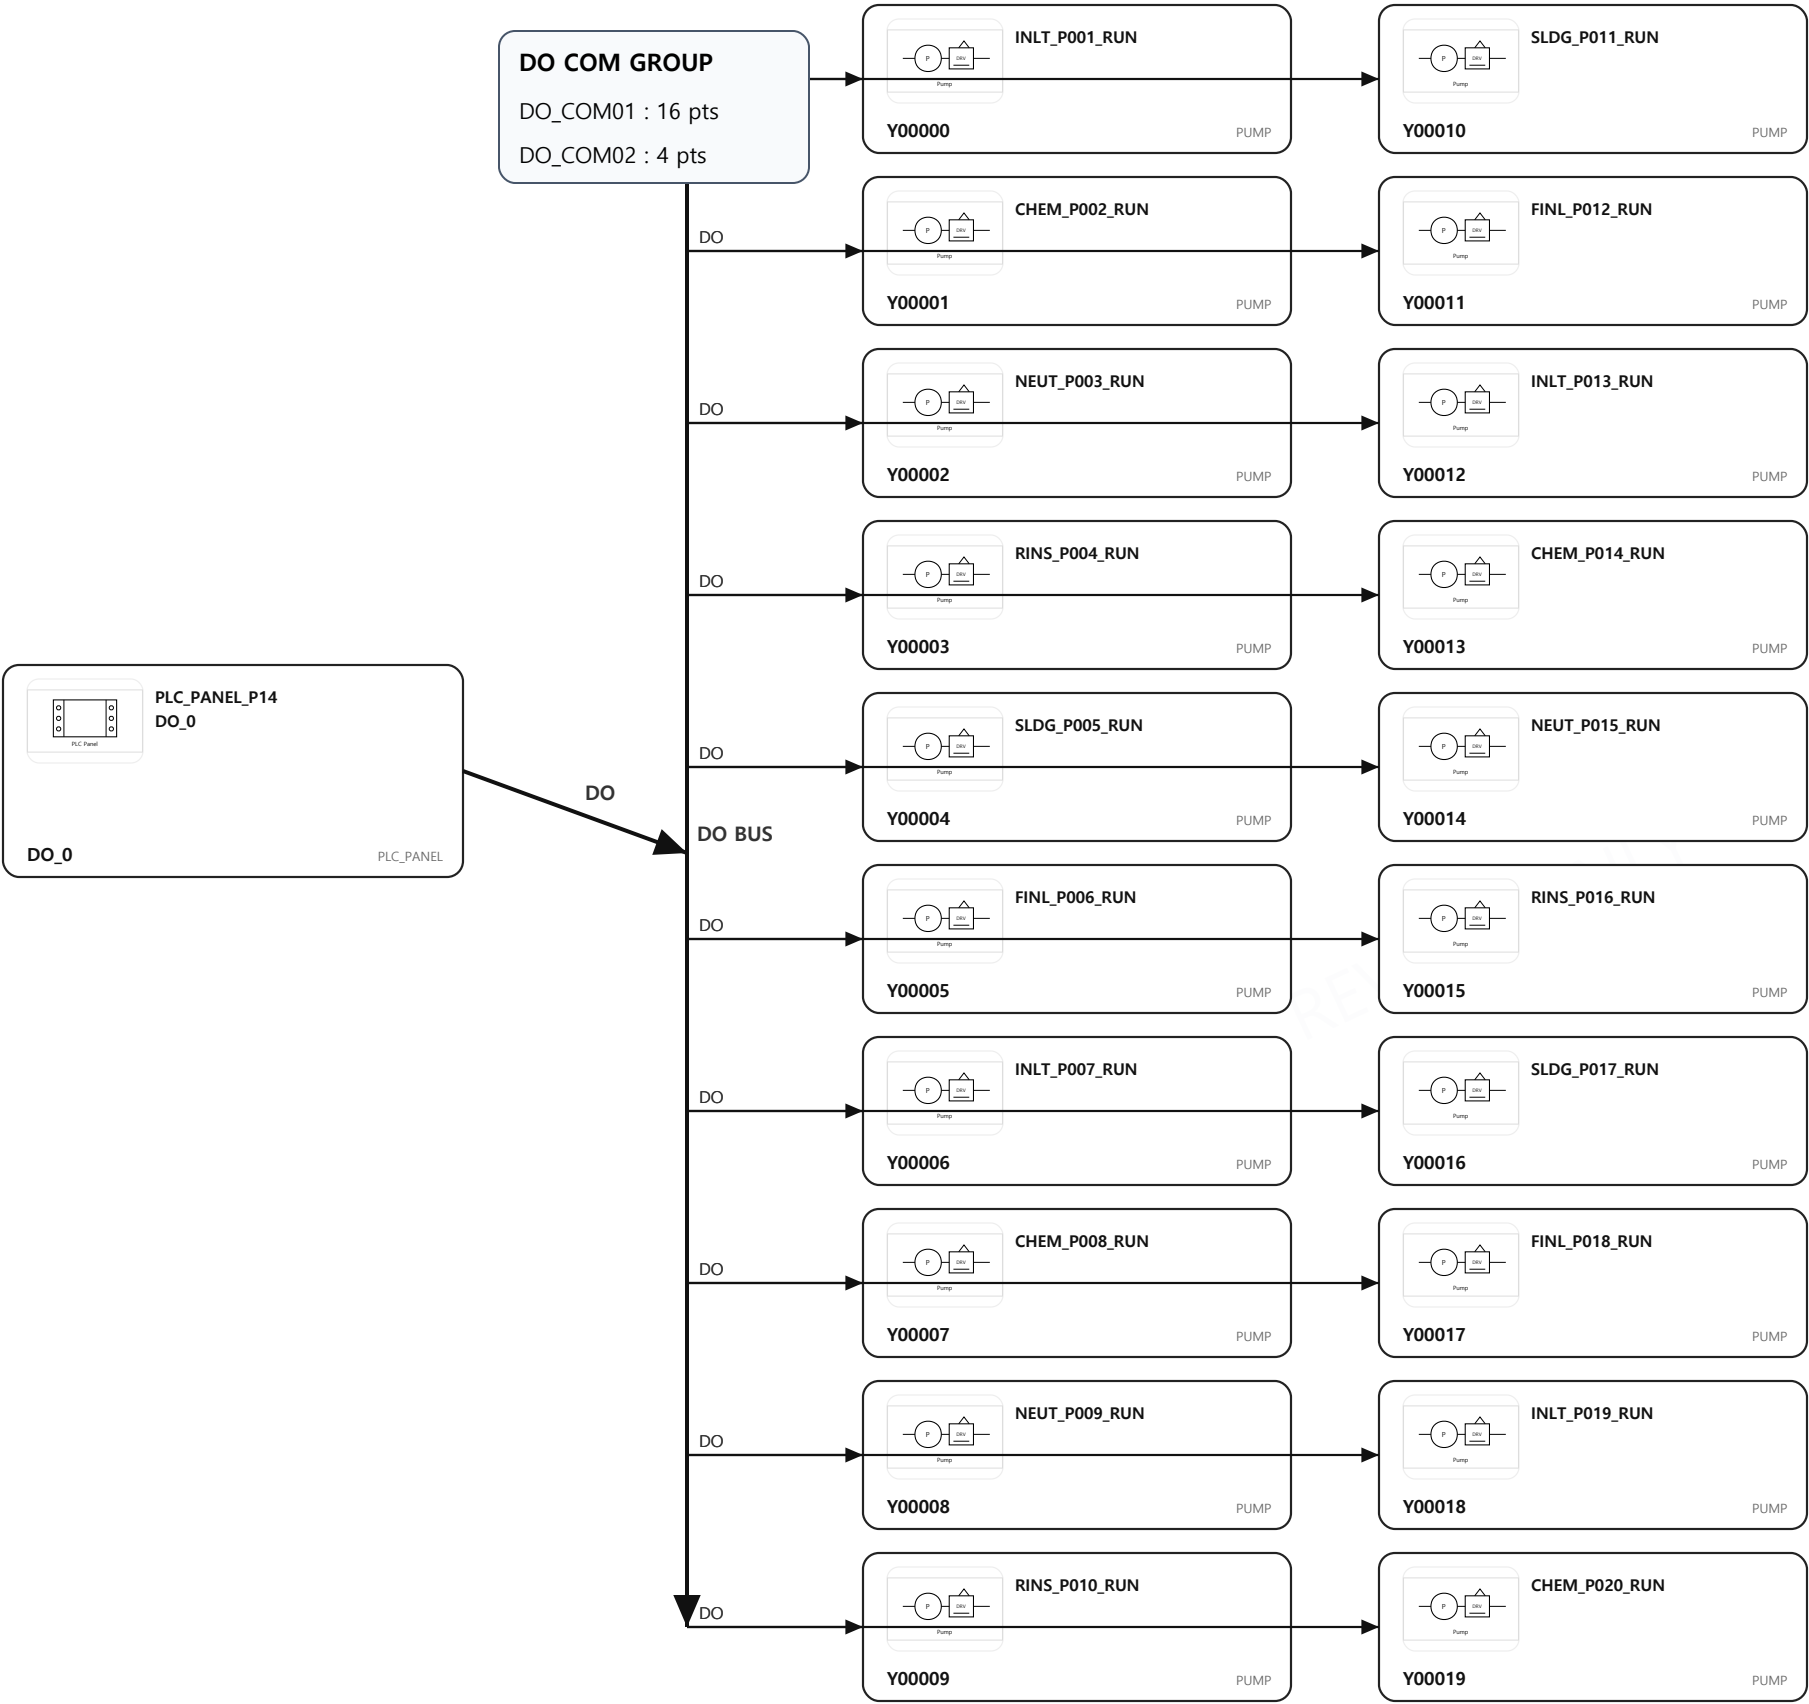

TITLE	DO Wiring 001-020
DRAWING NO	P14_DO_001_020
CASE	PLC-20260512-TYPE4-IO500-WW-001
REV / STATUS	A / REVIEW ONLY
GENERATED	2026-05-14 14:21

DO Wiring 021-040


PLC Package Viewer / TURN118_ENGINEERING_CLOSEOUT_CHECKLIST_REVIEW_ONLY_V1

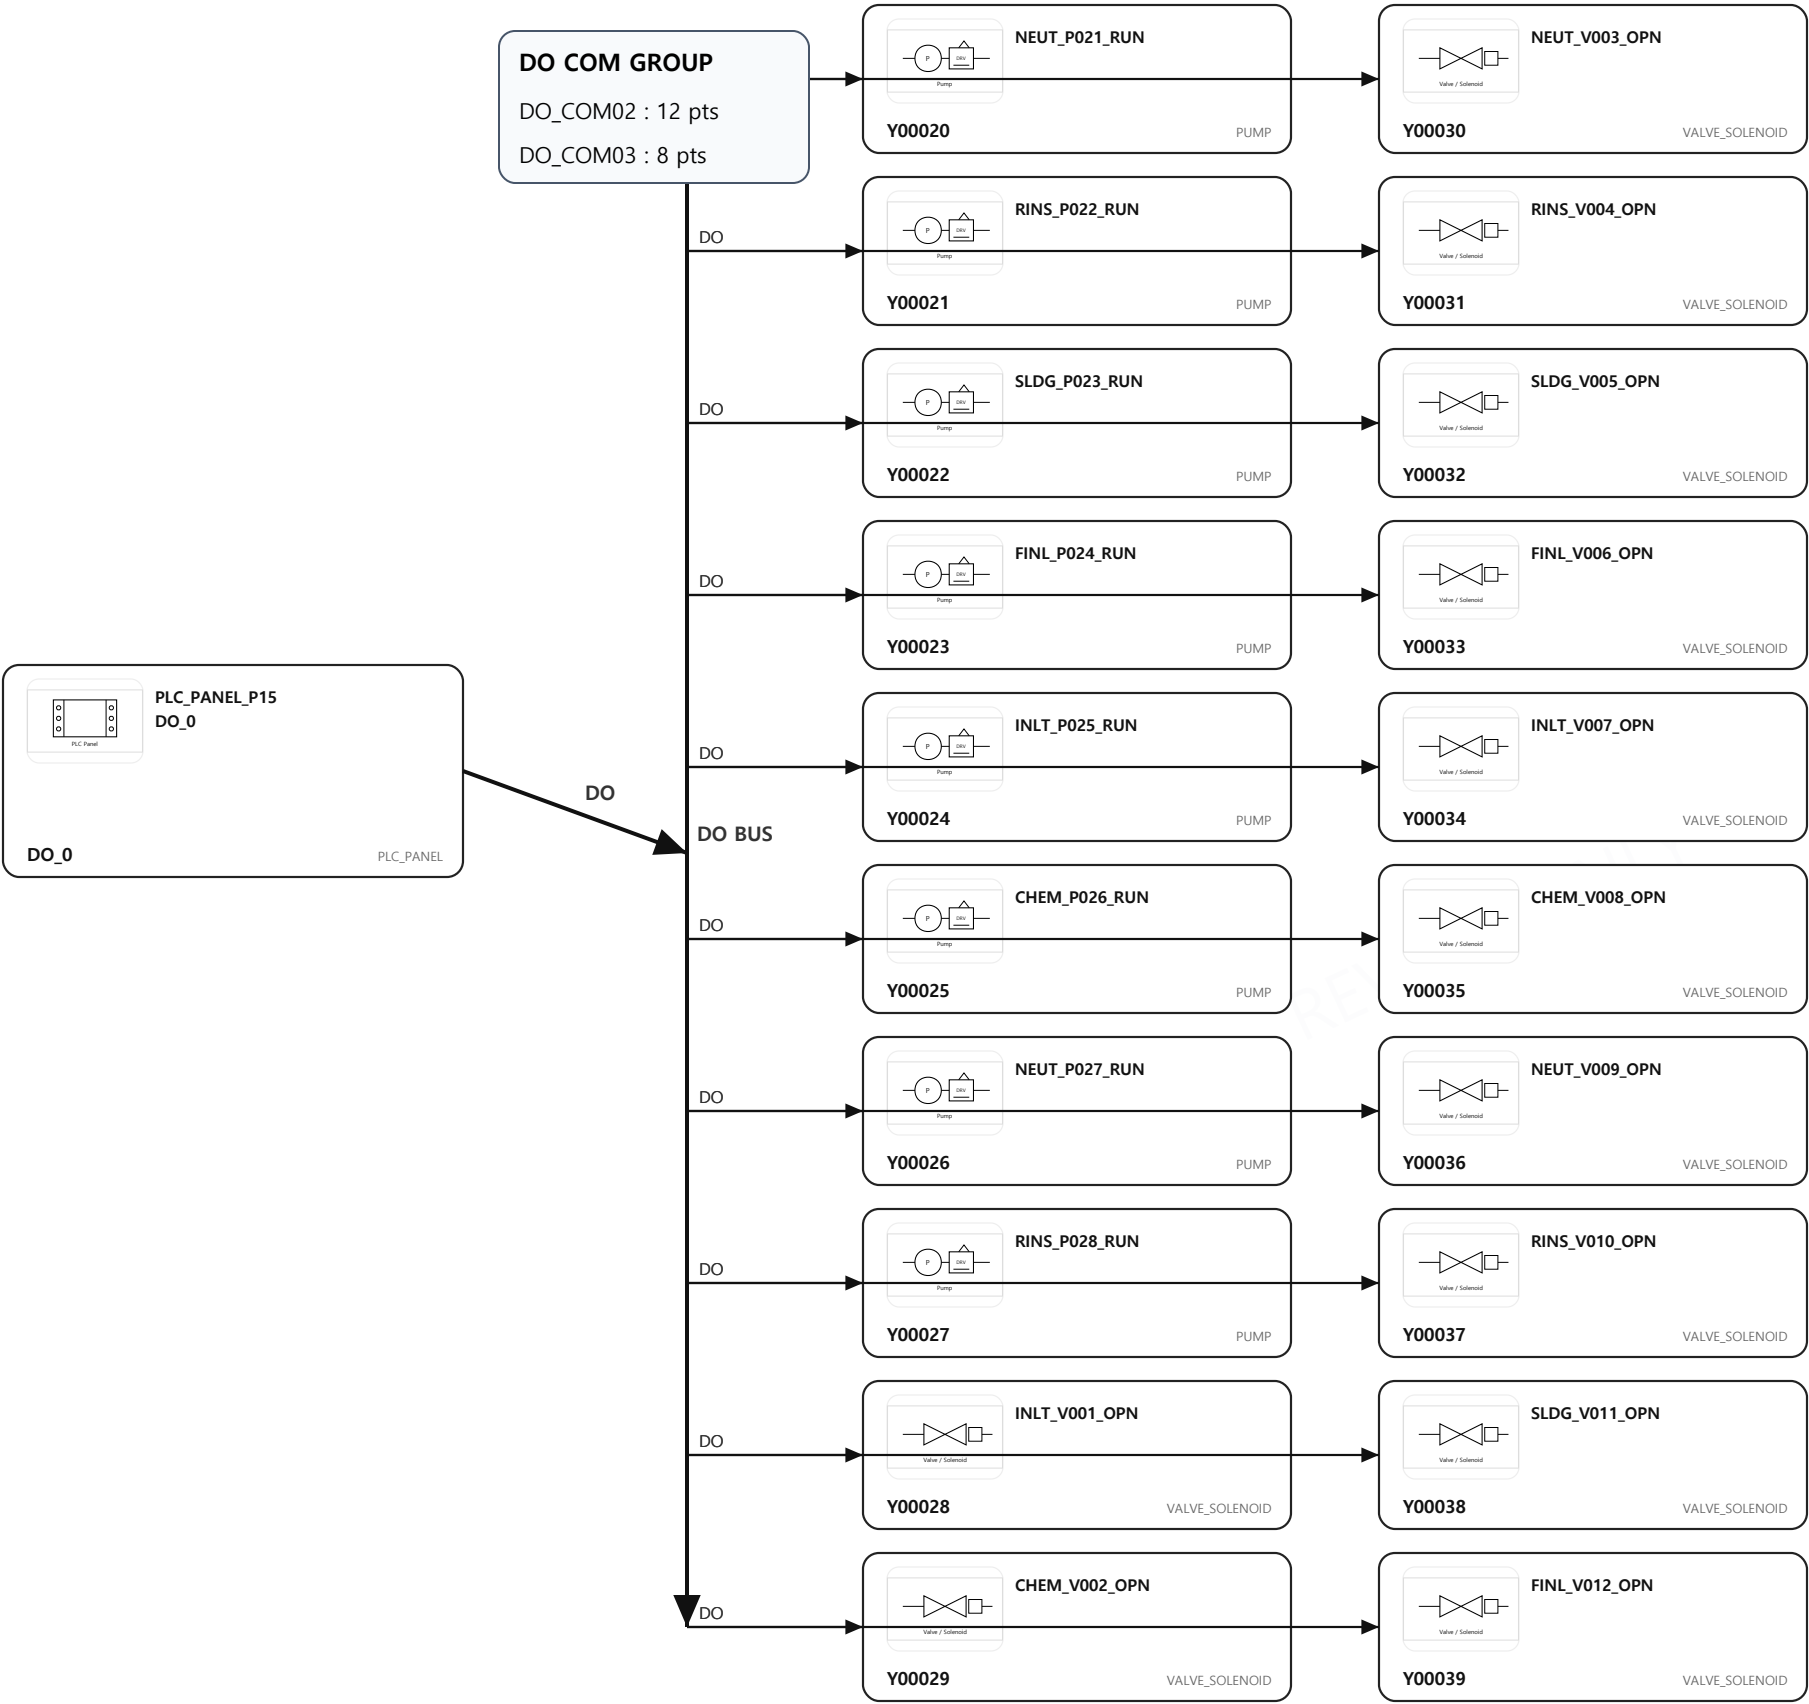

TITLE	DO Wiring 021-040
DRAWING NO	P15_DO_021_040
CASE	PLC-20260512-TYPE4-IO500-WW-001
REV / STATUS	A / REVIEW ONLY
GENERATED	2026-05-14 14:21

DO Wiring 041-060


PLC Package Viewer / TURN118_ENGINEERING_CLOSEOUT_CHECKLIST_REVIEW_ONLY_V1

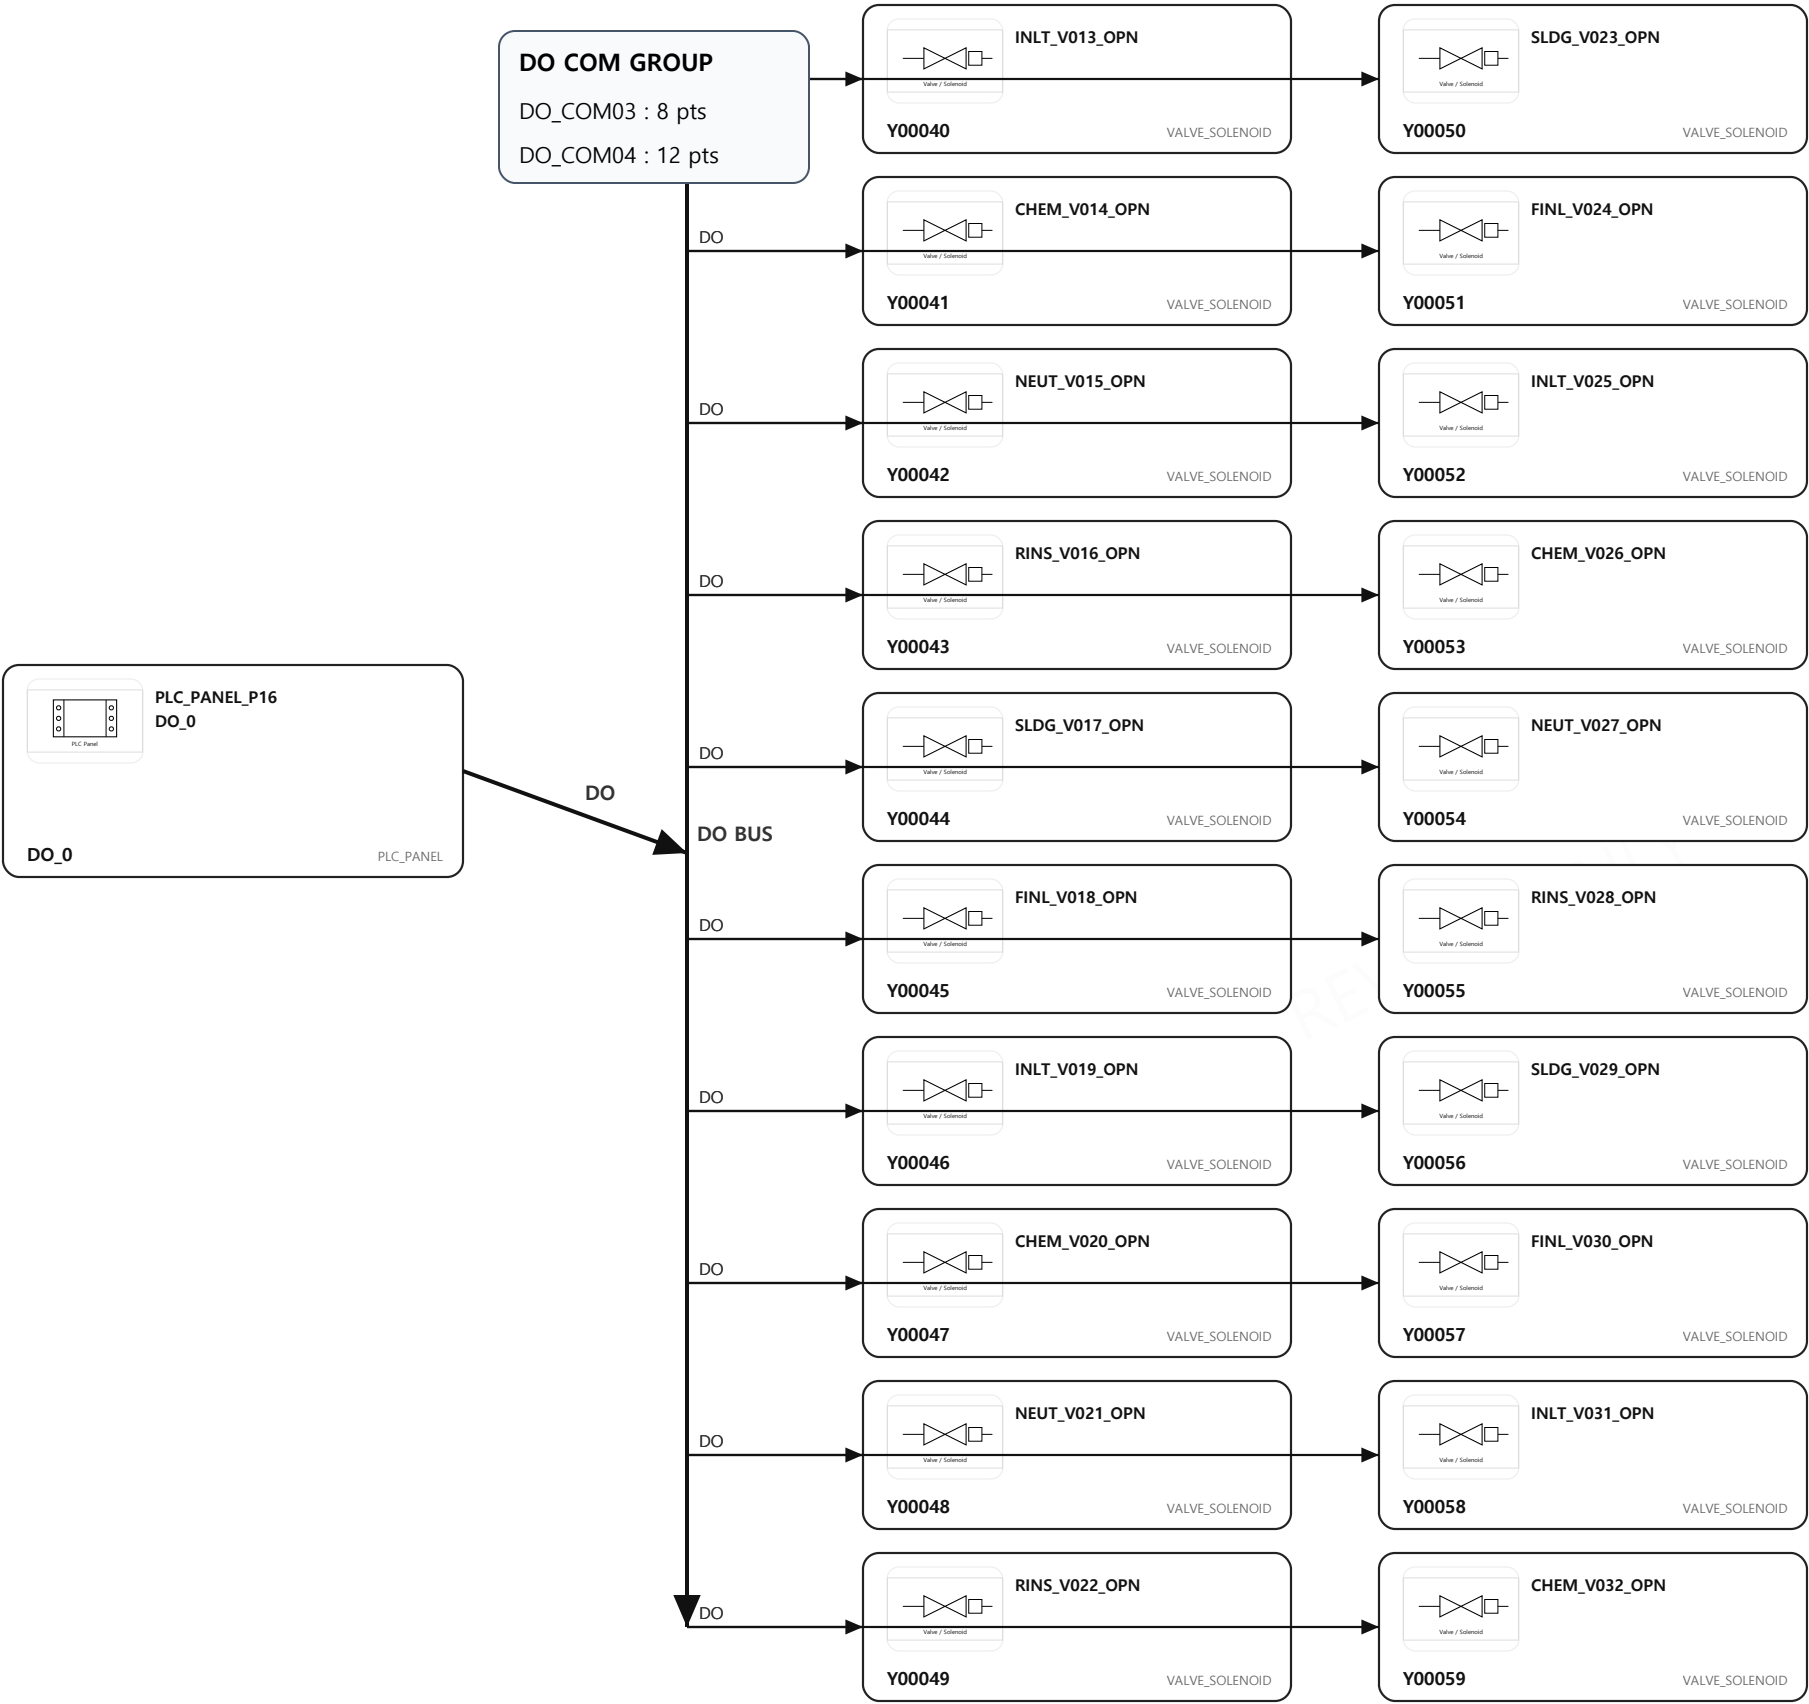

TITLE	DO Wiring 041-060
DRAWING NO	P16_DO_041_060
CASE	PLC-20260512-TYPE4-IO500-WW-001
REV / STATUS	A / REVIEW ONLY
GENERATED	2026-05-14 14:21

DO Wiring 061-080


PLC Package Viewer / TURN118_ENGINEERING_CLOSEOUT_CHECKLIST_REVIEW_ONLY_V1

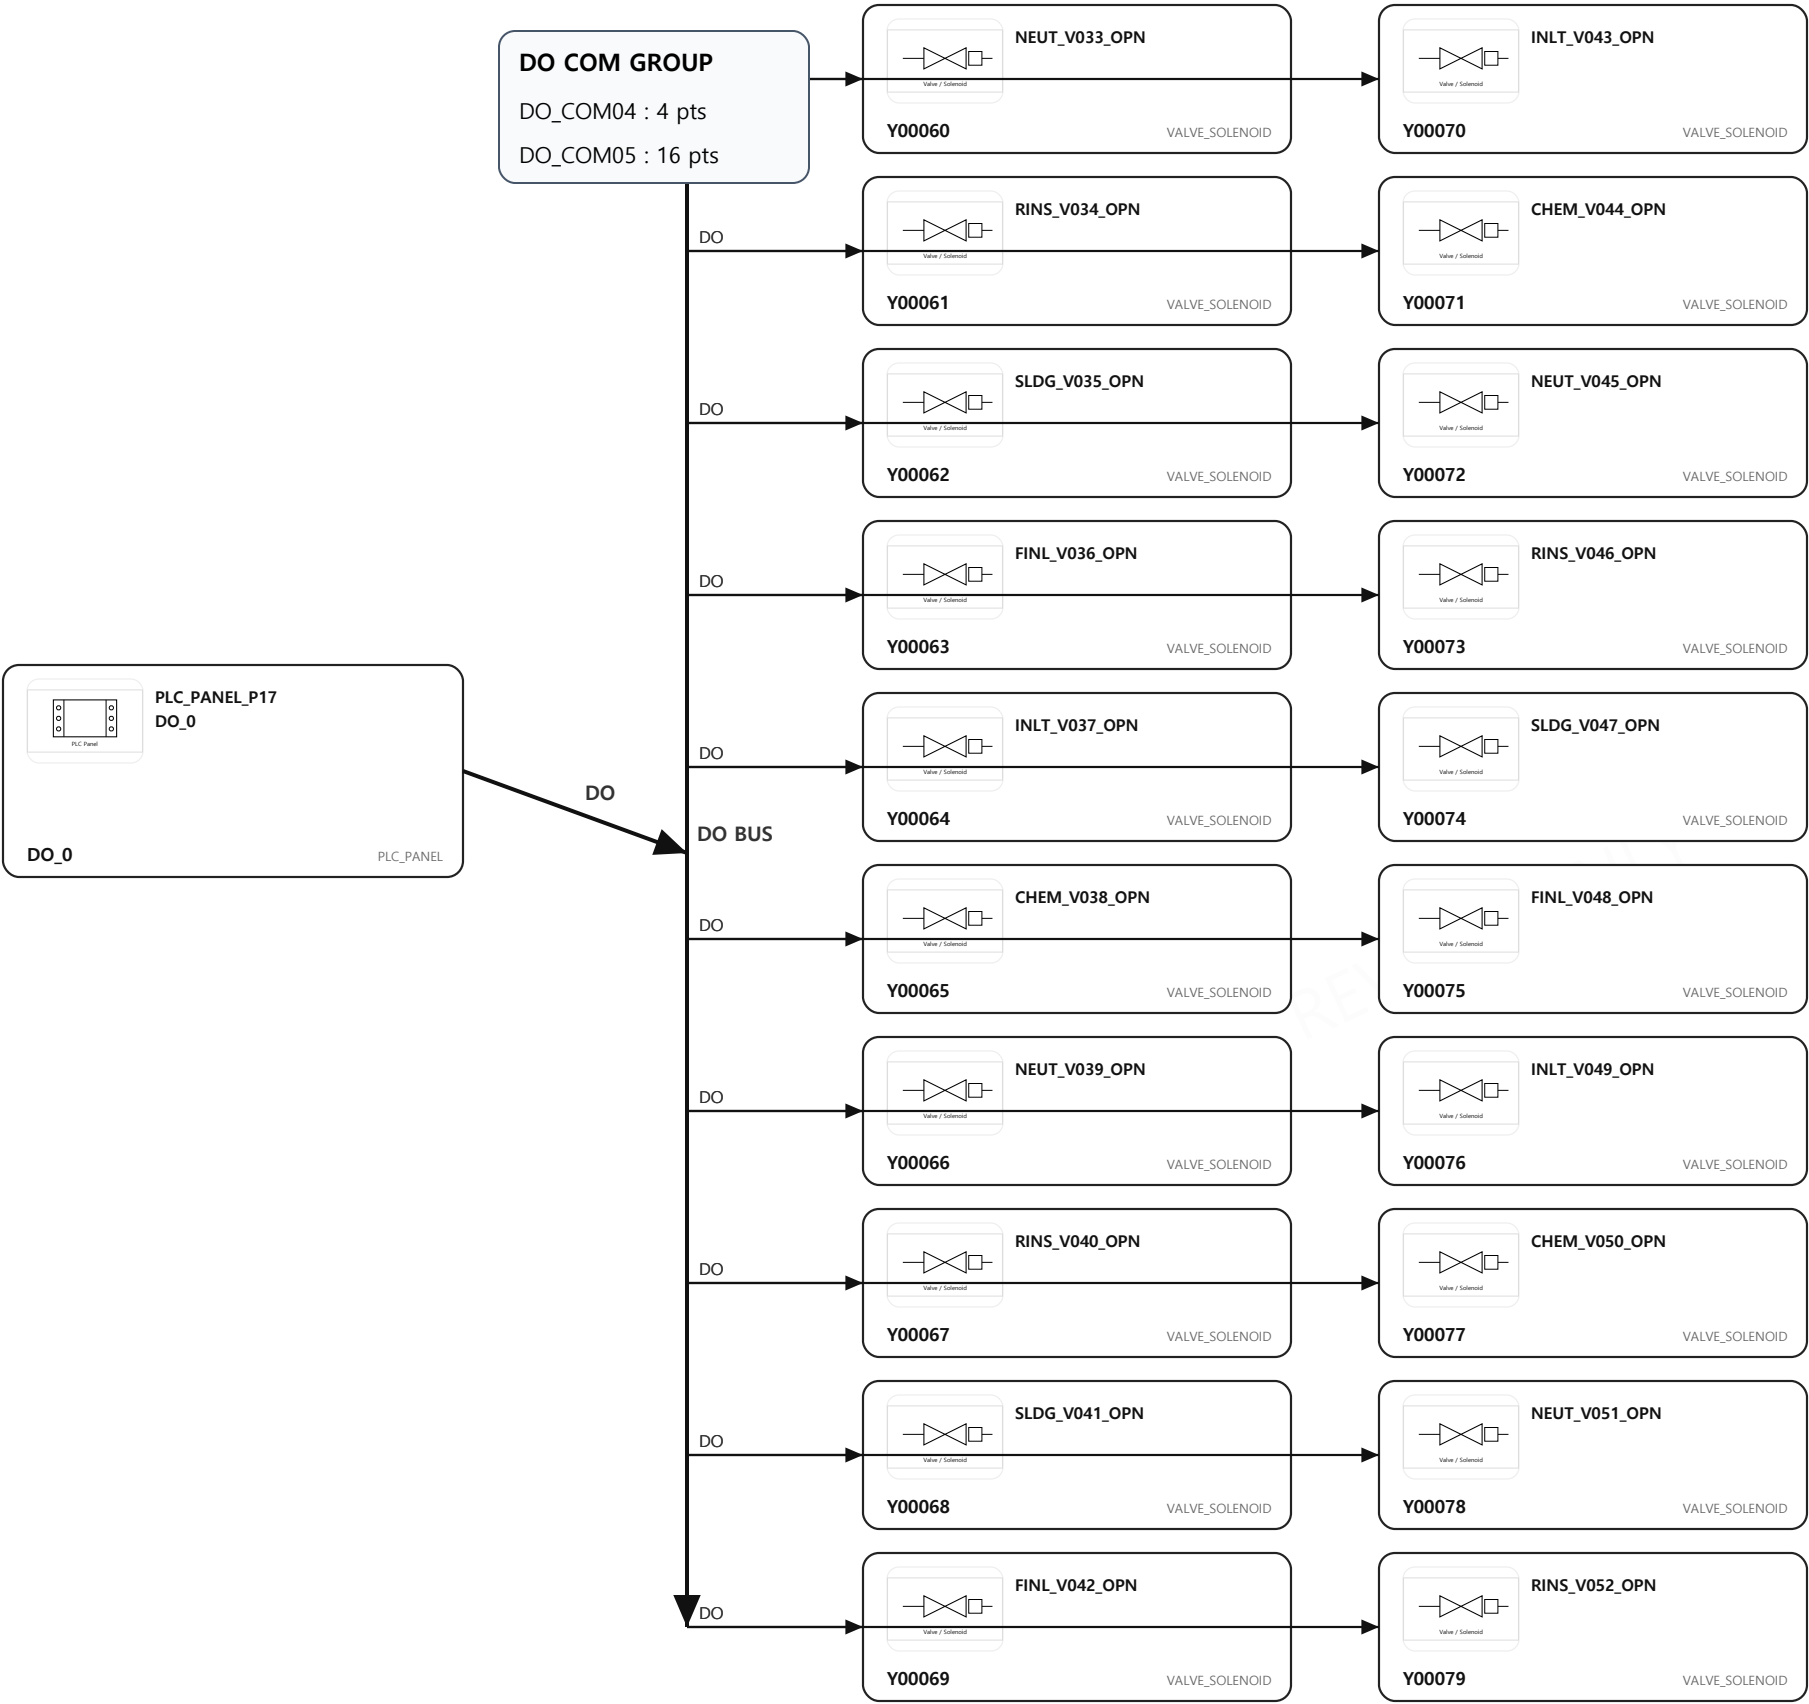

TITLE	DO Wiring 061-080
DRAWING NO	P17_DO_061_080
CASE	PLC-20260512-TYPE4-IO500-WW-001
REV / STATUS	A / REVIEW ONLY
GENERATED	2026-05-14 14:21

DO Wiring 081-100


PLC Package Viewer / TURN118_ENGINEERING_CLOSEOUT_CHECKLIST_REVIEW_ONLY_V1

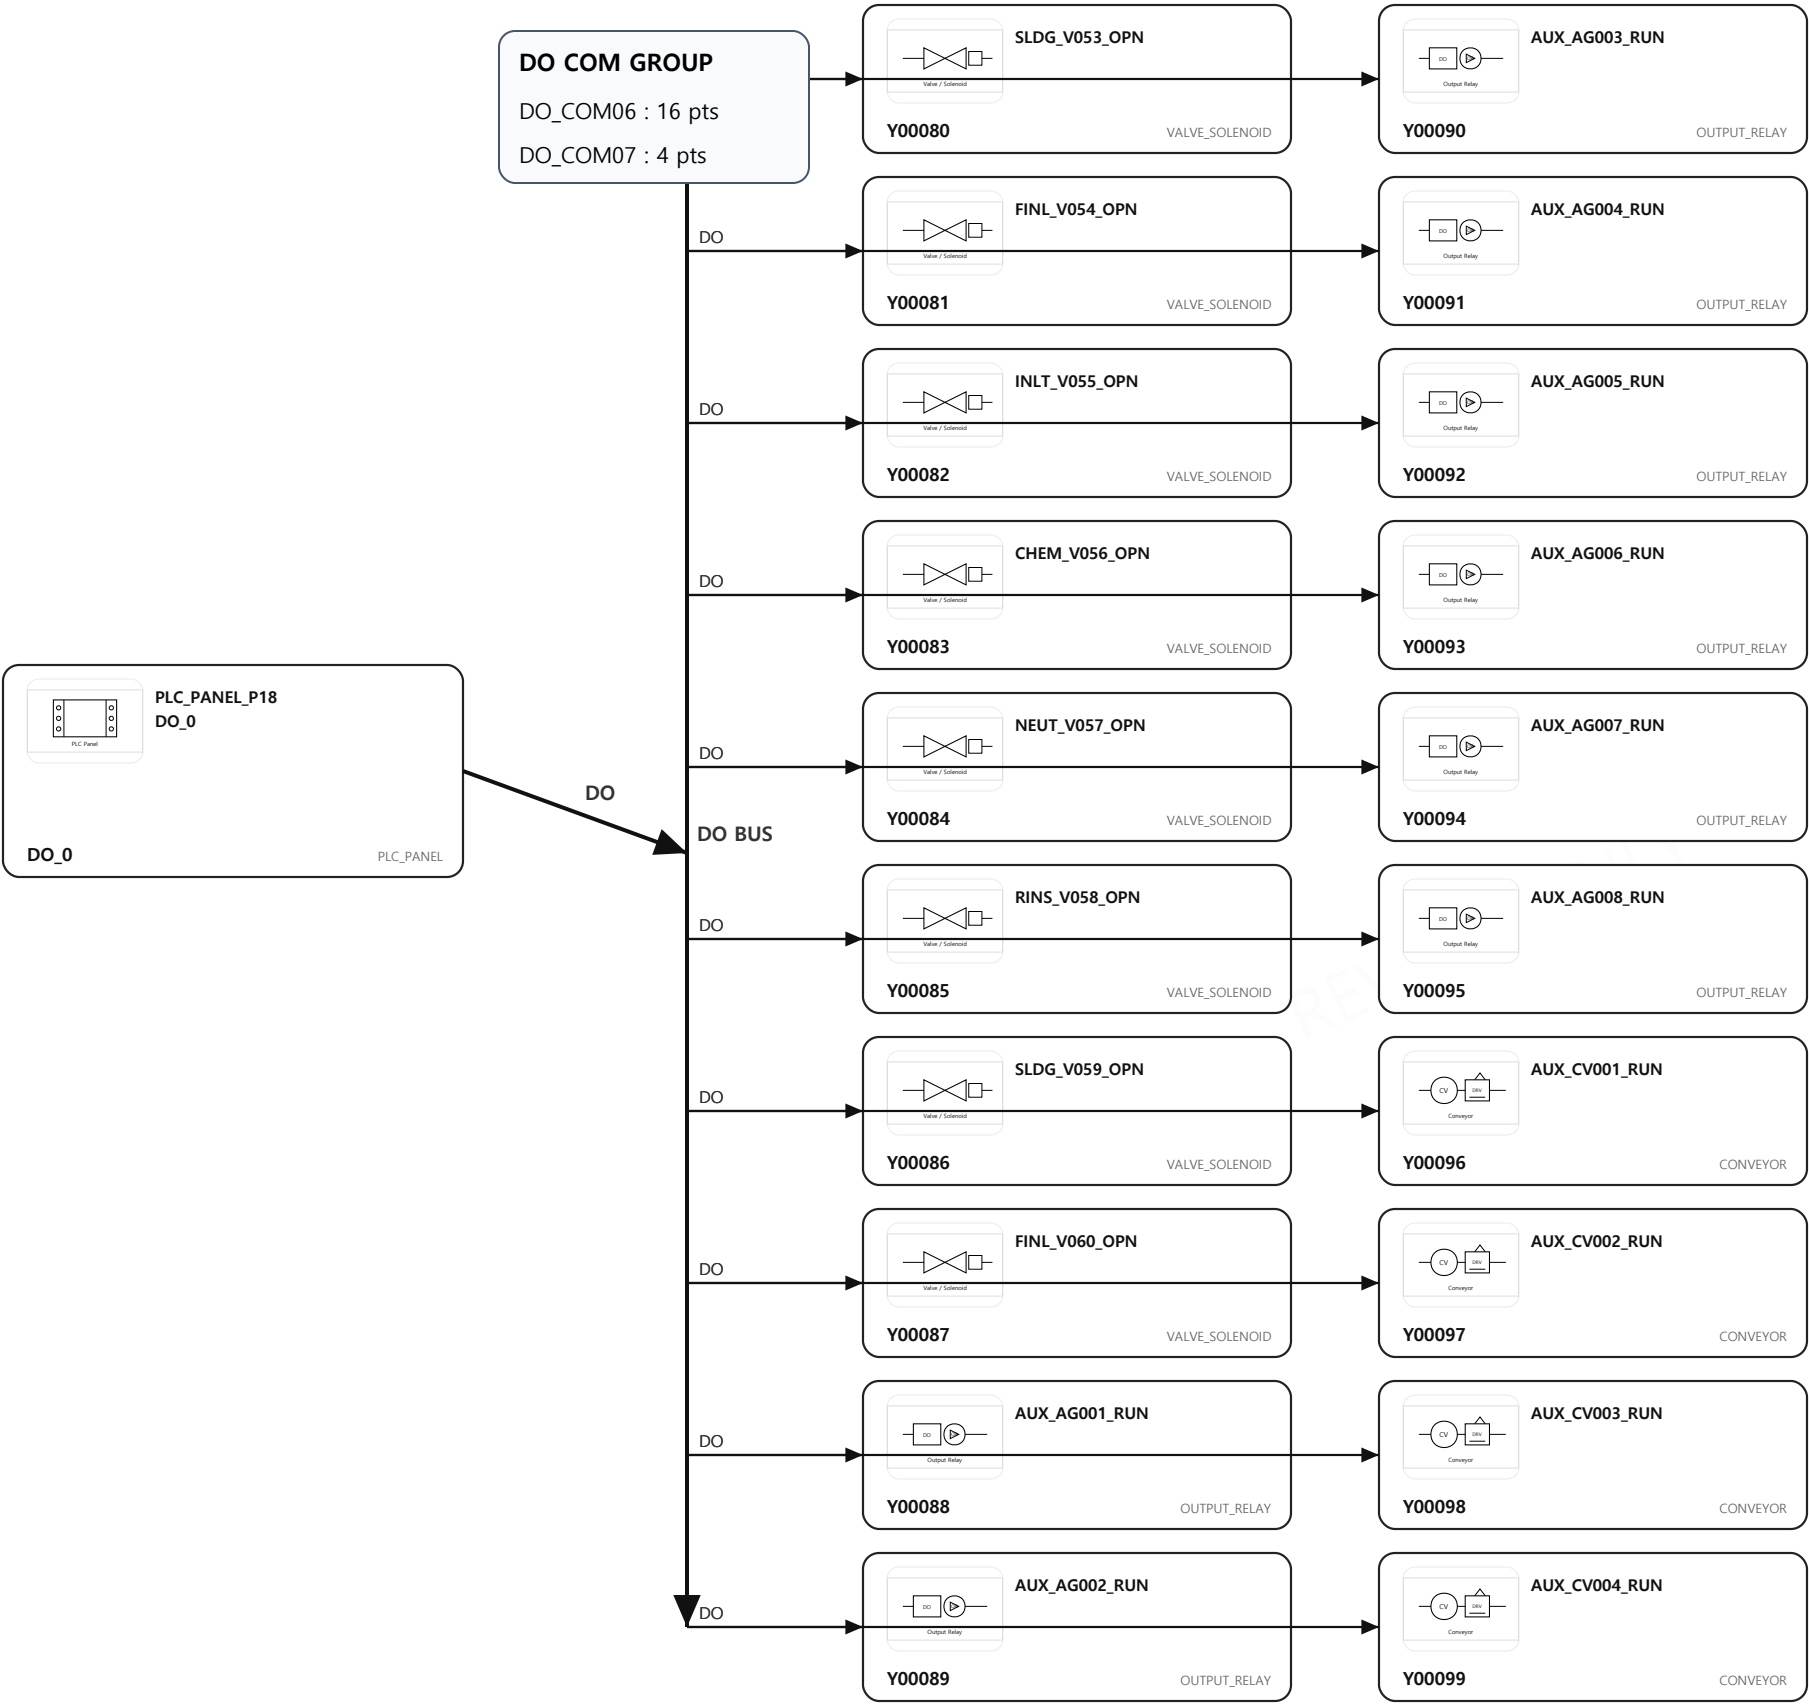

TITLE	DO Wiring 081-100
DRAWING NO	P18_DO_081_100
CASE	PLC-20260512-TYPE4-IO500-WW-001
REV / STATUS	A / REVIEW ONLY
GENERATED	2026-05-14 14:21

DO Wiring 101-120


PLC Package Viewer / TURN118_ENGINEERING_CLOSEOUT_CHECKLIST_REVIEW_ONLY_V1

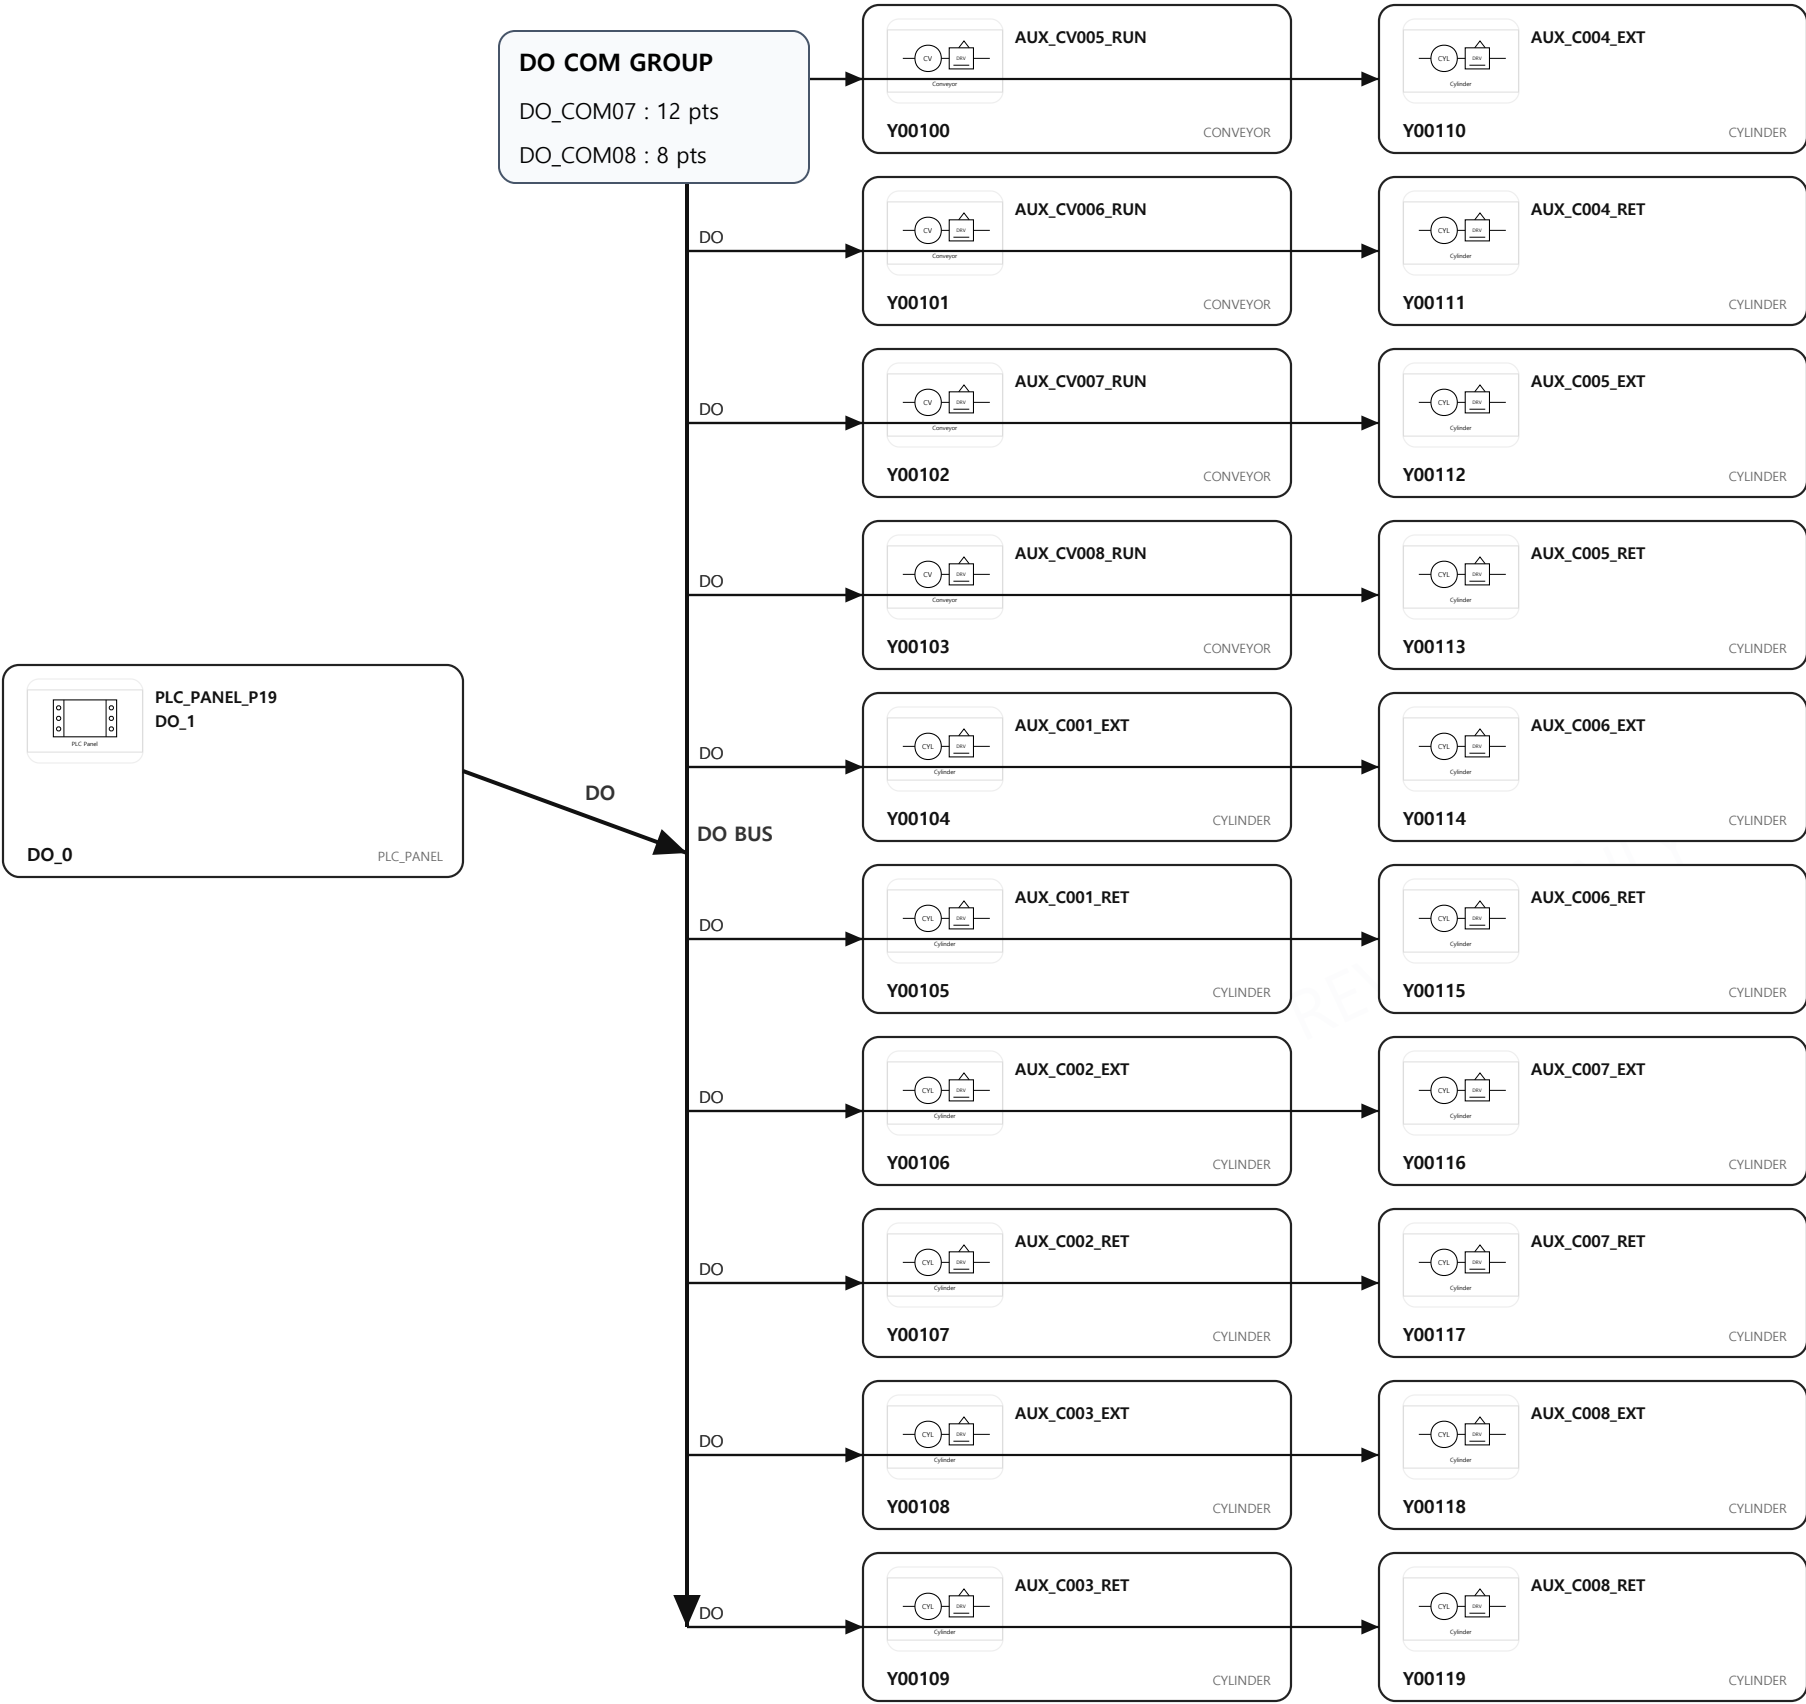

TITLE	DO Wiring 101-120
DRAWING NO	P19_DO_101_120
CASE	PLC-20260512-TYPE4-IO500-WW-001
REV / STATUS	A / REVIEW ONLY
GENERATED	2026-05-14 14:21

DO Wiring 121-140


PLC Package Viewer / TURN118_ENGINEERING_CLOSEOUT_CHECKLIST_REVIEW_ONLY_V1

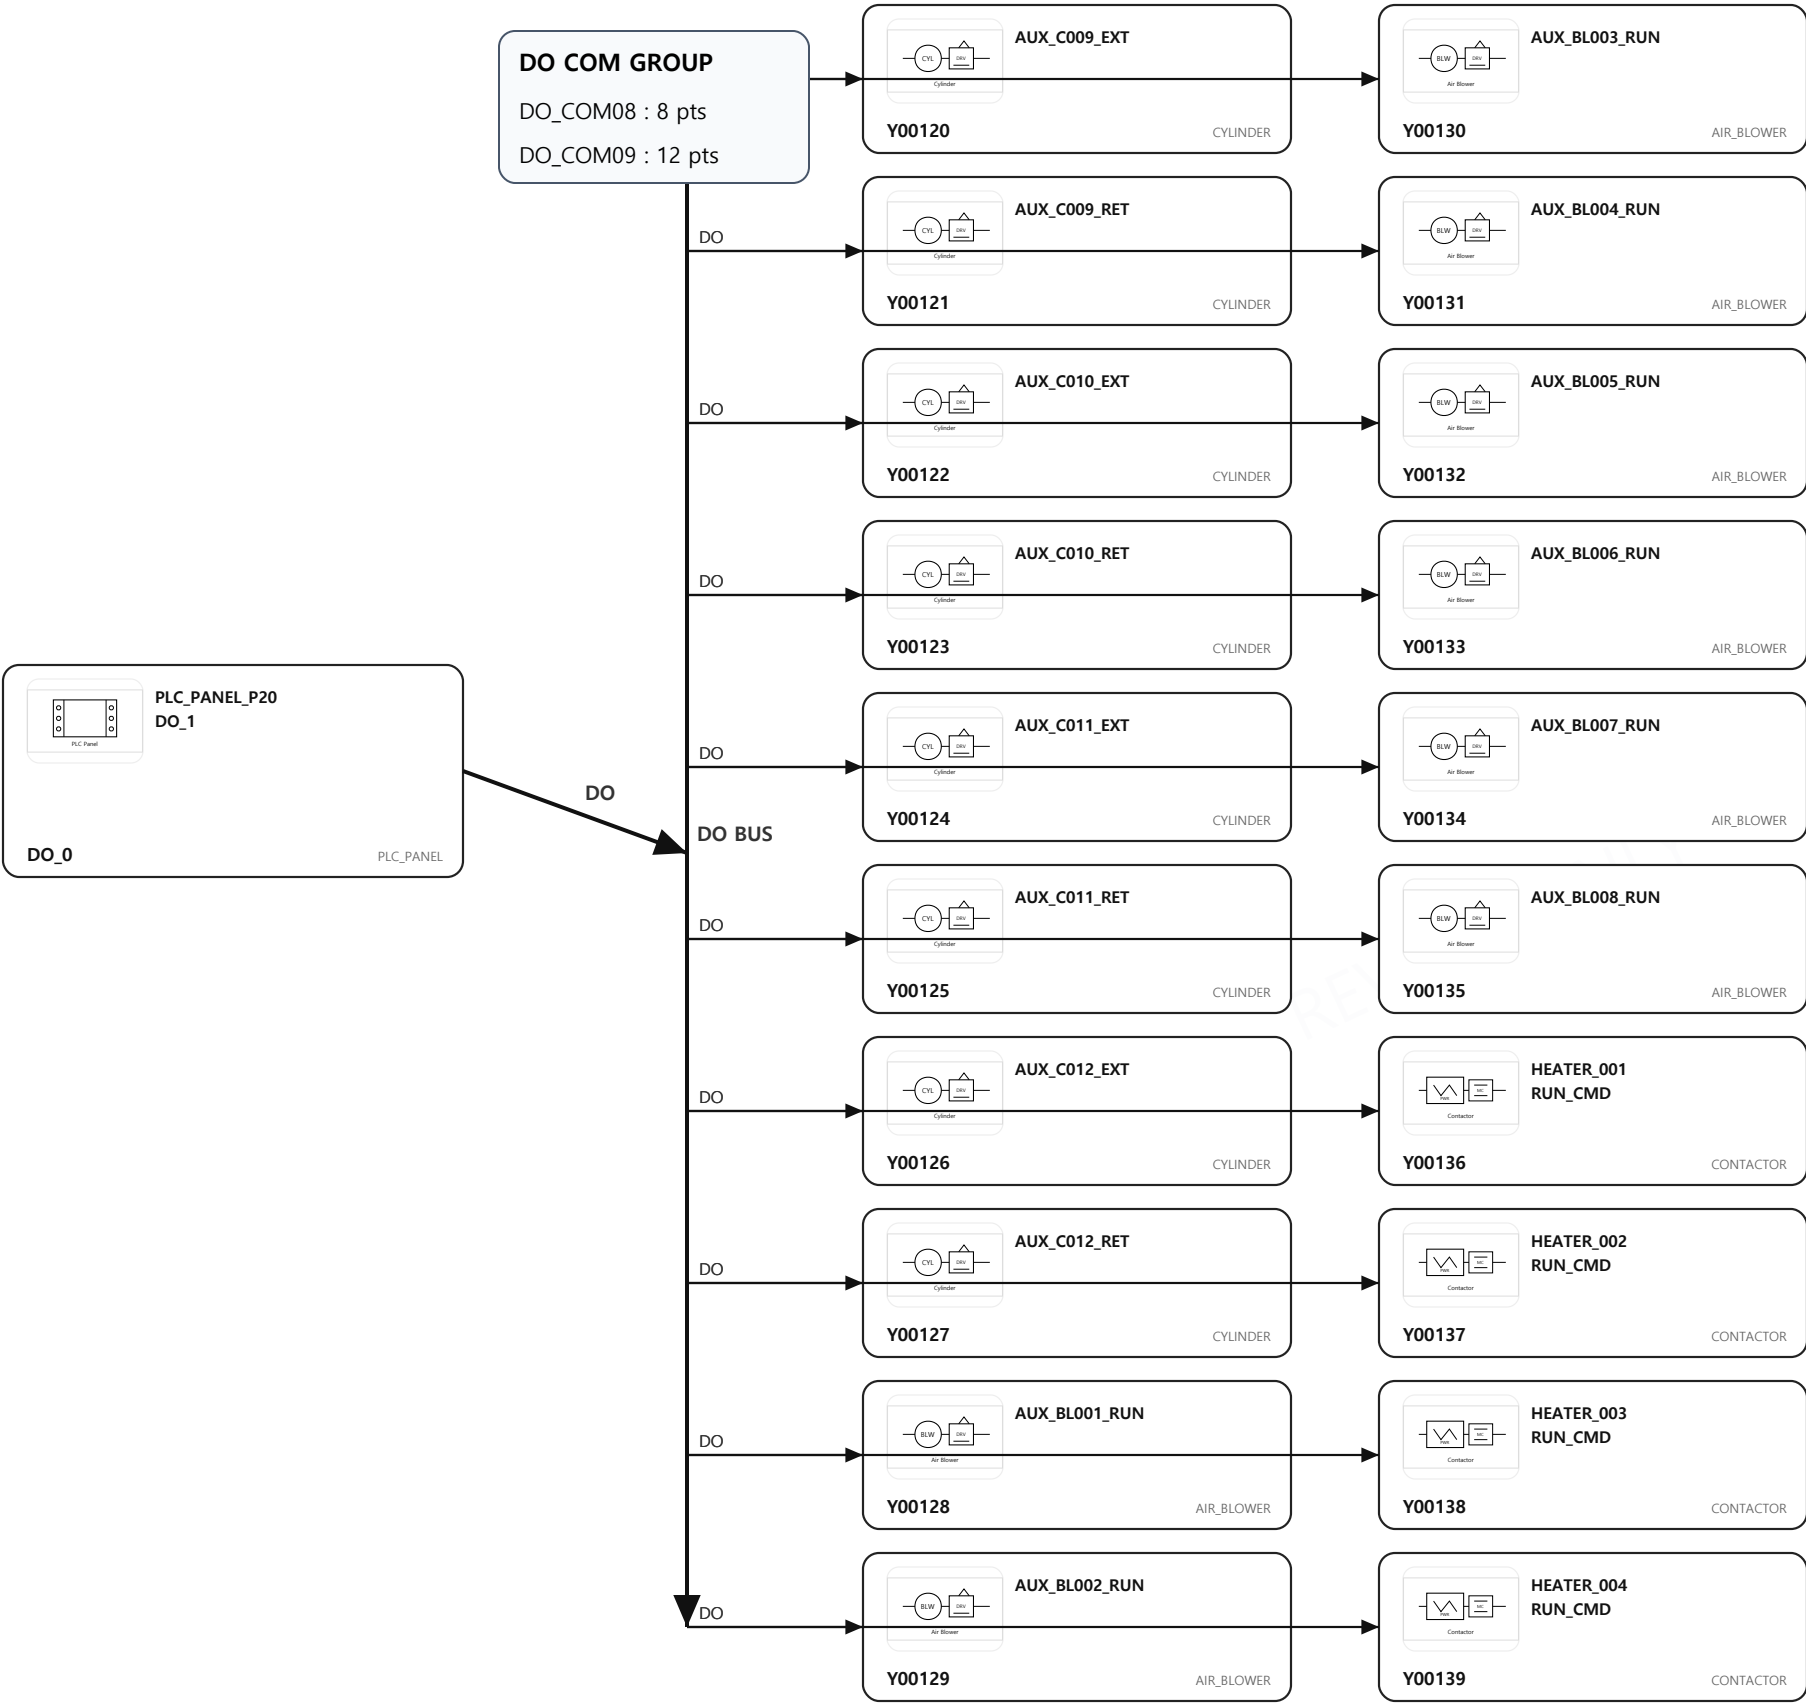

TITLE	DO Wiring 121-140
DRAWING NO	P20_DO_121_140
CASE	PLC-20260512-TYPE4-IO500-WW-001
REV / STATUS	A / REVIEW ONLY
GENERATED	2026-05-14 14:21

DO Wiring 141-160


PLC Package Viewer / TURN118_ENGINEERING_CLOSEOUT_CHECKLIST_REVIEW_ONLY_V1

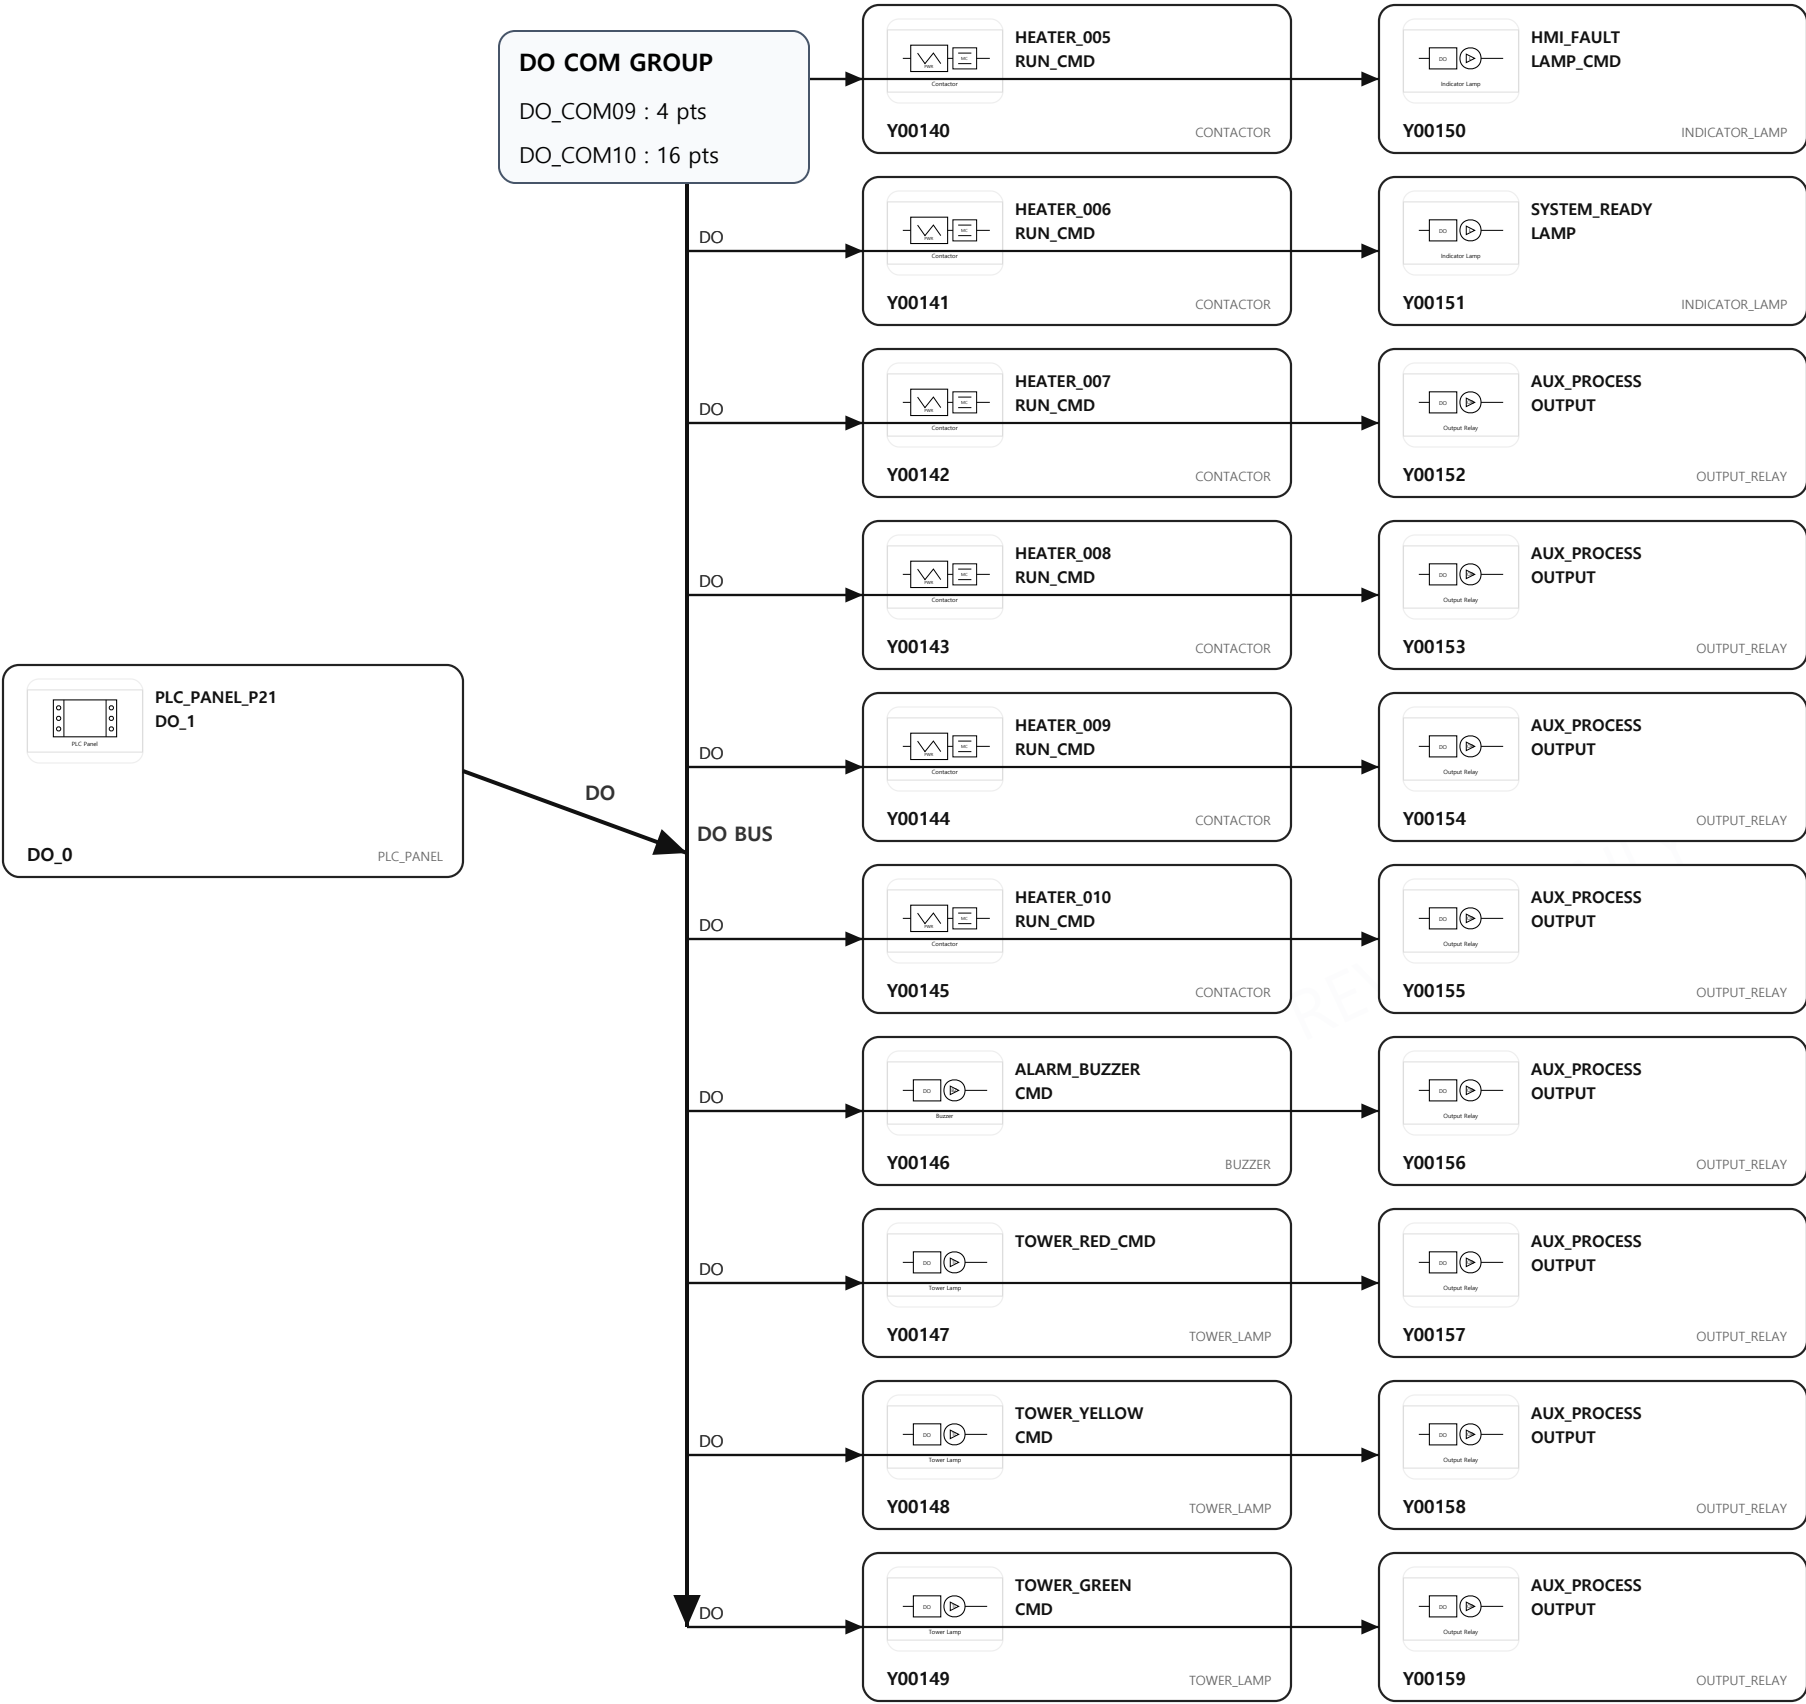

TITLE	DO Wiring 141-160
DRAWING NO	P21_DO_141_160
CASE	PLC-20260512-TYPE4-IO500-WW-001
REV / STATUS	A / REVIEW ONLY
GENERATED	2026-05-14 14:21

DO Wiring 161-180


PLC Package Viewer / TURN118_ENGINEERING_CLOSEOUT_CHECKLIST_REVIEW_ONLY_V1

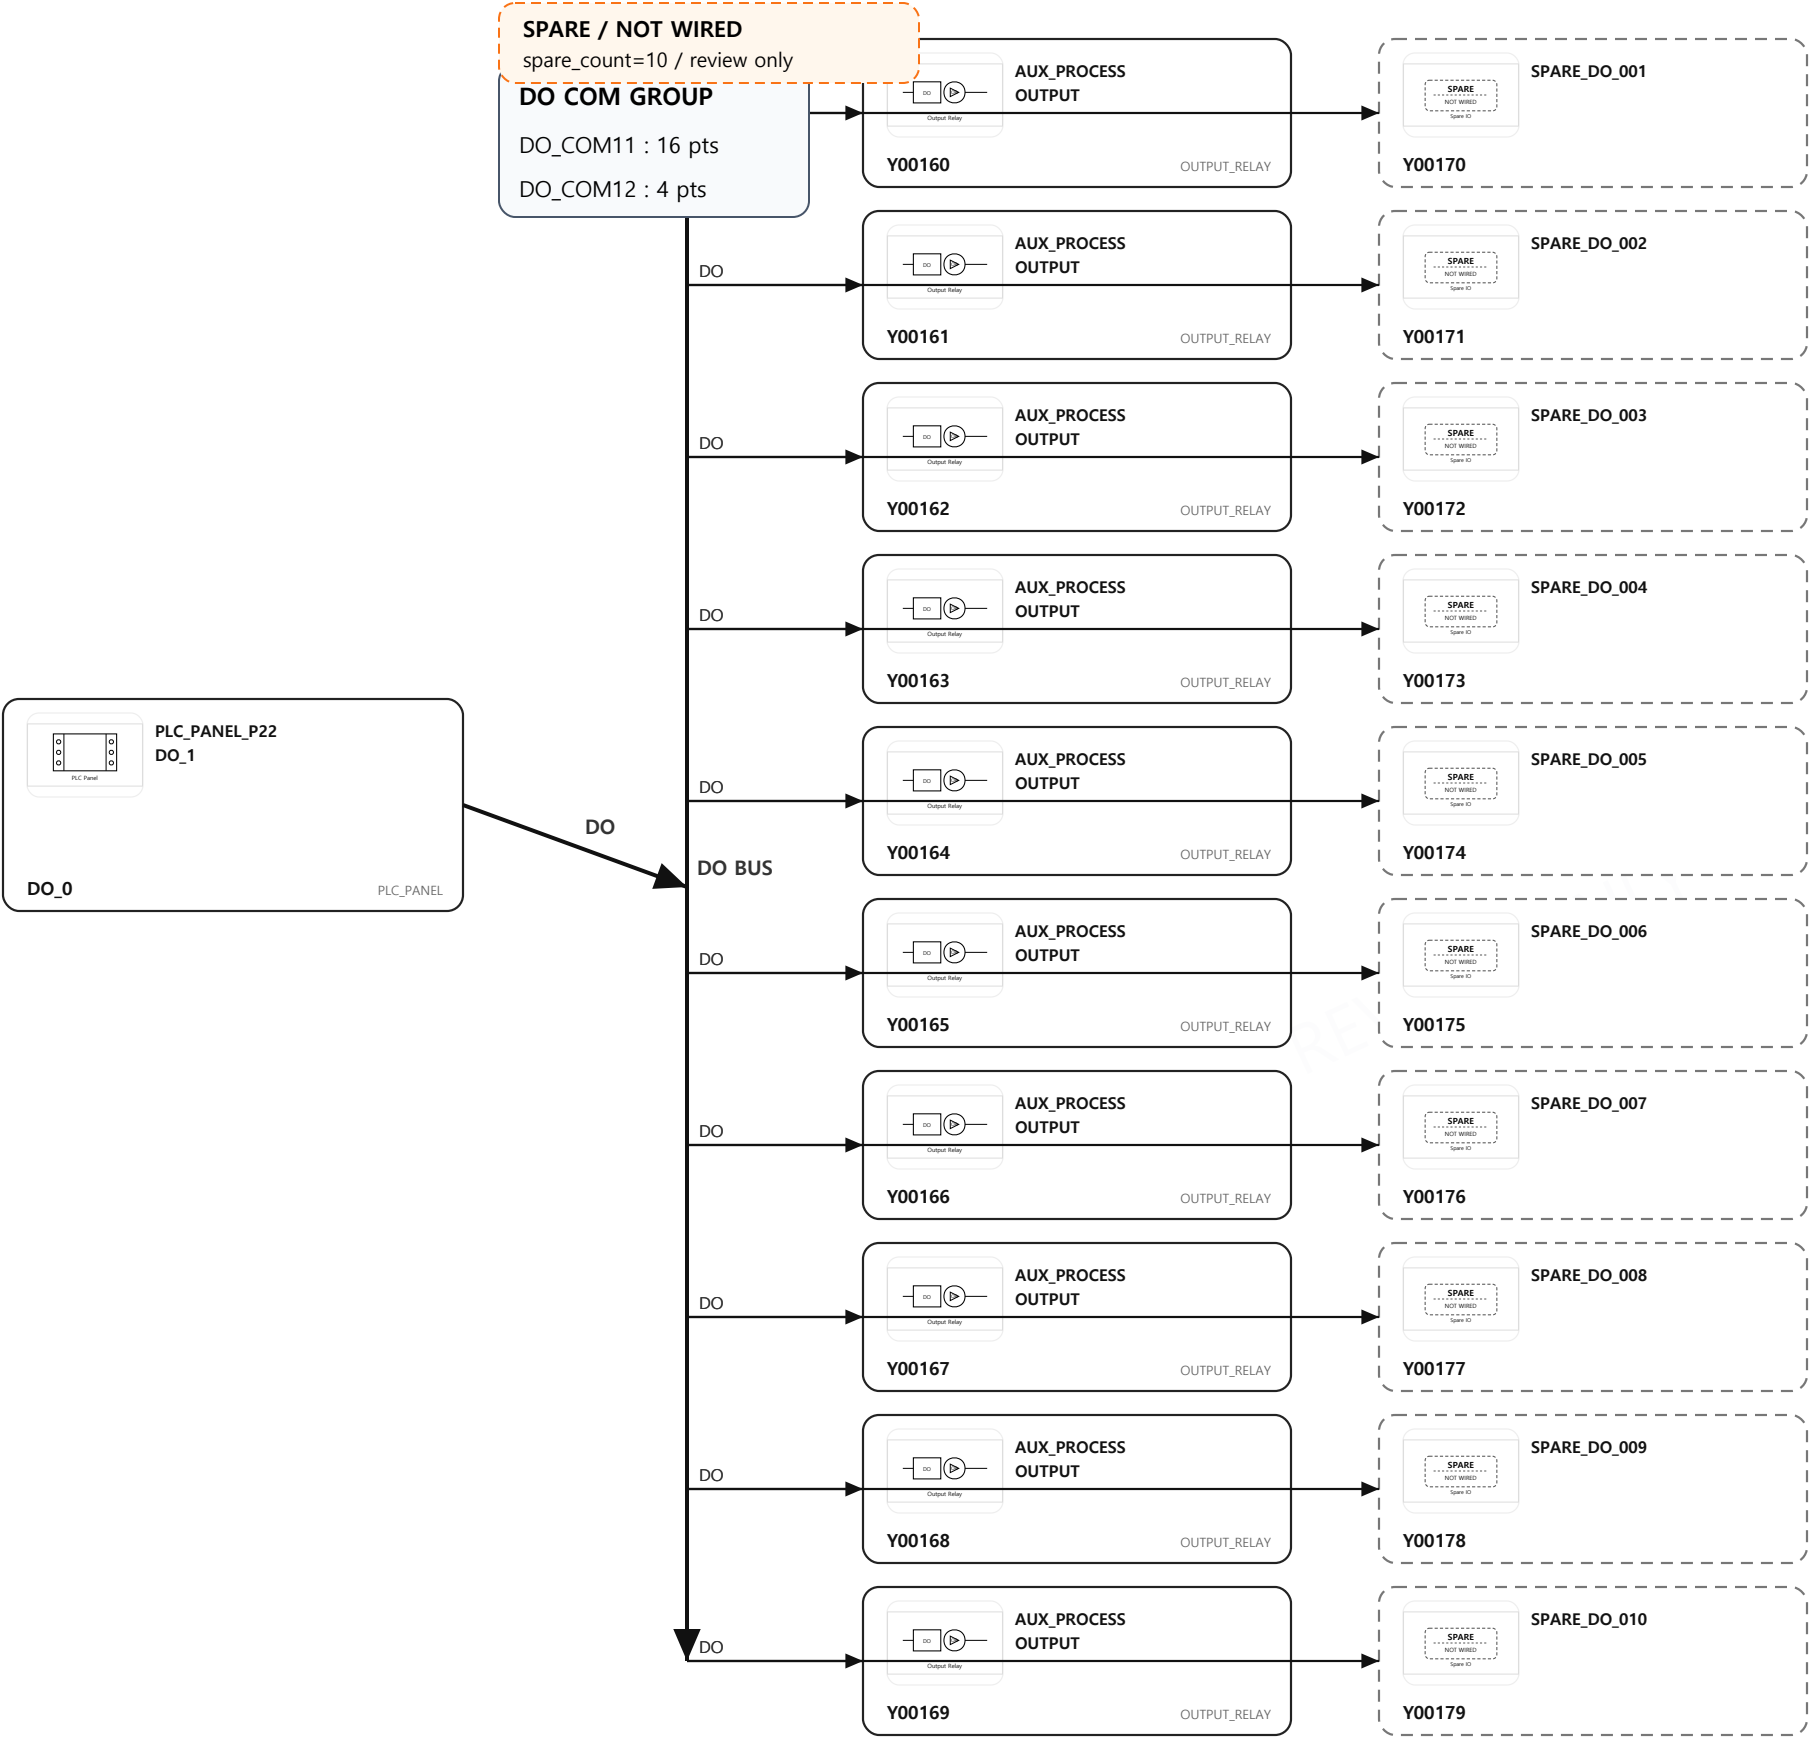

TITLE	DO Wiring 161-180
DRAWING NO	P22_DO_161_180
CASE	PLC-20260512-TYPE4-IO500-WW-001
REV / STATUS	A / REVIEW ONLY
GENERATED	2026-05-14 14:21

DO Wiring 181-200


PLC Package Viewer / TURN118_ENGINEERING_CLOSEOUT_CHECKLIST_REVIEW_ONLY_V1

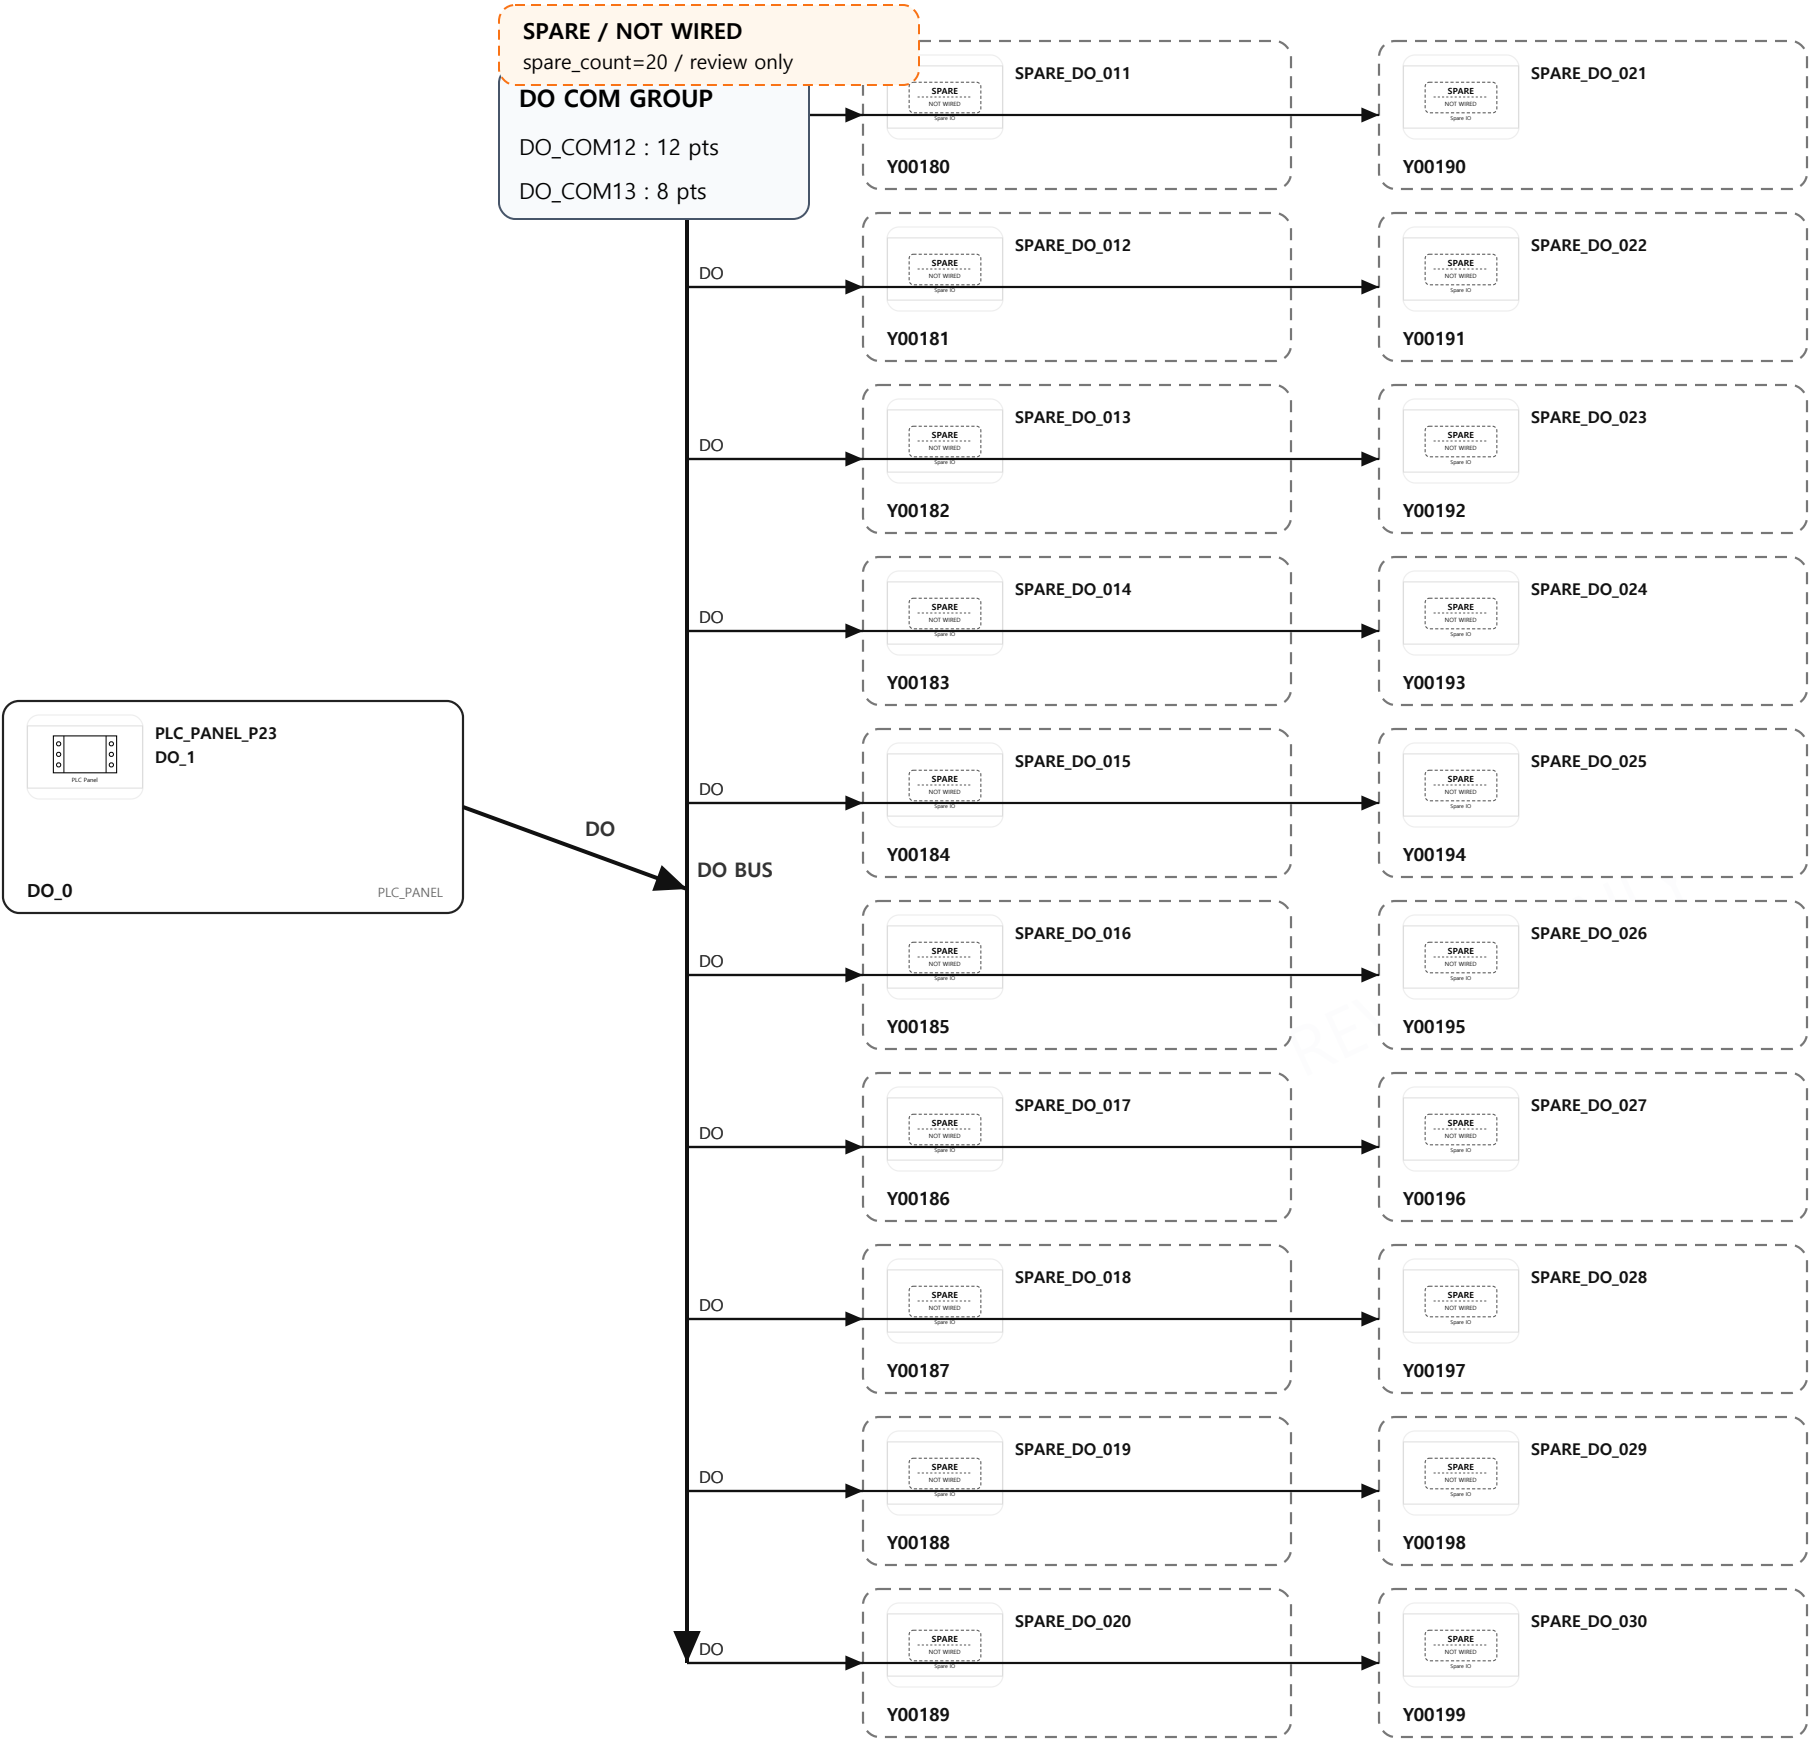

TITLE	DO Wiring 181-200
DRAWING NO	P23_DO_181_200
CASE	PLC-20260512-TYPE4-IO500-WW-001
REV / STATUS	A / REVIEW ONLY
GENERATED	2026-05-14 14:21

Safety Circuit Wiring Candidate

PLC_REVIEW_PACKAGE_EXTERNAL_SAFE_V1 / REVIEW ONLY / Case: PLC-20260512-TYPE4-IO500-WW-001

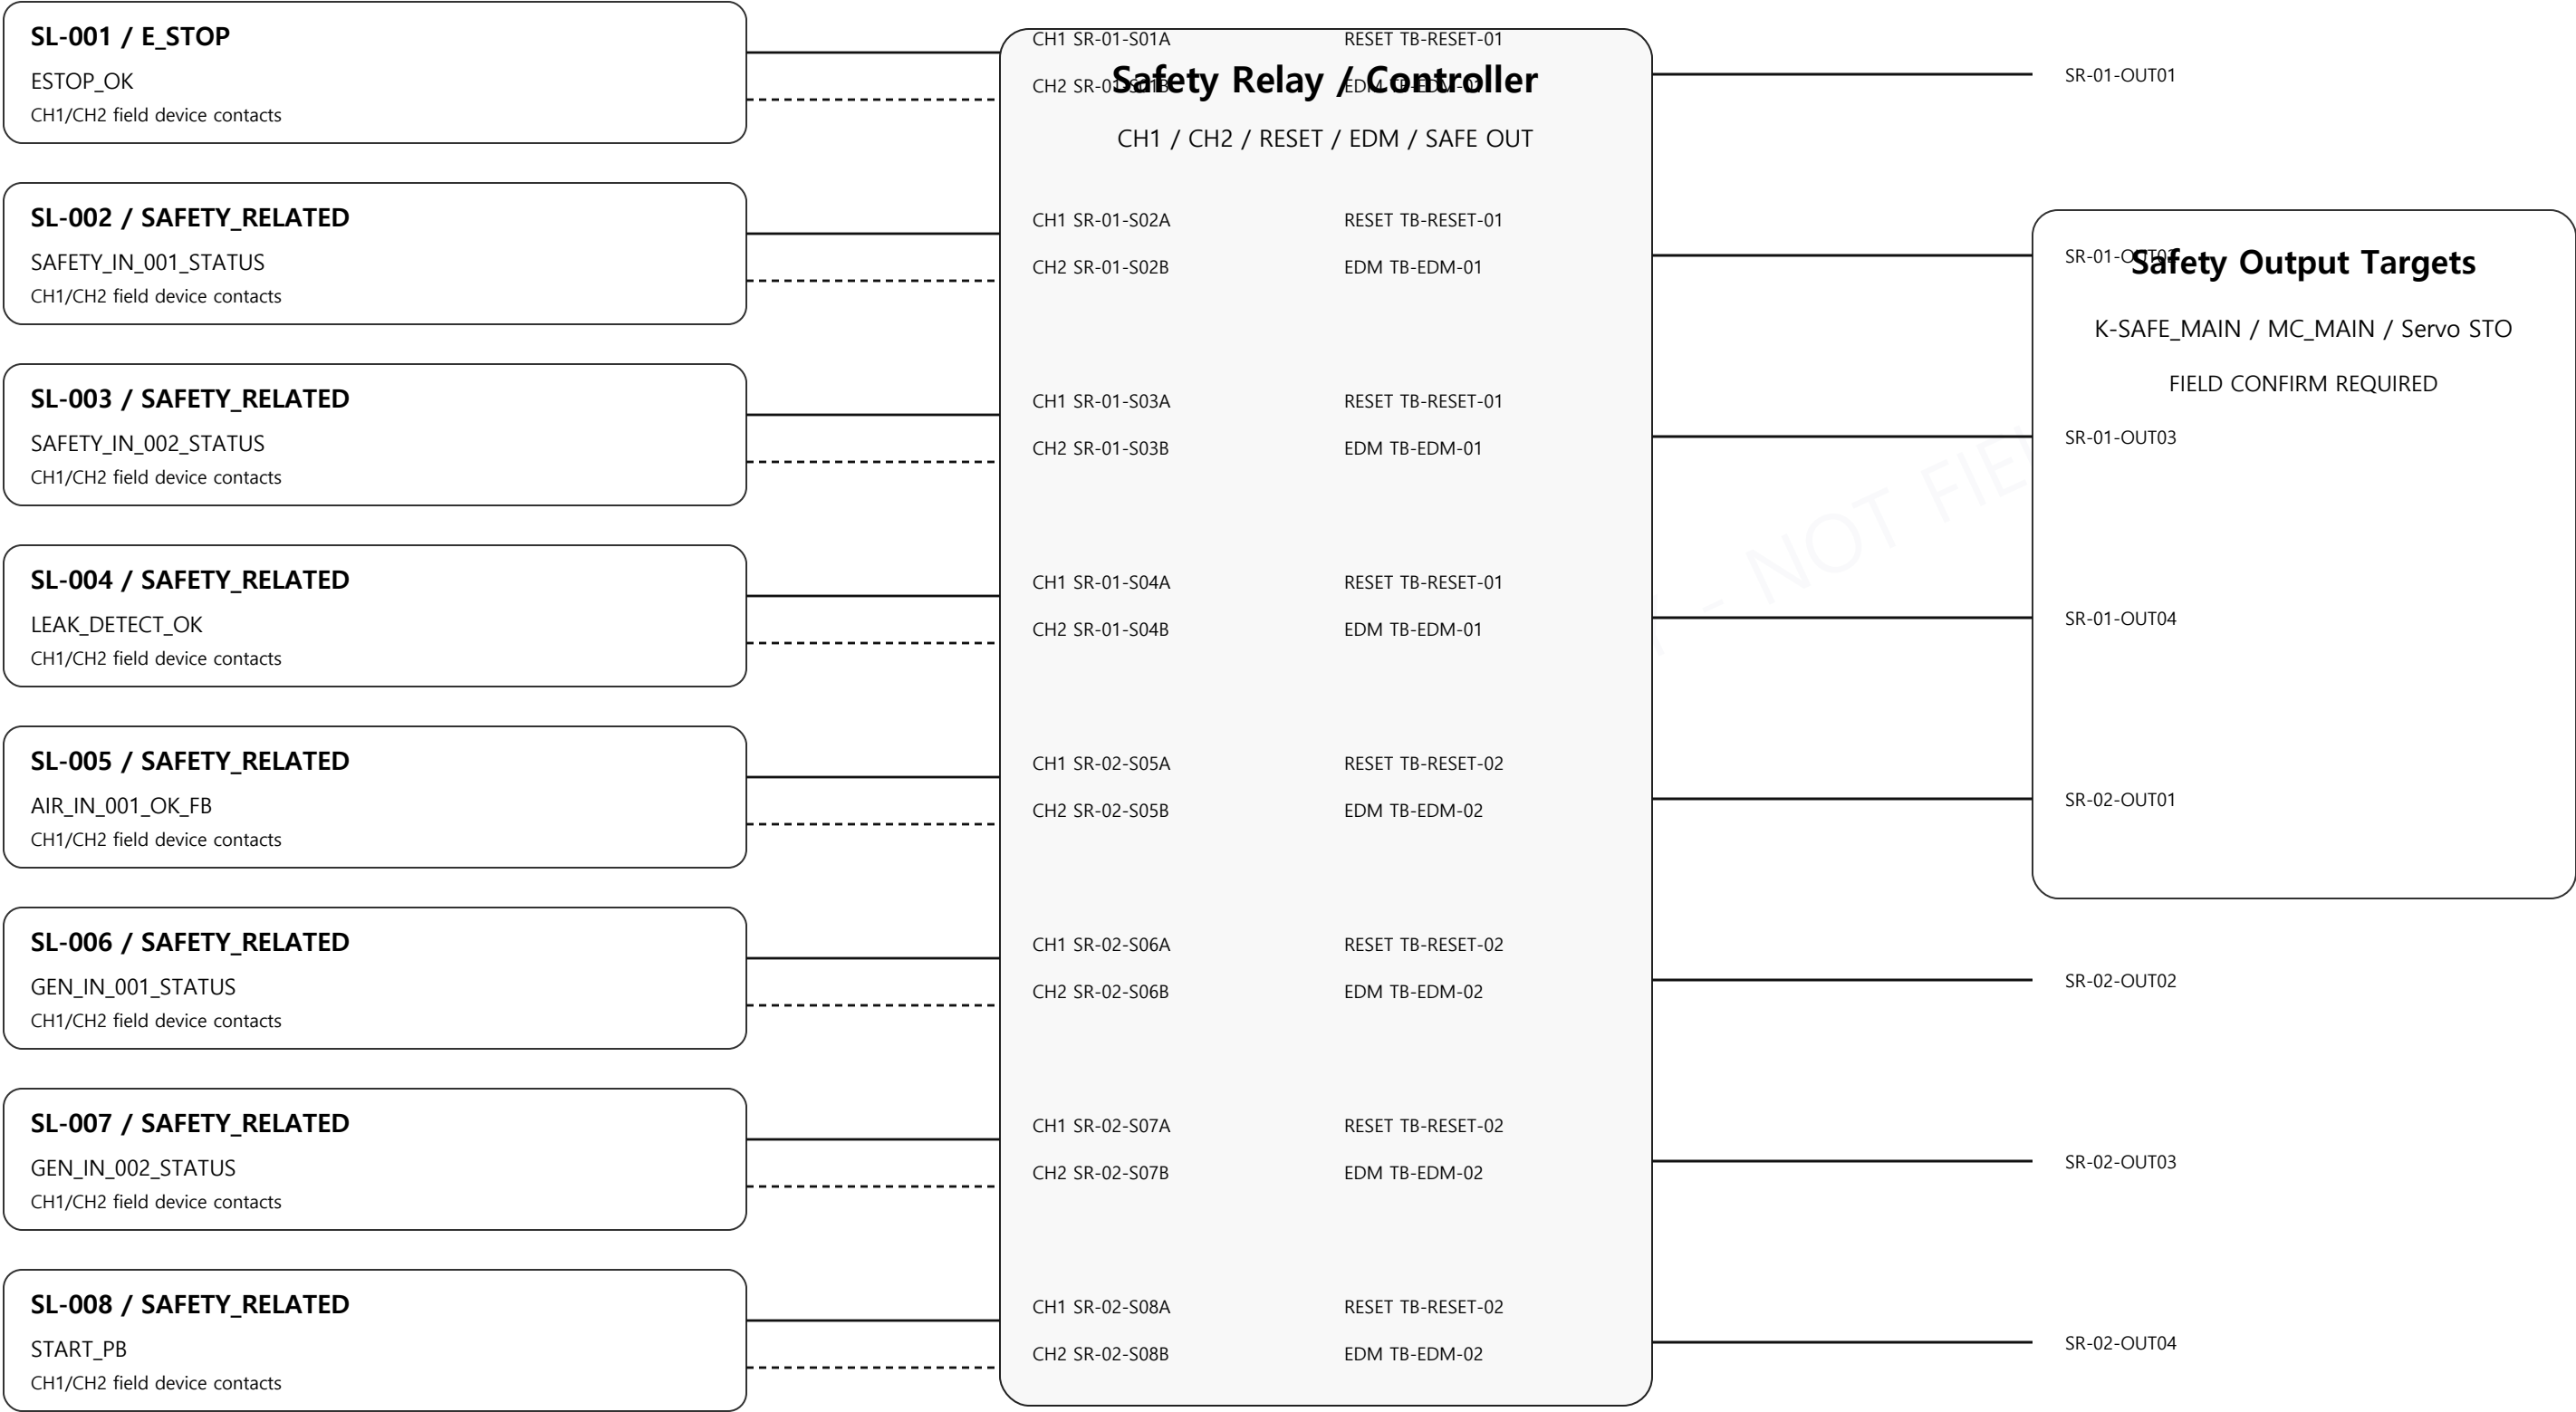


TITLE	Safety Circuit Wiring Candidate
STATUS	REVIEW ONLY / NOT FIELD FINAL
GENERATED	2026-05-14T14:20:01

P70 Power Circuit - MCC Review Candidate

Case: PLC-20260512-TYPE4-IO500-WW-001 | MCC candidate power circuit | IO 456 | Vendor: LS_XGT_MANUAL_REVIEW

REVIEW ONLY
Auto-generated candidate for engineer review

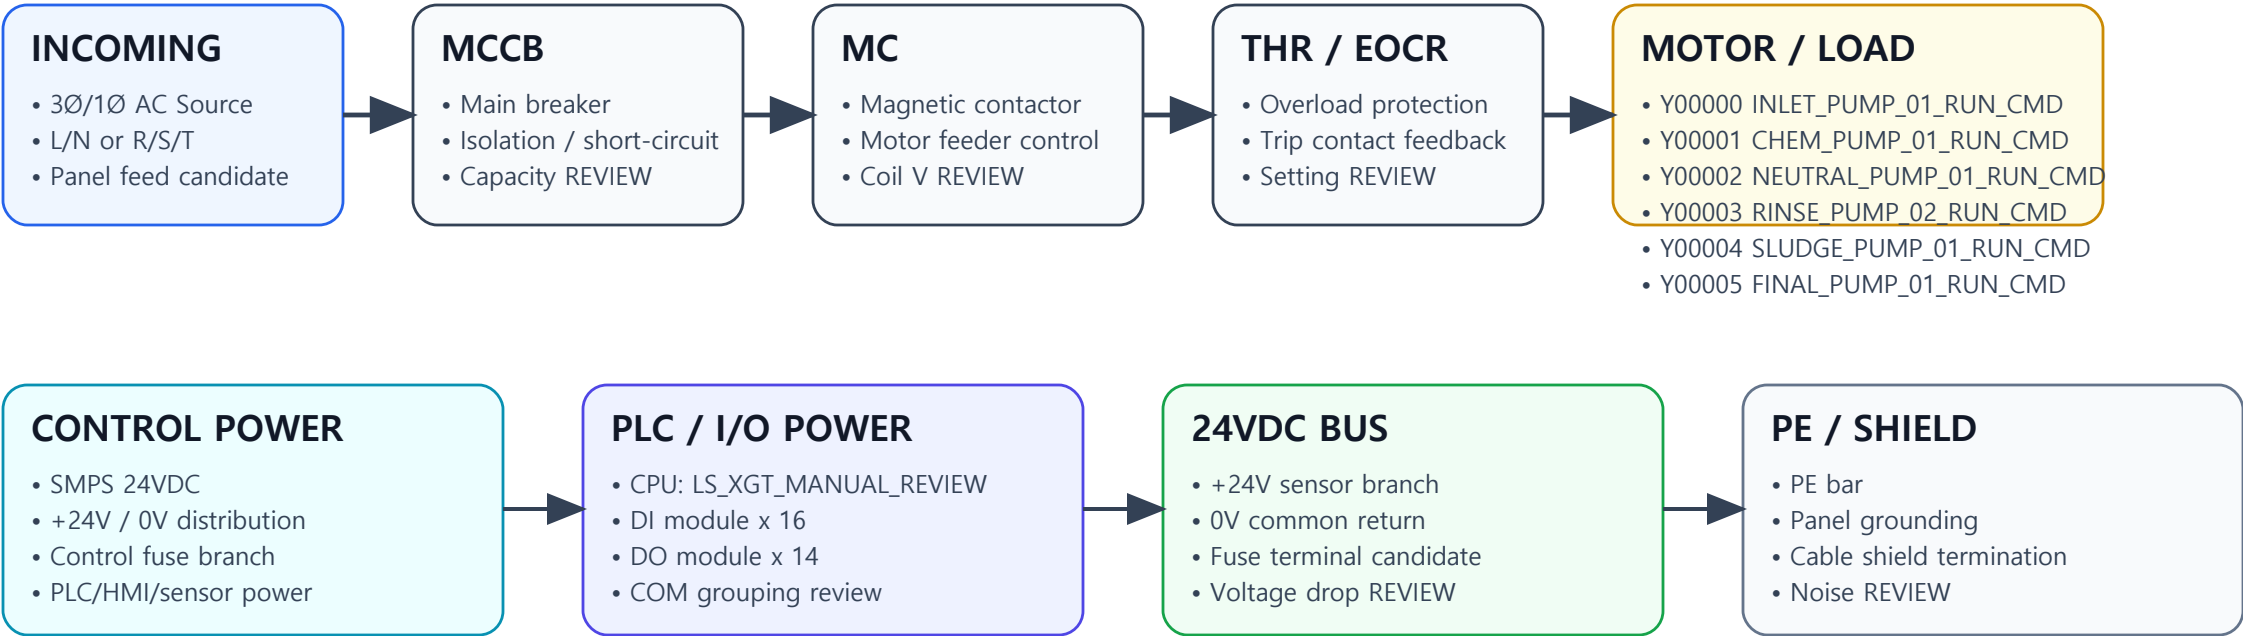

MCC REVIEW CHECKLIST

- MCCB capacity: REVIEW REQUIRED
- Motor rating / FLA: REVIEW REQUIRED
- Wire size / terminal: REVIEW REQUIRED
- MC coil voltage: REVIEW REQUIRED
- THR/EOCR range: REVIEW REQUIRED
- SMPS capacity: REVIEW REQUIRED
- 24VDC/0V branch fuse: REVIEW REQUIRED
- PE / shield standard: REVIEW REQUIRED

PUMP / MOTOR MCC FEEDER CANDIDATES

- MCC-01: Y00000 INLET_PUMP_01_RUN_CMD / MCCB+MC+THR / rating REVIEW
- MCC-02: Y00001 CHEM_PUMP_01_RUN_CMD / MCCB+MC+THR / rating REVIEW
- MCC-03: Y00002 NEUTRAL_PUMP_01_RUN_CMD / MCCB+MC+THR / rating REVIEW
- MCC-04: Y00003 RINSE_PUMP_02_RUN_CMD / MCCB+MC+THR / rating REVIEW
- MCC-05: Y00004 SLUDGE_PUMP_01_RUN_CMD / MCCB+MC+THR / rating REVIEW

FINAL CLOSEOUT POLICY

- Existing P70 has been strengthened from a simple power overview into an MCC review-candidate sheet.
- All capacities, ratings, wire sizes, grounding, and motor protection values remain engineer-confirmed REVIEW REQUIRED items.
- This drawing is not a field-issued construction drawing and does not change IO, logic, ST, Ladder, or interlock decisions.

P71 Panel Layout - Fabrication Review Candidate

Case: PLC-20260512-TYPE4-IO500-WW-001 | Fabrication review candidate | Vendor: LS_XGT_MANUAL_REVIEW

REVIEW ONLY
Auto-generated candidate for engineer review

CONTROL PANEL INTERNAL LAYOUT CANDIDATE

REVIEW ONLY / DIMENSION NOT FINAL

TOP WIRE DUCT

DIN RAIL - POWER / PLC / RELAY

POWER ZONE

- MCCB / MCB / Fuse
- SMPS 24VDC
- Control power branch
- Heat clearance REVIEW
- Incoming cable gland

PLC RACK ZONE

- CPU x 1 (LS_XGT_MANUAL_REVIEW)
- DI module x 16 / DO module x 14
- DI 244 / DO 210 / AI 2
- Slot/address label area
- Future module clearance

RELAY BANK

- Interposing relay
- Safety relay/controller
- Surge suppressor
- Manual reset/EDM wiring
- Service replacement space

HMI / NETWORK

- HMI/door device candidate
- Ethernet switch
- Engineering port
- Remote I/O option
- Cable bend radius REVIEW

DIN RAIL - TERMINAL BLOCK / PE / SPARE

TERMINAL BLOCK - DI / SENSOR

- Terminal blocks: 0
- +24V / 0V sensor branch
- DI COM group review

TERMINAL BLOCK - DO / LOAD

- Cables: 0
- Load fuse / relay interface
- DO COM group review

PE BAR

- Protective earth
- Shield termination
- Noise separation

SPARE SPACE

- Future I/O expansion
- Spare terminal / duct capacity
- Panel size REVIEW

BOTTOM WIRE DUCT

PANEL REVIEW NOTES


- Existing P71 has been strengthened into a panel fabrication review candidate layout with DIN rail, duct, PLC rack, relay bank, terminal, PE bar, and spare space zones.
- Actual panel size, heat, device dimension, spacing, manufacturable wiring route, and shop standards remain REVIEW REQUIRED.

P72 Network Topology

Case: PLC-20260512-TYPE4-IO500-WW-001 | IO: 456 | Network candidate topology

REVIEW ONLY

Engineer review draft

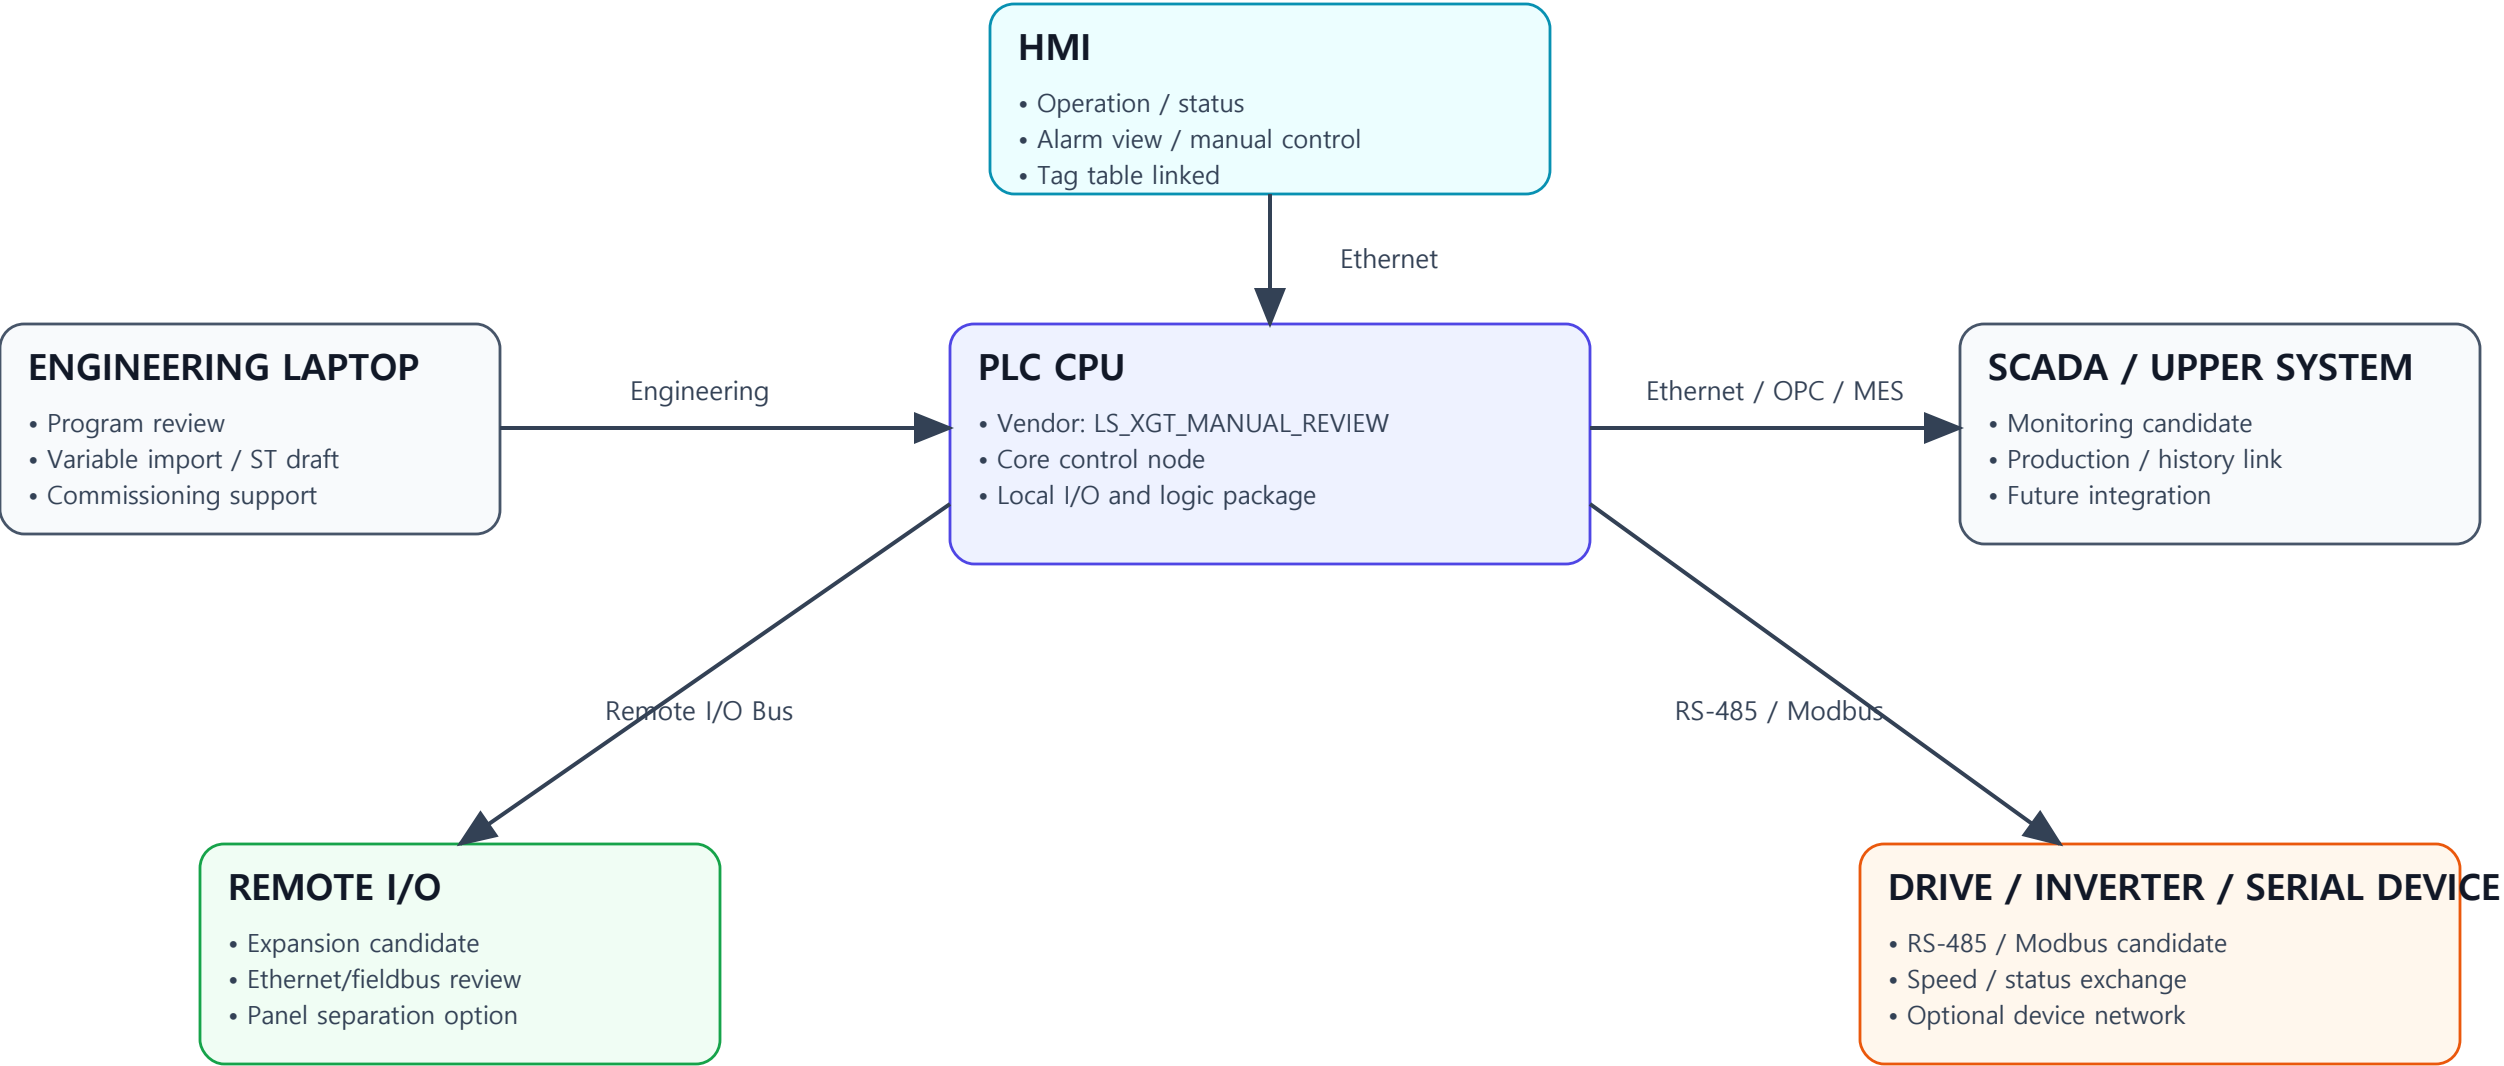

NETWORK REVIEW NOTES

- Current package did not yet finalize real communication engineering. This topology is a review-only candidate.
- HMI / PLC / upper system / remote I/O relationships are visualized to raise package completeness and explain value quickly.
- Actual IP addresses, protocol, port assignment, and remote I/O station details need engineer confirmation.

PLC Final Electrical Review Package Index

REVIEW ONLY / NOT FIELD FINAL

CASE: PLC-20260512-TYPE4-IO500-WW-001

GRADE: A_REVIEW_READY / READY 6/6

01. terminal_numbers	READY
02. plc_slot_channel	READY
03. power_common	READY
04. protection_devices	READY
05. cable_wire_numbers	READY
06. safety_circuit_candidate	READY

TITLE	Final Package Index
STATUS	REVIEW ONLY
GENERATED	2026-05-14T14:20:14

P00 Master Drawing Index

Case: PLC-20260512-TYPE4-IO500-WW-001 | Drawing Index Ready 19/19 | REVIEW ONLY

REVIEW ONLY
Auto-generated candidate for engineer review

01. DI Wiring

• 05_drawings | READY | DI wiring page group

02. DO Wiring

• 05_drawings | READY | DO wiring page group

03. Safety Circuit

• 05_drawings | READY | Safety relay/controller candidate

04. Power Circuit

• 05_drawings/P70_POWER_CIRCUIT_OVERVIEW.pdf | READY | Power overview

05. Panel Layout

• 05_drawings/P71_PANEL_LAYOUT.pdf | READY | Panel layout

06. Network Topology

• 05_drawings/P72_NETWORK_TOPOLOGY.pdf | READY | Communication topology

07. Ladder Visual

• 03_logic_review/ladder_draft_visual.pdf | READY | Ladder visual review

08. QA Dashboard

• 00_PACKAGE_QA_DASHBOARD.pdf | READY | Package first page

09. Data Pipeline Map

• 05_drawings/P00_PACKAGE_DATA_PIPELINE_MAP.pdf | READY | Package flow map

10. Combined Drawings PDF


• 05_drawings/00_ALL_DRAWINGS_COMBINED.pdf | READY | Merged drawing pack

P00 PLC Package Data Pipeline Map

Case: PLC-20260512-TYPE4-IO500-WW-001 | PLC package overview | IO: 456

REVIEW ONLY

Engineer review draft

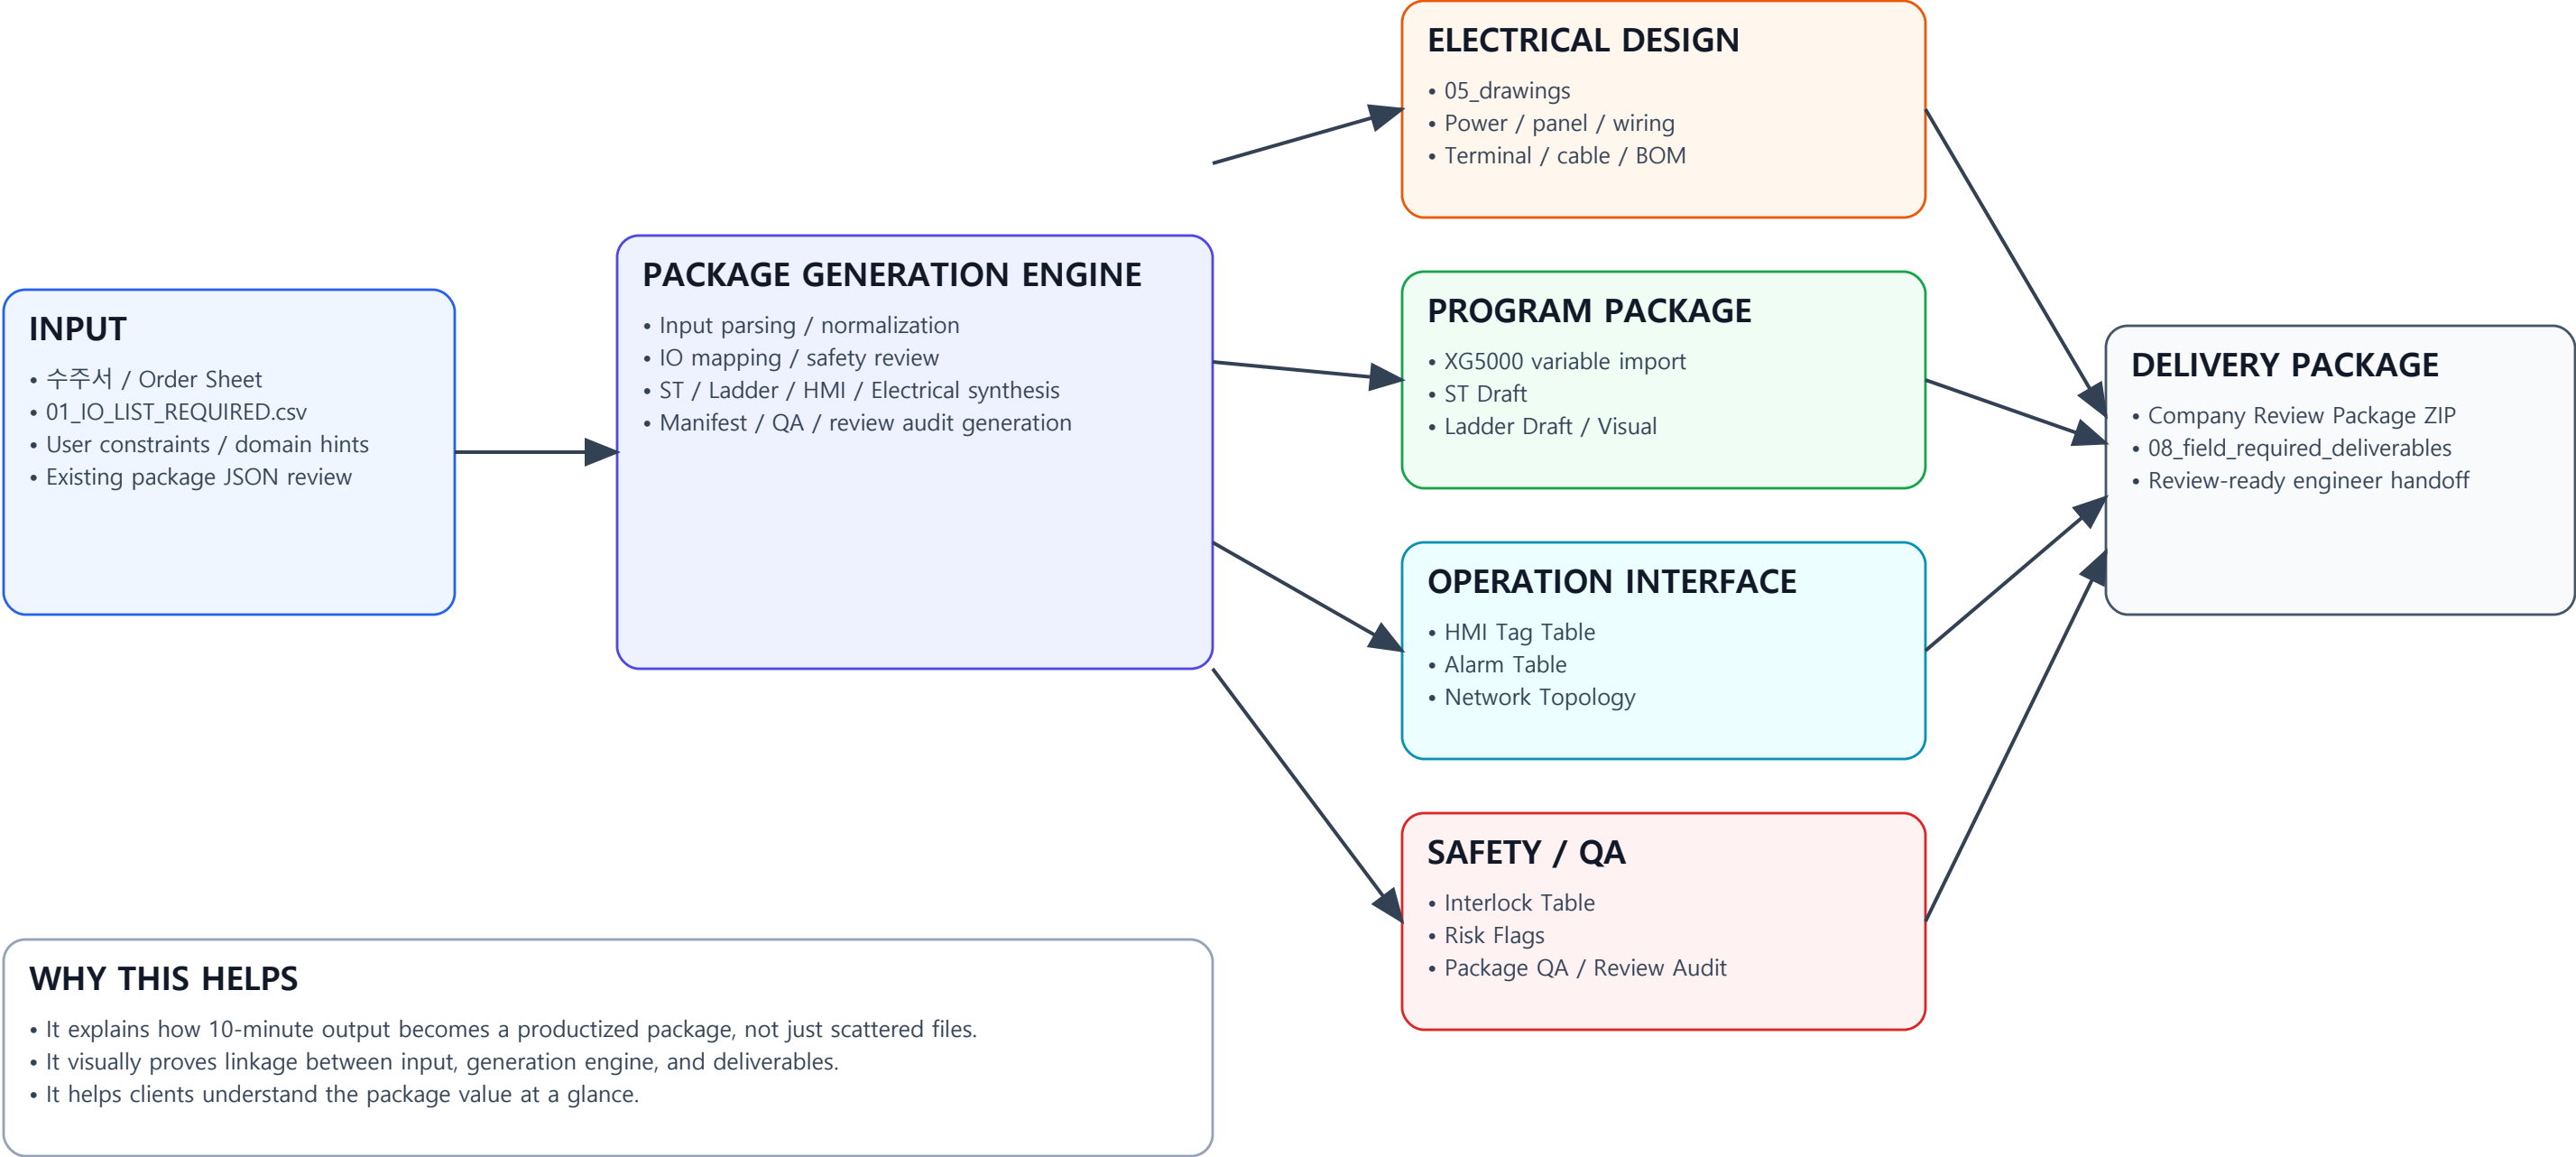

PLC PLC Package Viewer / PLC REVIEW PACKAGE EXTERNAL SAFE V1 / REVIEW ONLY / CASE PLC-20260512-TYPE4-IO500-WW-001



REVIEW ONLY - 검토용 Ladder 시각화입니다. 실제 PLC 빌드/현장 투입 전 엔지니어 검수가 필요합니다.

MAIN OPERATION

Case: PLC-20260512-TYPE4-IO500-WW-001

XP-Builder / XGT Panel Style



MODE: AUTO



RUN: READY




SAFETY: OK



ALARM: 16 LIST

Process Flow Simulator

Generated screen concept for XP-Builder style review

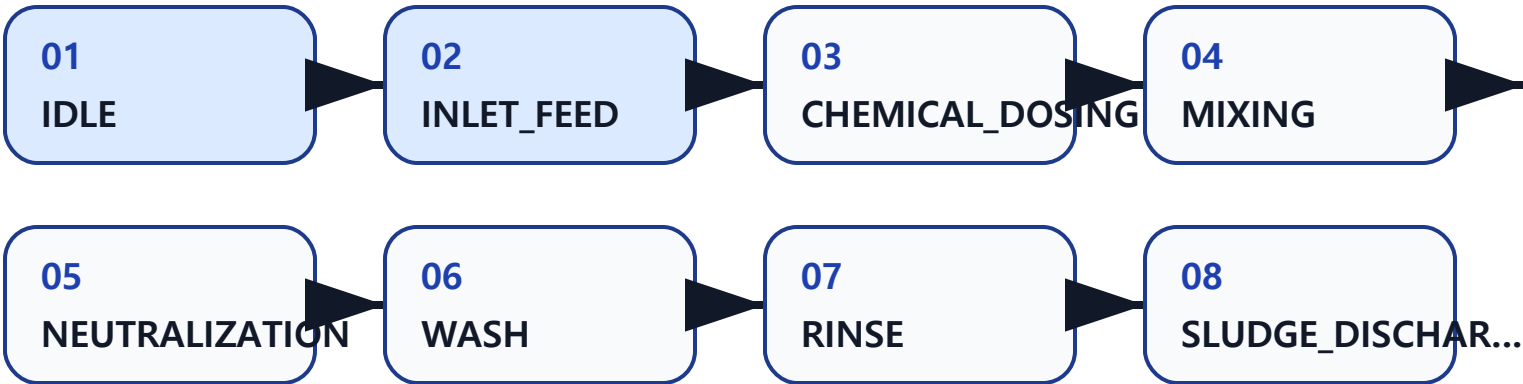

Operator Buttons



Live I/O Status

- X00000 estop_ok ON
- X00001 safety_door... ON
- X00002 safety_door... ON
- X00003 leak_detect... ON
- X00004 air_pressure... ON
- X00005 auto_mode_sel ON
- X00006 manual_mode... ON
- Y00000 inlet_feed_p... ON
- Y00001 chemical_dos... ON
- Y00002 neutral_tran... ON
- Y00003 rinse_circul... ON
- Y00004 sludge_disch... ON

EXPOSURE CONTROL: screen image only. No schema, domain_map, generator, wrapper, prompt, raw ST, or raw Ladder source is included.

MAIN

MANUAL

ALARM

I/O

SETTING

Visual simulator preview only — final XP-Builder project requires engine

MAIN OPERATION

Case: PLC-20260512-TYPE4-IO500-WW-001

XP-Builder / XGT Panel Style

MODE: AUTO


RUN: READY

SAFETY: OK

ALARM: 16 LIST

Process Flow Simulator

Generated screen concept for XP-Builder style review

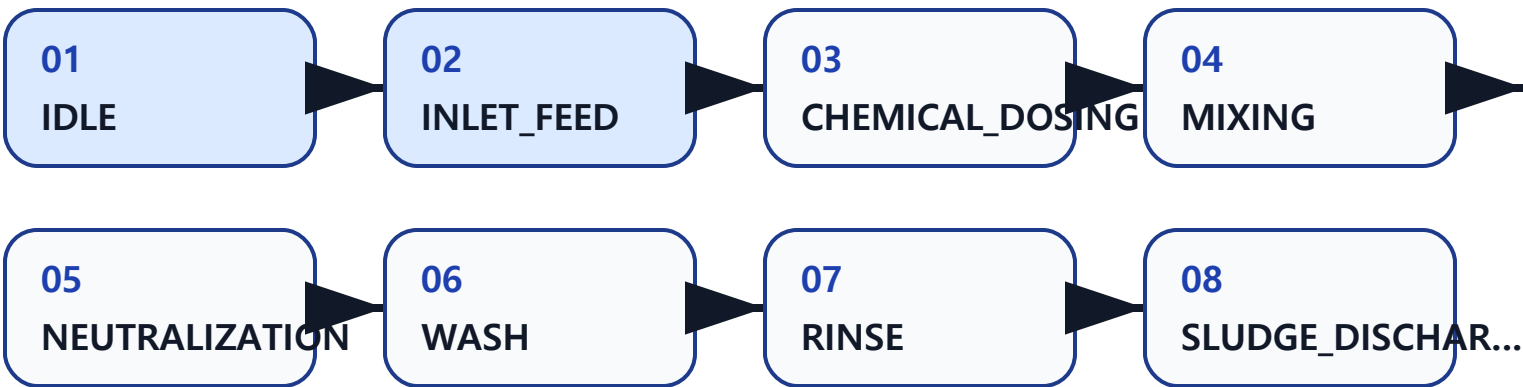

Operator Buttons



Live I/O Status

- X00000 estop_ok ON
- X00001 safety_door... ON
- X00002 safety_door... ON
- X00003 leak_detect... ON
- X00004 air_pressure... ON
- X00005 auto_mode_sel ON
- X00006 manual_mode... ON
- Y00000 inlet_feed_p... ON
- Y00001 chemical_dos... ON
- Y00002 neutral_tran... ON
- Y00003 rinse_circul... ON
- Y00004 sludge_disch... ON

EXPOSURE CONTROL: screen image only. No schema, domain_map, generator, wrapper, prompt, raw ST, or raw Ladder source is included.

MAIN

MANUAL

ALARM

I/O

SETTING

Visual simulator preview only — final XP-Builder project requires engine

XP-Builder Style Alarm List

Operator alarm preview / ACK and reset policy are review-required

NO	ALARM MESSAGE	CONDITION	ACTION / RESET	ACK
01	비상정지 입력 비정상	NOT estop_ok	Remove cause → RESET/ACK	WAIT
02	안전문 열림	NOT safety_door_01_closed OR NOT s...	Remove cause → RESET/ACK	WAIT
03	누액 감지	NOT leak_detect_ok	Remove cause → RESET/ACK	WAIT
04	공압 압력 저하	NOT air_pressure_ok	Remove cause → RESET/ACK	WAIT
05	원수 유입 탱크 저수위	NOT inlet_tank_level_low_ok	Remove cause → RESET/ACK	WAIT
06	원수 유입 탱크 고수위	inlet_tank_level_high	Remove cause → RESET/ACK	WAIT
07	약품 탱크 저수위	NOT chemical_tank_level_low_ok	Remove cause → RESET/ACK	WAIT
08	중화 탱크 저수위	NOT neutral_tank_level_low_ok	Remove cause → RESET/ACK	WAIT
09	히터 과온	NOT heater_overtemp_ok OR ai_neutr...	Remove cause → RESET/ACK	WAIT
10	pH 이상	NOT ph_in_range	Remove cause → RESET/ACK	WAIT
11	최종 배출 유량 없음	NOT final_discharge_flow_ok AND cu...	Remove cause → RESET/ACK	WAIT
12	컨베이어 잼	NOT conveyor_jam_ok	Remove cause → RESET/ACK	WAIT
13	스크류 막힘/슬러지 배출 이상	NOT screw_clog_ok OR NOT sludge_sc...	Remove cause → RESET/ACK	WAIT
14	밸브 열림/닫힘 시간초과	T_VALVE_OPEN_TIMEOUT.Q OR T_VALVE_...	Remove cause → RESET/ACK	WAIT

FINAL POLICY: alarm severity, ACK, reset behavior, and PLC linkage require responsible engineer/vendor approval.

EXPOSURE CONTROL: alarm preview only; no raw logic/schema/domain_map/generator information is included.

XP-Builder Style Alarm List

Operator alarm preview / ACK and reset policy are review-required

NO	ALARM MESSAGE	CONDITION	ACTION / RESET	ACK
01	비상정지 입력 비정상	NOT estop_ok	Remove cause → RESET/ACK	WAIT
02	안전문 열림	NOT safety_door_01_closed OR NOT s...	Remove cause → RESET/ACK	WAIT
03	누액 감지	NOT leak_detect_ok	Remove cause → RESET/ACK	WAIT
04	공압 압력 저하	NOT air_pressure_ok	Remove cause → RESET/ACK	WAIT
05	원수 유입 탱크 저수위	NOT inlet_tank_level_low_ok	Remove cause → RESET/ACK	WAIT
06	원수 유입 탱크 고수위	inlet_tank_level_high	Remove cause → RESET/ACK	WAIT
07	약품 탱크 저수위	NOT chemical_tank_level_low_ok	Remove cause → RESET/ACK	WAIT
08	중화 탱크 저수위	NOT neutral_tank_level_low_ok	Remove cause → RESET/ACK	WAIT
09	히터 과온	NOT heater_overtemp_ok OR ai_neutr...	Remove cause → RESET/ACK	WAIT
10	pH 이상	NOT ph_in_range	Remove cause → RESET/ACK	WAIT
11	최종 배출 유량 없음	NOT final_discharge_flow_ok AND cu...	Remove cause → RESET/ACK	WAIT
12	컨베이어 잼	NOT conveyor_jam_ok	Remove cause → RESET/ACK	WAIT
13	스크류 막힘/슬러지 배출 이상	NOT screw_clog_ok OR NOT sludge_sc...	Remove cause → RESET/ACK	WAIT
14	밸브 열림/닫힘 시간초과	T_VALVE_OPEN_TIMEOUT.Q OR T_VALVE_...	Remove cause → RESET/ACK	WAIT

FINAL POLICY: alarm severity, ACK, reset behavior, and PLC linkage require responsible engineer/vendor approval.

EXPOSURE CONTROL: alarm preview only; no raw logic/schema/domain_map/generator information is included.

Manual Operation Simulator

Display-only concept. Actual manual output permission must be safety-gated in PLC and HMI authority settings.

Manual Output Buttons

Y00000 inlet_feed_pump_01_run_...	ON
Y00001 chemical_dosing_pump_02...	ON
Y00002 neutral_transfer_pump_0...	ON
Y00003 rinse_circulation_pump_...	ON
Y00004 sludge_discharge_pump_0...	ON
Y00005 final_discharge_pump_06...	ON
Y00006 inlet_feed_pump_07_run_...	ON
Y00007 chemical_dosing_pump_08...	ON
Y00008 neutral_transfer_pump_0...	ON
Y00009 rinse_circulation_pump_...	ON

Interlock Conditions

- Safety OK ON
- Auto Run OFF ON
- Manual Mode ON ON
- Air Pressure OK ON
- No Critical Alarm ON
- Door Closed ON
- Reset Ready REVIEW
- Engineer Review REVIEW

Input Feedback

- X00000 estop_ok ON
- X00001 safety_door_... ON
- X00002 safety_door_... ON
- X00003 leak_detect_... ON
- X00004 air_pressure... ON
- X00005 auto_mode_sel ON
- X00006 manual_mode_... ON
- X00007 start_pb ON

MANUAL POLICY: this is not a bypass design. Manual controls must remain safety/interlock gated and require responsible engineer approval.
EXPOSURE CONTROL: visual screen concept only; no raw PLC/HMI project file, schema, prompt, or generator source is exposed.

Engineering Closeout Checklist

Case: PLC-20260512-TYPE4-IO500-WW-001

XP-Builder / XGT Panel Style

REVIEW ONLY / NOT FIELD FINAL / ENGINEER CONFIRM REQUIRED

Vendor: LS_XGT_MANUAL_REVIEW | IO: 502

AREA	CLOSEOUT ITEM	STATUS	ENGINEERING NOTE
Electrical	MCCB / MC capacity	REVIEW REQUIRED	Confirm motor FLA, load current, breaker/contact rating before ...
Electrical	SMPS 24VDC capacity	REVIEW REQUIRED	Calculate PLC, HMI, sensor, relay and spare load current with e...
Electrical	Wire size / terminal spec	REVIEW REQUIRED	Confirm wire gauge, terminal model, ferrule, duct route, heat a...
Safety	Safety relay / controller model	REVIEW REQUIRED	Select device model and confirm PLr/SIL/category with responsib...
Safety	SL-001~008 field wiring	FIELD CONFIRM	Confirm CH1/CH2, RESET, EDM and safe output wiring at actual ma...
PLC	XG5000 variable/address mapping	IMPORT REVIEW REQUIRED	Import CSV, check duplicate addresses, variable names, comments...
HMI	XP-Builder tag binding	HMI BINDING REQUIRED	Bind HMI objects to PLC tags and confirm permissions, alarms, r...
Network	IP / protocol / station setup	NETWORK REVIEW	Confirm PLC-HMI-SCADA IP, protocol, port, station number and up...
Commissioning	Dry-run / simulation / I/O test	REVIEW REQUIRED	Run offline review first, then panel I/O test and supervised ma...

FIELD RELEASE LOCK

This package is blocked from field issue until every closeout item is confirmed by the responsible engineer.

EXPOSURE CONTROL

No schema, domain_map, prompt, generator, wrapper, raw ST or raw Ladder source is exposed on this page.

FINAL POLICY: Review-ready engineering handoff only. Not a construction drawing, not a build guarantee, not a machine RUN approval.