
Mean CV 0 Values by DSSP Full Secondary Structure and Residue - MLCV-TRANS

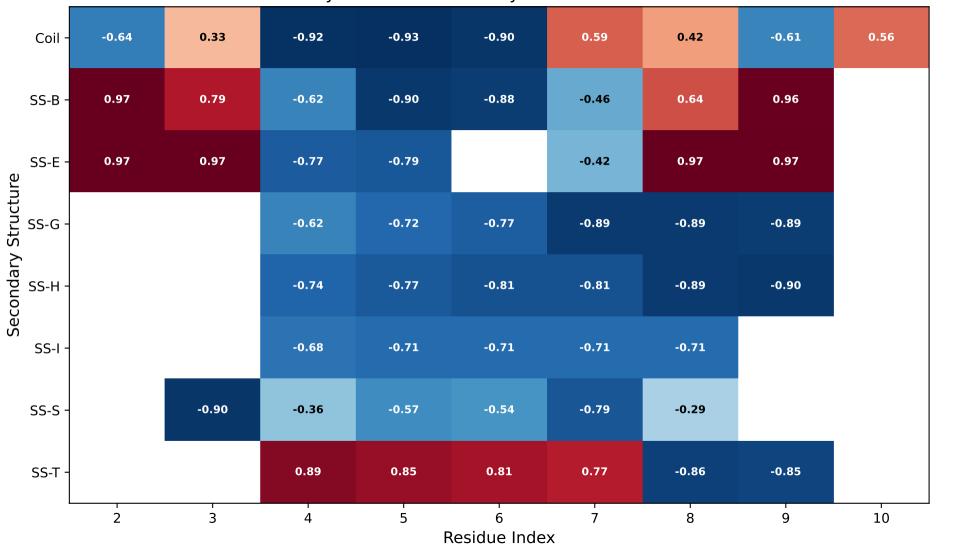

- 0.75

- 0.50

0.00

ŀ −0.50