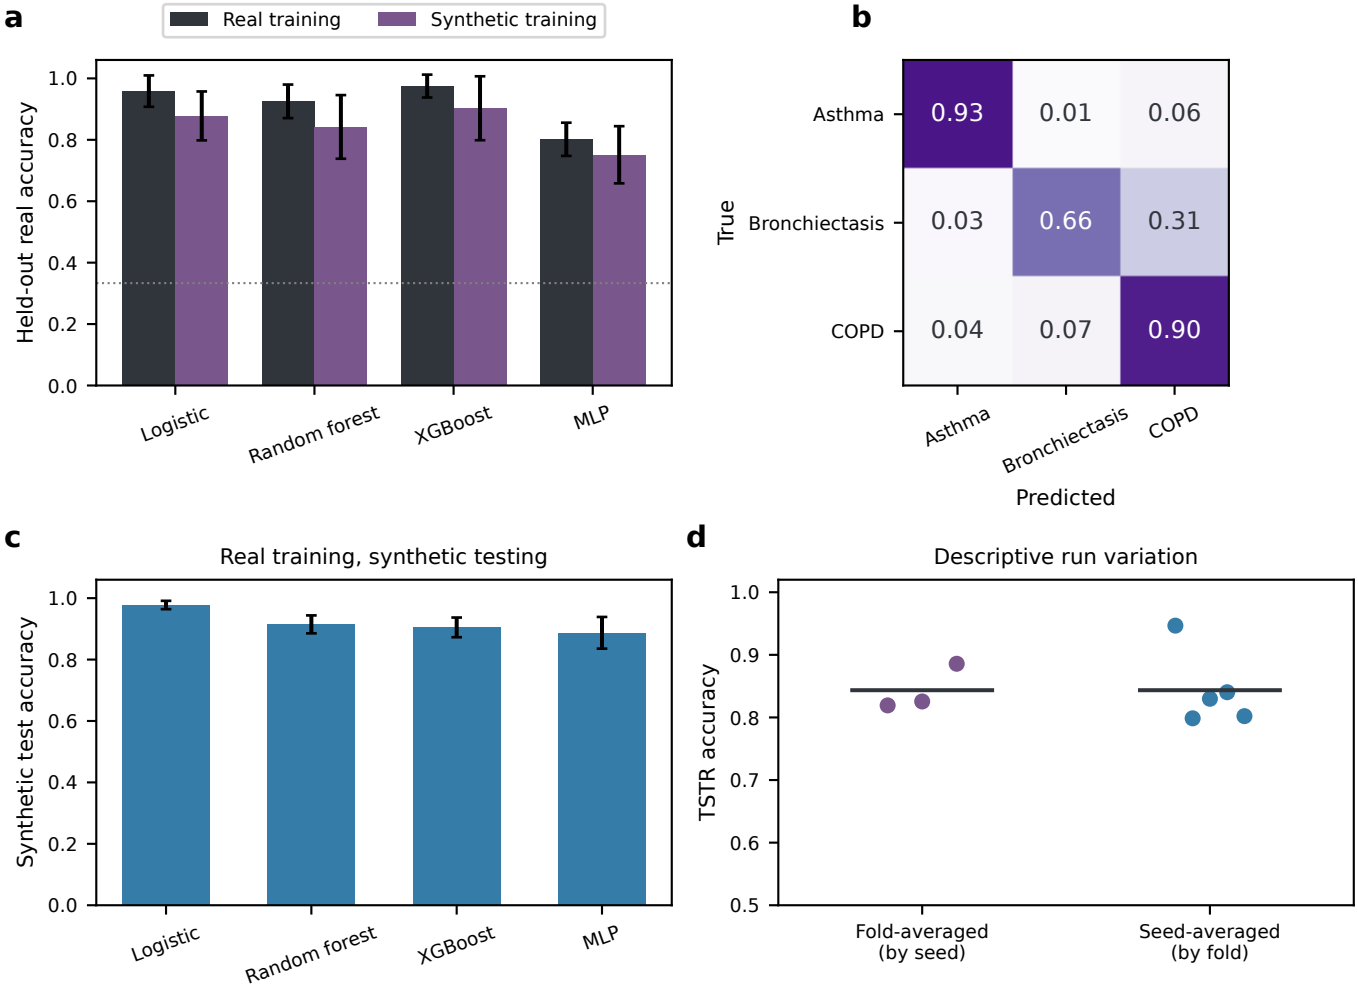
a
Real training
Synthetic training
Held-out real accuracy
1.0
0.8
0.6
0.4
0.2
0.0
Logistic
Random forest
XGBoost
MLP
b
True
Asthma
Bronchiectasis
COPD
0.93
0.01
0.06
0.03
0.66
0.31
0.04
0.07
0.90
Asthma
Bronchiectasis
COPD
Predicted
c
Real training, synthetic testing
Synthetic test accuracy
1.0
0.8
0.6
0.4
0.2
0.0
Logistic
Random forest
XGBoost
MLP
d
Descriptive run variation
TSTR accuracy
1.0
0.9
0.8
0.7
0.6
0.5
Fold-averaged
(by seed)
Seed-averaged
(by fold)