


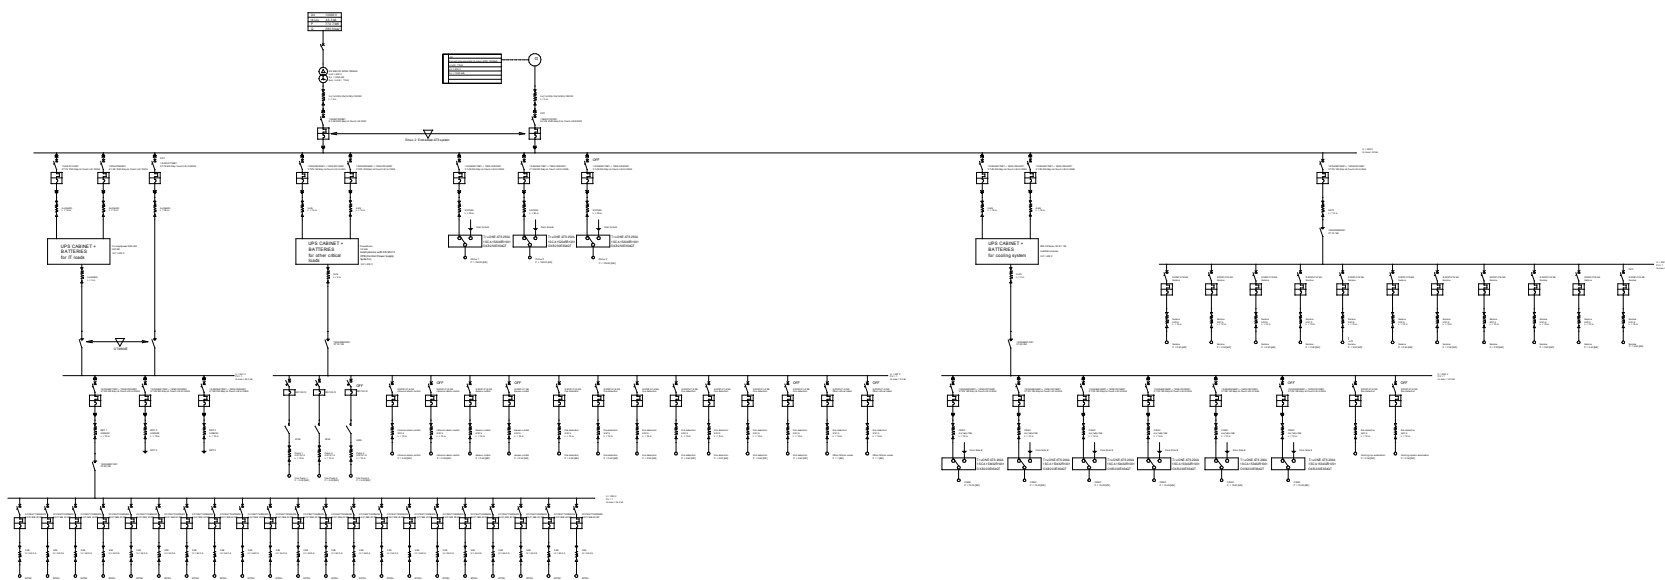

NOTES

This topology represents both, the power supply for the IT load and the power supply for the non-IT loads.

This topology represents side A of power supply

For other notes, please refer to document attached with this file

Maximum Load Breakdown

IT load	441 kW
Cooling load	275 kW
Critical load	19 kW
Non-critical load	25 kW
Total data center load	760 kW

Project Name		Project No.	
Client Name		Client No.	
Project Location		Project Date	
Project Manager		Project Engineer	
Project Status		Project Budget	
Project Risk		Project Impact	
Project Notes		Project Comments	
Project Sign-off		Project Approval	
Project Review		Project Feedback	
Project Close		Project Archive	

