




SAFETY — DO NOT USE FOR ENERGIZED WORK. This document is not for use in work on live or energized electrical equipment. Before conducting any work on the equipment listed in this document, consult your engineer and qualified safety personnel, and follow your organization's electrical safety program and documentation.

NOT AN ENGINEERING DOCUMENT · NOT FOR FIELD USE

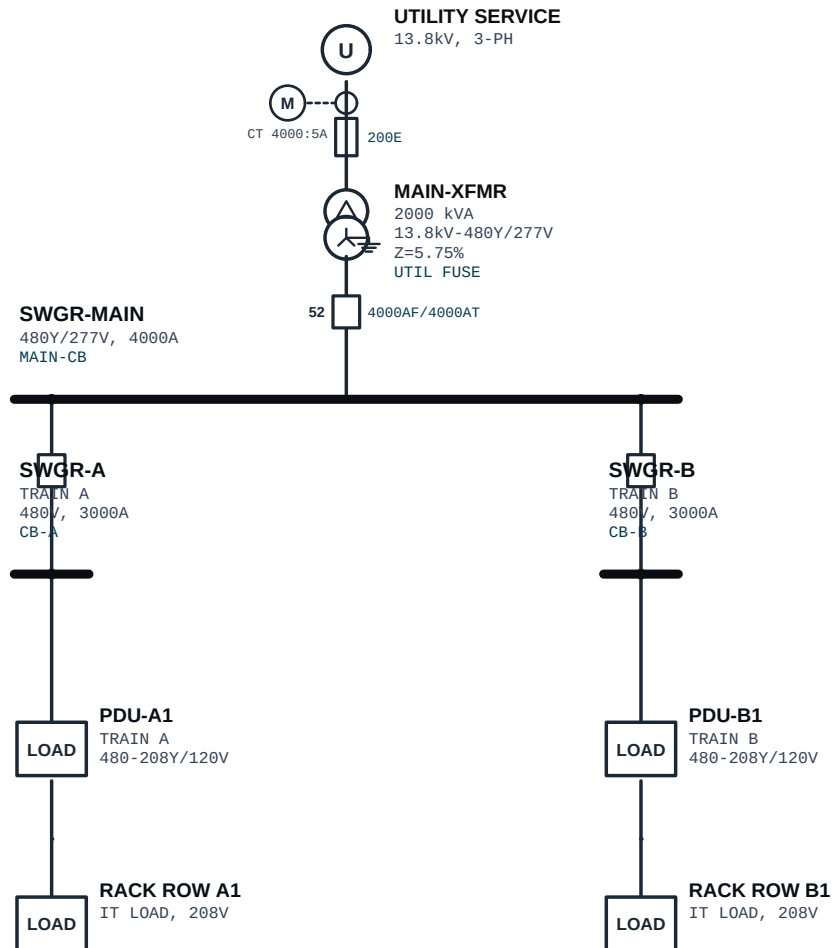

◆ SERVICECYCLE

ONE-LINE DIAGRAM - 2N DISTRIBUTION

PROJECT Northfield Data Center - Hall 2

DWG NO. SC-TEST-001

DATE JULY 2026

REV 0

SCALE NTS · SHEET 1 OF 1

NOT AN ENGINEERING DOCUMENT — SEE DISCLAIMER

GENERAL NOTES

1. System configured 2N: Train A and Train B are each independently capable of carrying full IT load.
2. Fabricated data for ServiceCycle extractor regression testing -- not a real facility.