




SAFETY — DO NOT USE FOR ENERGIZED WORK. This document is not for use in work on live or energized electrical equipment. Before conducting any work on the equipment listed in this document, consult your engineer and qualified safety personnel, and follow your organization's electrical safety program and documentation.

NOT AN ENGINEERING DOCUMENT · NOT FOR FIELD USE

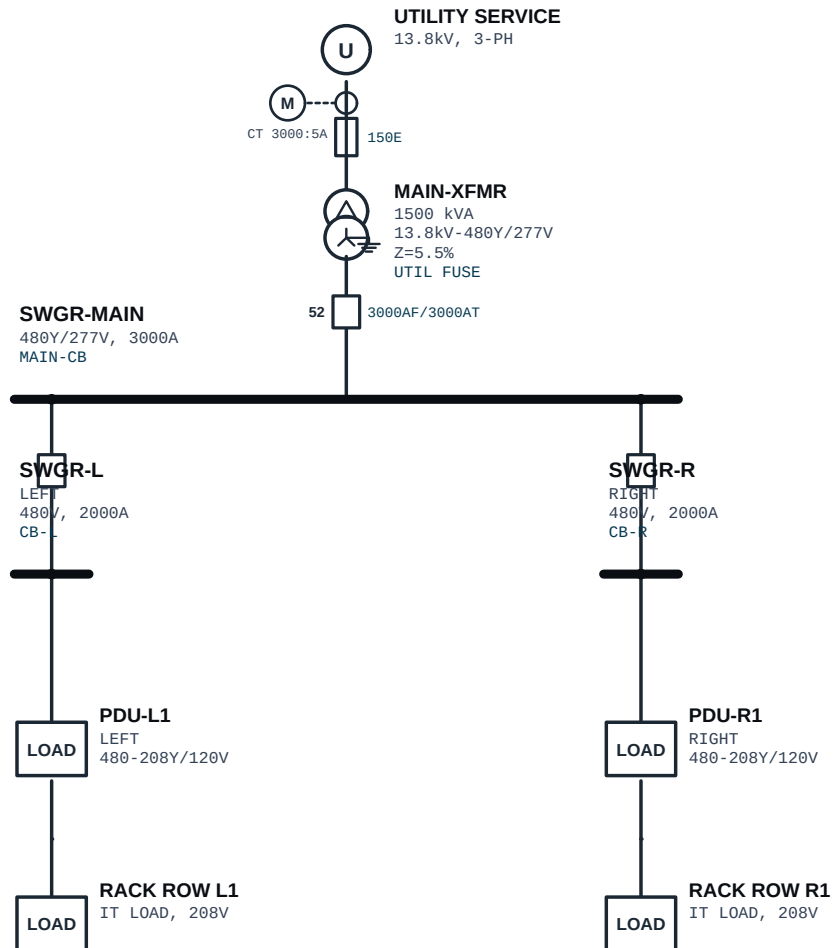

◆ SERVICECYCLE

ONE-LINE DIAGRAM - N+1 DISTRIBUTION

PROJECT Meridian Health Data Hall

DWG NO. SC-TEST-002

DATE JULY 2026

REV 0

SCALE NTS · SHEET 1 OF 1

NOT AN ENGINEERING DOCUMENT — SEE DISCLAIMER

GENERAL NOTES

- N+1 distribution: Left and Right paths share the common main switchgear bus upstream.
- Fabricated data for ServiceCycle extractor regression testing -- not a real facility.