




SAFETY — DO NOT USE FOR ENERGIZED WORK. This document is not for use in work on live or energized electrical equipment. Before conducting any work on the equipment listed in this document, consult your engineer and qualified safety personnel, and follow your organization's electrical safety program and documentation.

NOT AN ENGINEERING DOCUMENT · NOT FOR FIELD USE

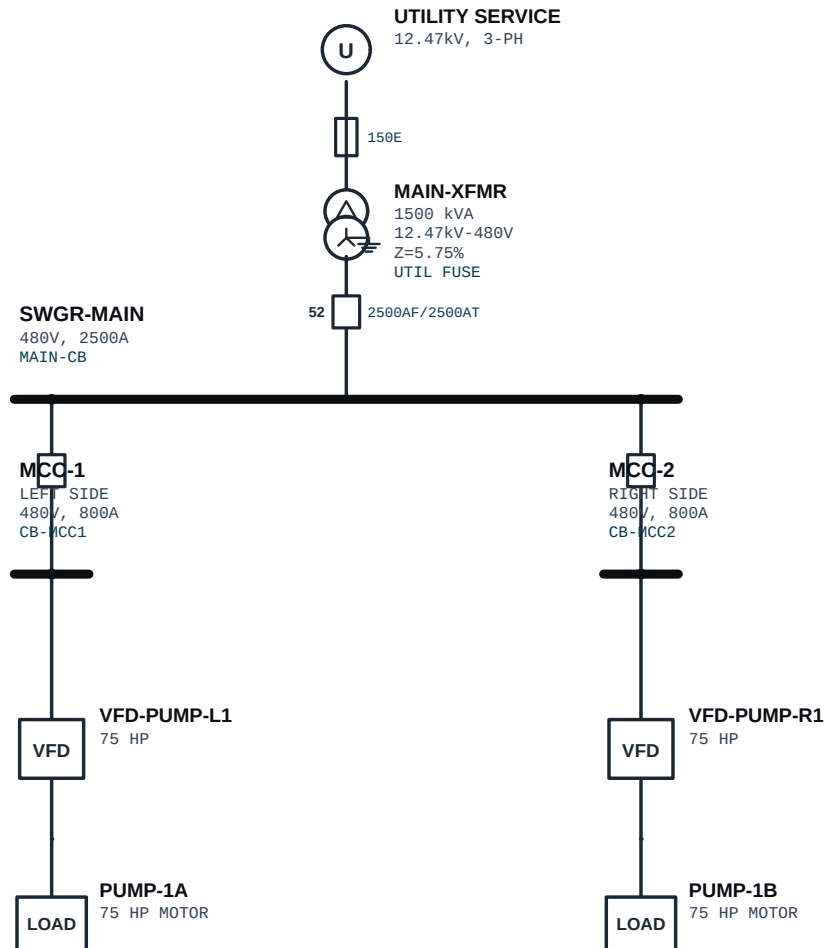

◆ SERVICECYCLE

ONE-LINE DIAGRAM - REDUNDANT PUMP FEED

PROJECT Riverside Industrial Plant - Pump House 1

DWG NO. SC-TEST-003

DATE JULY 2026

REV 0

SCALE NTS · SHEET 1 OF 1

NOT AN ENGINEERING DOCUMENT — SEE DISCLAIMER

GENERAL NOTES

1. Redundant N+1 pump feed: Left Side and Right Side MCCs each sized for full duty load.
2. Fabricated data for ServiceCycle extractor regression testing -- not a real facility.