


E-101 Simplified Electrical Layout - School

Areas: 3 floors with classrooms, cafeteria, gym, admin office, and library

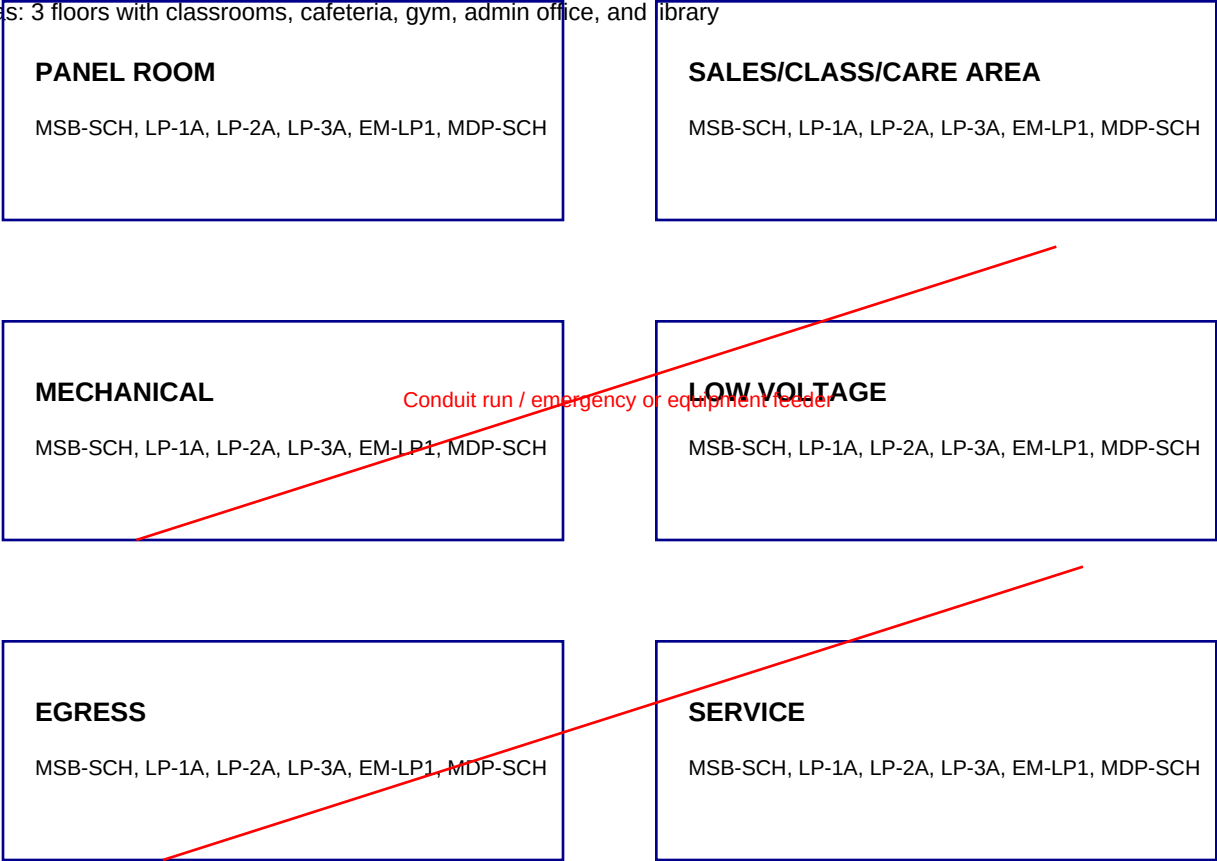

Key drawing notes:

1. The 3rd floor HVAC system is served from panel MDP-SCH using feeder H3-42.
2. Emergency lighting is tied to EM-LP1 and covers stairwells, corridors, cafeteria exits, gym exit
3. Data rooms are located on each floor and use low-voltage backbone conduit to the MDF.
4. Lighting revision CO-SCH-002 adds dimmable LED fixtures in the cafeteria and high-bay LED repla