


bilstm_new_data | test | fixed_0_5

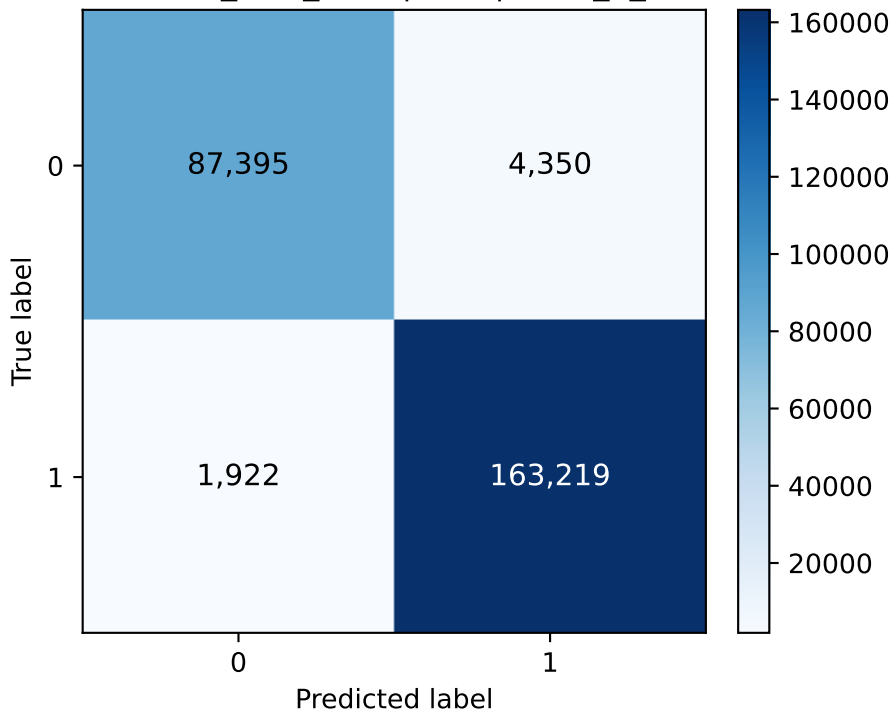

threshold=0.5000 accuracy=0.9756 f1=0.9811