


bilstm_new_data | validation | fixed_0_5

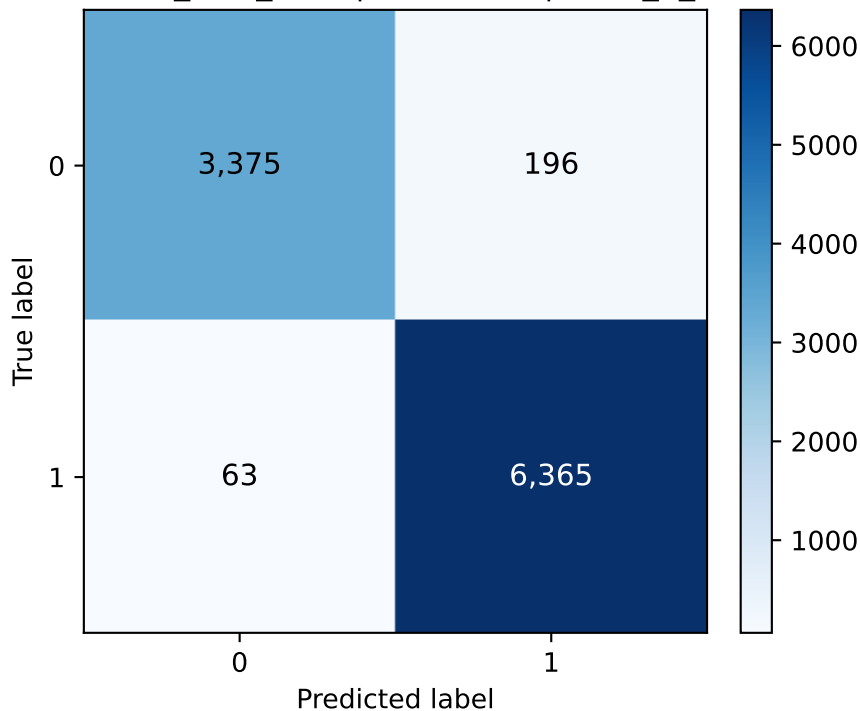

threshold=0.5000 accuracy=0.9741 f1=0.9801