


transformer_new_data | test | fixed_0_5

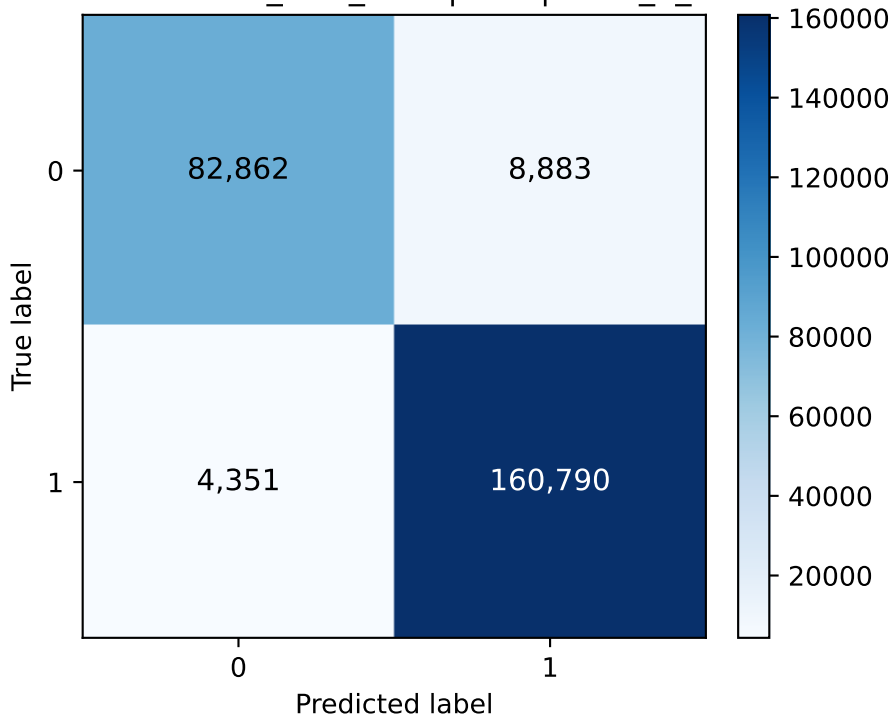

threshold=0.5000 accuracy=0.9485 f1=0.9605