


transformer_new_data | validation | fixed_0_5

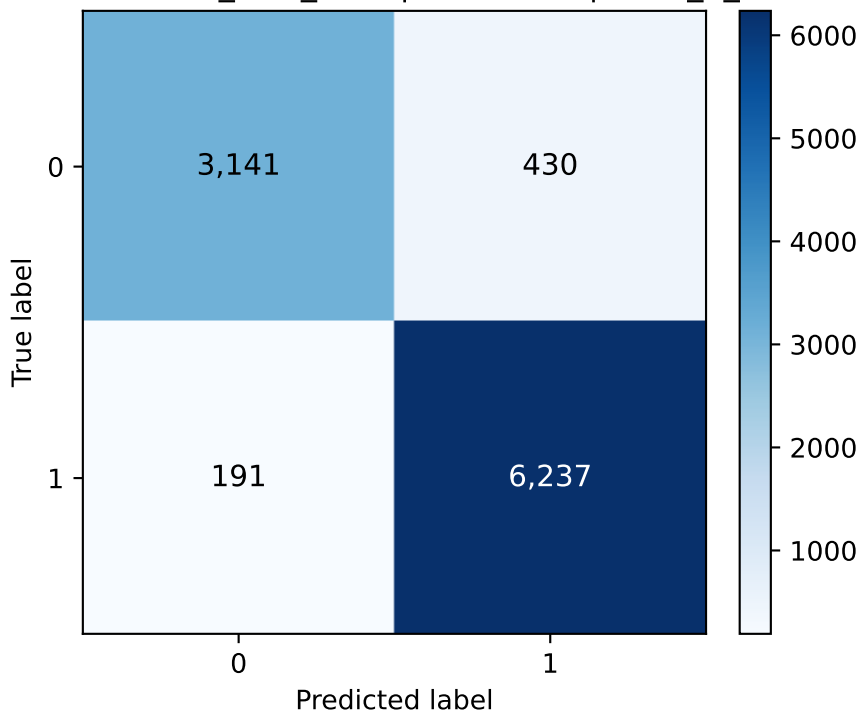

threshold=0.5000 accuracy=0.9379 f1=0.9526