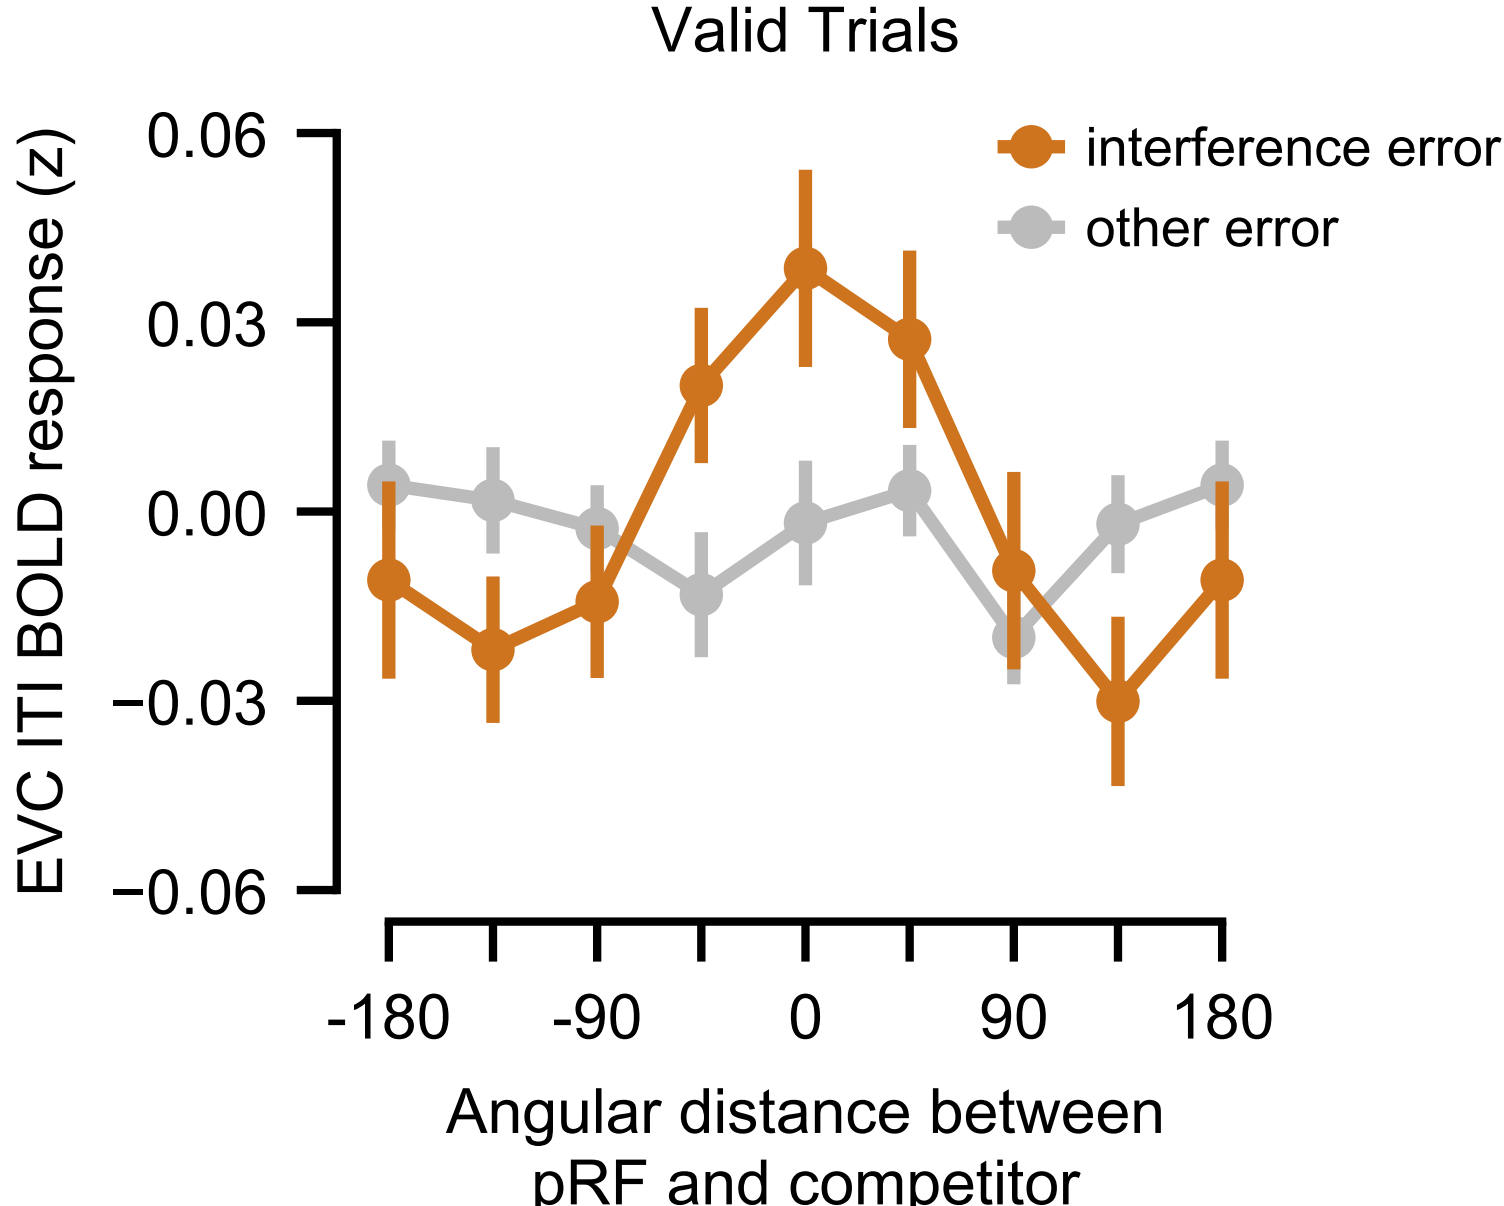
Valid Trials
interference error
other error
EVC ITI BOLD response (z)
0.06
0.03
0.00
−0.03
−0.06
-180
-90
0
90
180
Angular distance between
pRF and competitor