

Electrical Single-Line Diagram & Specifications

Doc No: ELEC-002
Rev: B
Date: 2026-05-10

Project: Lakefront Office Tower — Phase II

ACME Engineering Associates, Inc.
123 Industrial Pkwy, Suite 400
Chicago, IL 60601

SECTION 26 05 53 — ELECTRICAL IDENTIFICATION & SINGLE-LINE

1.0 SYSTEM OVERVIEW

The electrical distribution system for Lakefront Office Tower Phase II is a 15kV utility service stepped down through two 2,000 kVA pad-mounted transformers (XFMR-1 and XFMR-2) to a 480/277V 4-wire grounded-wye main distribution panel (MDP) located in the basement electrical room. A 750 kW diesel generator provides emergency standby service.

2.0 SINGLE-LINE DIAGRAM

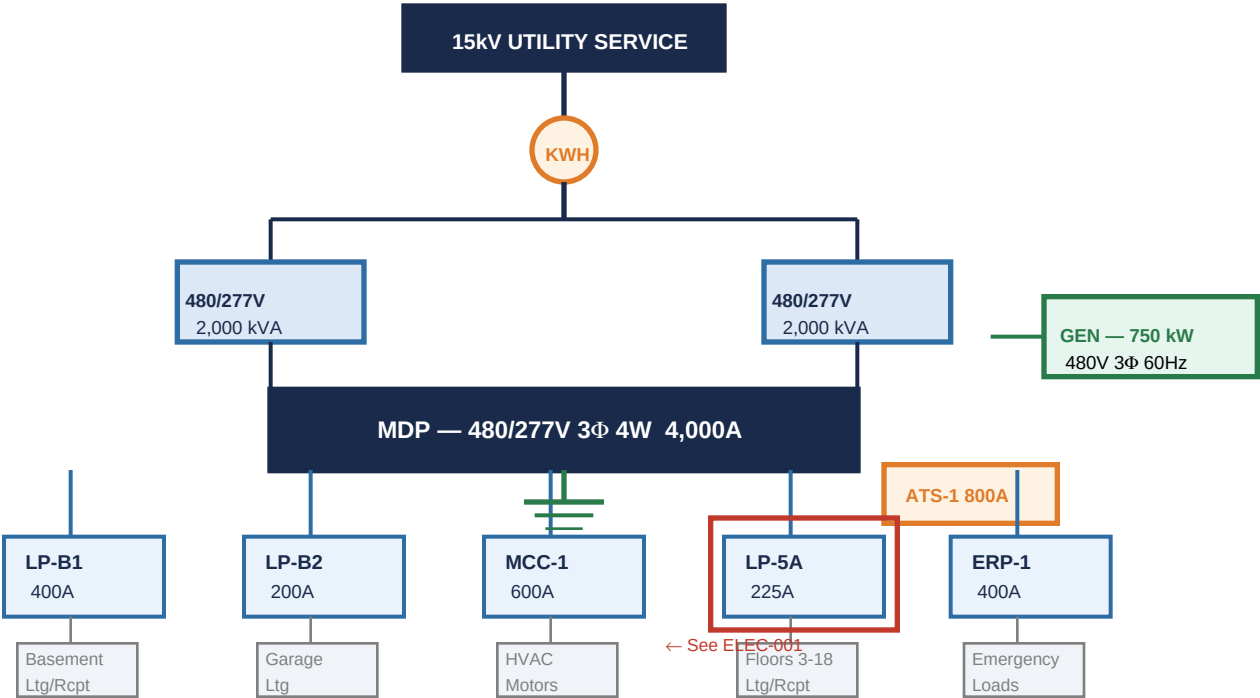


Figure 4 — Electrical Single-Line Diagram (Schematic — Not to Scale)

3.0 EQUIPMENT SPECIFICATIONS

Tag	Description	Rating	Mfr / Model	AIC
XFMR-1/2	Pad-Mounted Transformer	2,000 kVA, 15kV–480Y/277V	ABB / OFAF-2000	—

MDP	Main Distribution Panel	4,000A, 480/277V 3Φ4W	Square D / I-Line	65 kAIC
ATS-1	Automatic Transfer Switch	800A, 480V	Asco / 7000 Series	—
GEN-1	Emergency Generator	750 kW, 480V 3Φ	Caterpillar / 3512C	—
LP-5A	Lighting Panel Floor 5	225A, 208Y/120V 3Φ4W	Square D / QO	22 kAIC
MCC-1	Motor Control Center	600A, 480V, NEMA 12	Allen-Bradley	65 kAIC

END OF SECTION 26 05 53