

Electrical Panel Schedule

Doc No: ELEC-001
Rev: A
Date: 2026-05-03

Project: Lakefront Office Tower — Phase II

ACME Engineering Associates, Inc.
123 Industrial Pkwy, Suite 400
Chicago, IL 60601

SECTION 26 24 16 — PANELBOARDS

1.0 PANEL LP-5A — LIGHTING & RECEPTACLE (FLOOR 5)

Mains:	225A, 3-pole	Voltage:	208Y/120V, 3Φ, 4W
Mounting:	Flush, recessed	Spaces:	42 circuits
AIC Rating:	22 kAIC @208V	Fed From:	MDP-B Ckt 12/14/16

2.0 CIRCUIT SCHEDULE

CKT	DESCRIPTION	BKR (A)	LOAD (VA)	CKT	DESCRIPTION	BKR (A)	LOAD (VA)
1	Open Office Ltg-A	20	1,800	2	Open Office Ltg-B	20	1,800
3	Open Office Rcpt-A	20	1,500	4	Open Office Rcpt-B	20	1,500
5	Conf Room 501 Ltg	20	600	6	Conf Room 501 Rcpt	20	900
7	Conf Room 502 Ltg	20	600	8	Conf Room 502 Rcpt	20	900
9	Private Off. A Ltg	20	300	10	Private Off. A Rcpt	20	600
11	Private Off. B Ltg	20	300	12	Private Off. B Rcpt	20	600
13	Break Room Ltg	20	450	14	Break Room Rcpt	20	900
15	Reception Ltg	20	360	16	Reception Rcpt	20	600
17	Corridor Ltg E	20	720	18	Corridor Ltg W	20	720
19	Exit / Emerg Ltg	20	300	20	Stair Ltg	20	300
21	SPARE	20	—	22	SPARE	20	—
23	Elev Lobby Ltg	20	480	24	Janitor Rcpt	20	180
25	Server Rm Rcpt	20	1,800	26	Server Rm Rcpt	20	1,800
27	VAV-501 Ctrl	20	120	28	VAV-502 Ctrl	20	120
29	VAV-503 Ctrl	20	120	30	VAV-504 Ctrl	20	120
31	BMS Panel F5	20	500	32	Security Panel F5	20	300
33	Elec Rm Ltg	20	240	34	Elec Rm Rcpt	20	300
35	SPARE	20	—	36	SPARE	20	—
37	SPARE	20	—	38	SPARE	20	—
39	SPARE	20	—	40	SPARE	20	—
41	SPARE	20	—	42	SPARE	20	—
TOTAL CONNECTED			22,560				
DEMAND (80%)			18,048				

3.0 PANEL LP-5A — ONE-LINE WIRING DIAGRAM

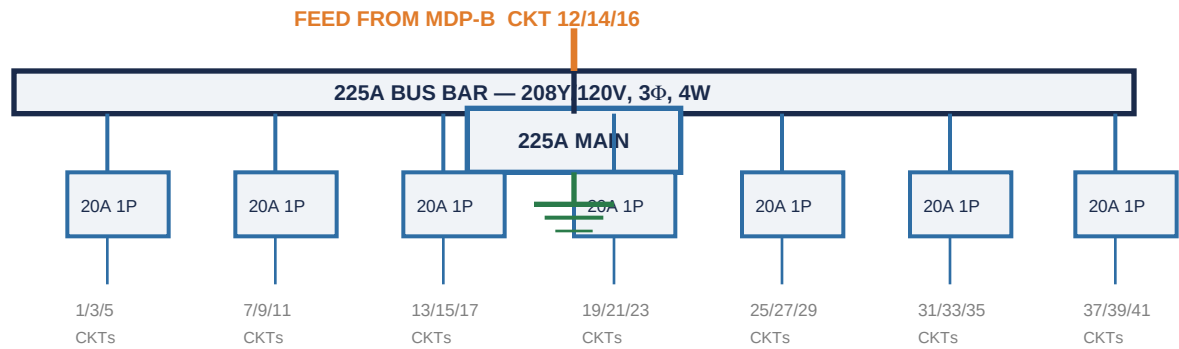


Figure 1 — Panel LP-5A One-Line Wiring Diagram (Schematic — Not to Scale)

4.0 PANELBOARD SPECIFICATIONS

4.1 General

Panelboards shall be dead-front, safety type, with bolt-on branch circuit breakers. Enclosure: NEMA Type 1, steel, with hinged door and flush trim. Bus bar: copper, rated 225A continuous. Neutral: 100% rated, insulated.

4.2 Branch Circuit Breakers

Single-pole, 20A, 120/240V, 10 kAIC minimum interrupting capacity. Provide AFCI breakers for all bedroom/dormitory circuits per NEC 210.12. GFCI breakers where required by NEC 210.8.

4.3 Acceptable Manufacturers

Manufacturer	Series	Notes
Square D	QO / NQ	Basis of Design
Eaton	CH / PRL1a	Approved Equal
Siemens	P1 / SPNW	Approved Equal

END OF SECTION 26 24 16