

36"Øx16"Ø TEE AND 16" GATE VALVE


3/8"=1'-0"

1

WD-2775-2

1

WD-2775-2C

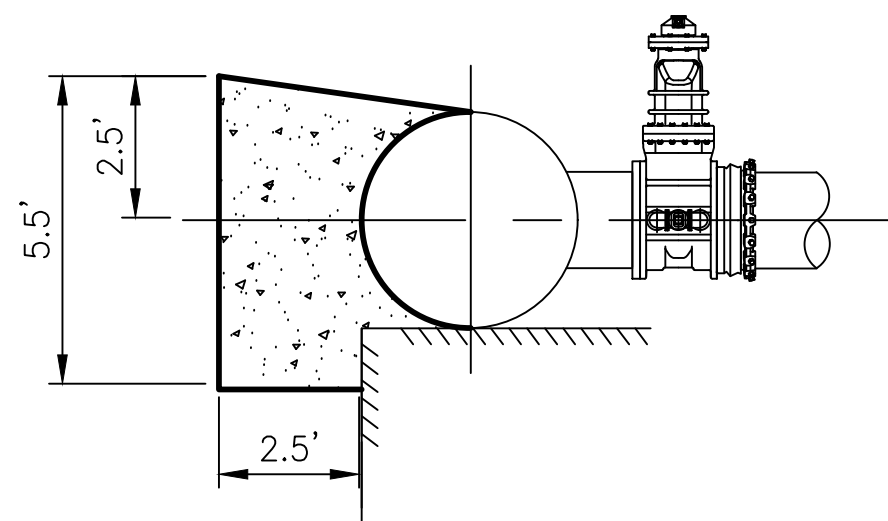


SECTION

3/8"=1'-0"

B

NOTES:

1. REFER TO NOTES ON DRAWING WD-2775-2.
2. DIP PIPE FLANGES SHALL CONFORM TO ANSI B16.1 CLASS 125, STEEL PIPE FLANGE TO AWWA C-207 CLASS E.
3. FOR STEEL PIPE COATING AND LINING SEE SPECIFICATION 09 97 72. FOR GASKETS, BOLTS, AND IFJ'S SEE SPECIFICATION 26 42 40.
4. CONTRACTOR SHALL FURNISH AND INSTALL NEW 54" X 36" TEE AND INSTALL CITY FURNISHED GATE VALVE UNDER WD-2817.
5. CONTRACTOR SHALL COORDINATE WITH CITY REPRESENTATIVE FOR PICKING UP 36" GV.

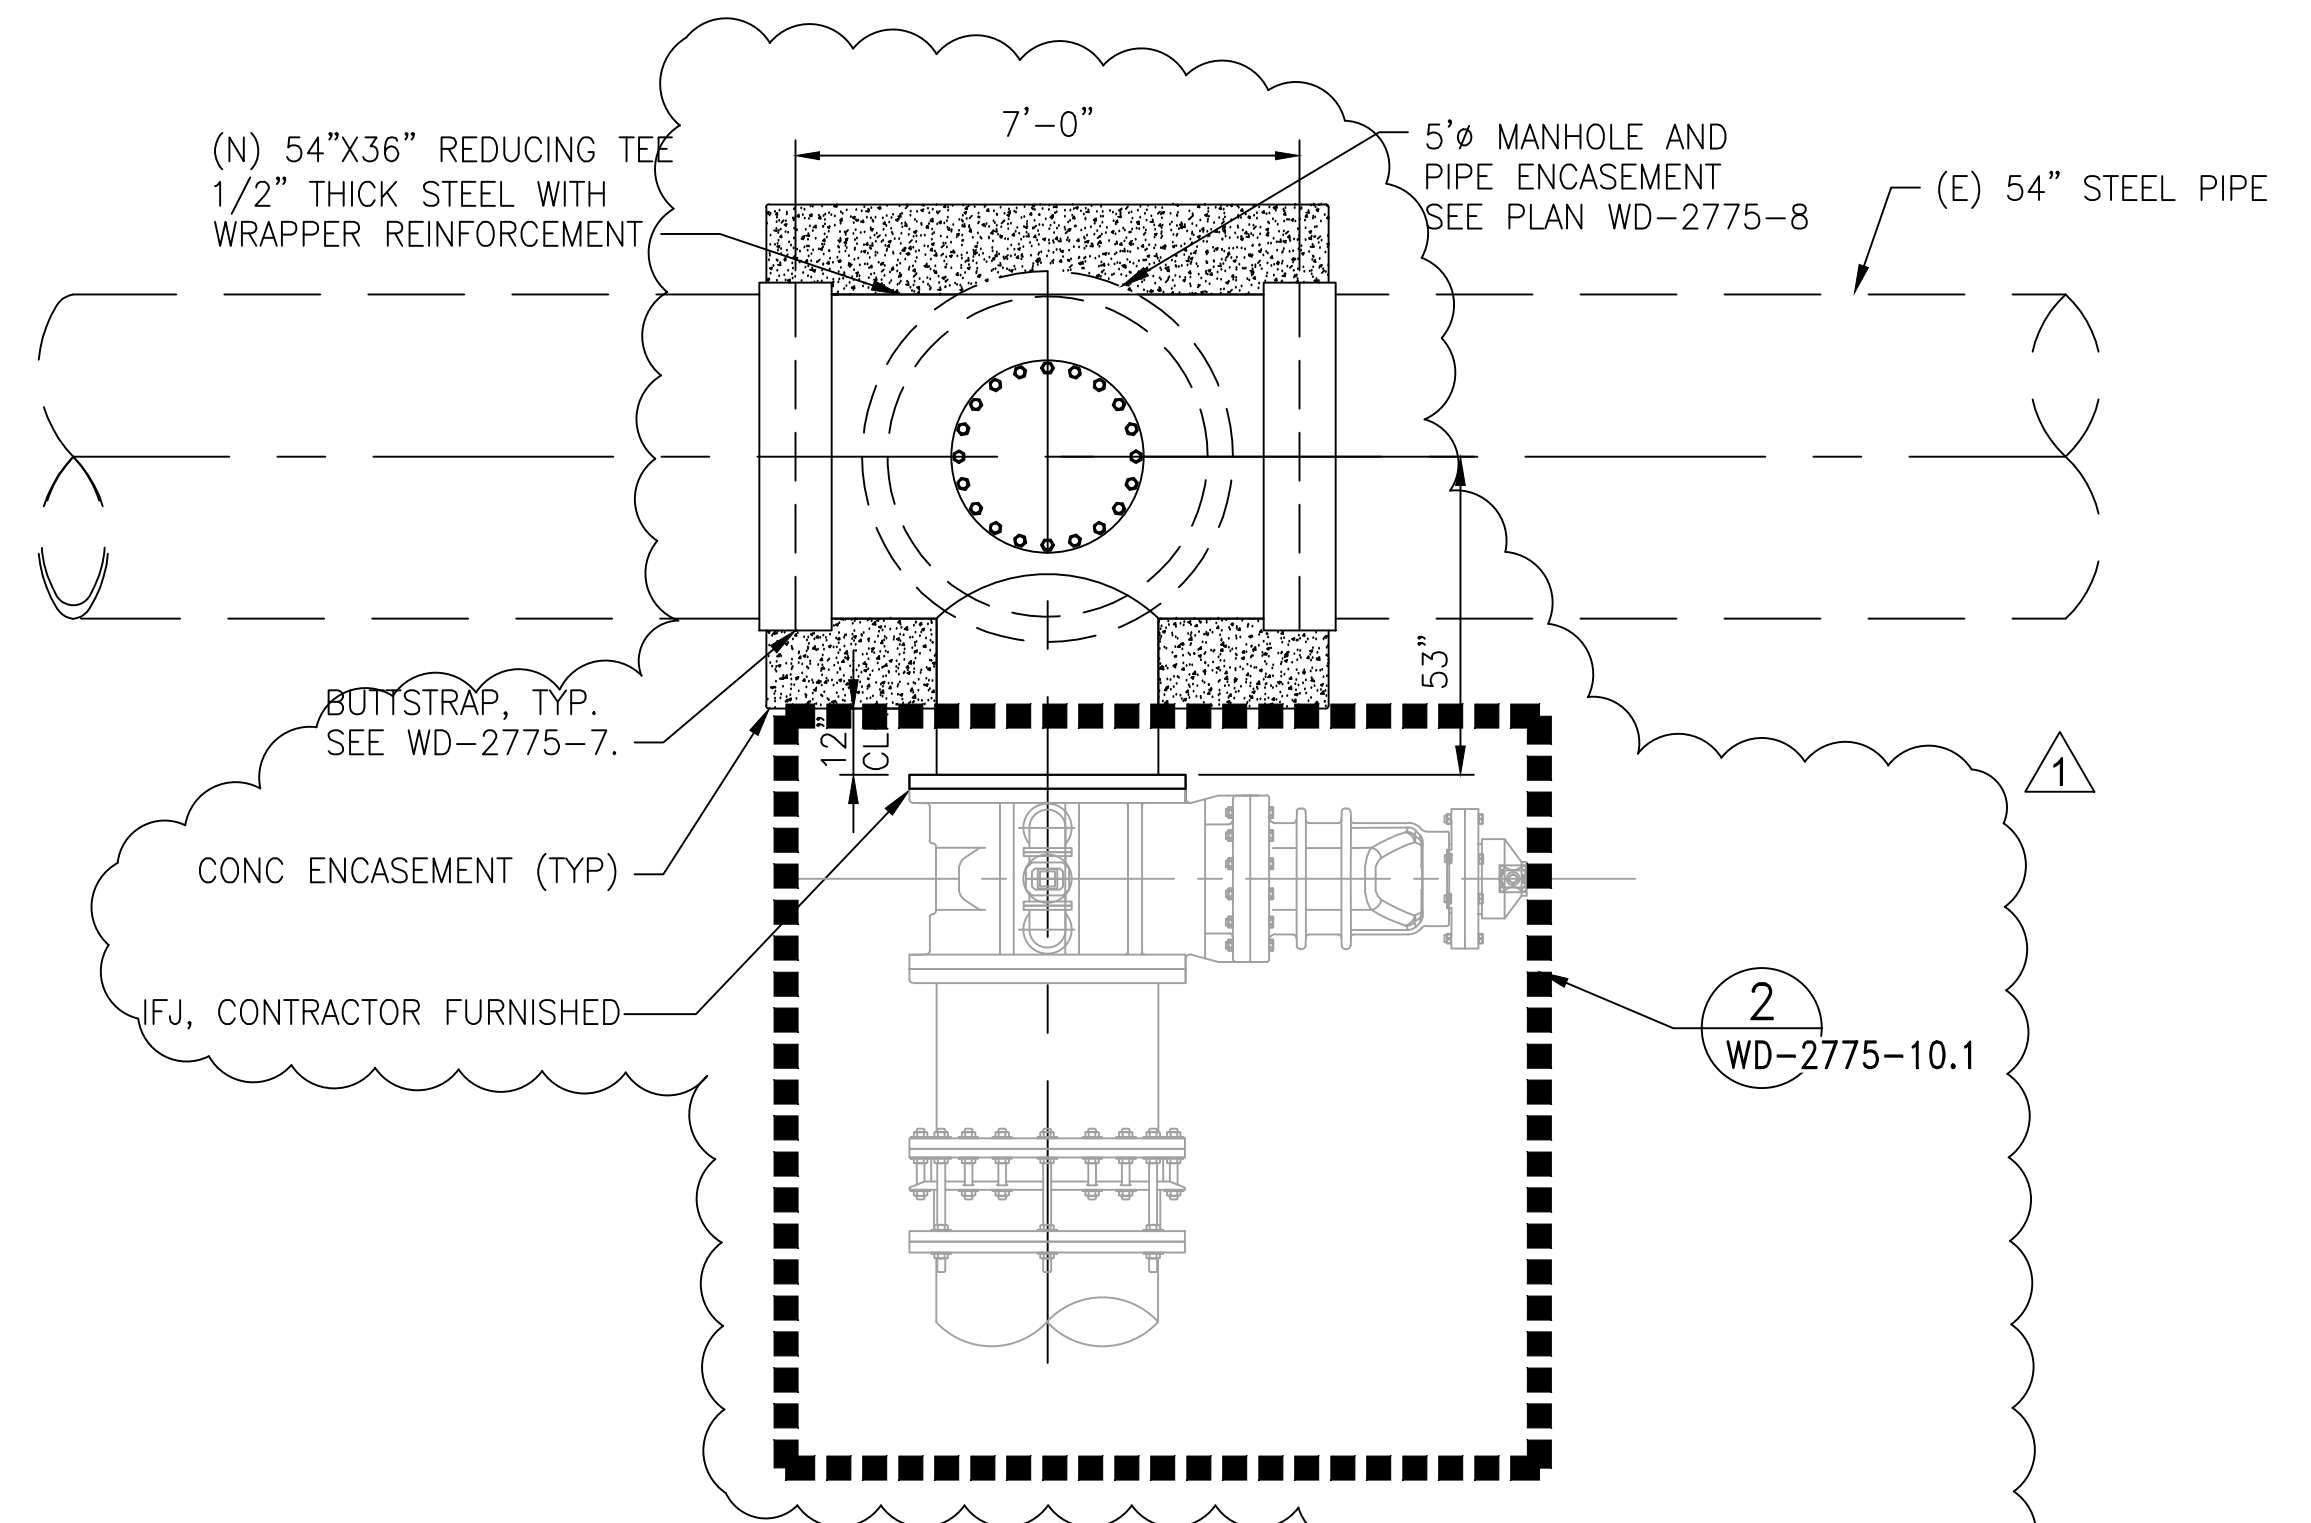

TEE CONNECTION DETAIL 54"Øx36"Ø TEE

3/8"=1'-0"

2


WD-2775-2

FOR THE SOLE USE OF THE DOCUMENT RECIPIENT  
- DO NOT CITE, COPY, OR CIRCULATE WITHOUT  
THE EXPRESSED PERMISSION OF THE SFPUC.

REFERENCES

GATE BOOK PAGES, PLANS,  
SURVEY NOTES, ETC., USED

CCSF 2013  
NAVD88

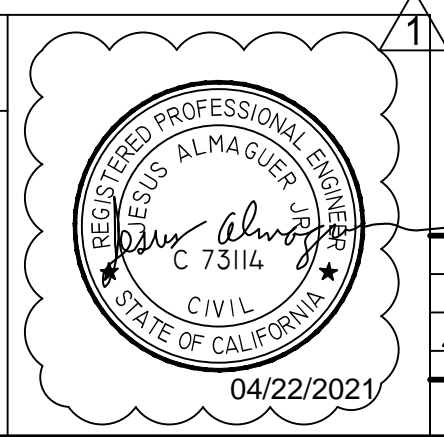

NO.	DATE	DESCRIPTION	BY	APPR'D
1	03/10/21	PCO #3 - REVISE SECTION DETAILS	AC	JA

WATER CONTRACT NO. WD-2775 CONTRACT NO. 2652J			
CITY AND COUNTY OF SAN FRANCISCO <b>PUBLIC UTILITIES COMMISSION</b> INFRASTRUCTURE DIVISION ENGINEERING MANAGEMENT BUREAU			
INSTALLATION OF 16-INCH AND 36-INCH, AND RELOCATION OF 8-INCH DUCTILE IRON WATER MAINS AT VARIOUS LOCATIONS ON 19TH AVENUE FROM HOLLOWAY AVENUE TO LINCOLN WAY INSTALLATION OF 54-INCH x 36-INCH TEE AND 36-INCH GATE VALVE			
CHECKED / APPROVED	BY / EC	DRAWN	AS SHOWN
SECTION MANAGER	T. LEE	DESIGNED	OCT 2018
APPROVED	APPROVED		
MANAGER, ENGINEERING MANAGEMENT BUREAU		MANAGER, CITY DISTRIBUTION DIVISION	
SHEET		PLAN NO.	DRAWING NO.
. OF .		WD-2775-10	E-31378
		REVISION NO.	

PLOT: EXTEND  
SCALE: 1:1  
BORDER:  
22,34  
COLOR: No.  
RED 0.70MM  
YELLOW 0.20MM  
GREEN 0.25MM  
CYAN 0.40MM  
BLUE 0.50MM  
MAGENTA 0.20MM  
WHITE 0.35MM  
GRAY 0.15MM  
9 0.15MM  
10 1.00MM  
100 0.70MM  
210 0.60MM