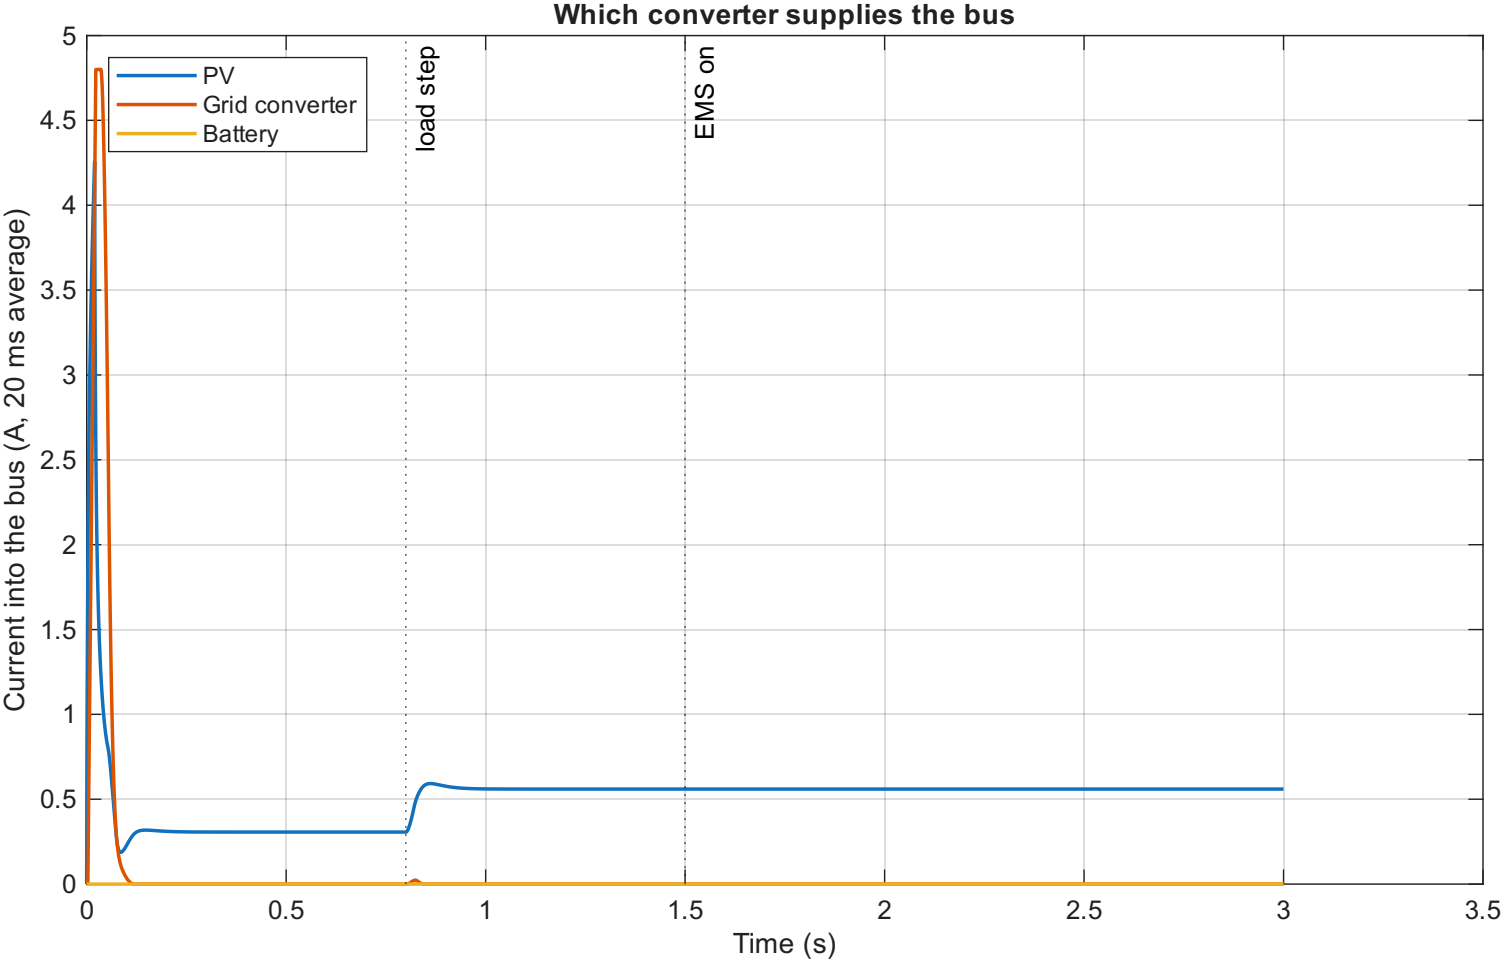

Which converter supplies the bus
PV
Grid converter
Battery
load step
EMS on
Current into the bus (A, 20 ms average)
Time (s)
0
0.5
1
1.5
2
2.5
3
3.5
4
4.5
5