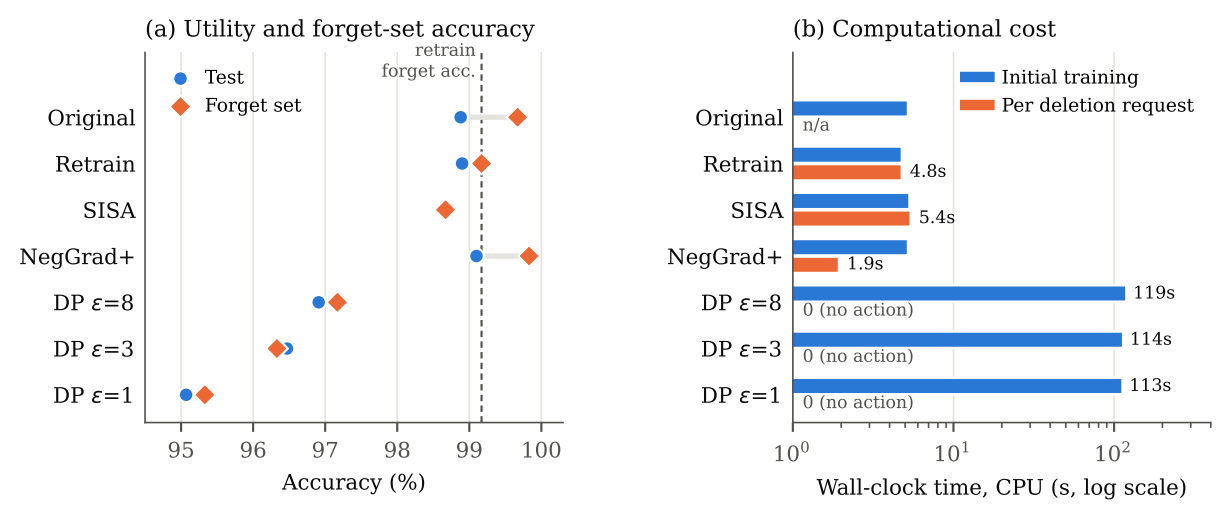
(a) Utility and forget-set accuracy
retrain
forget acc.
Test
Forget set
Original
Retrain
SISA
NegGrad+
DP ε=8
DP ε=3
DP ε=1
95
96
97
98
99
100
Accuracy (%)
(b) Computational cost
Initial training
Per deletion request
n/a
4.8s
5.4s
1.9s
119s
0 (no action)
114s
0 (no action)
113s
0 (no action)
10^0
10^1
10^2
Wall-clock time, CPU (s, log scale)