


53
MISS. SHRUTI MANHAR
13 Years/F

Date: 09-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:08:31
Page:1/29
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

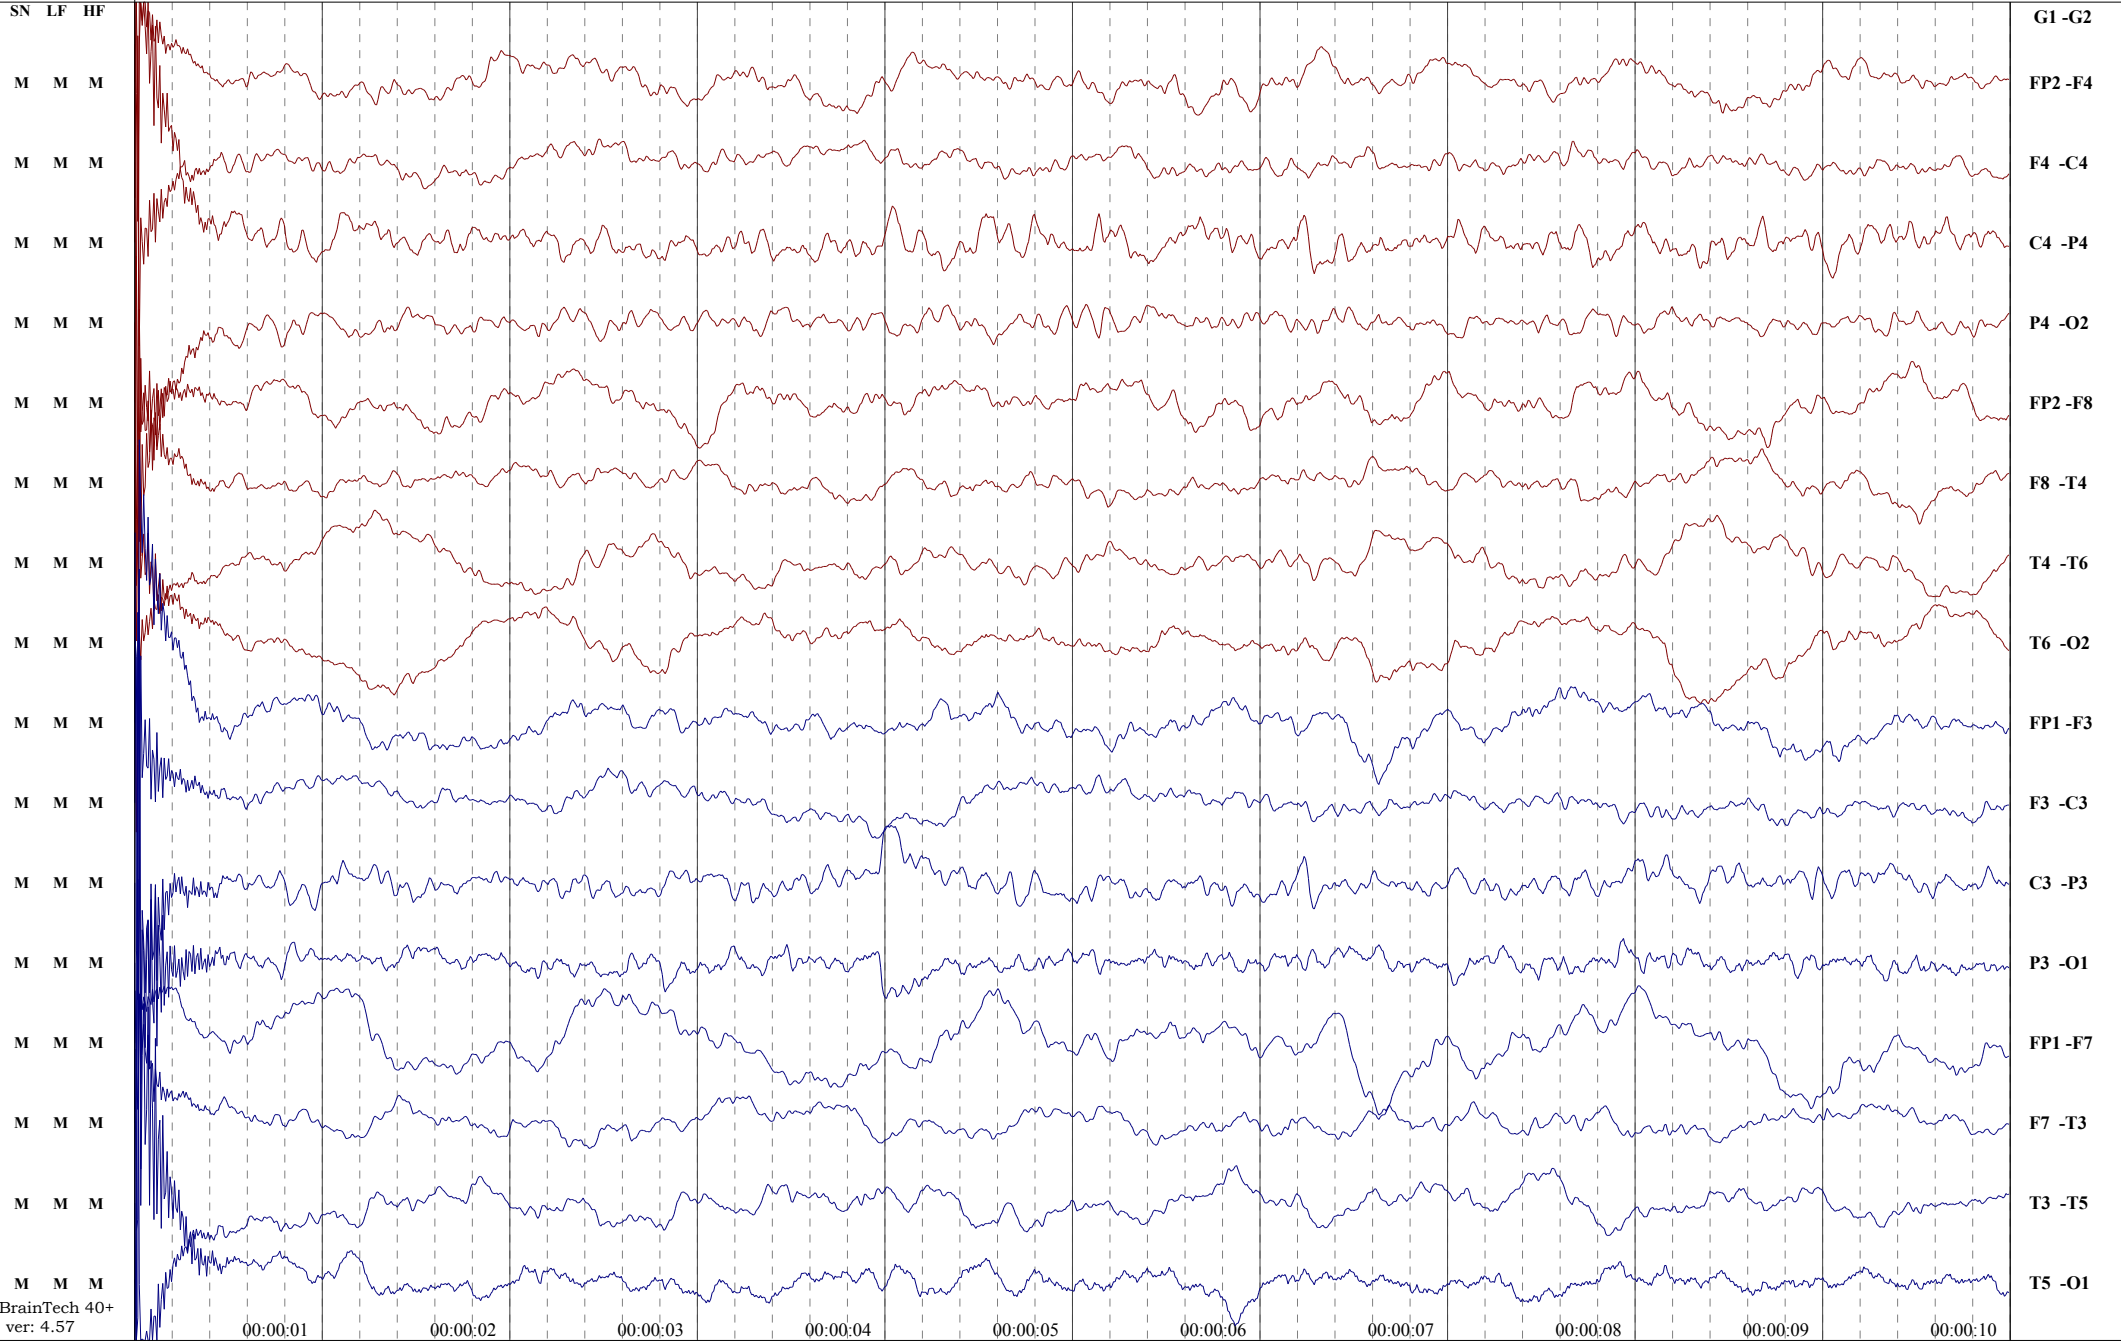


53
MISS. SHRUTI MANHAR
13 Years/F

Date: 09-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:08:51
Page:3/29
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

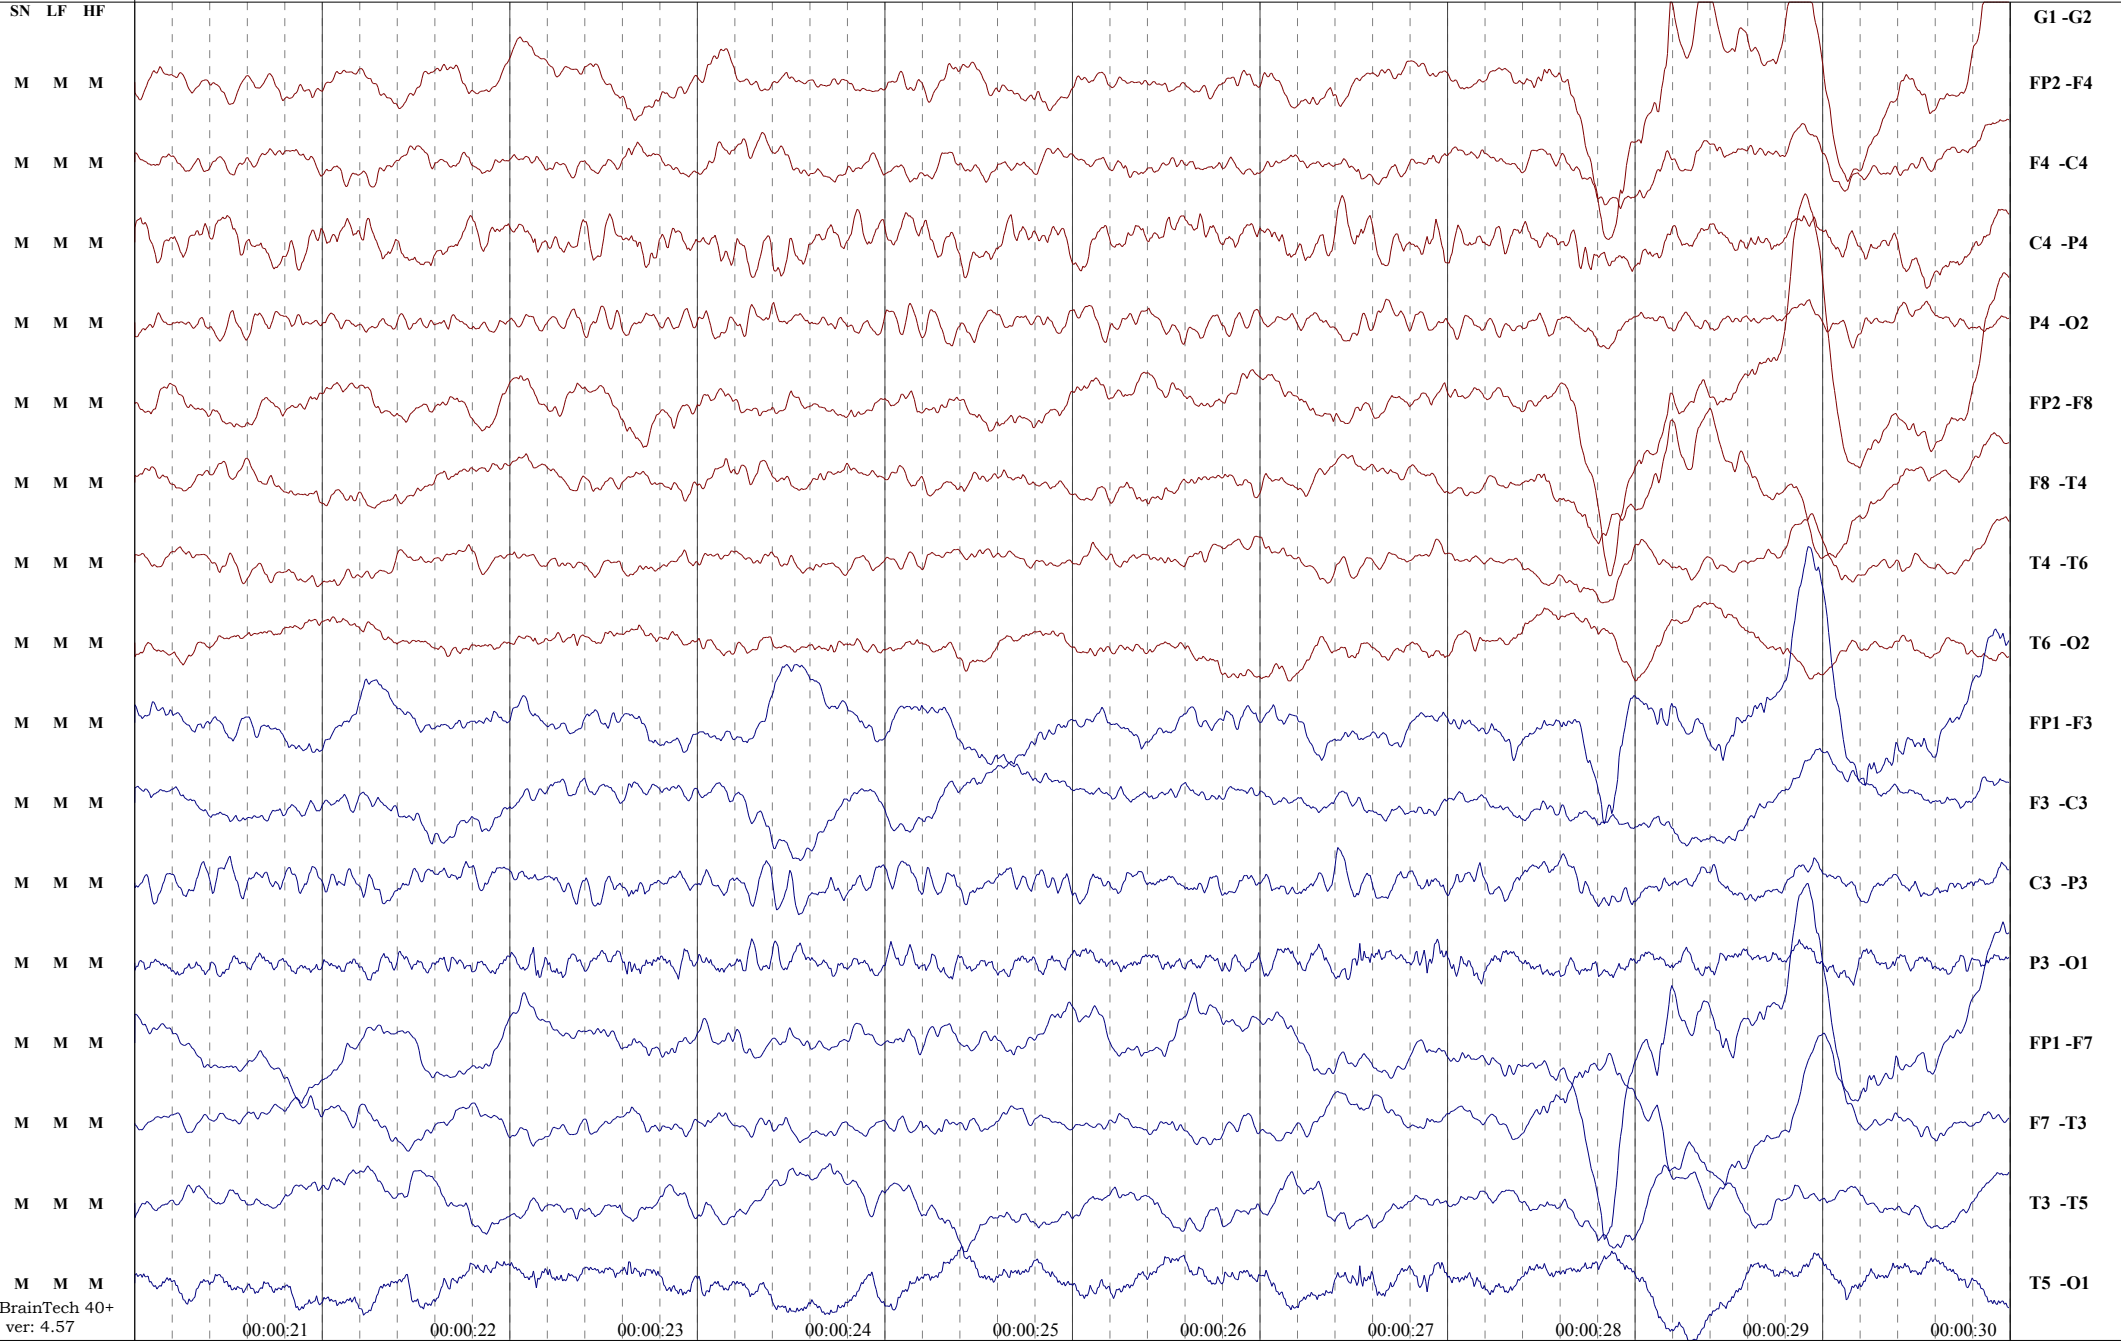


53
MISS. SHRUTI MANHAR
13 Years/F


Date: 09-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:09:11
Page:5/29
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

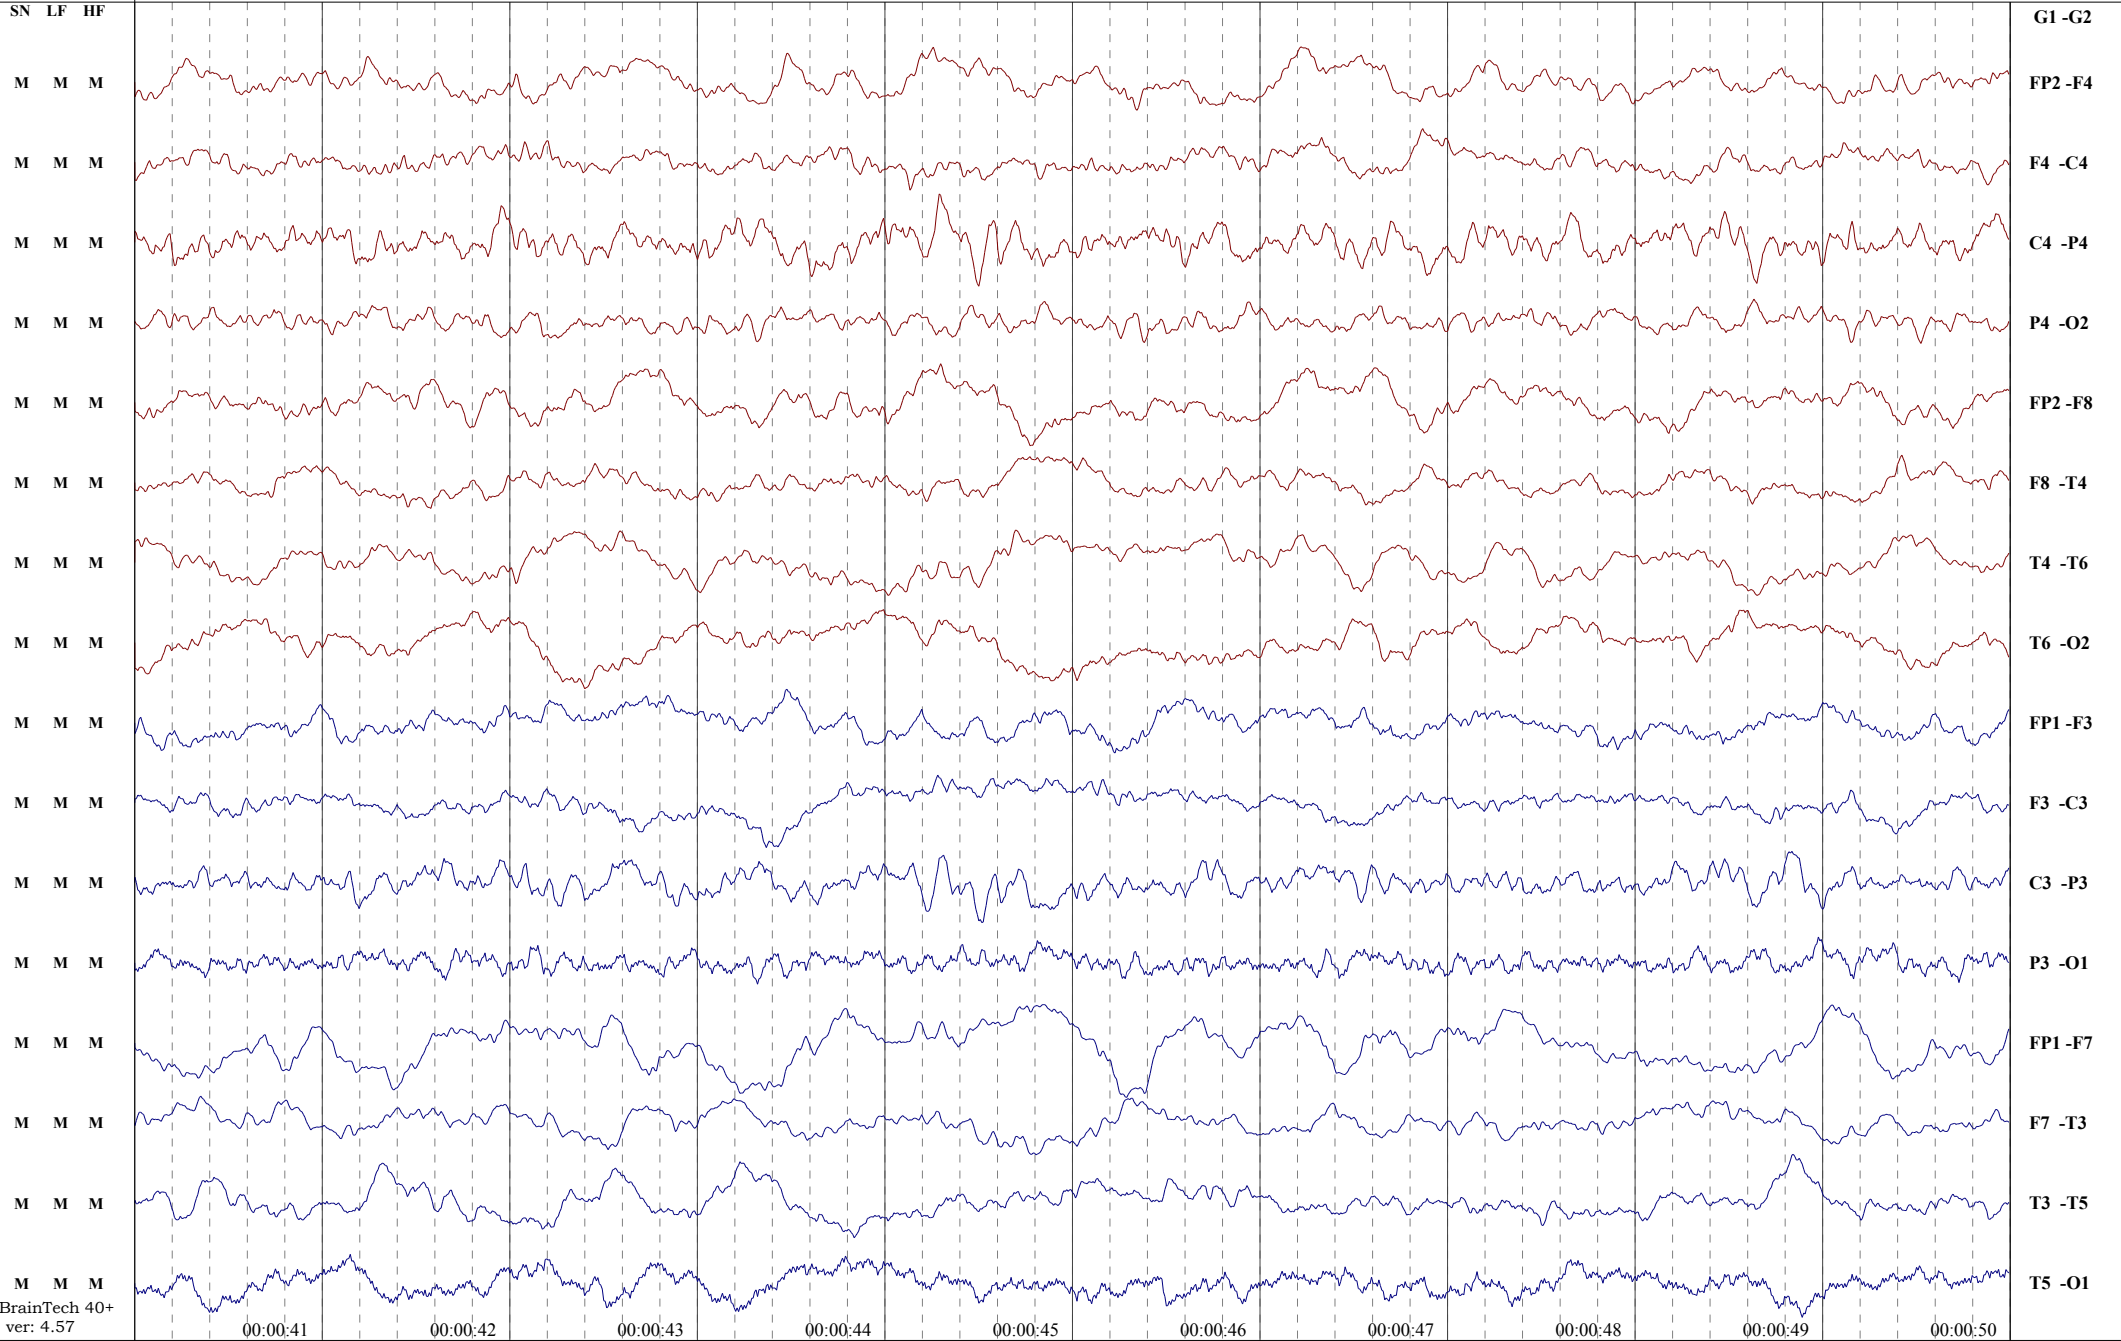

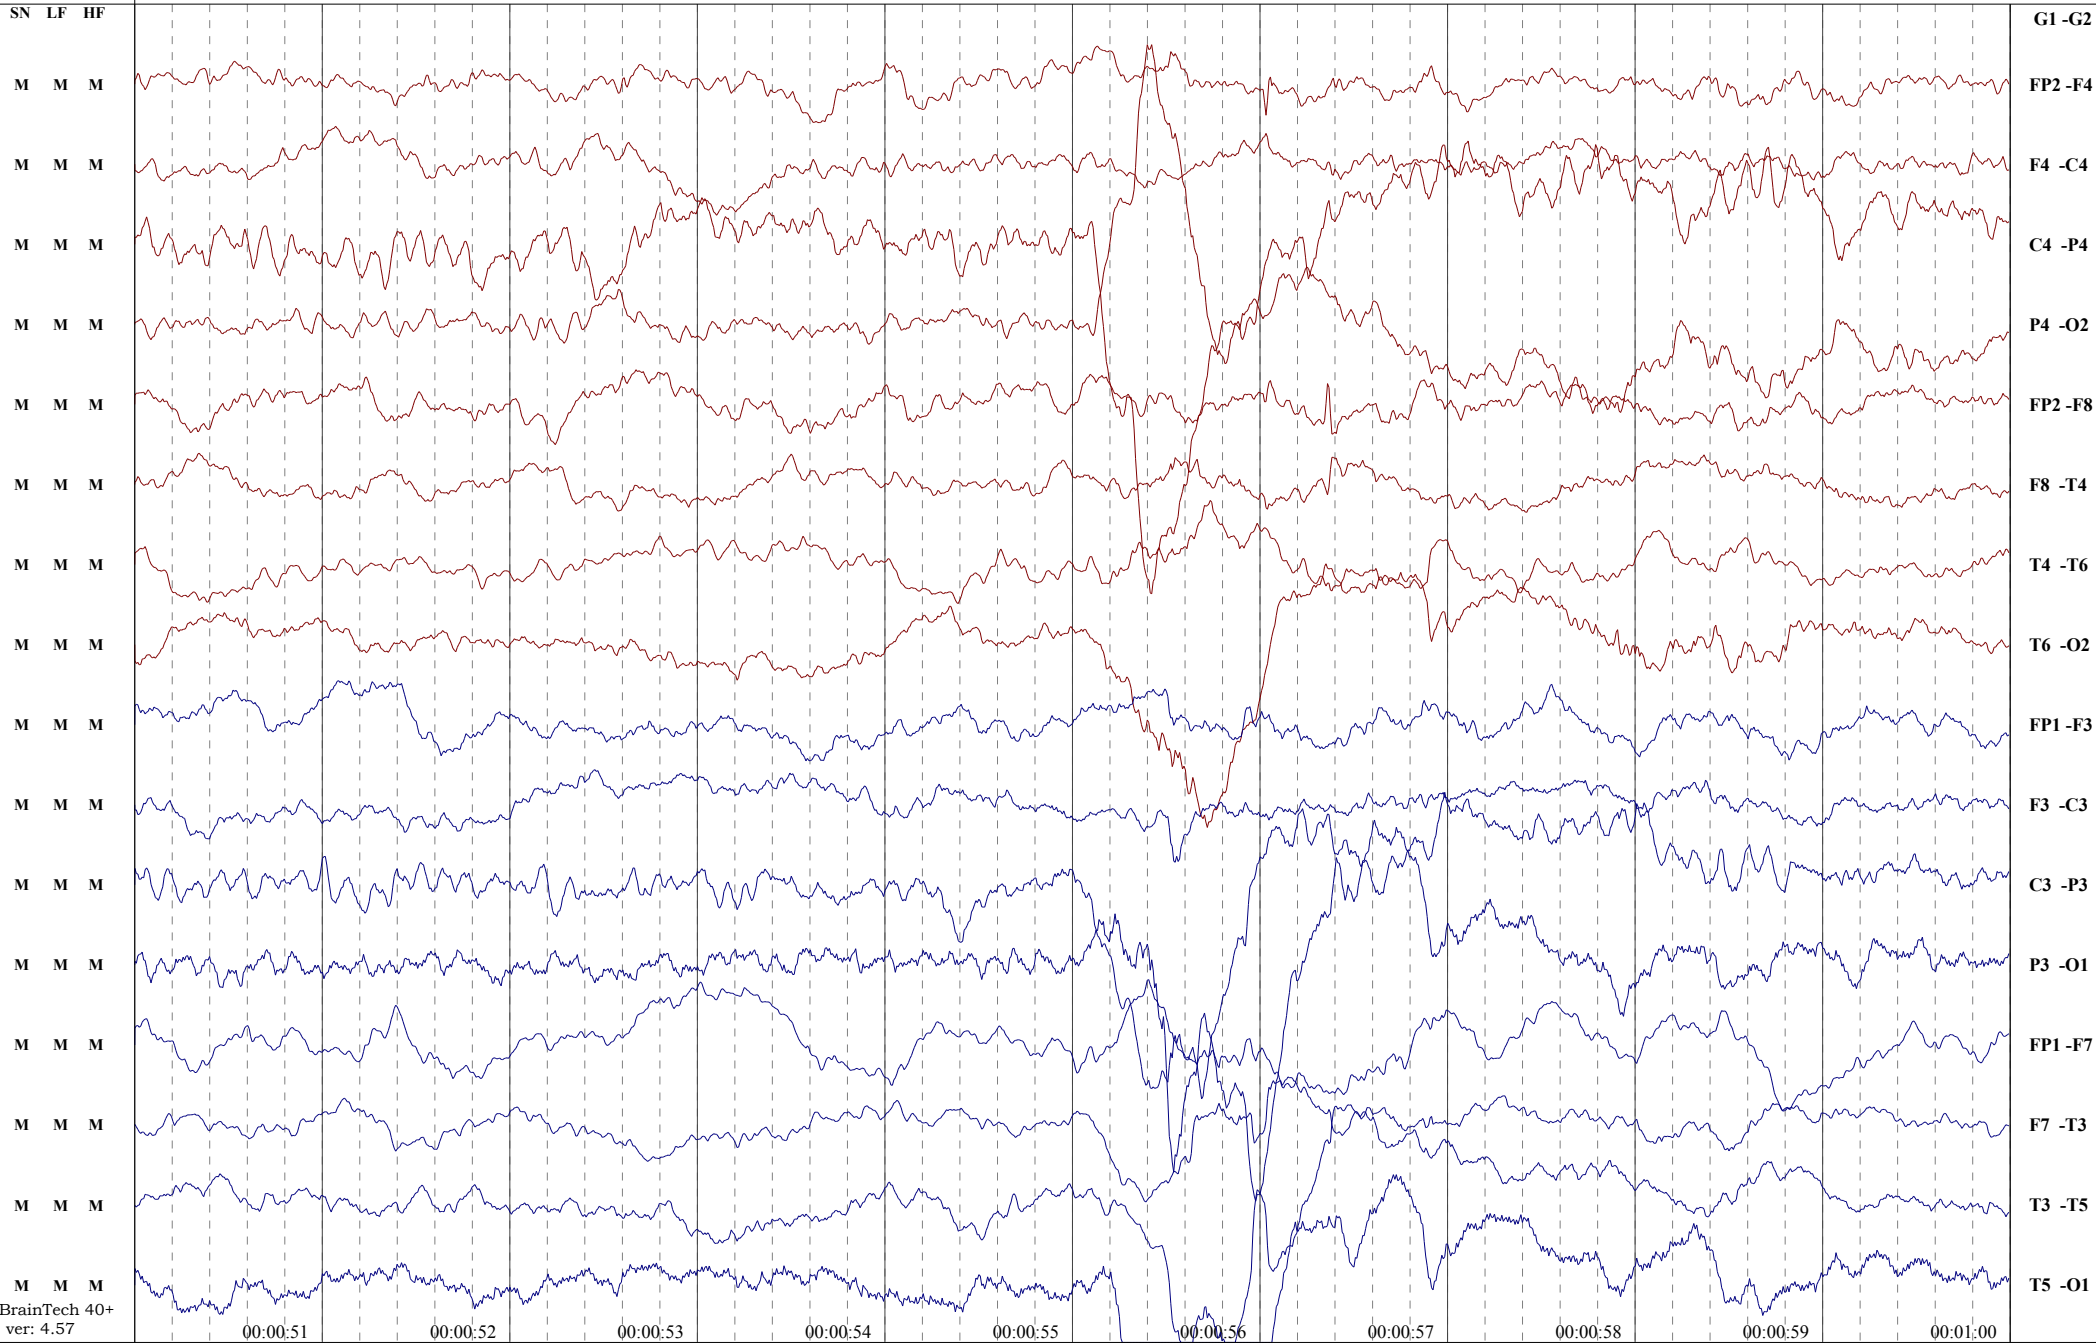


53
MISS. SHRUTI MANHAR
13 Years/F

Date: 09-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:09:31
Page:7/29
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

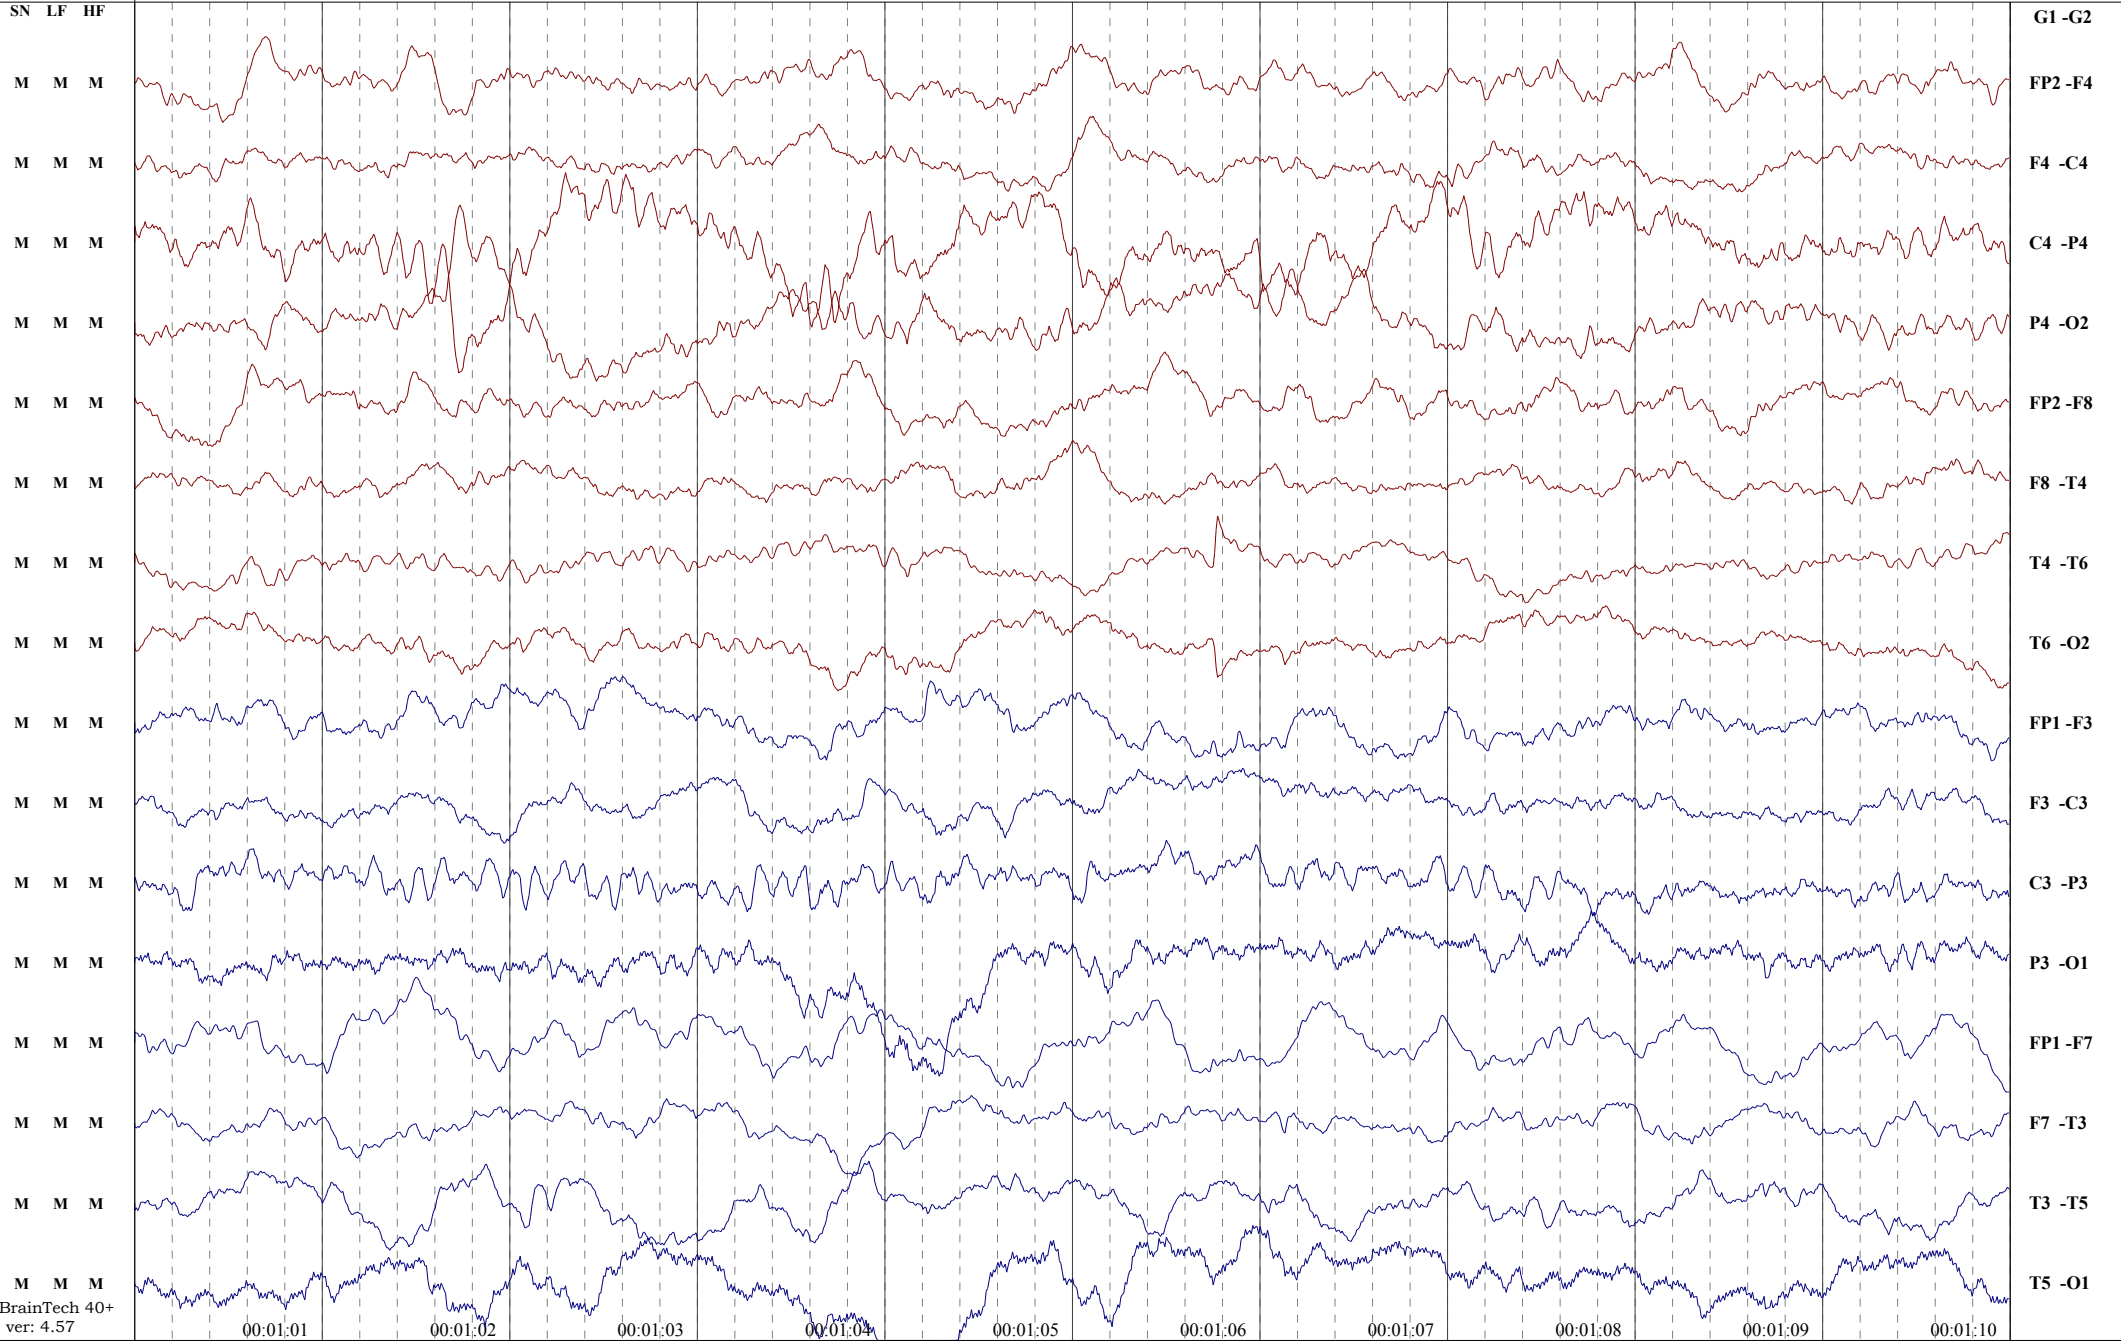


53
MISS. SHRUTI MANHAR
13 Years/F


Date: 09-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL


Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz


Time: 14:09:41
Page:8/29
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

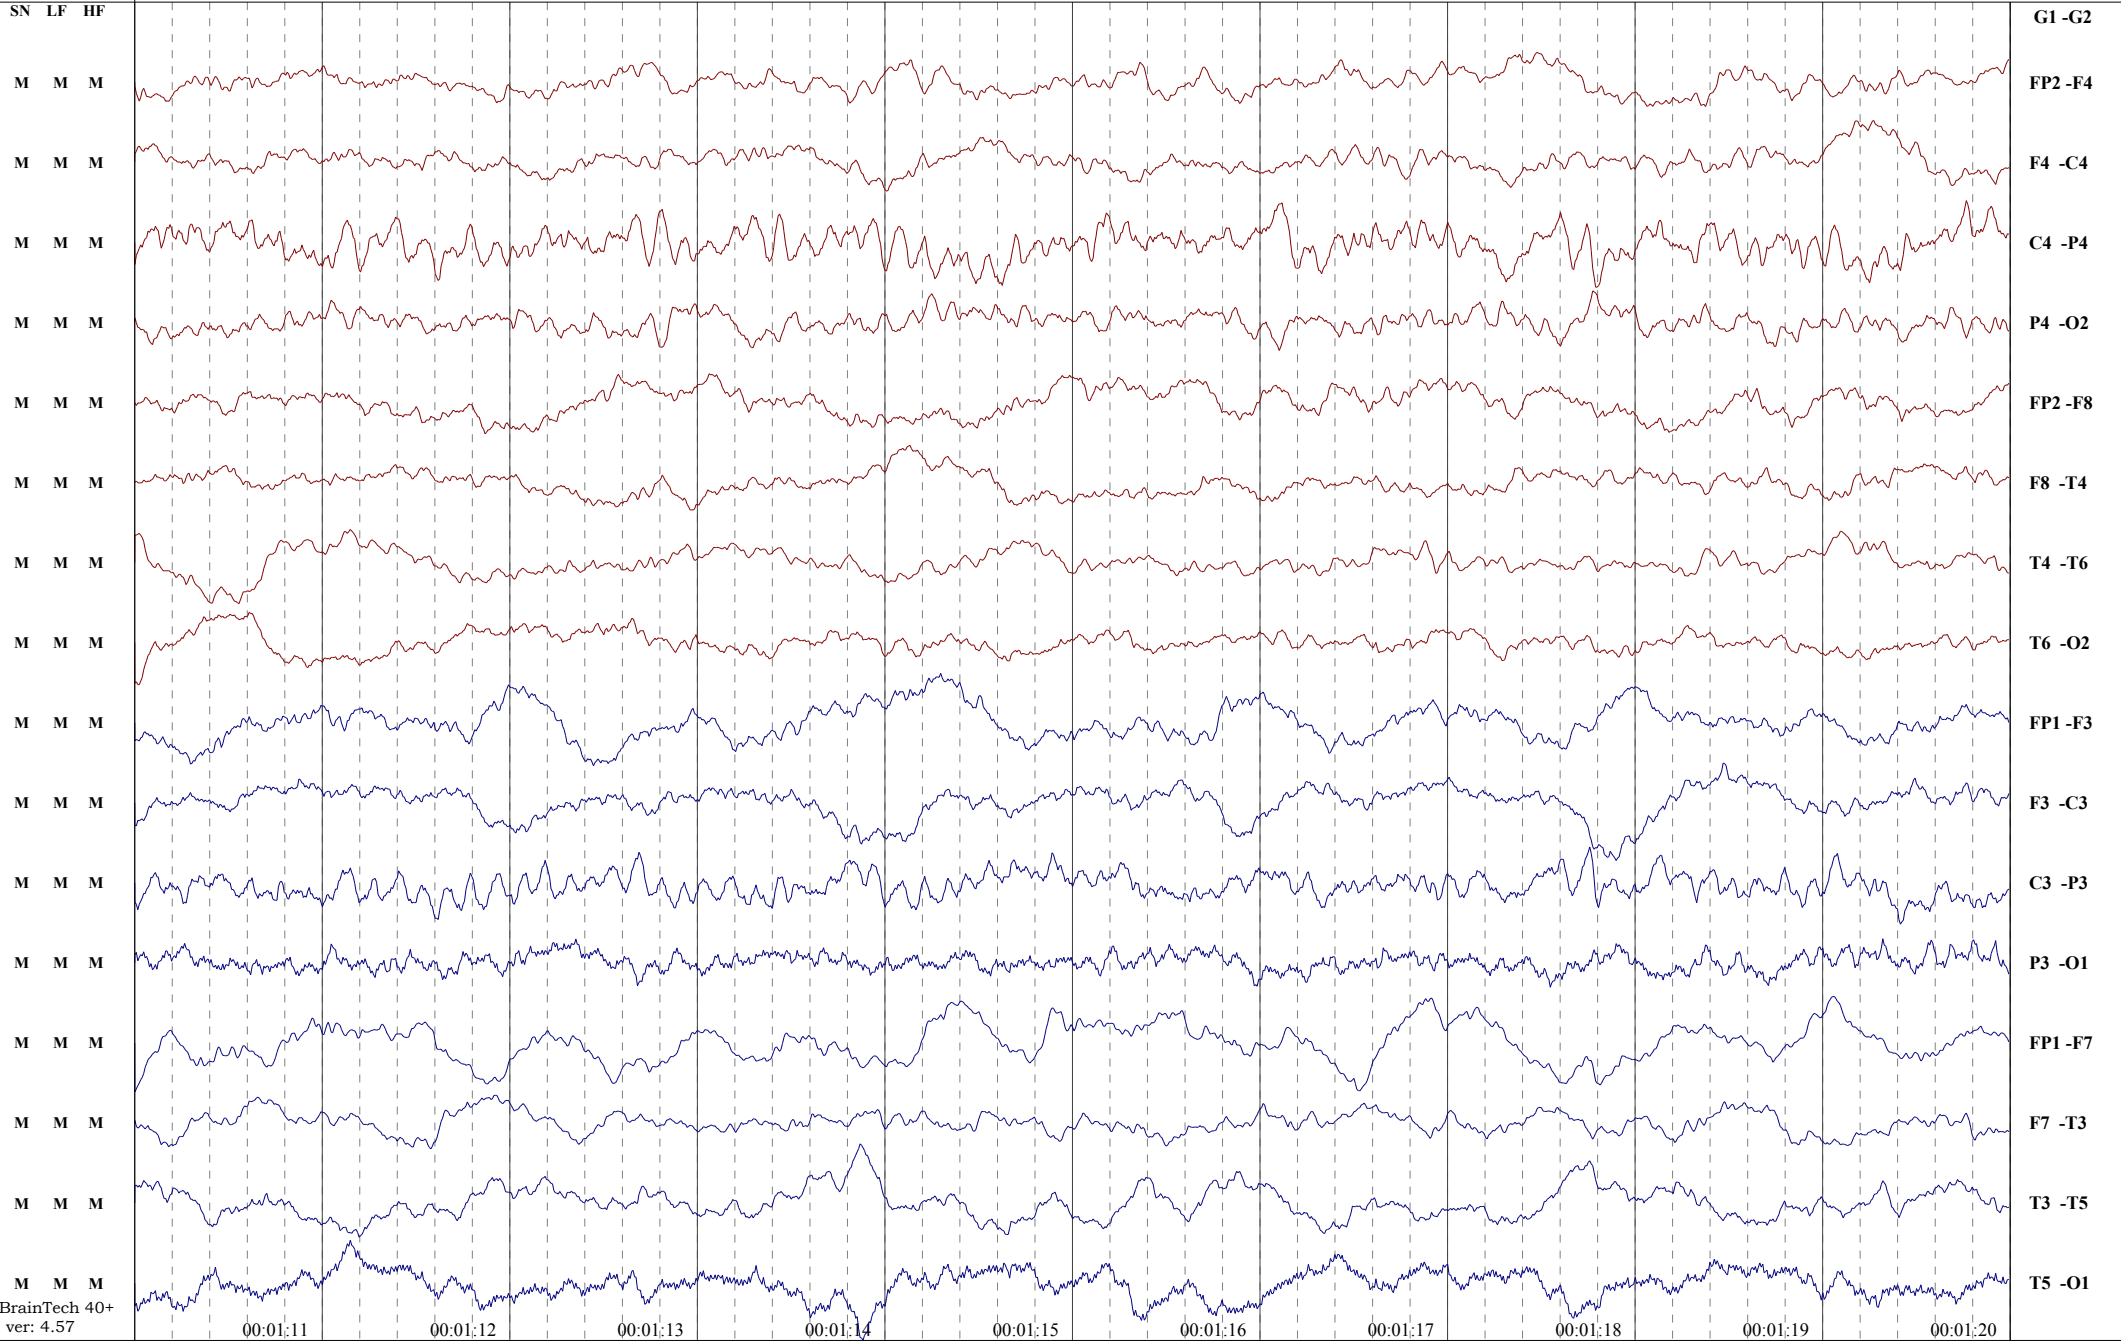

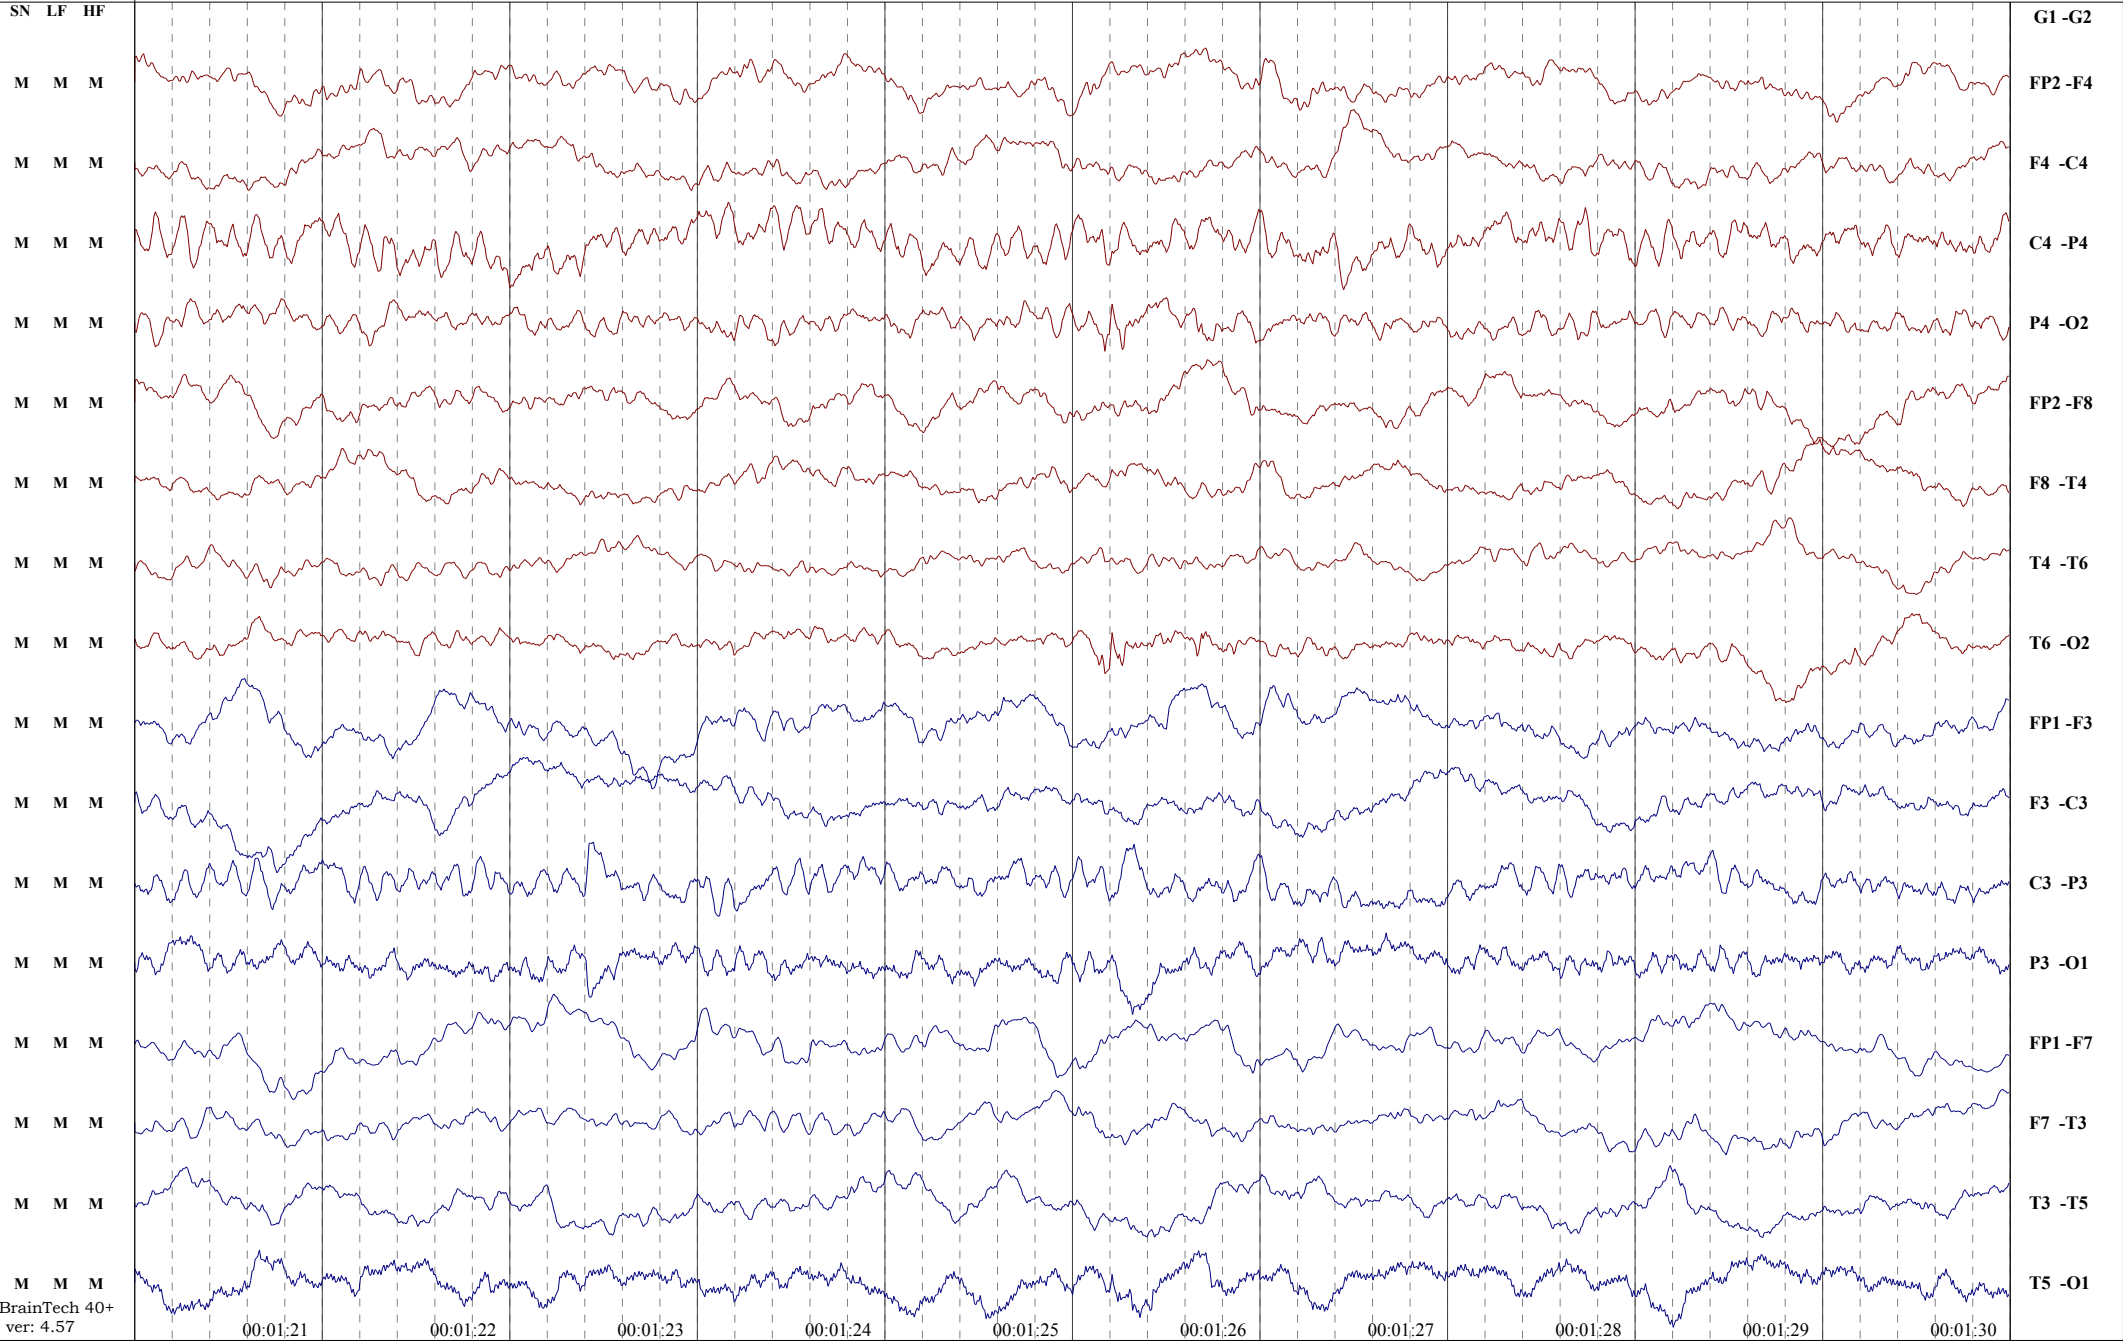

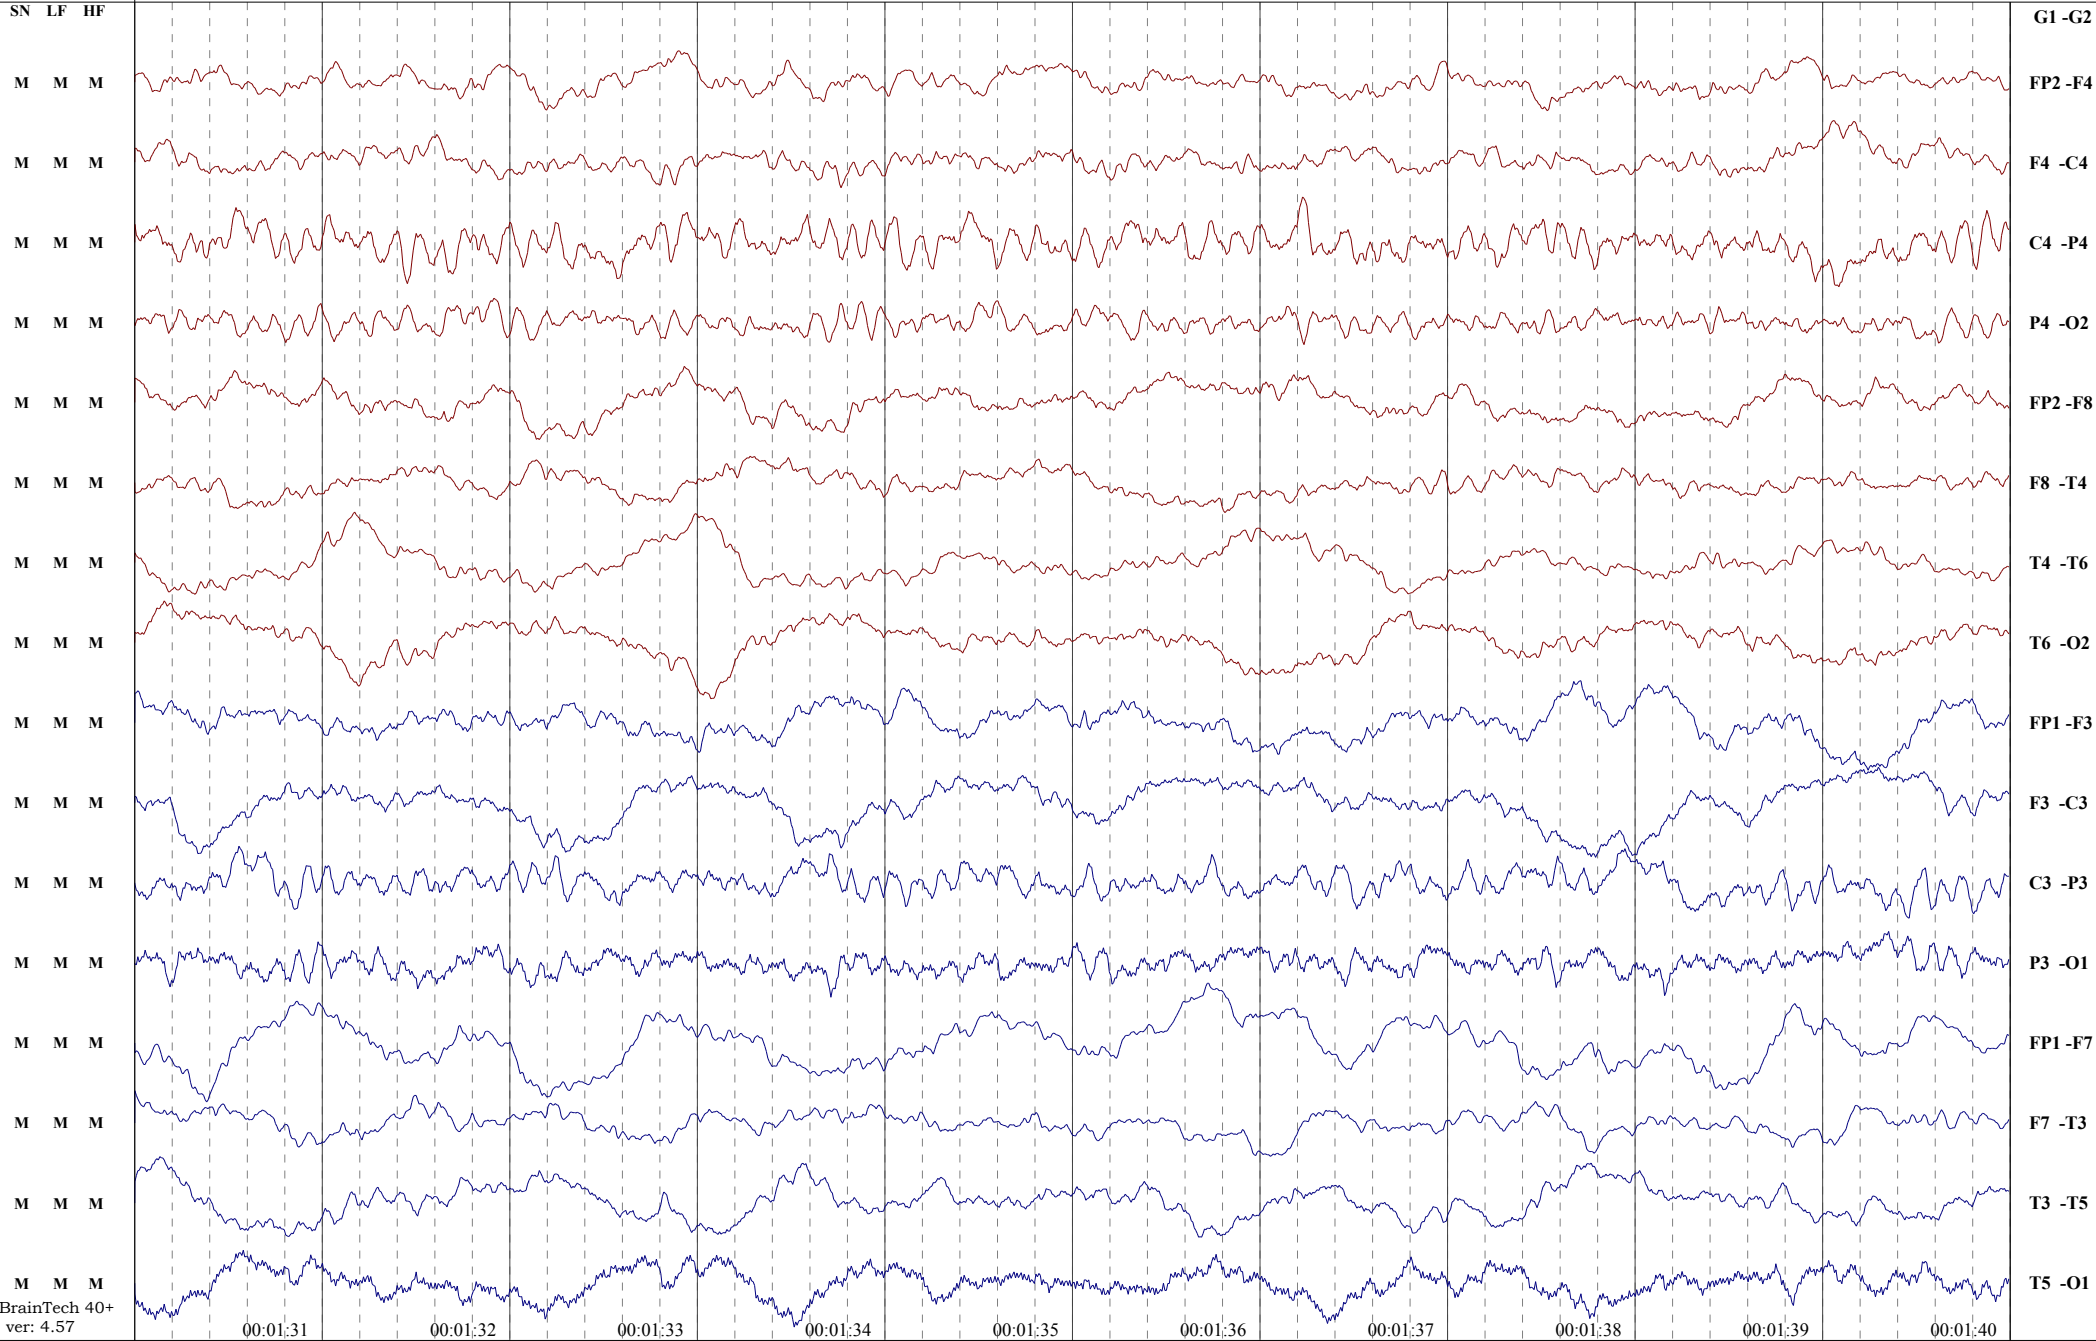

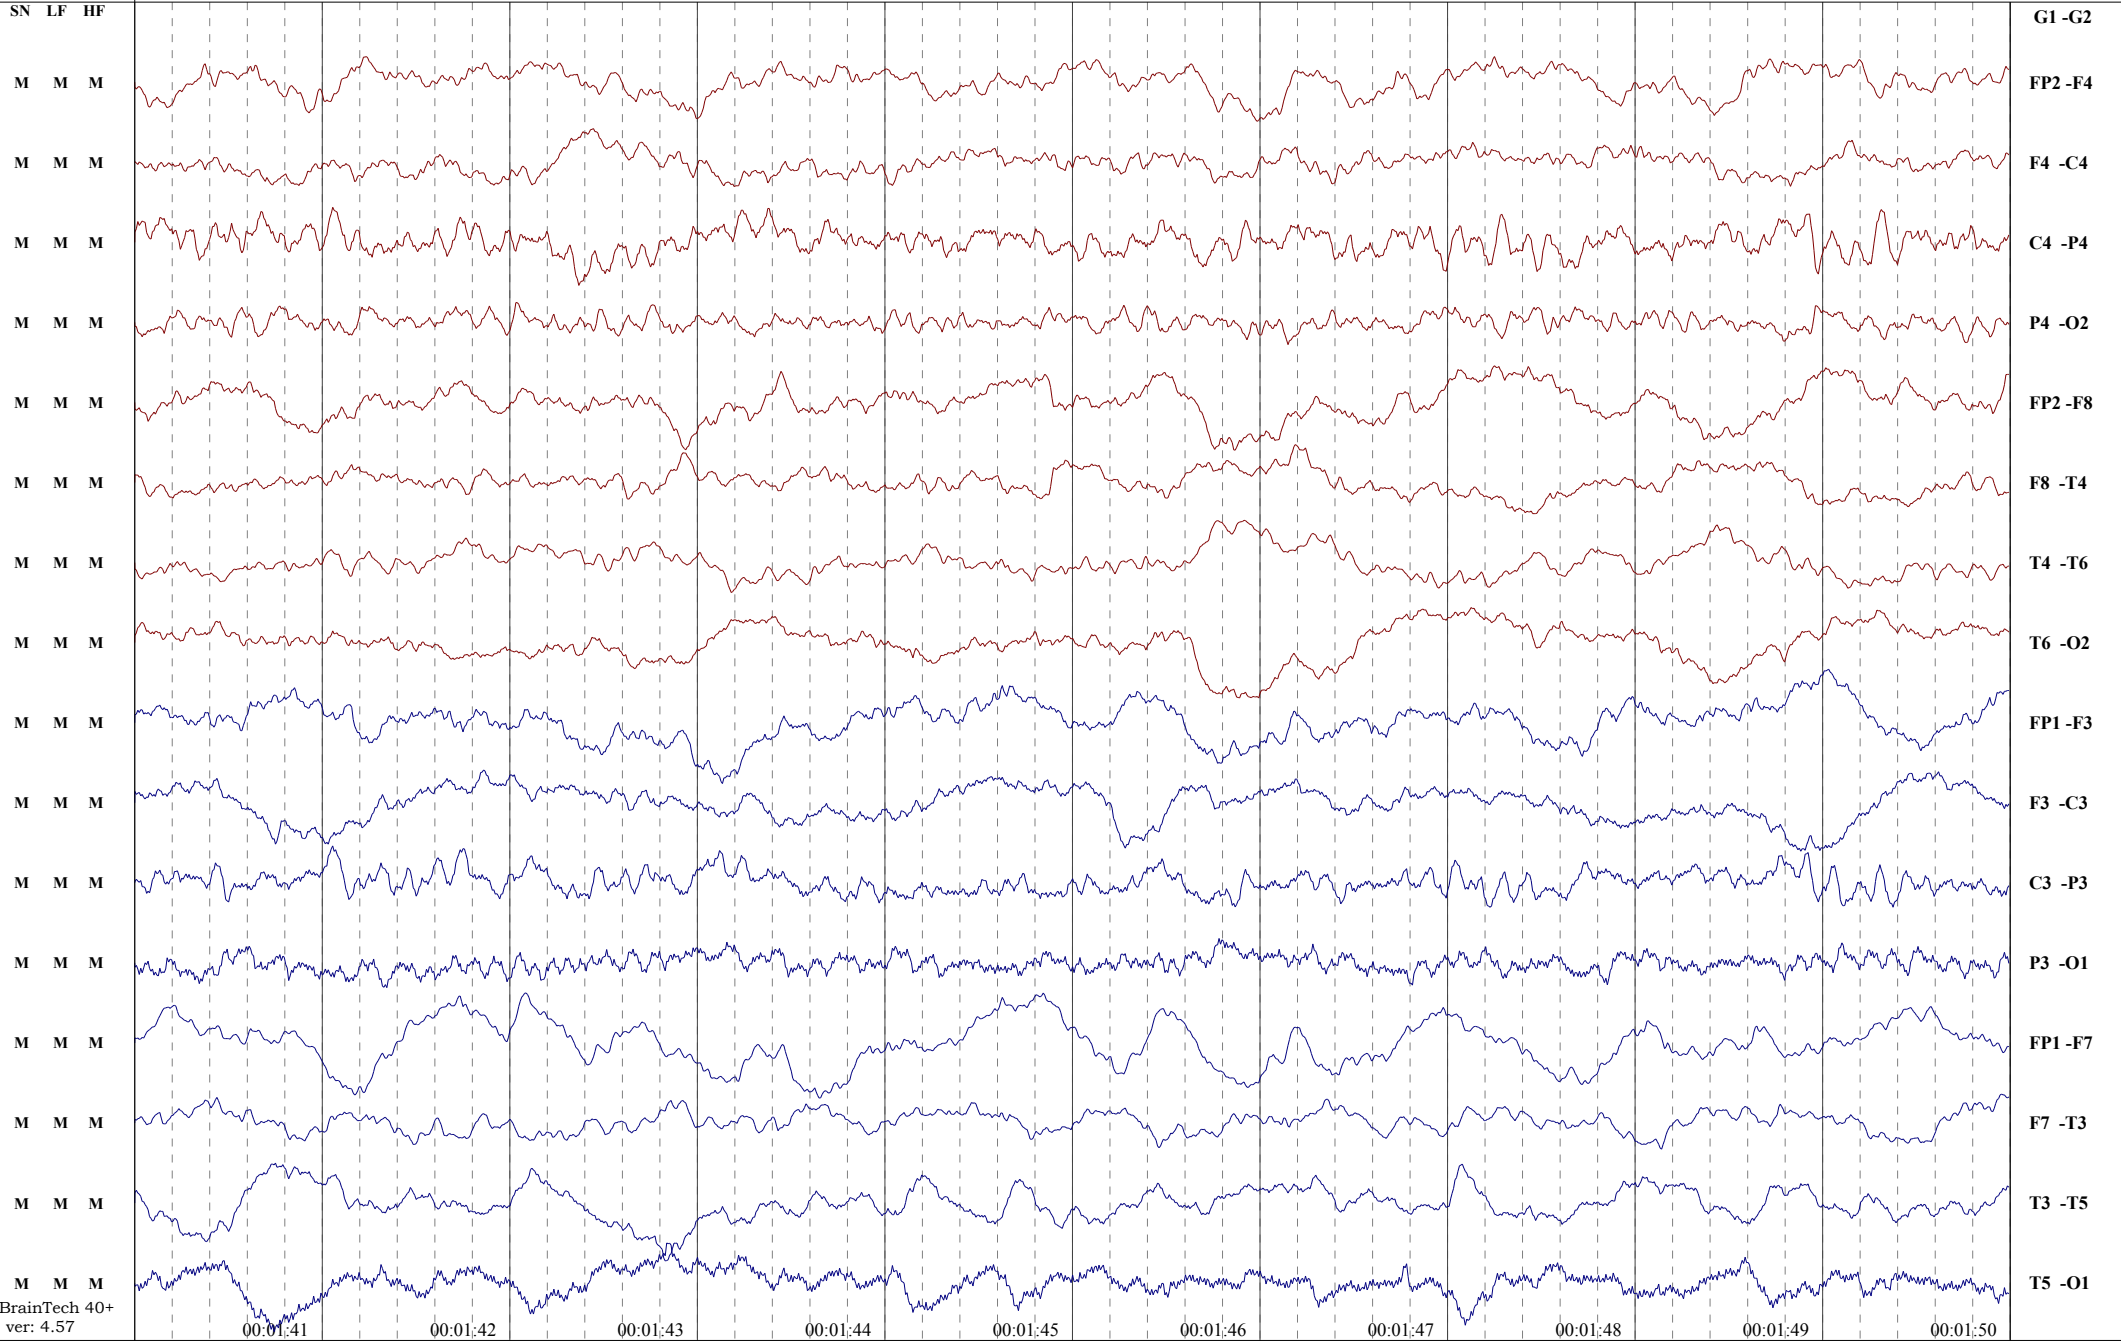


53
MISS. SHRUTI MANHAR
13 Years/F

Date: 09-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:10:21
Page:12/29
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

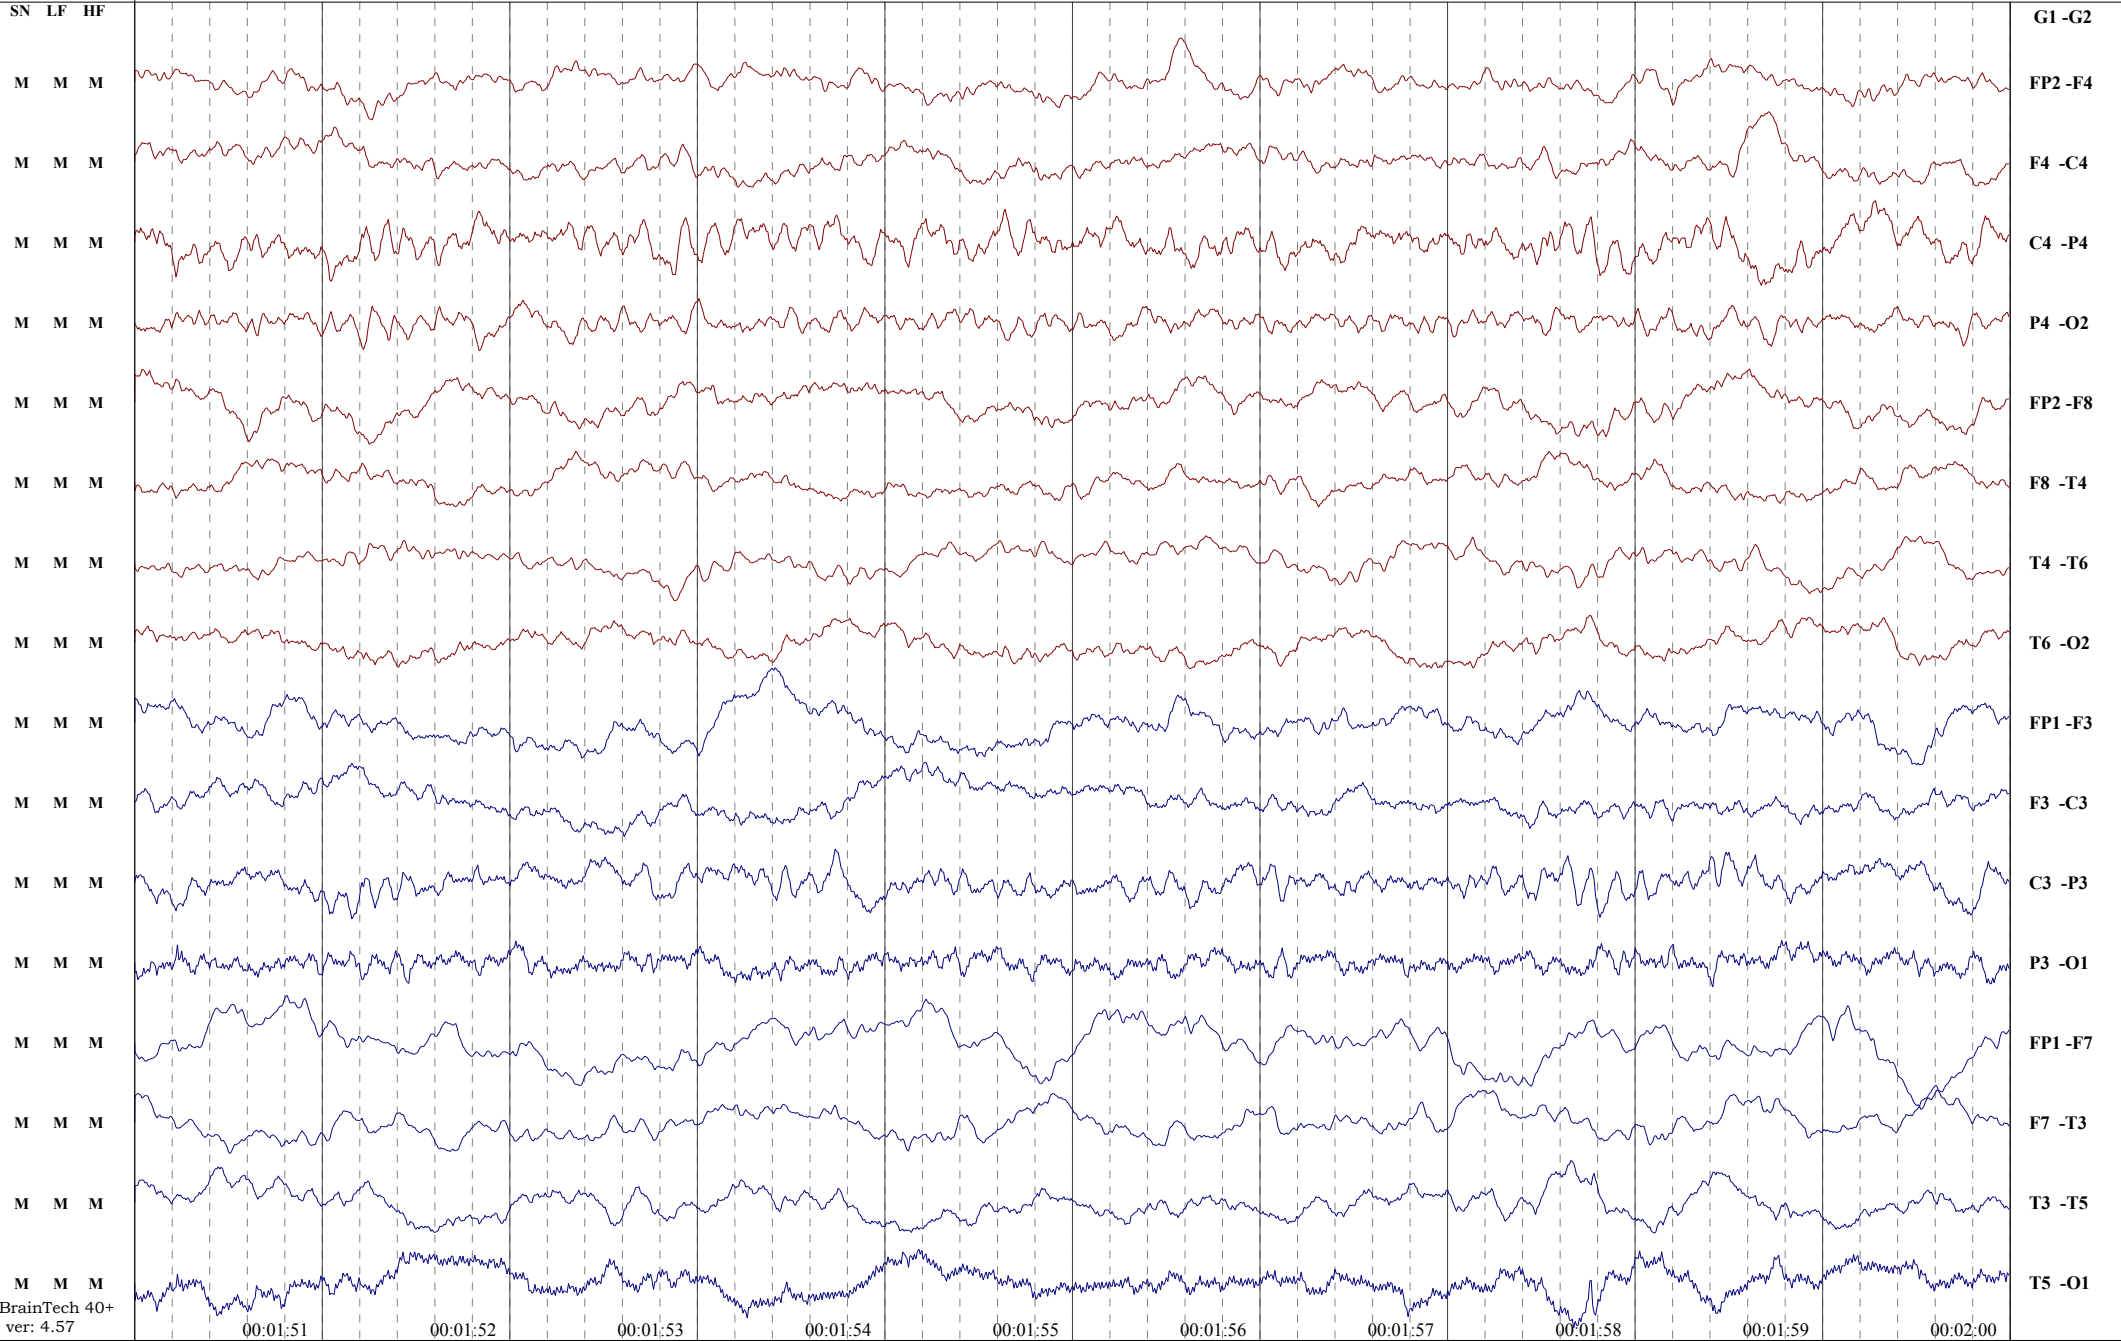


53
MISS. SHRUTI MANHAR
13 Years/F


Date: 09-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:10:31
Page:13/29
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

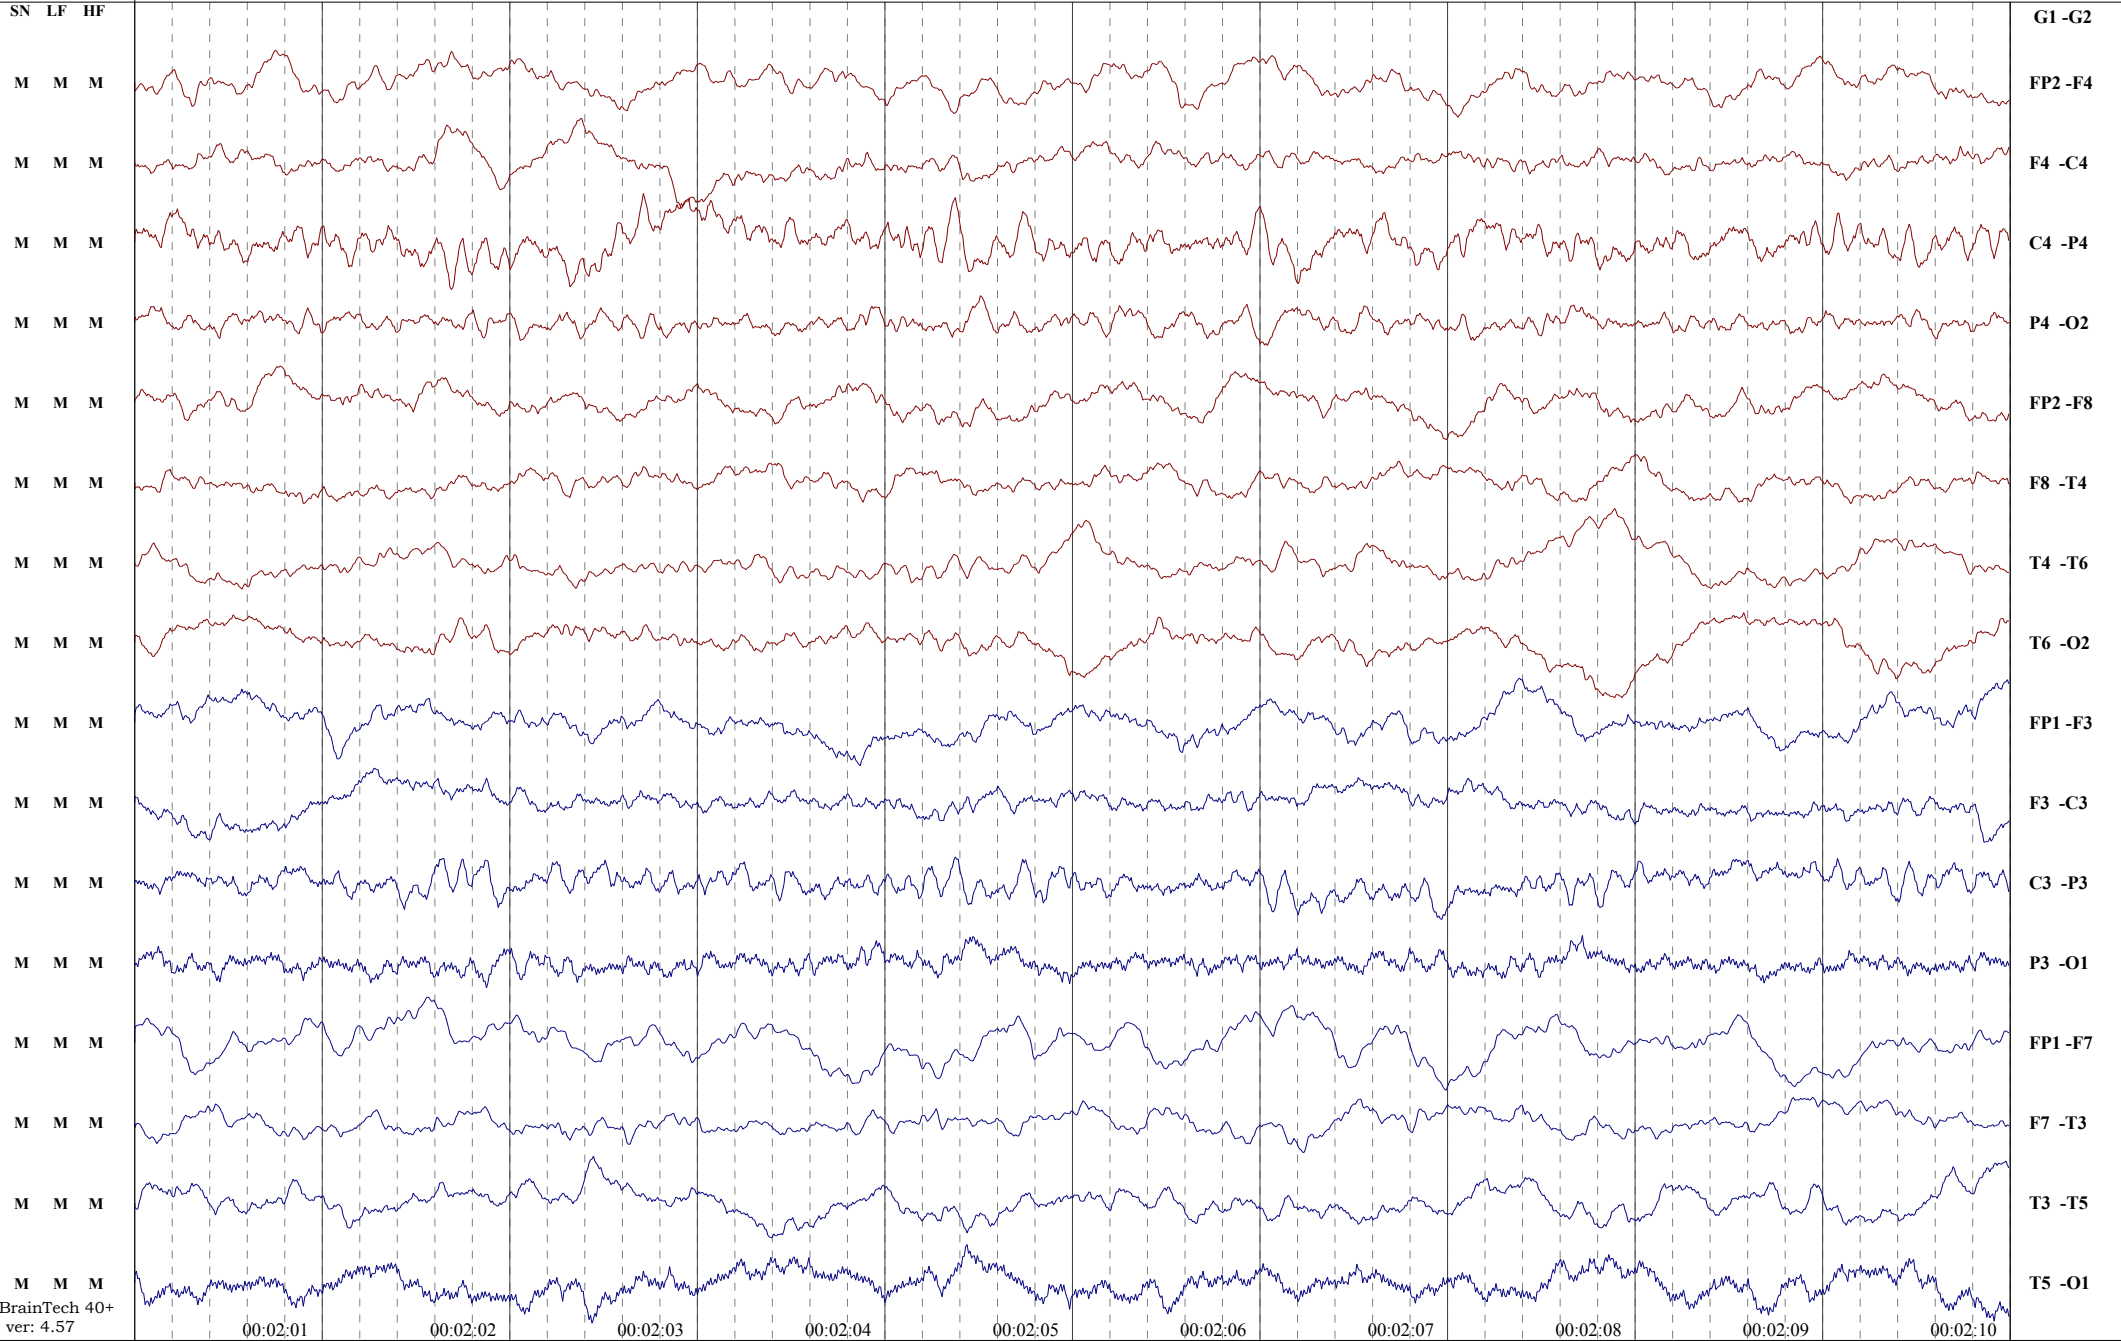

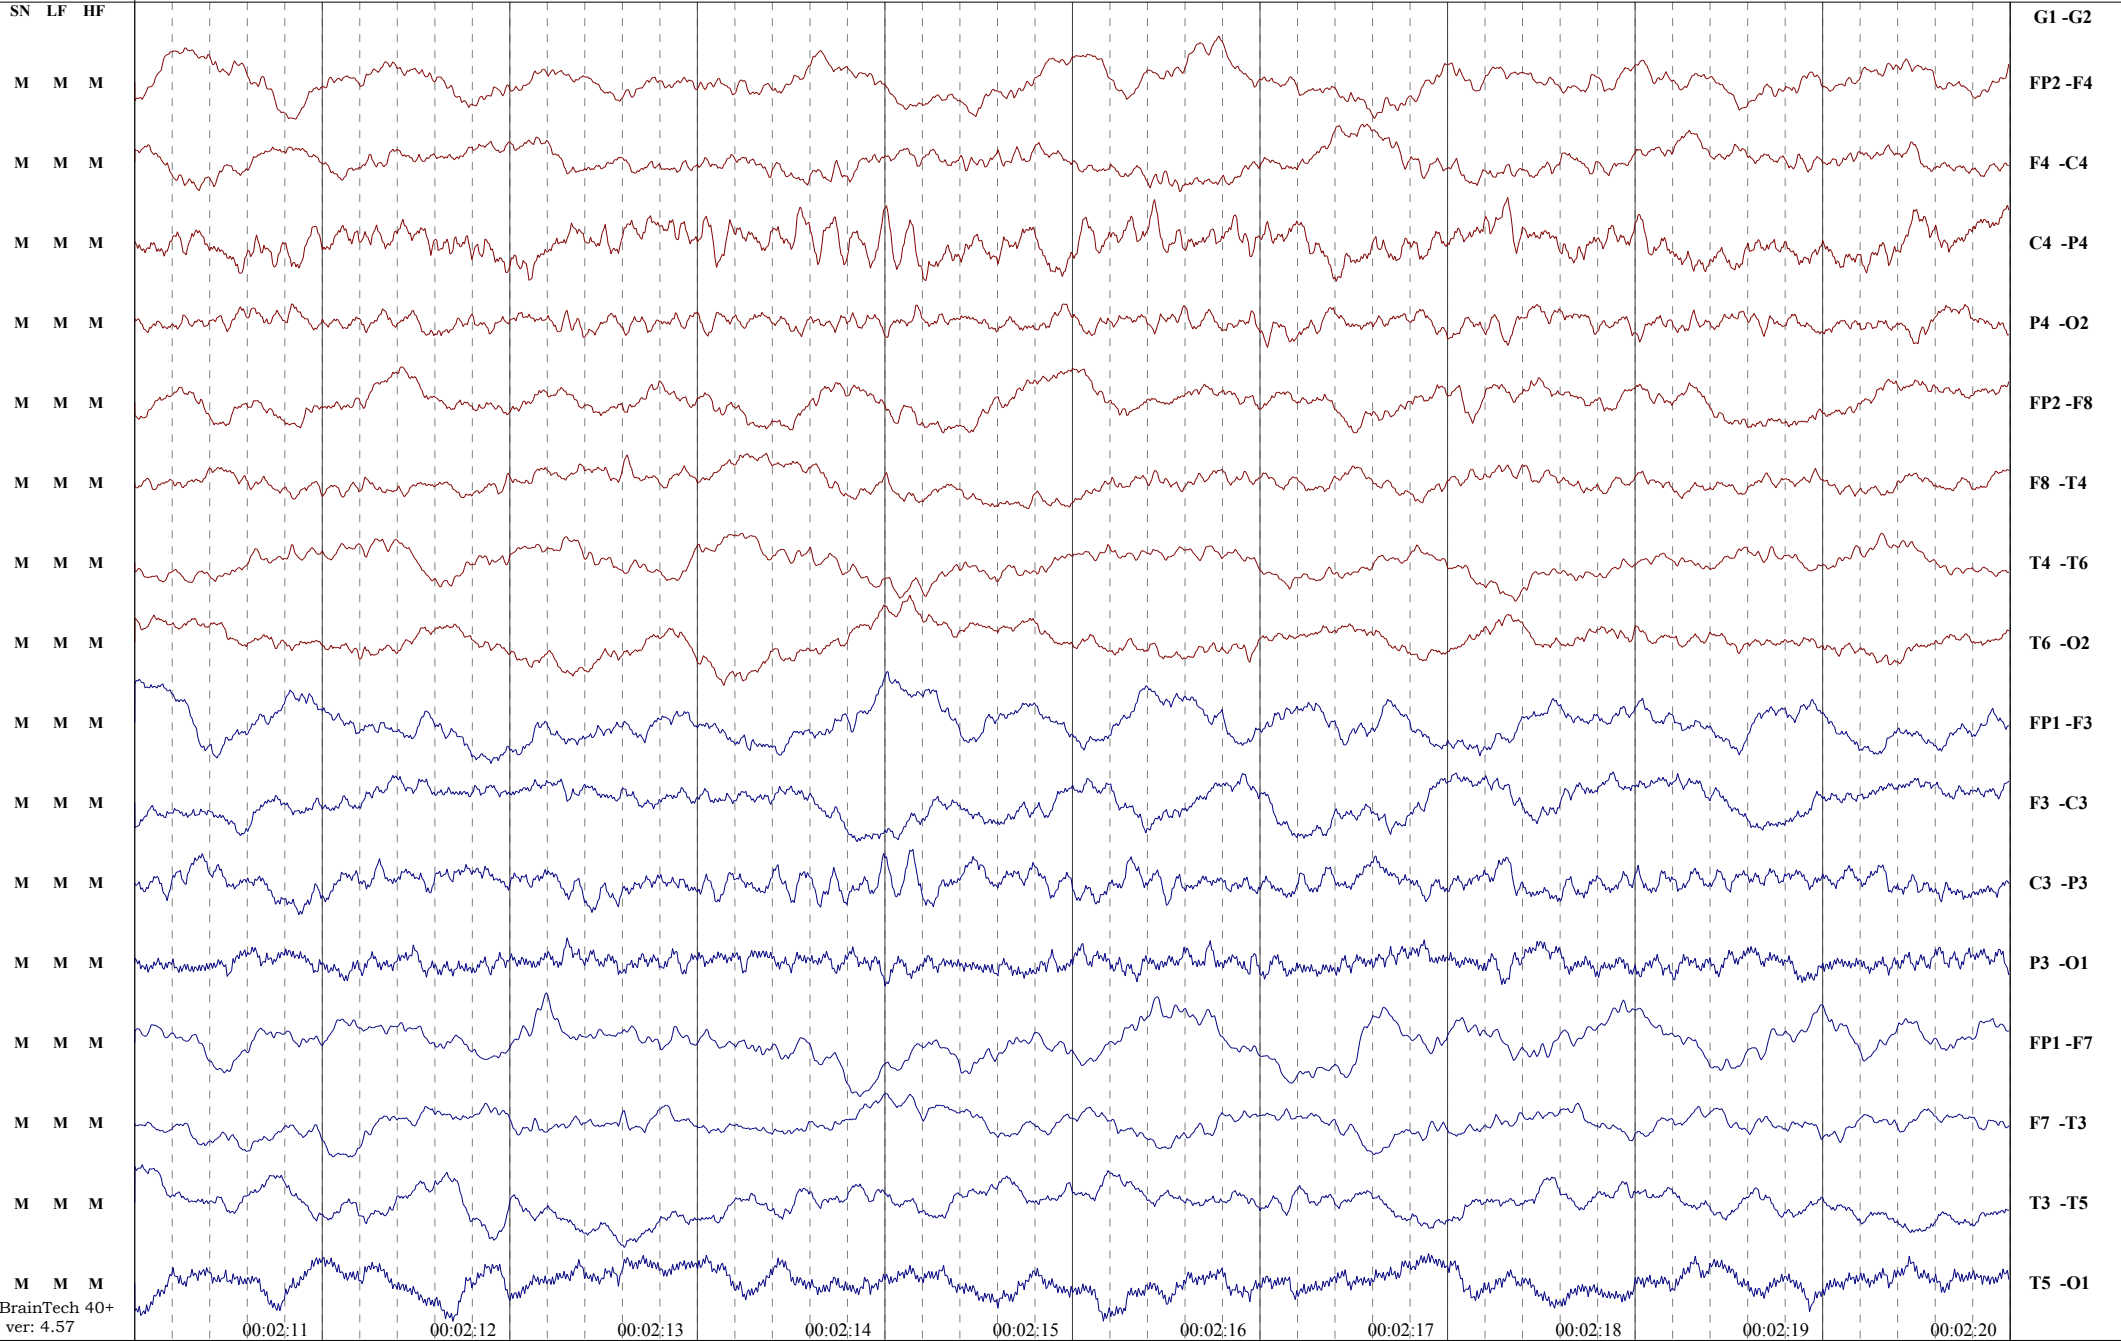


53
MISS. SHRUTI MANHAR
13 Years/F

Date: 09-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:10:51
Page:15/29
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

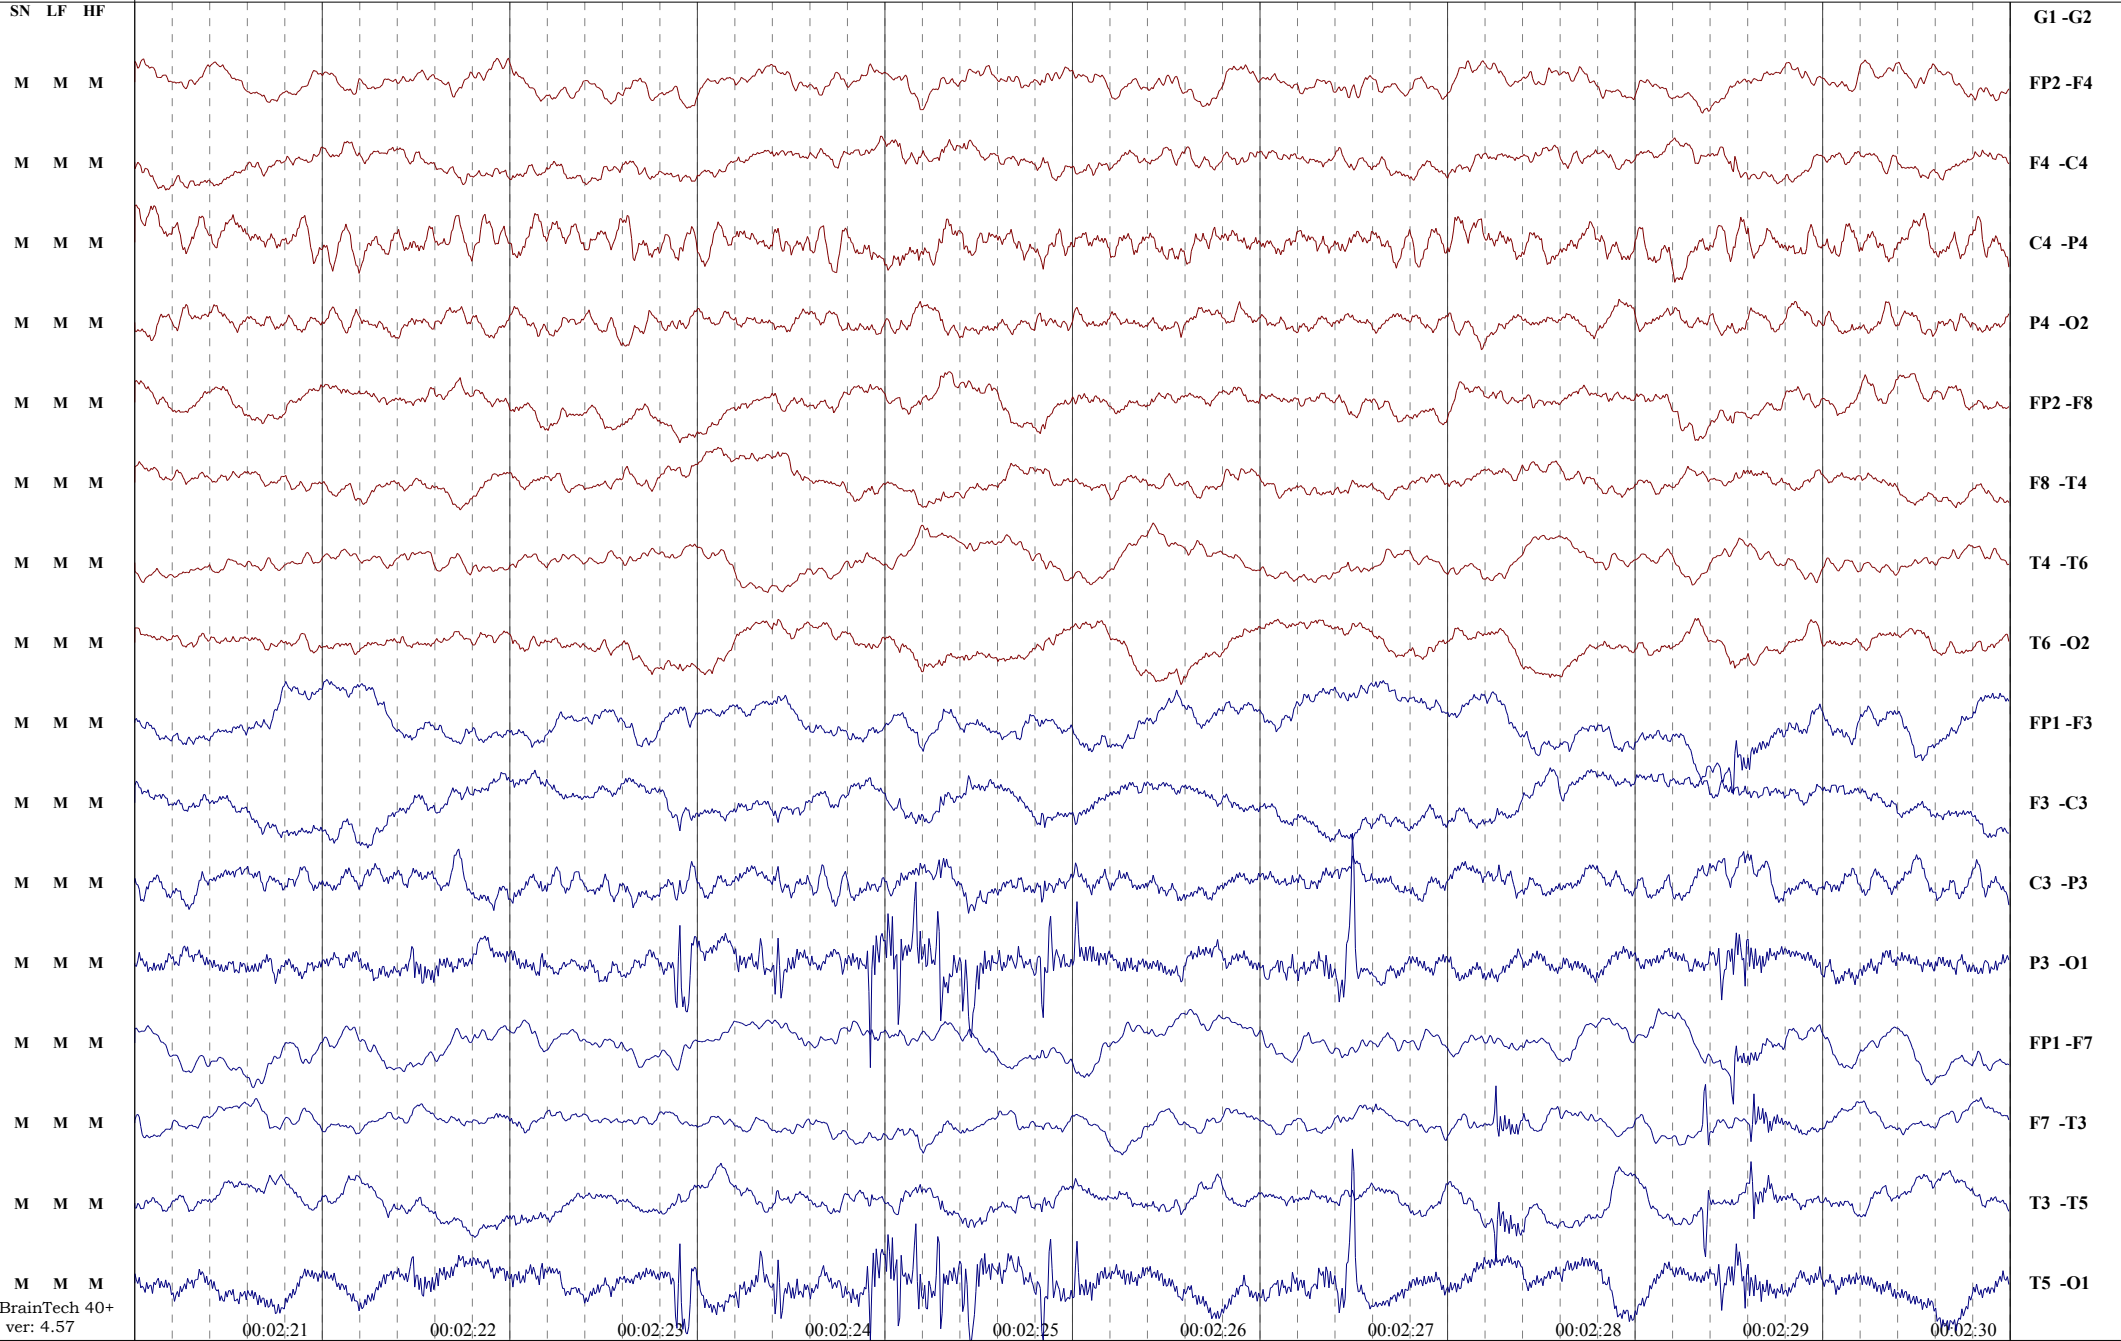


53
MISS. SHRUTI MANHAR
13 Years/F


Date: 09-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:11:21
Page:18/29
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

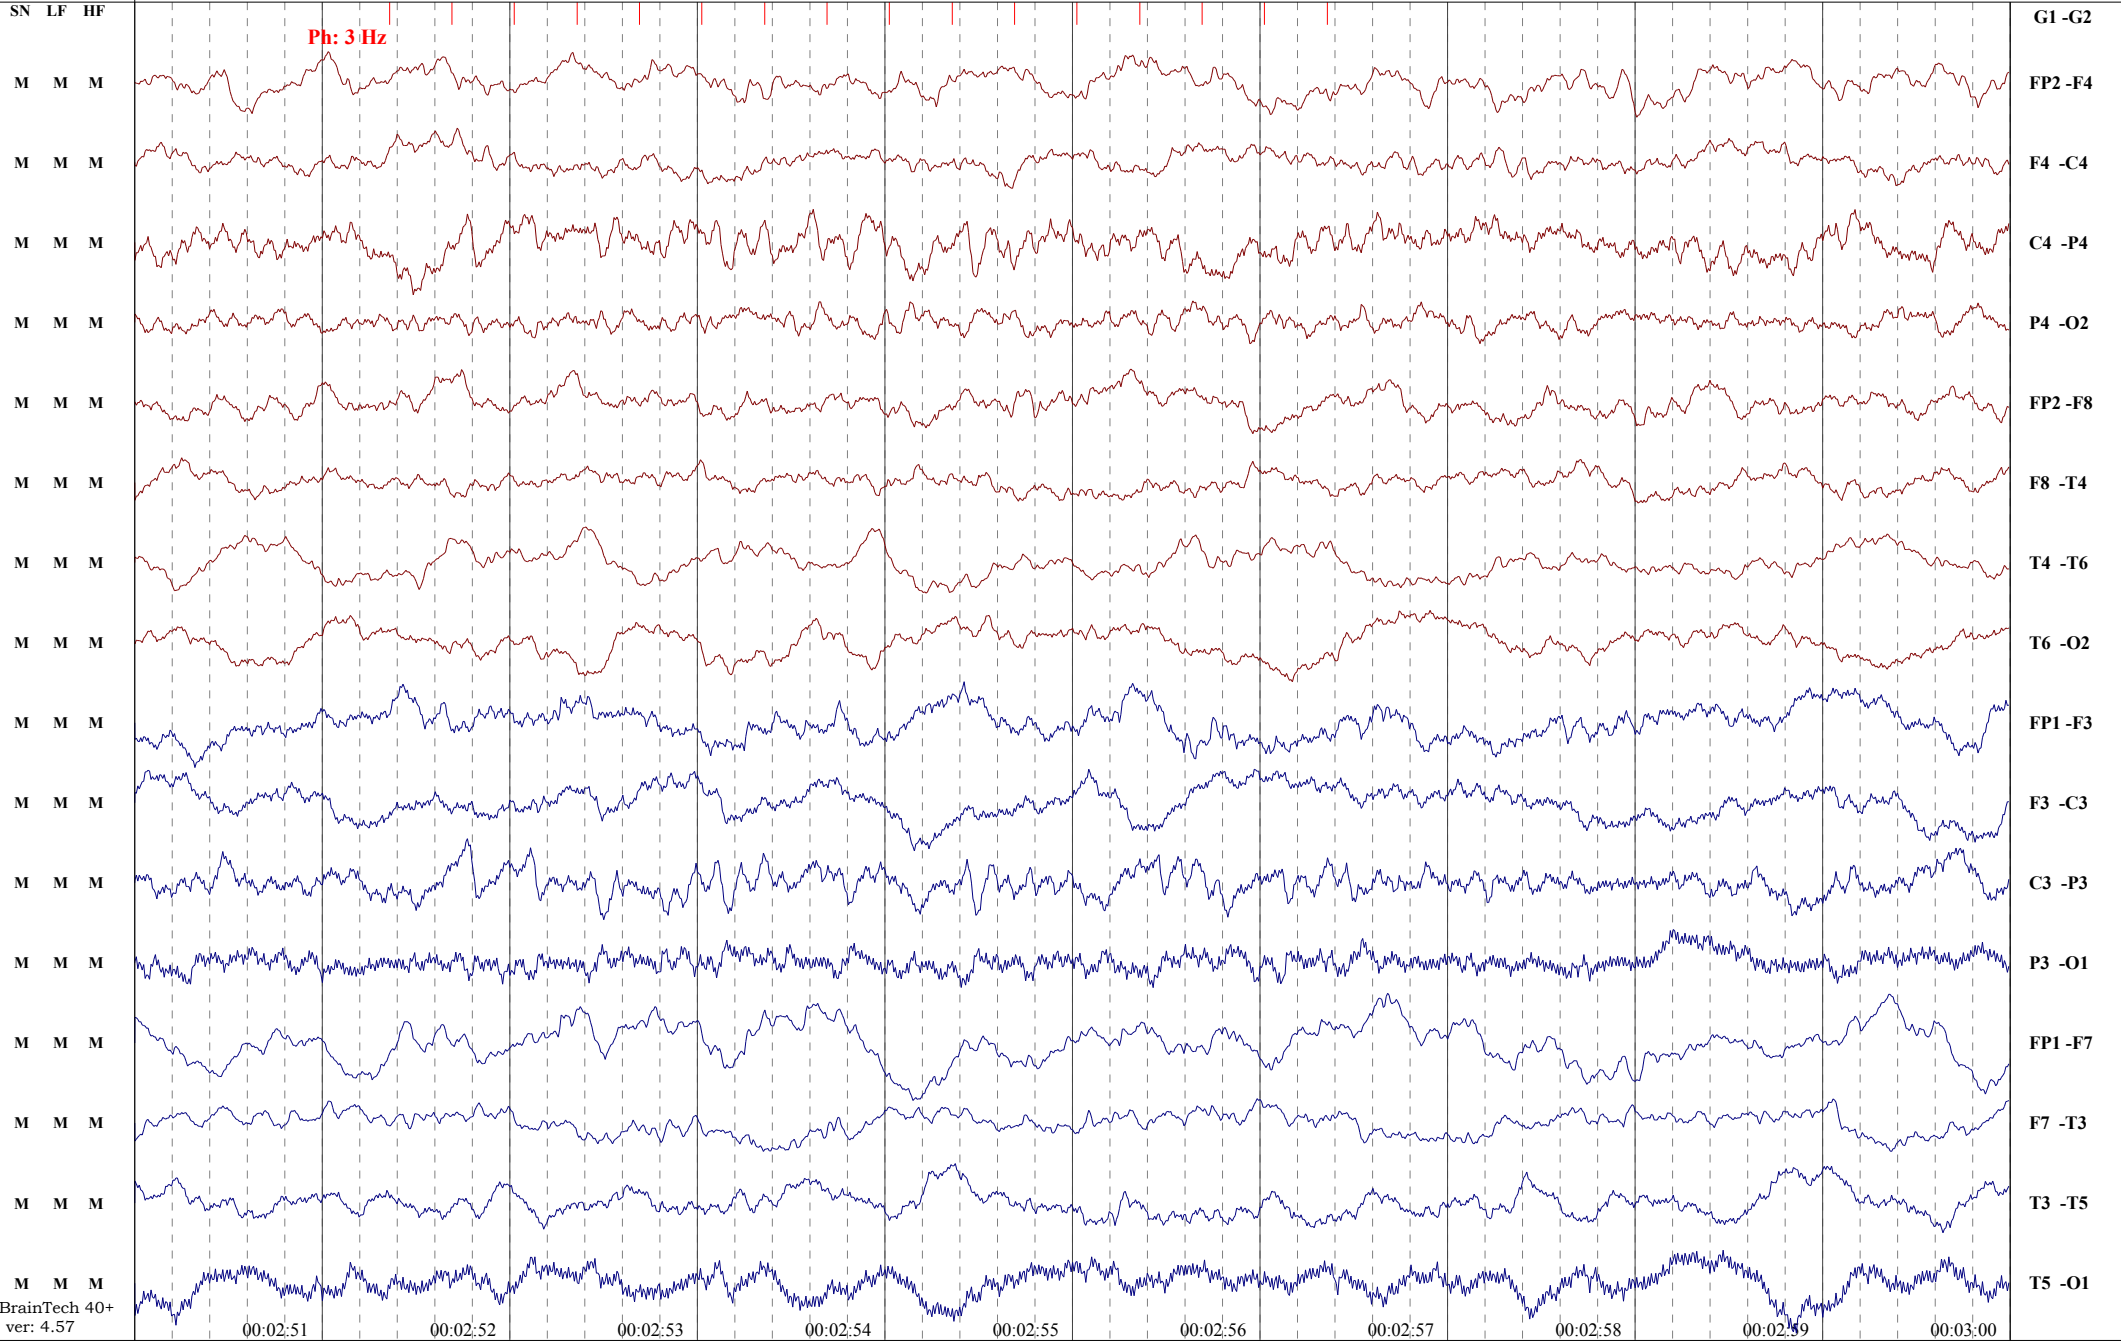

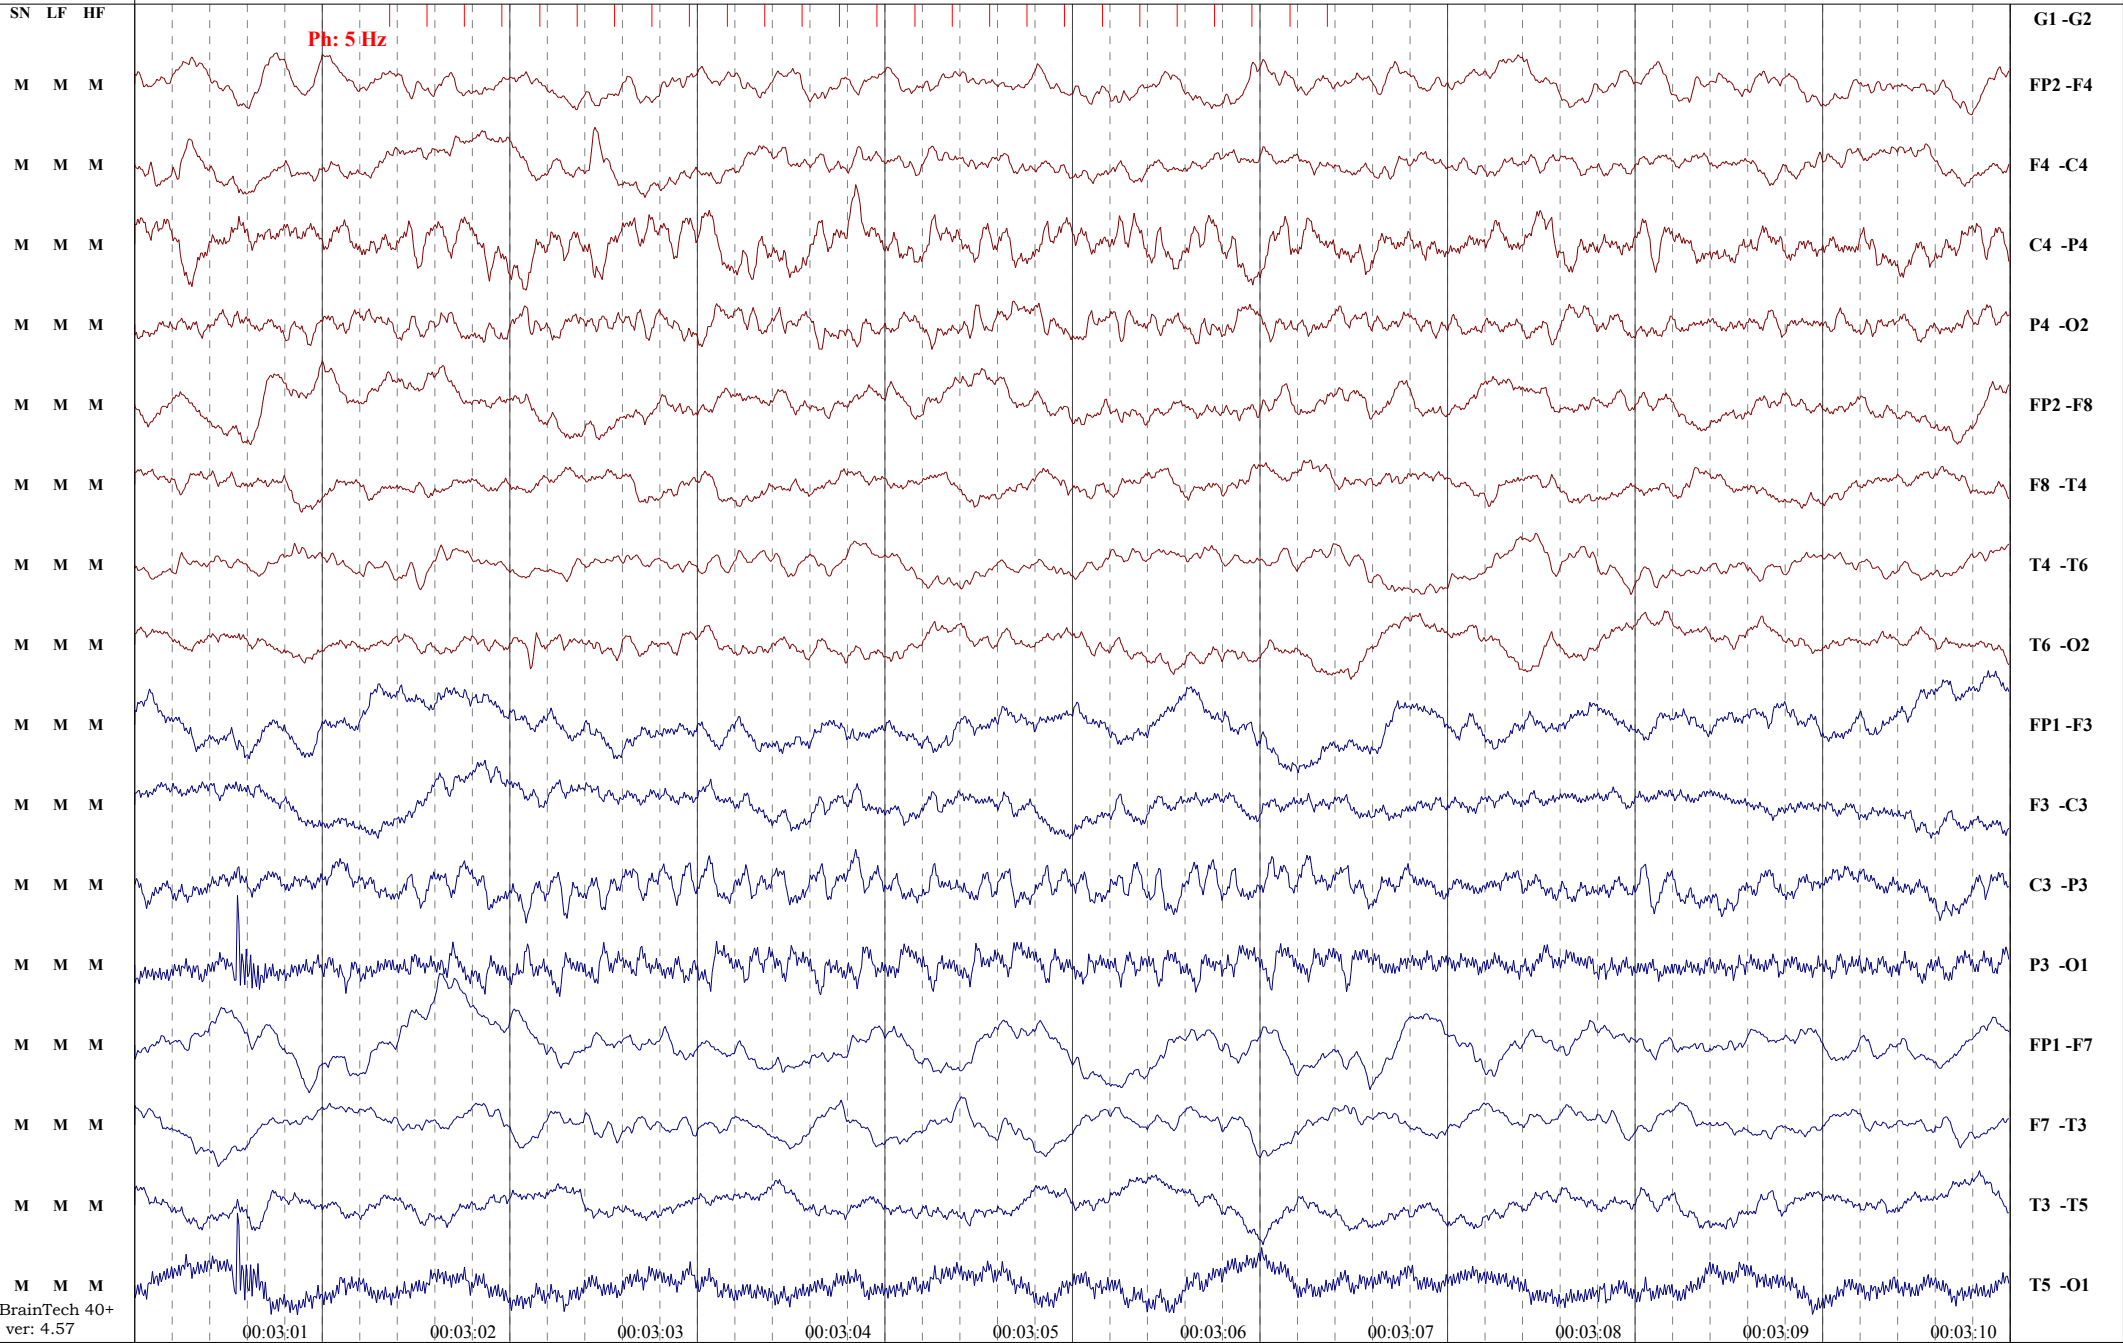


53
MISS. SHRUTI MANHAR
13 Years/F

Date: 09-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:11:51
Page:21/29
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

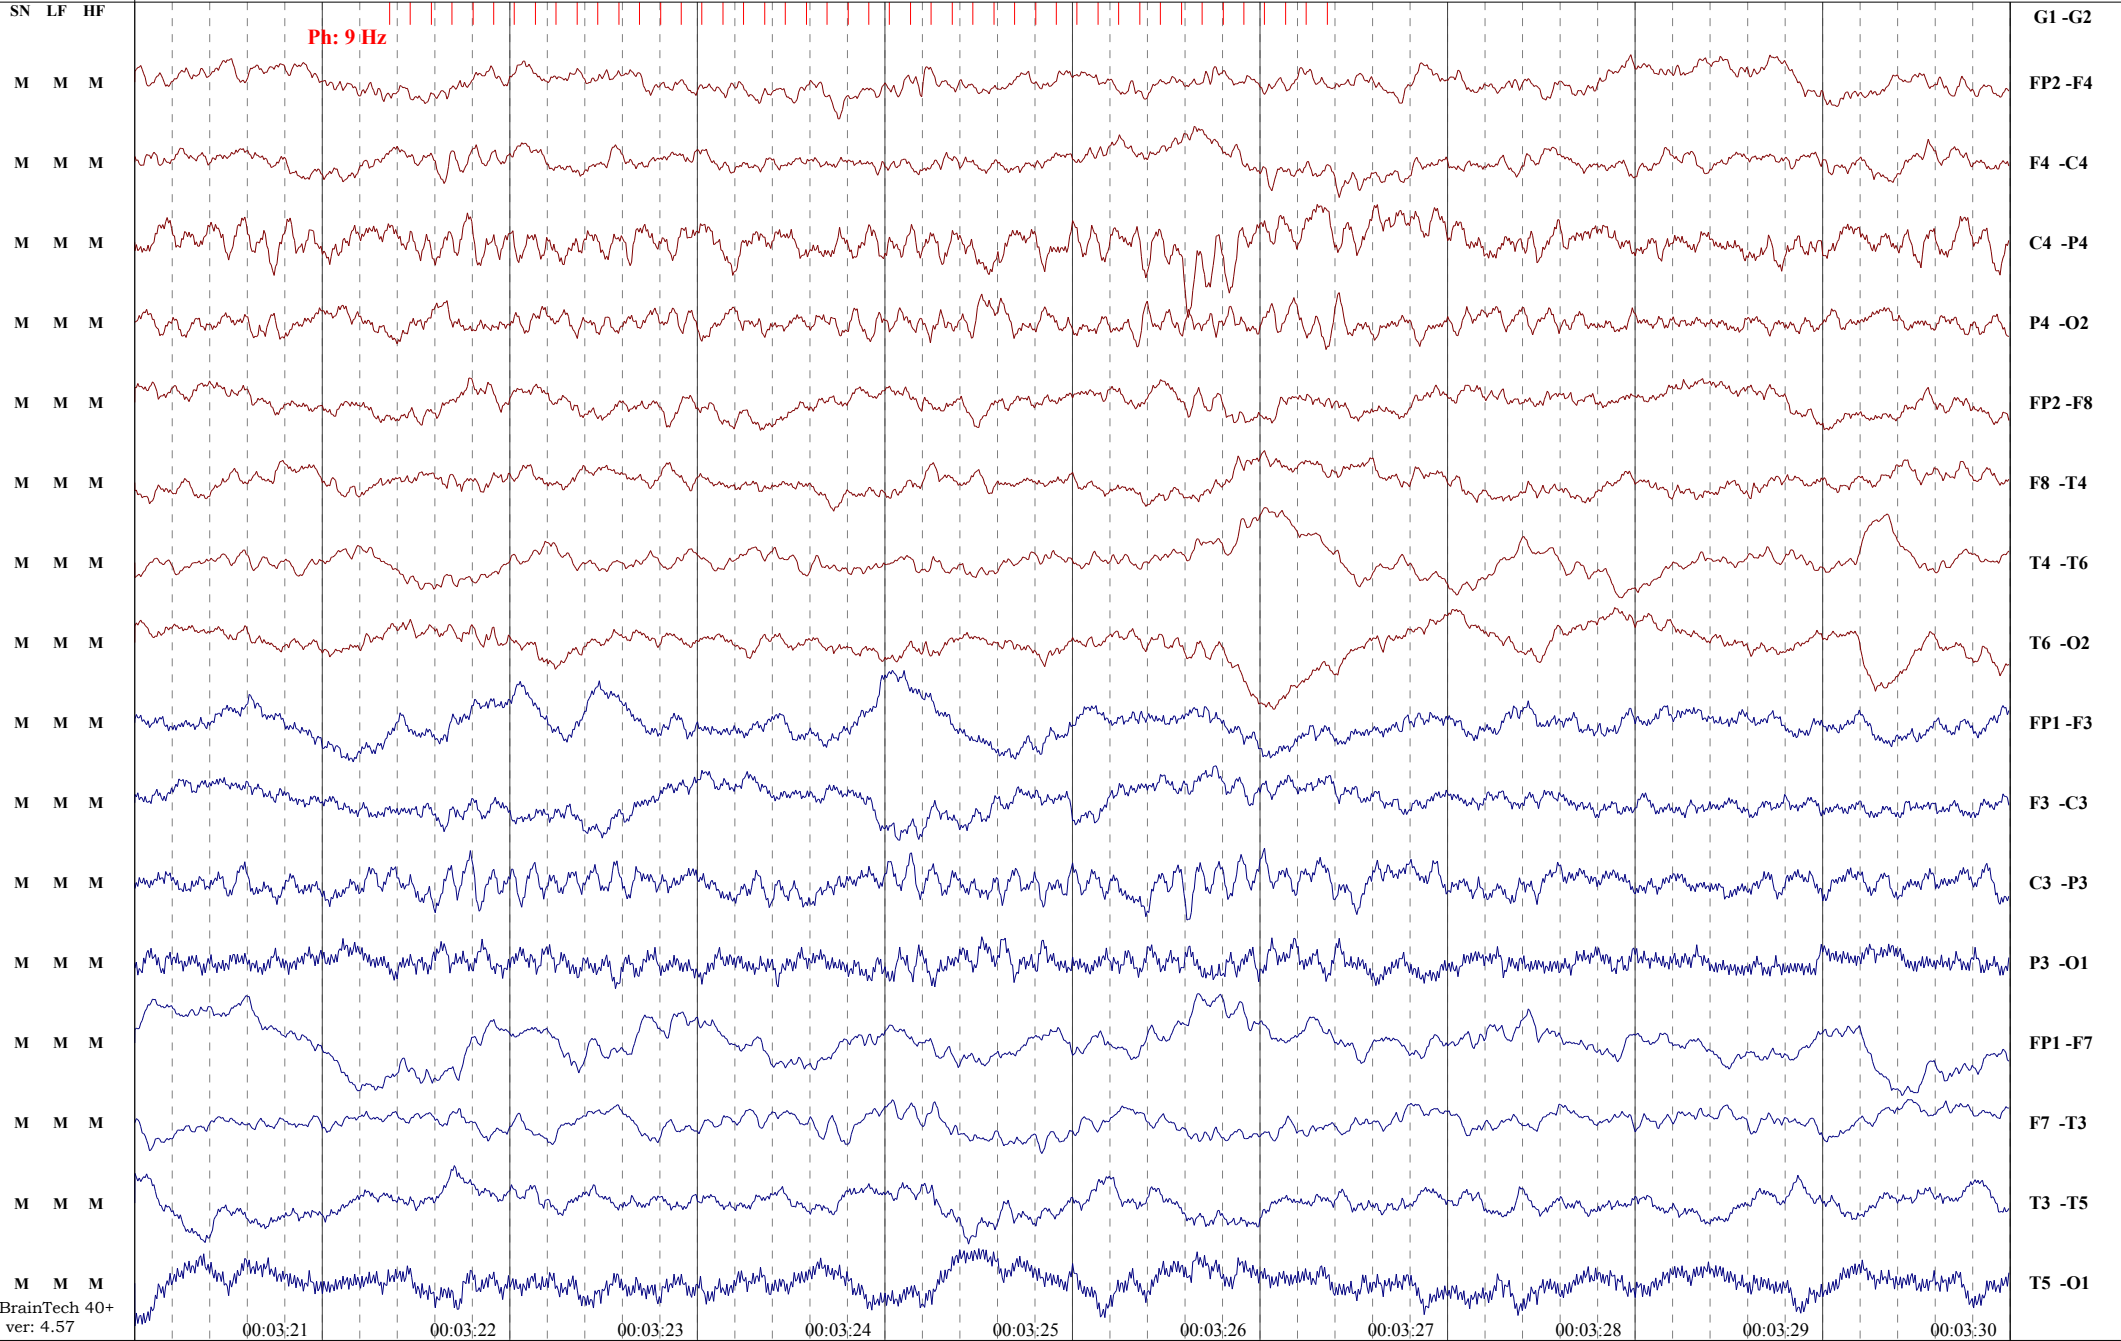


53
MISS. SHRUTI MANHAR
13 Years/F


Date: 09-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL


Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz


Time: 14:12:01
Page:22/29
Notch: ON


Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

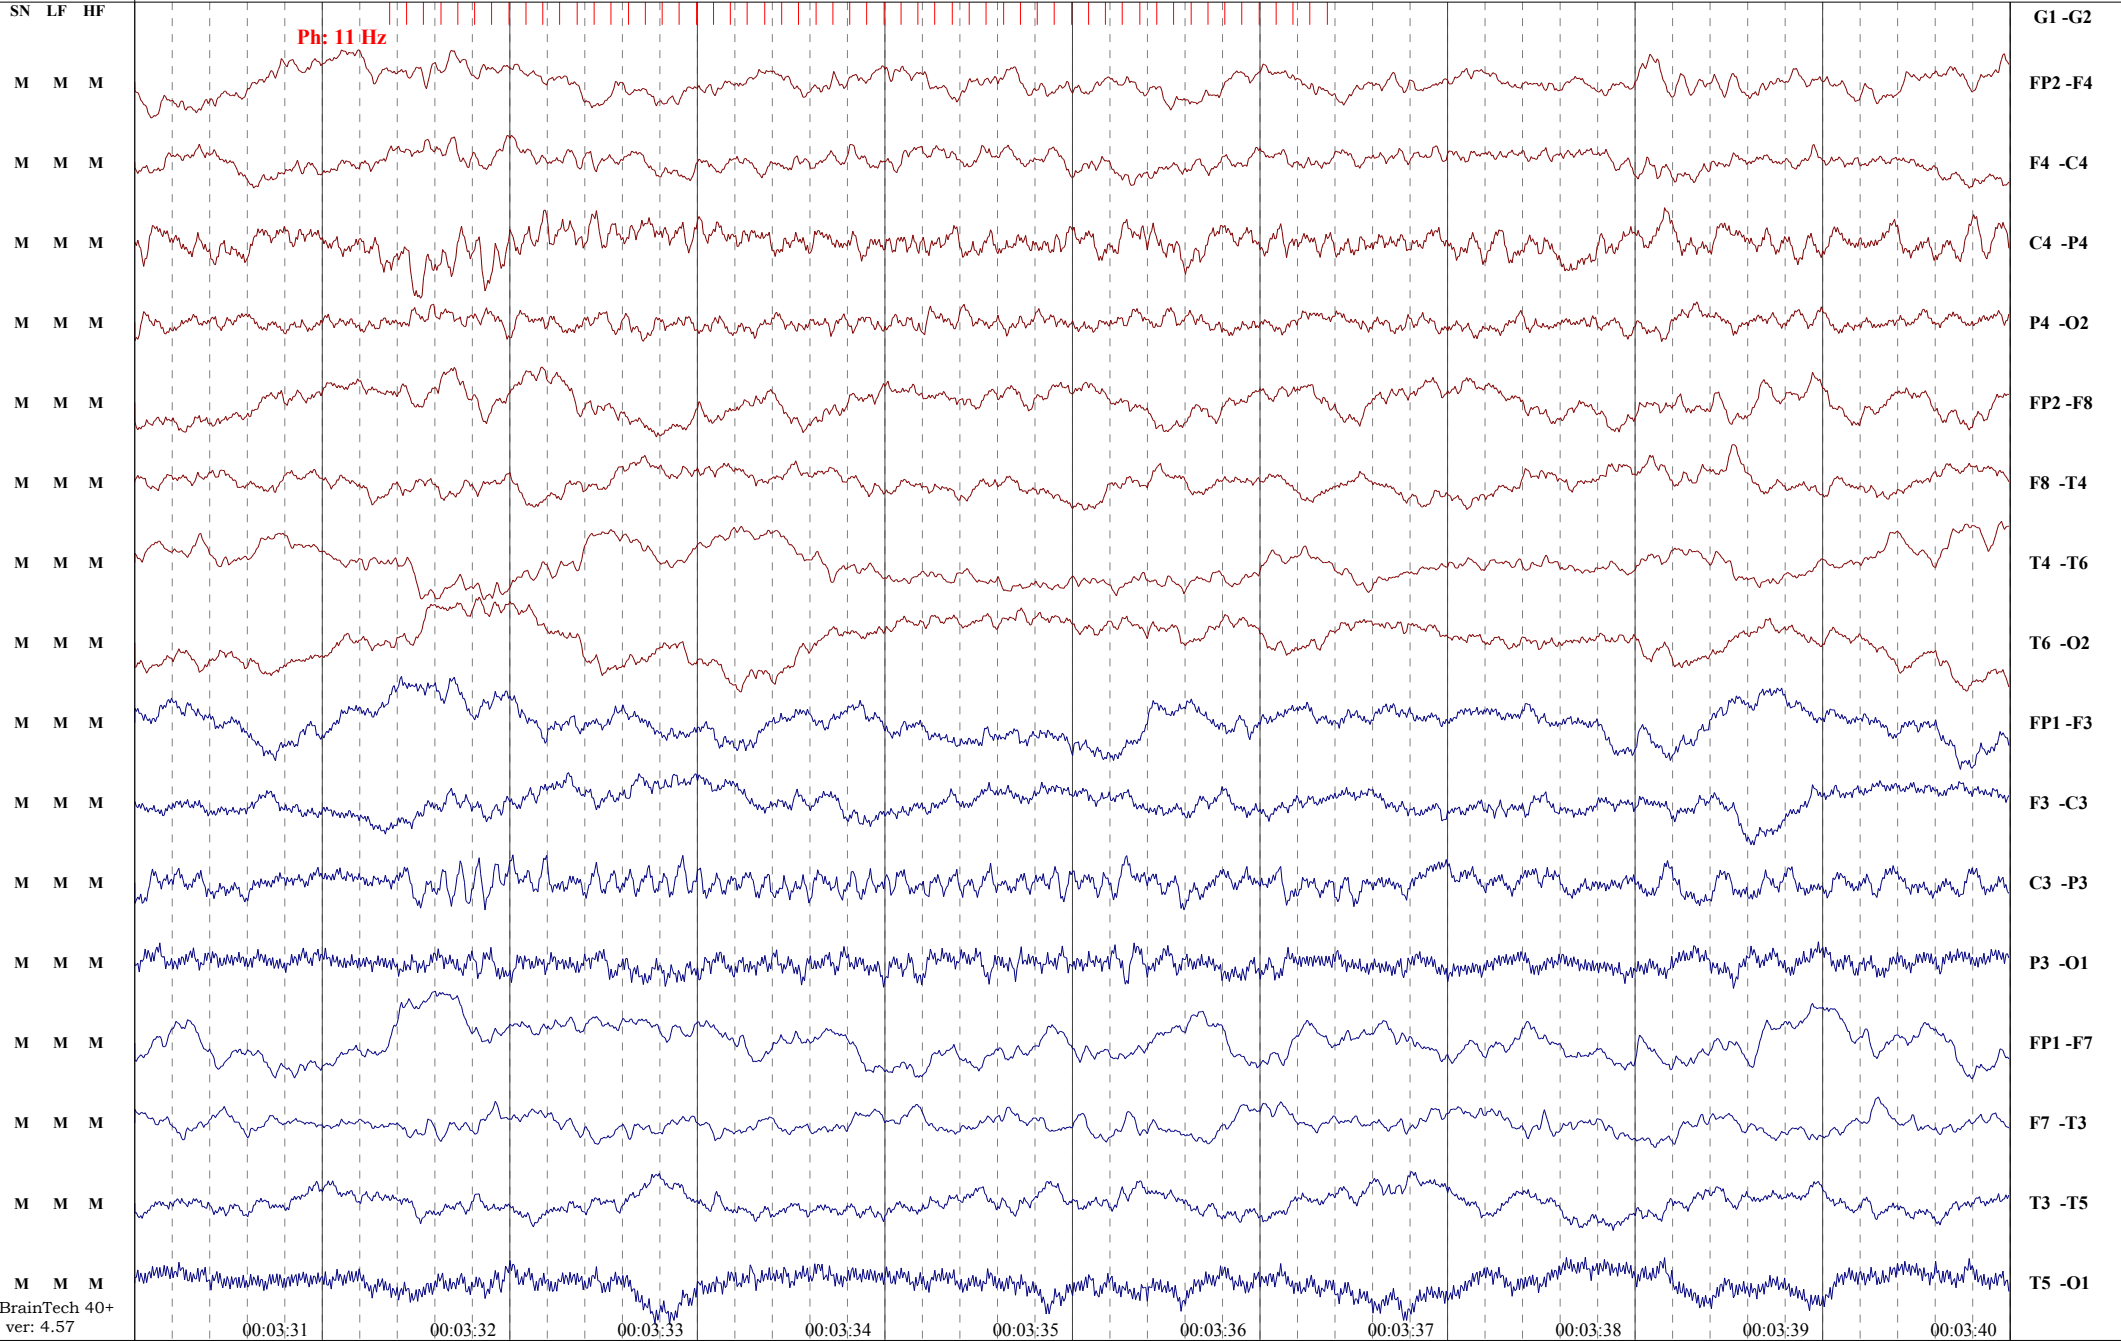


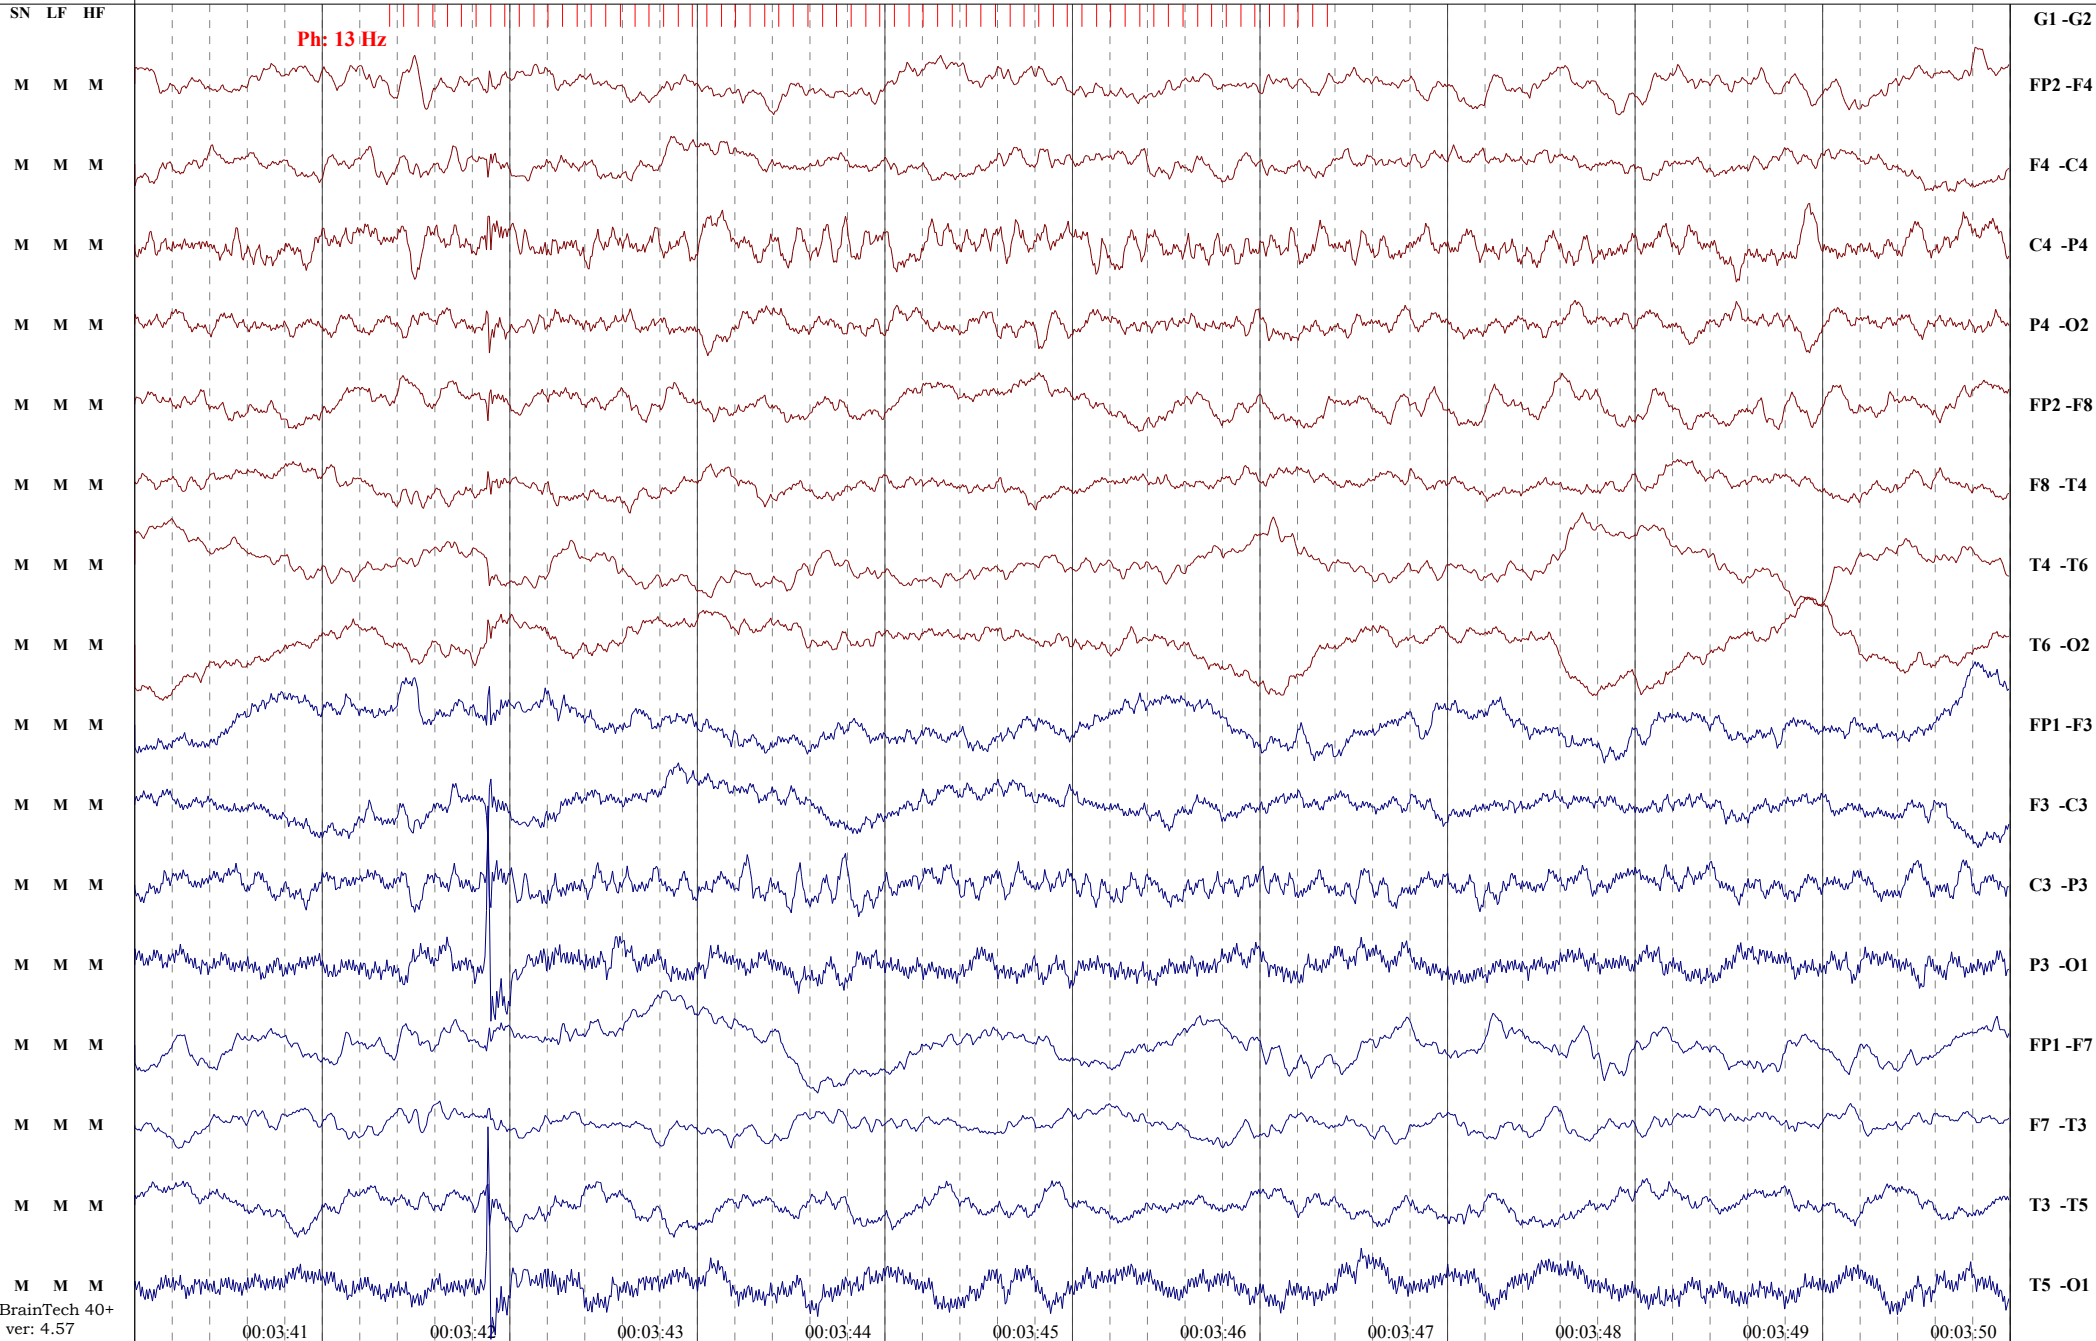

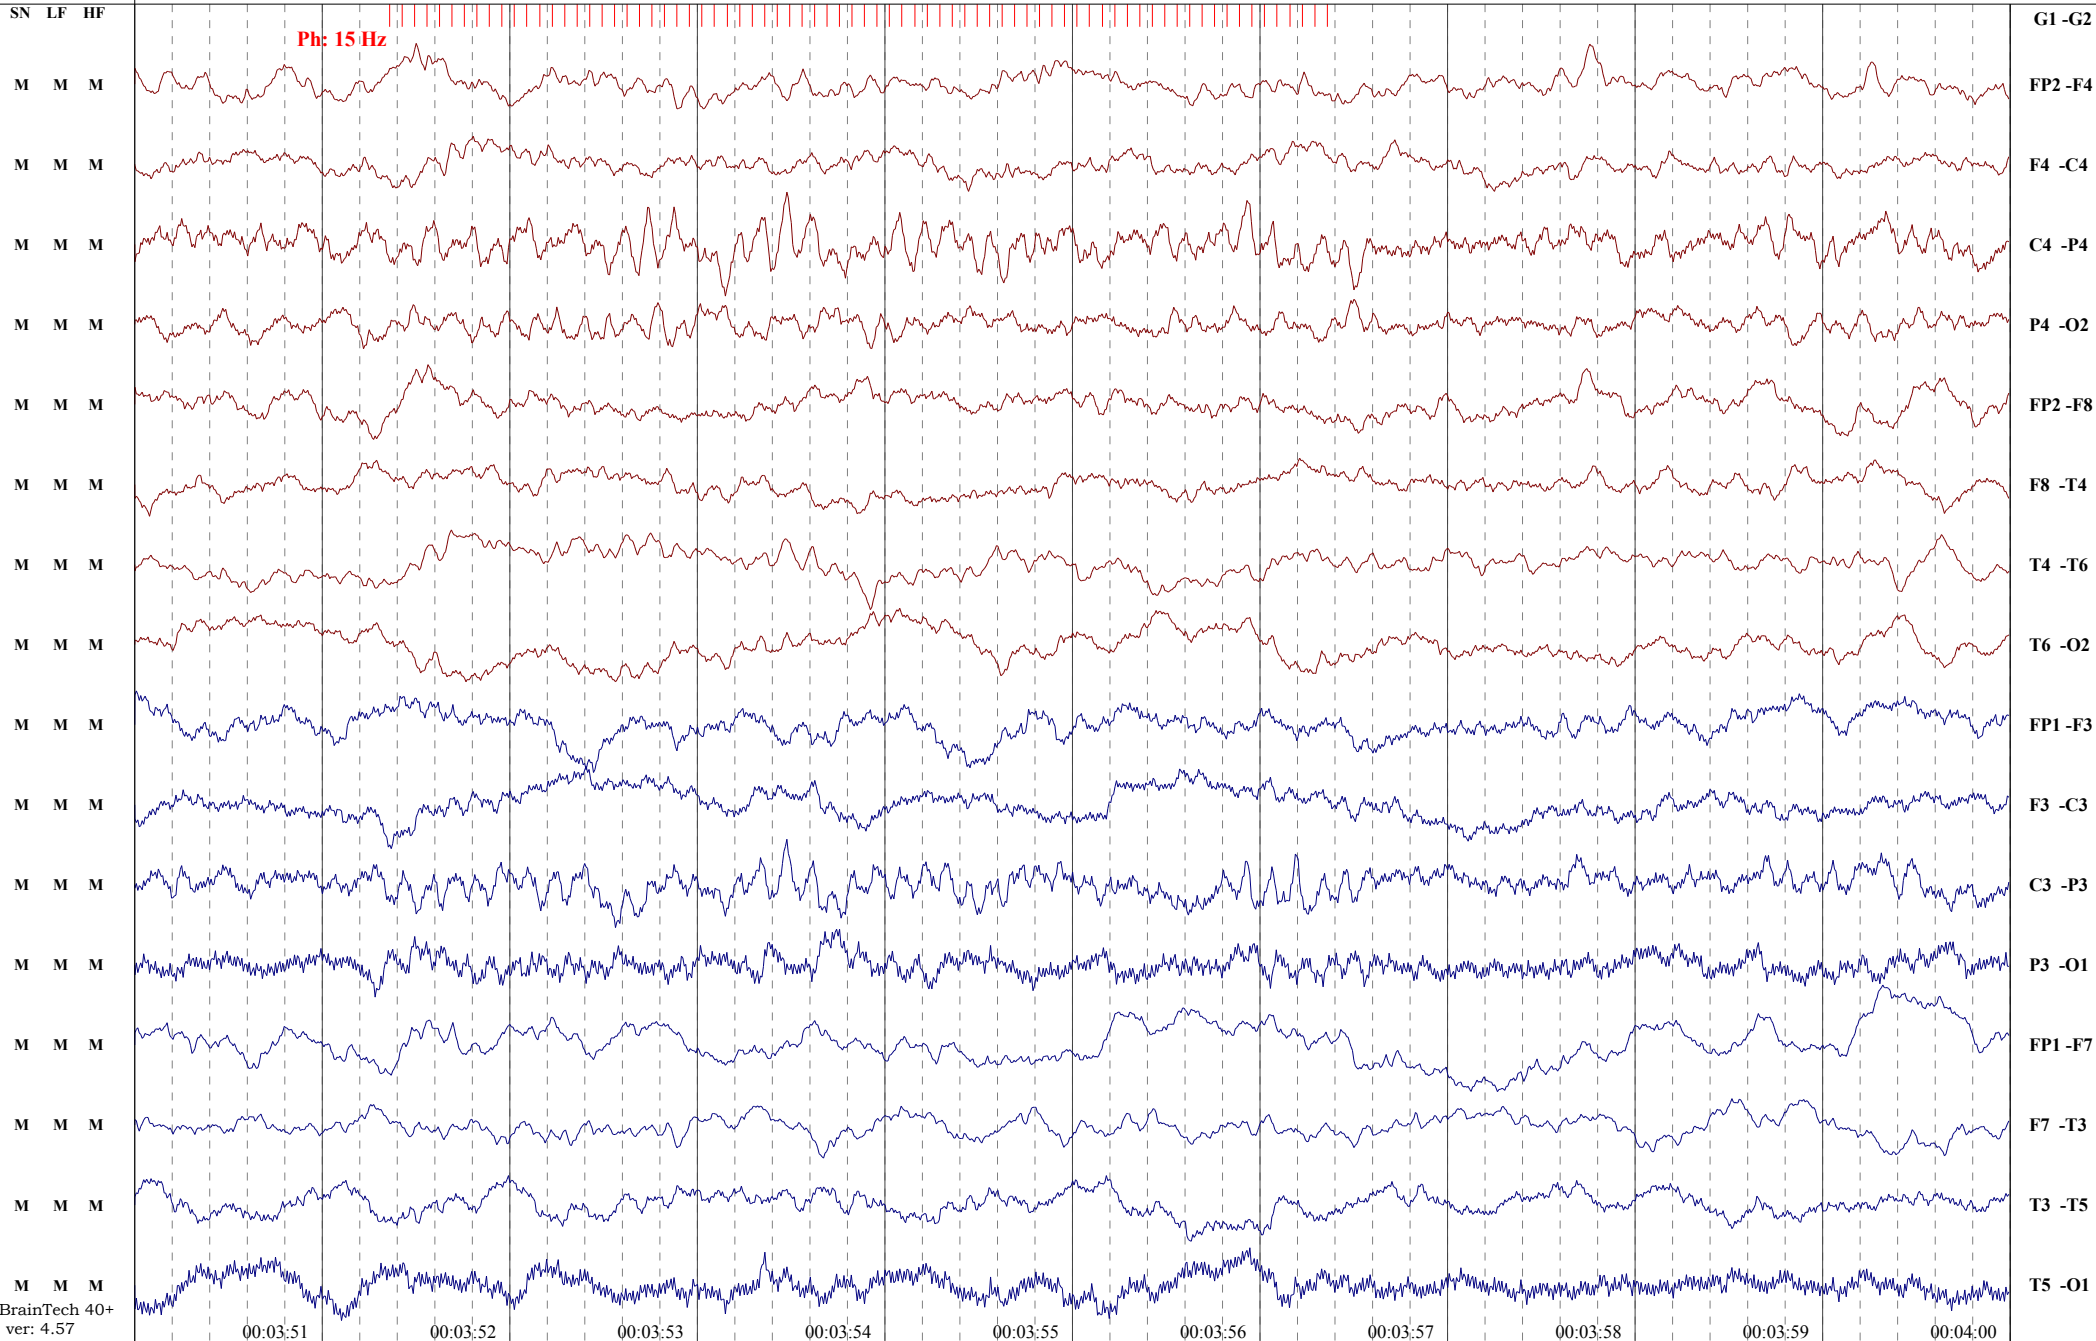

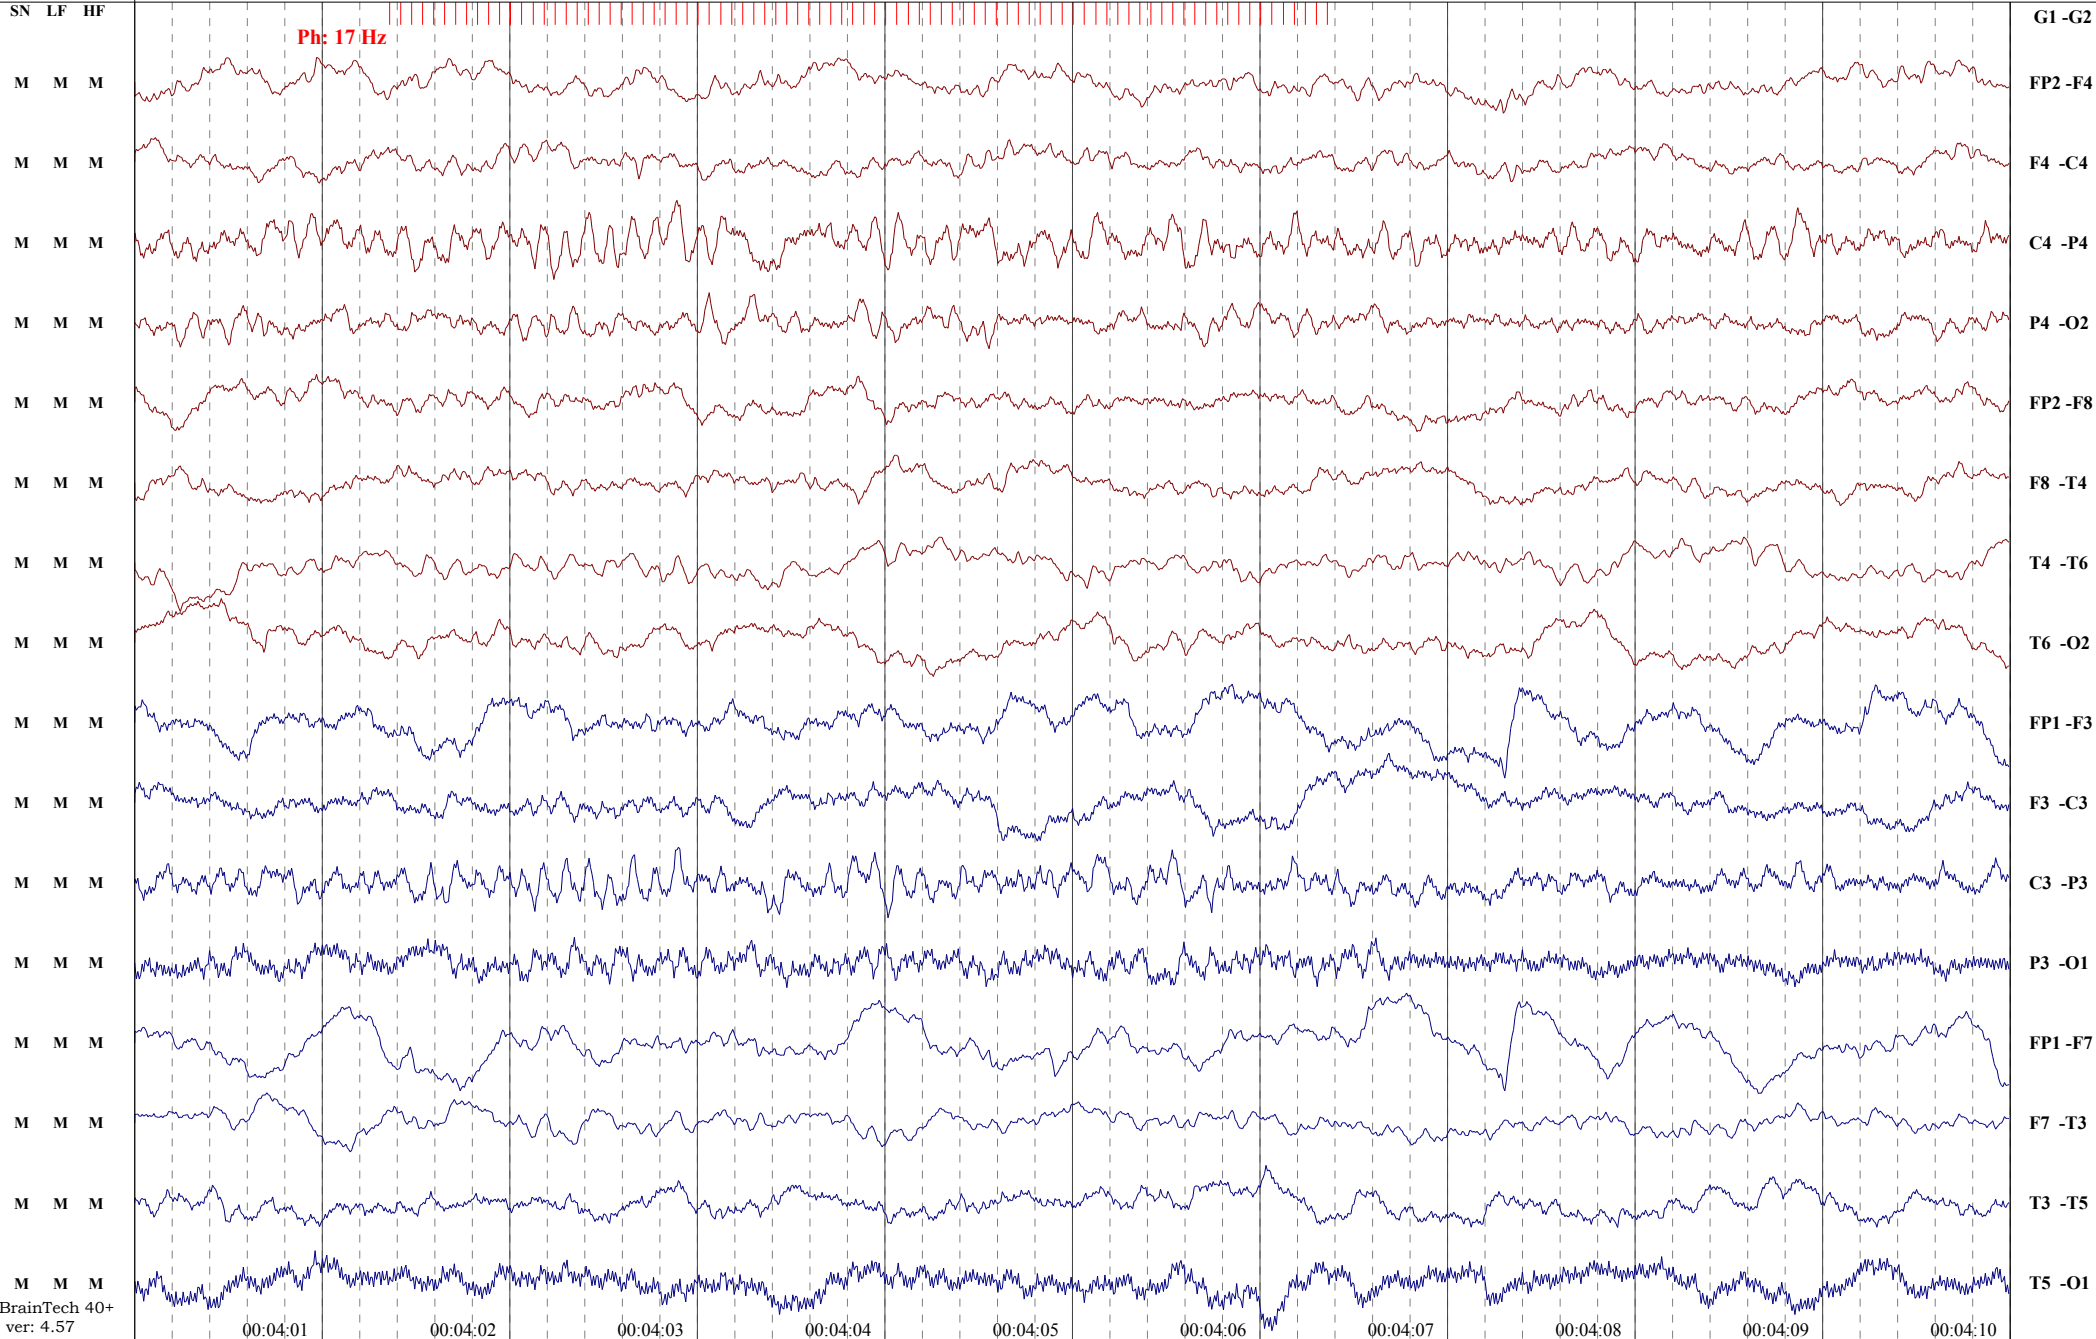

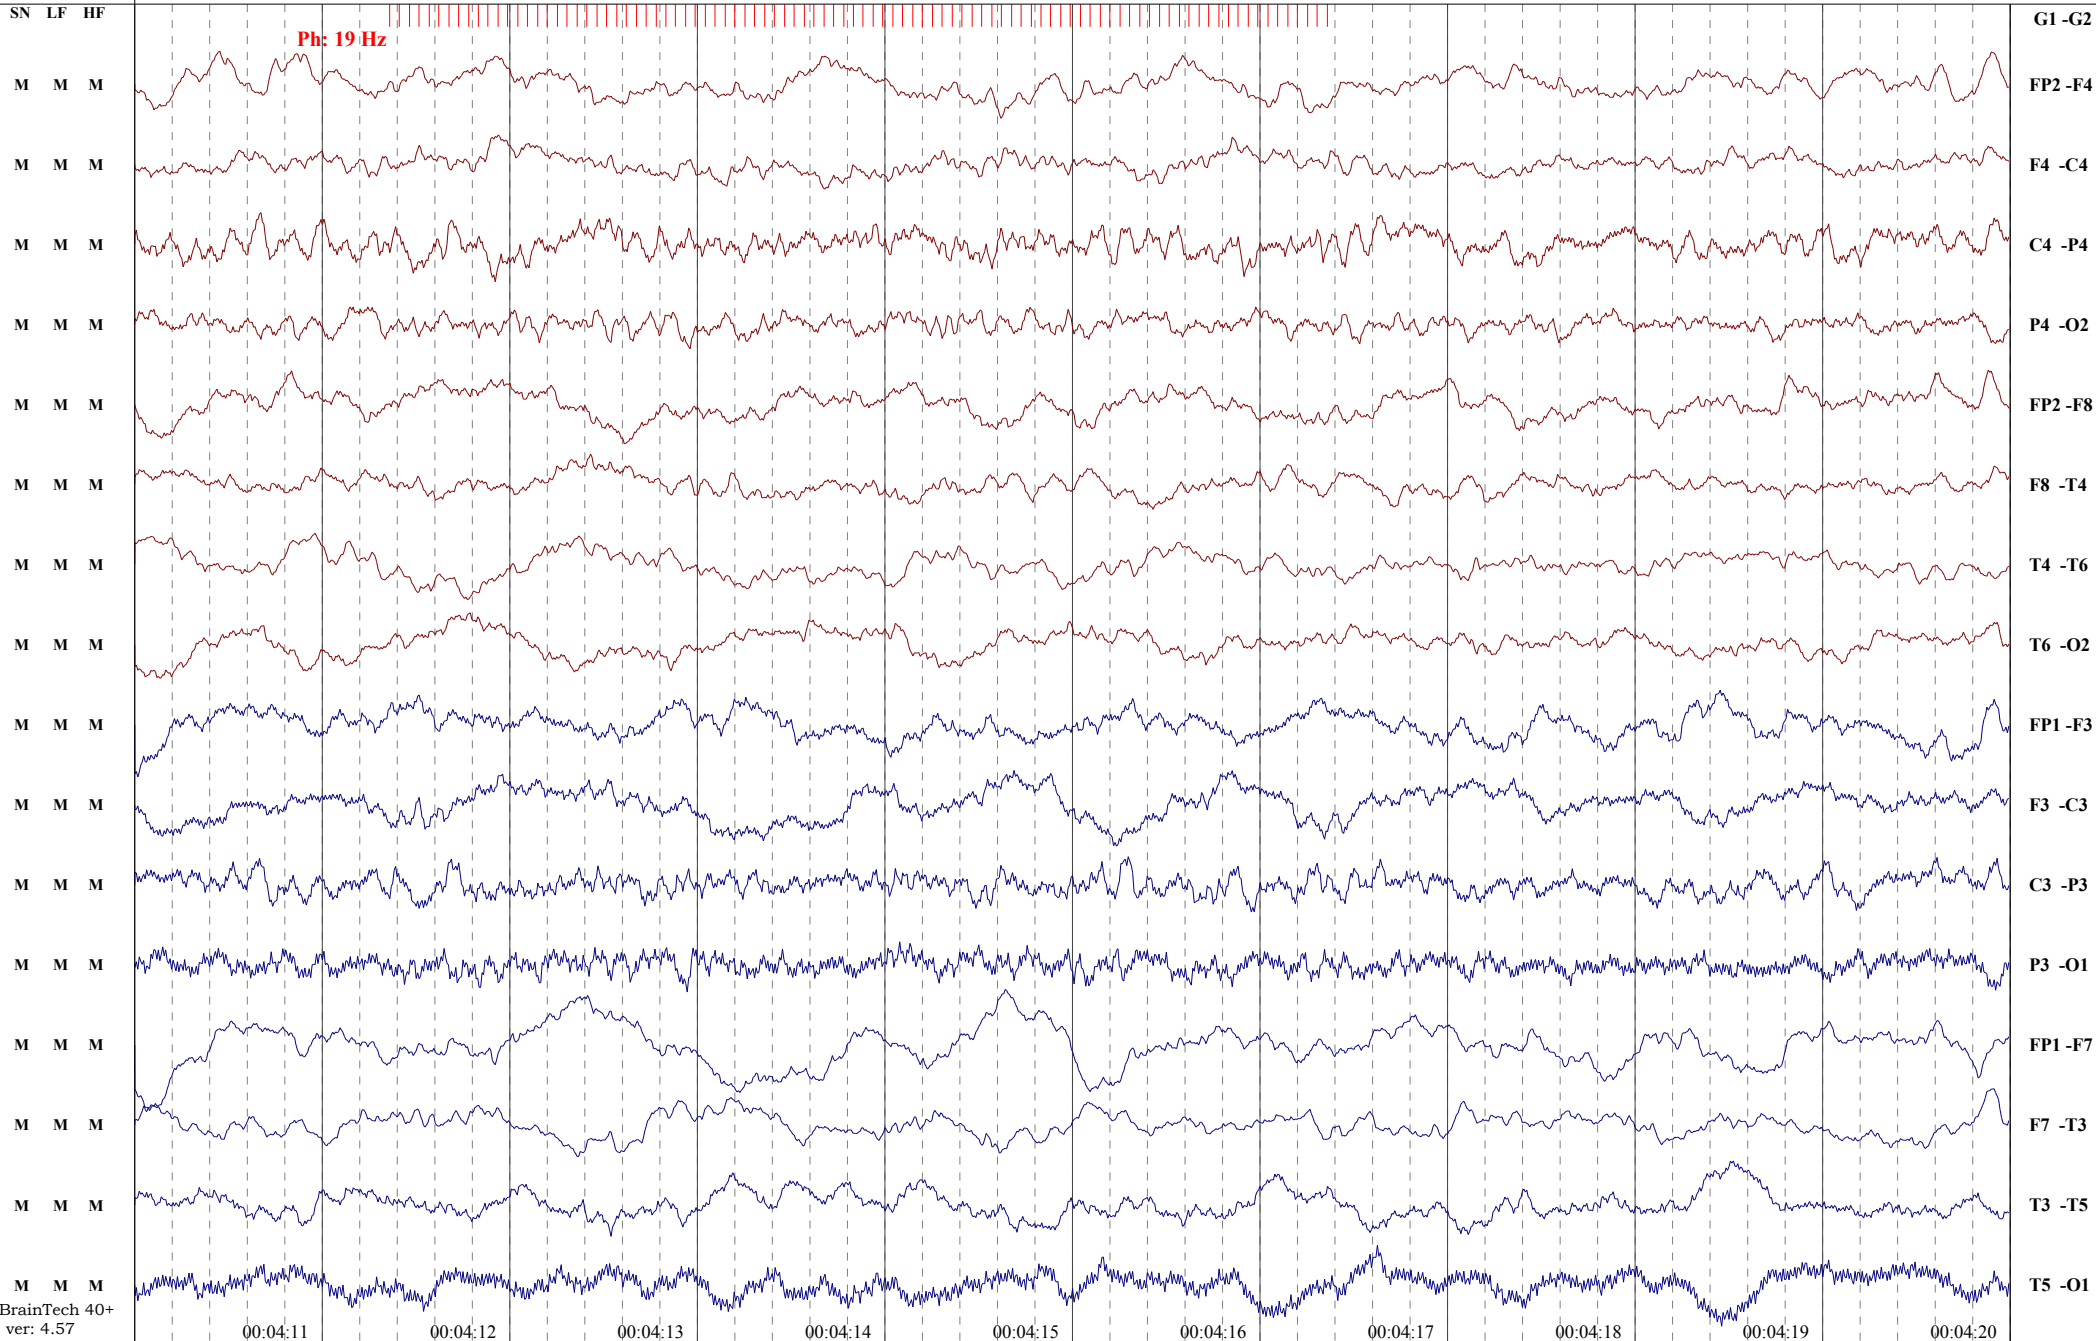

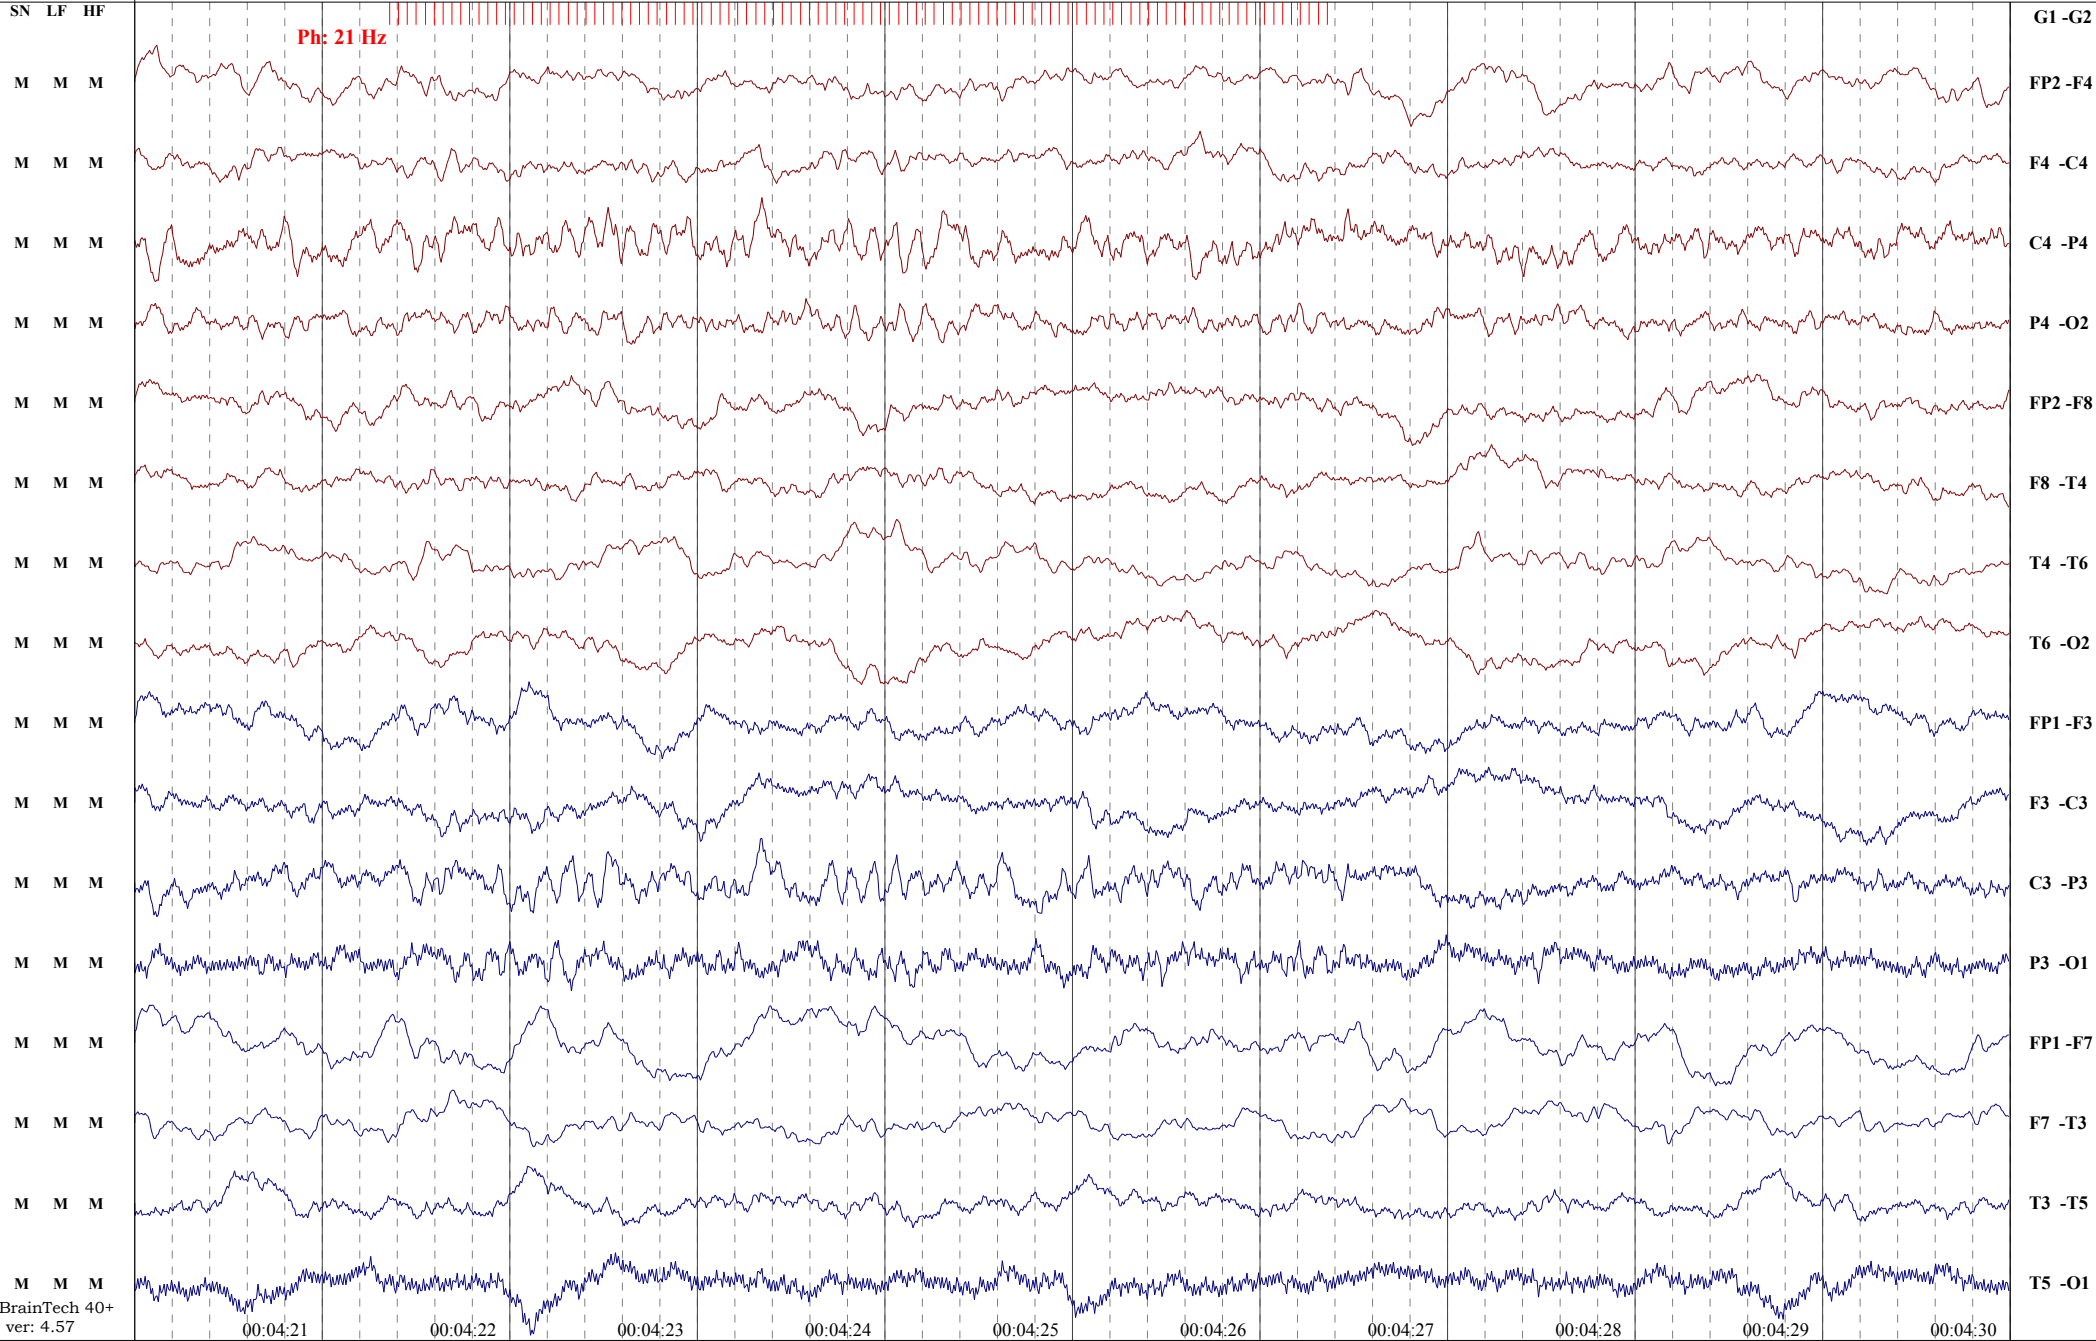

53
MISS. SHRUTI MANHAR
13 Years/F

Date: 09-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 14:13:01
Page:28/29
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

