


77
MRS. JAMILA BEGAM
35 Years/F


Date: 19-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 16:42:59
Page:1/27
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

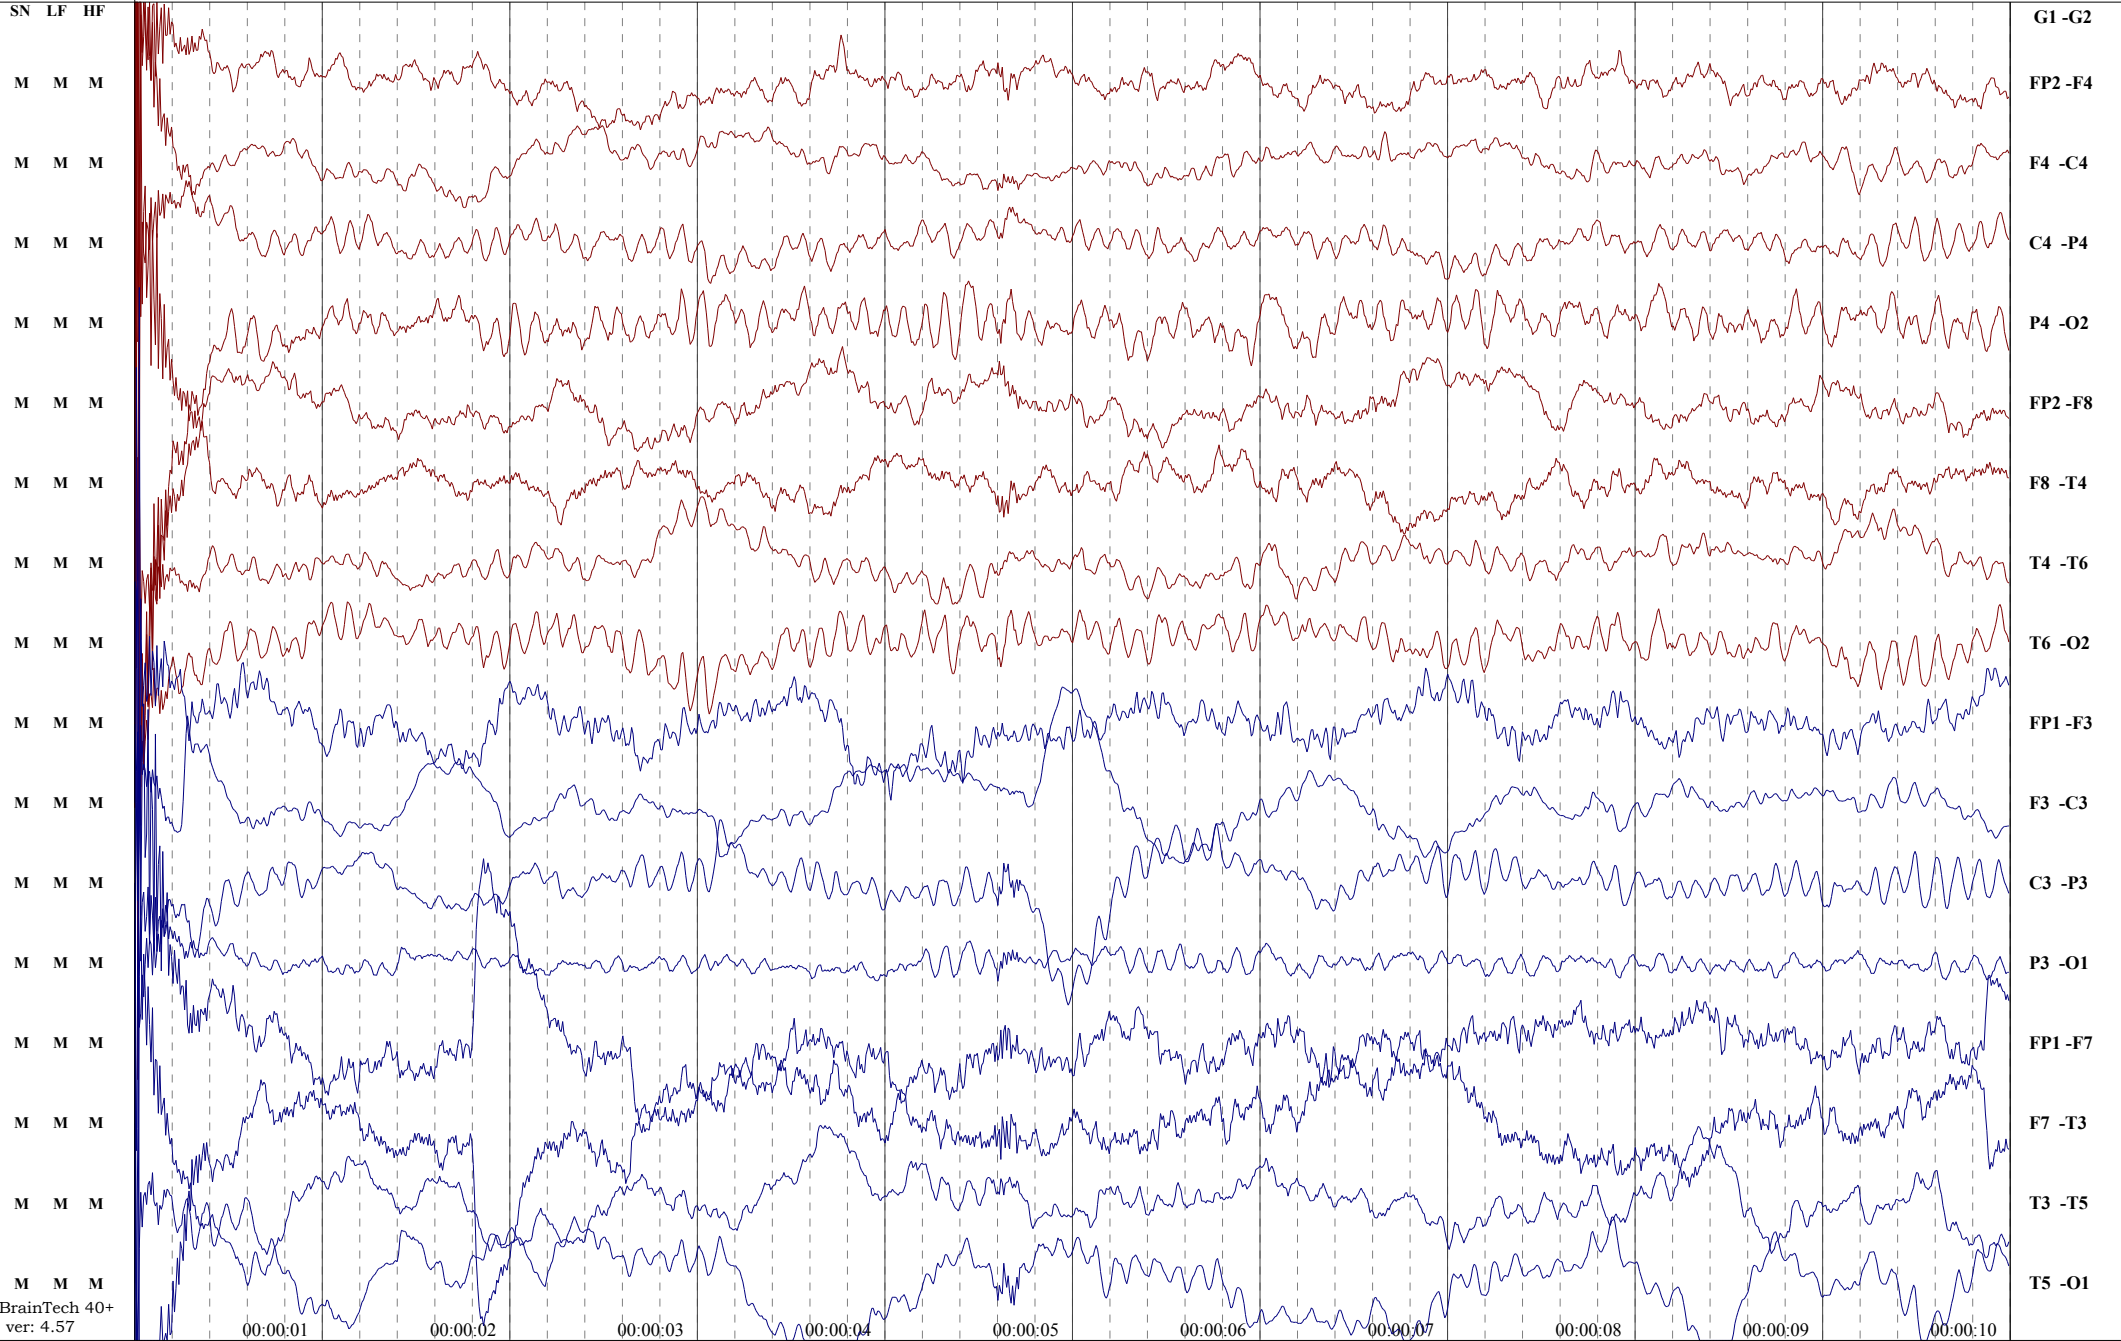

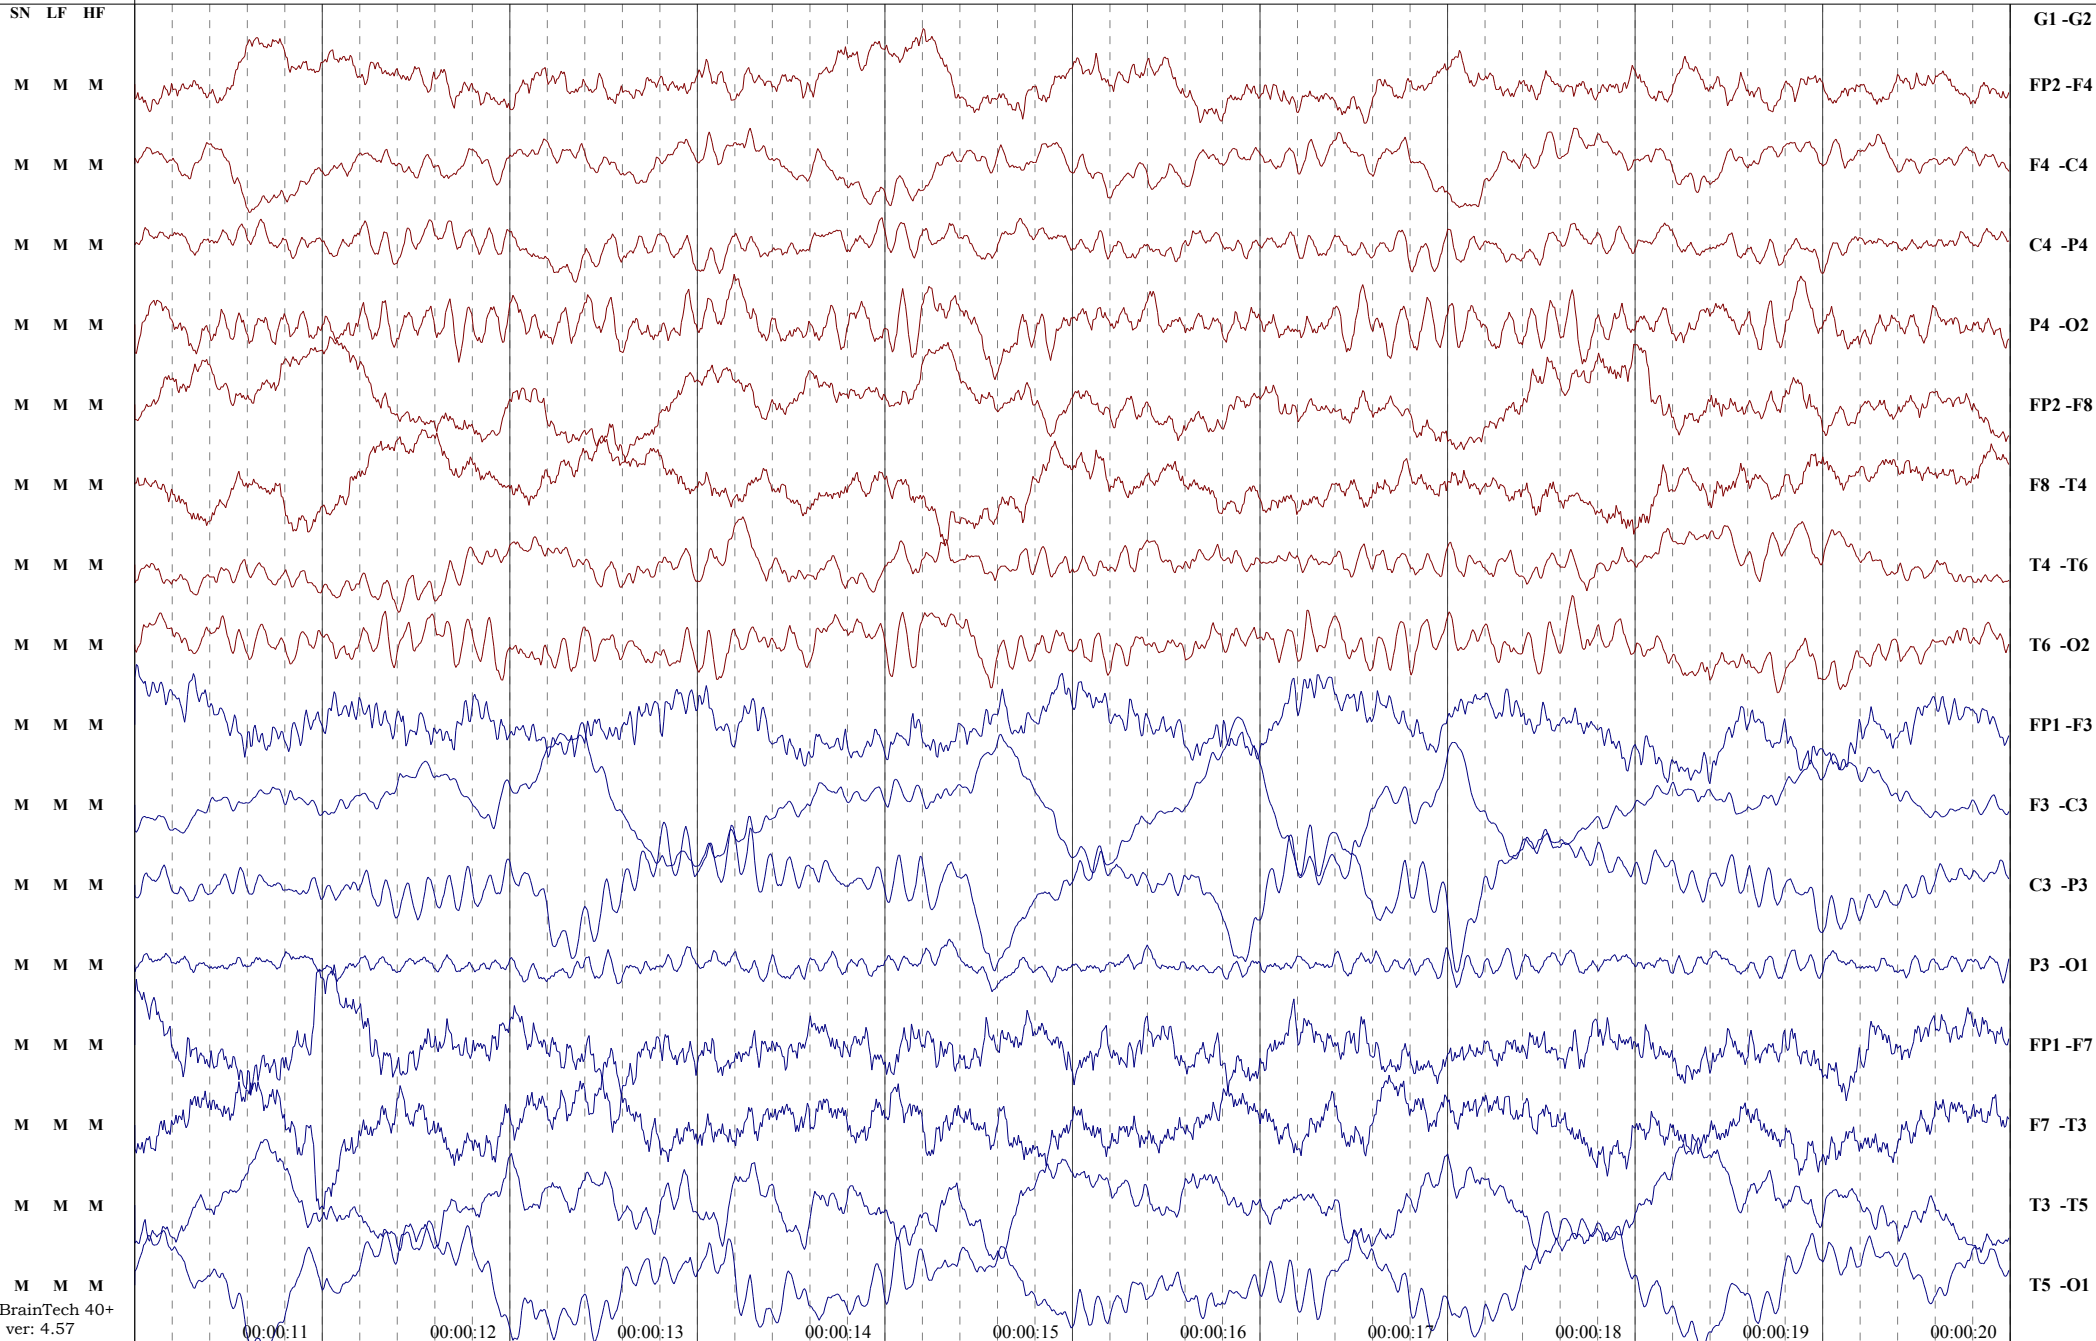


77
MRS. JAMILA BEGAM
35 Years/F

Date: 19-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 16:43:19
Page:3/27
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

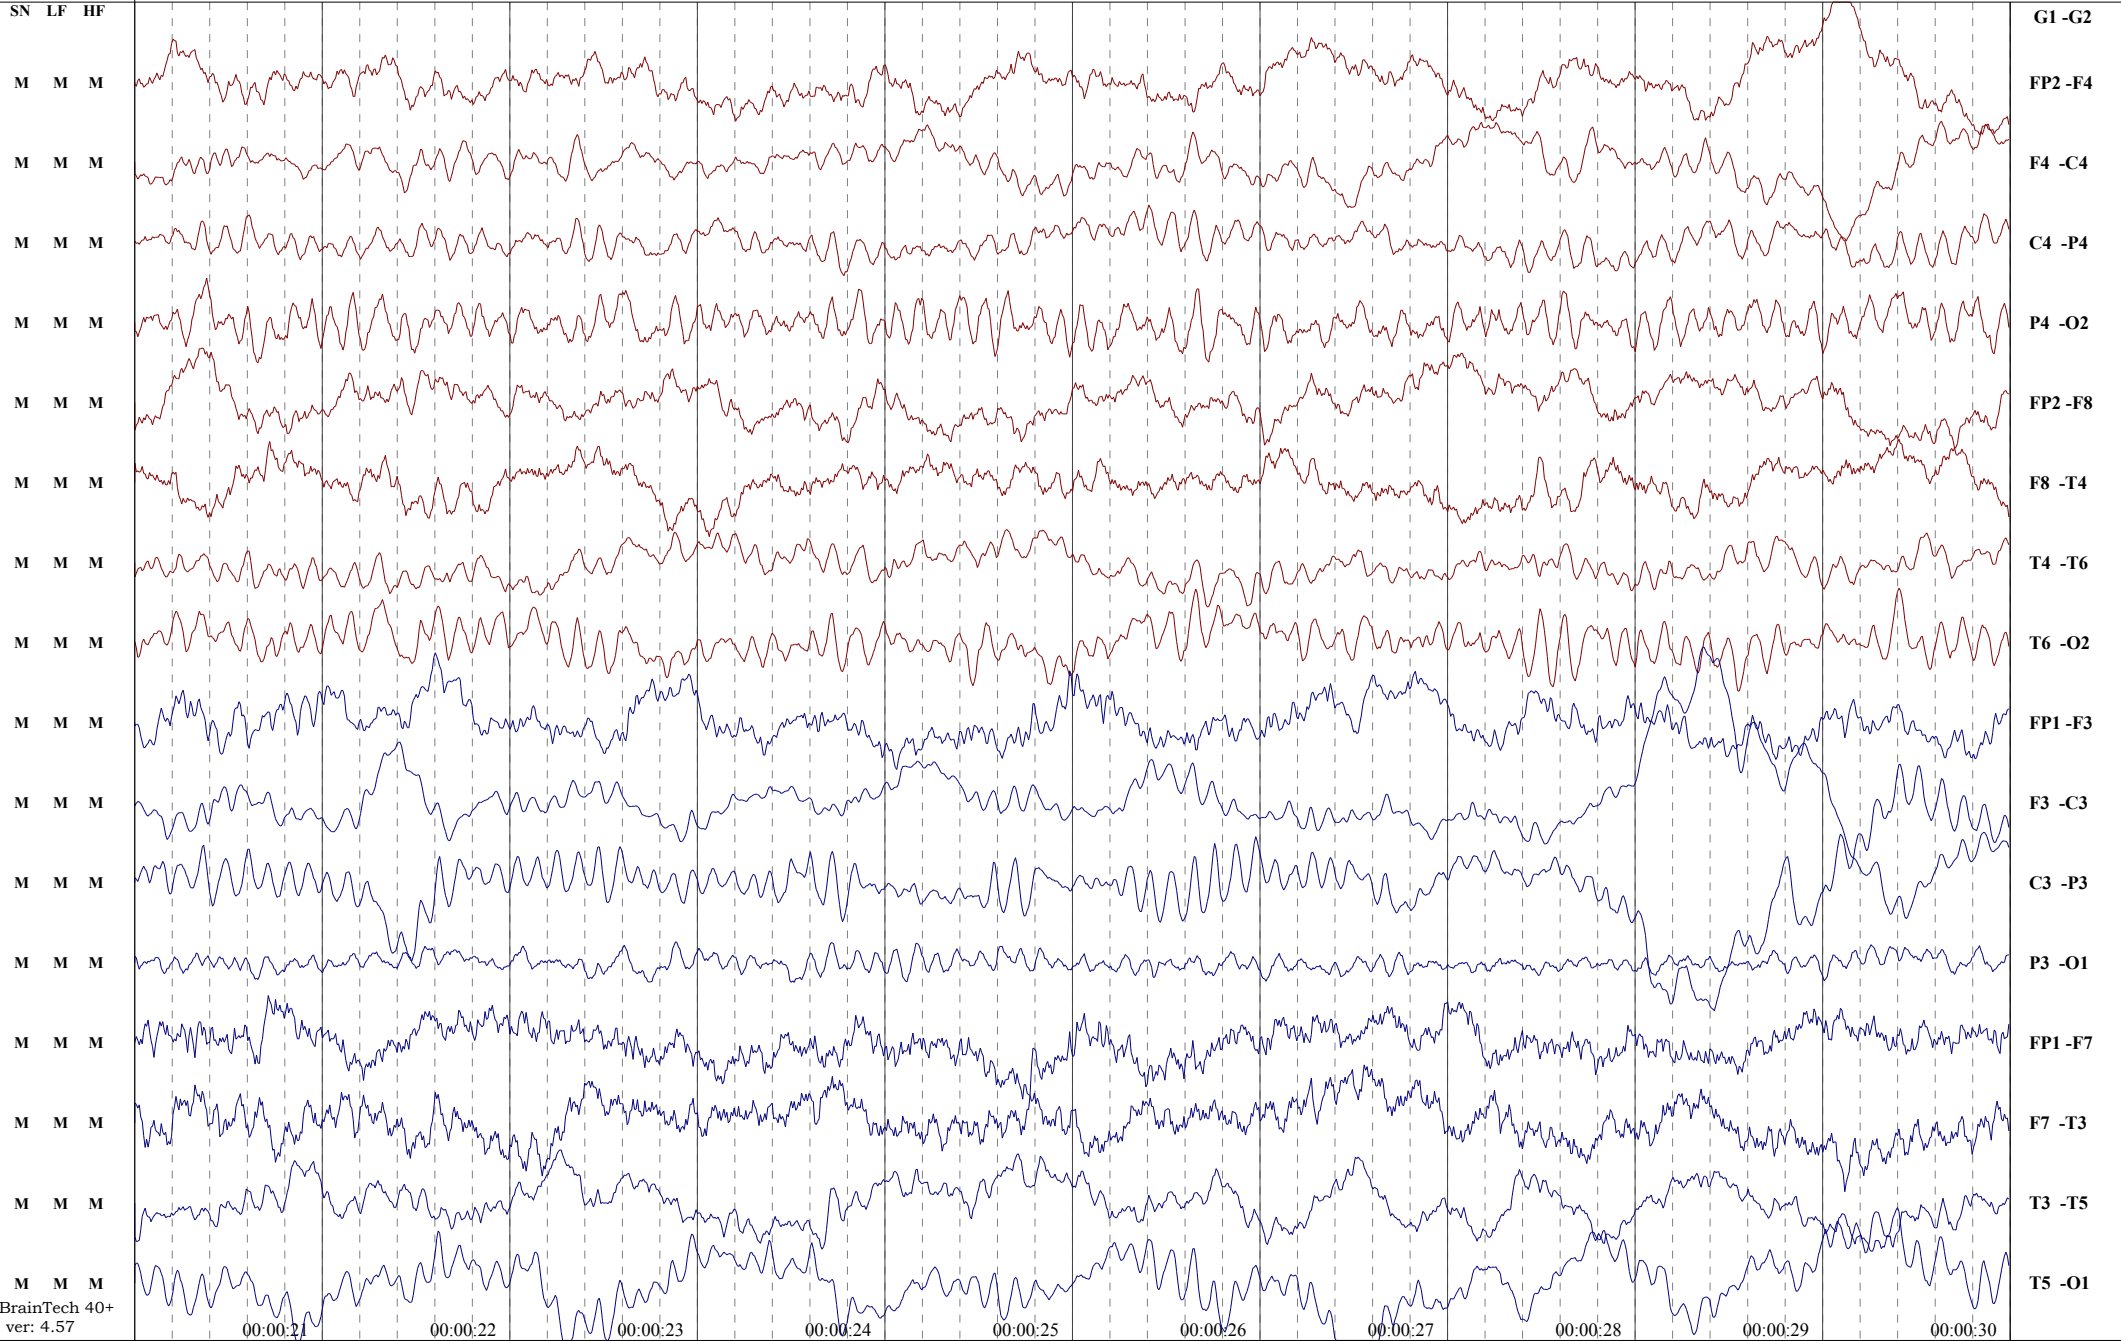


77
MRS. JAMILA BEGAM
35 Years/F

Date: 19-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 16:43:29
Page:4/27
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

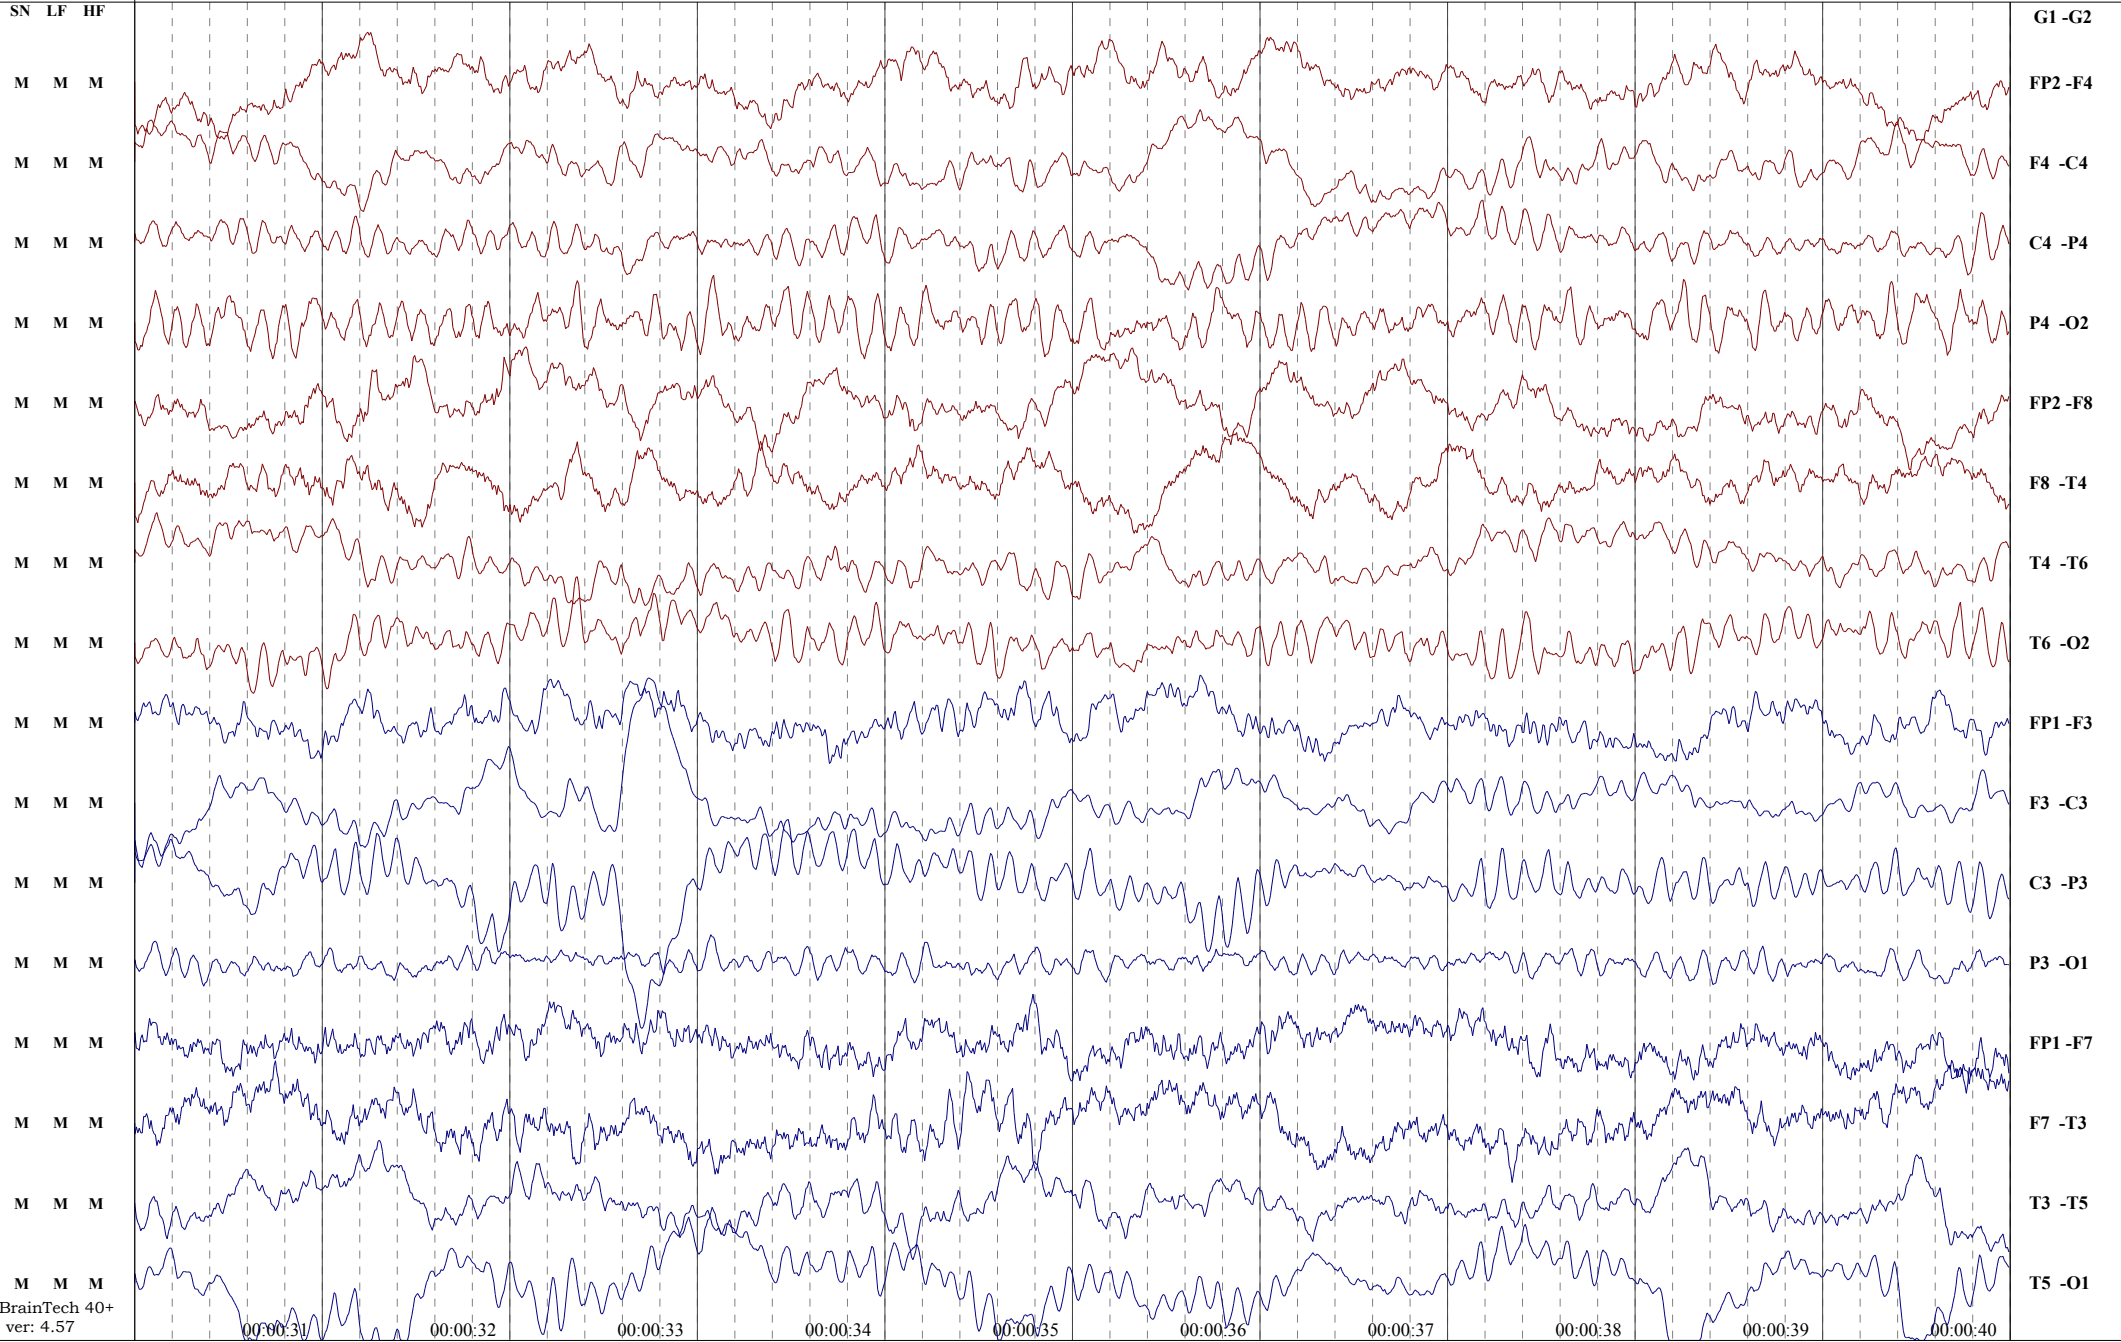


77
MRS. JAMILA BEGAM
35 Years/F

Date: 19-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 16:43:39
Page:5/27
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

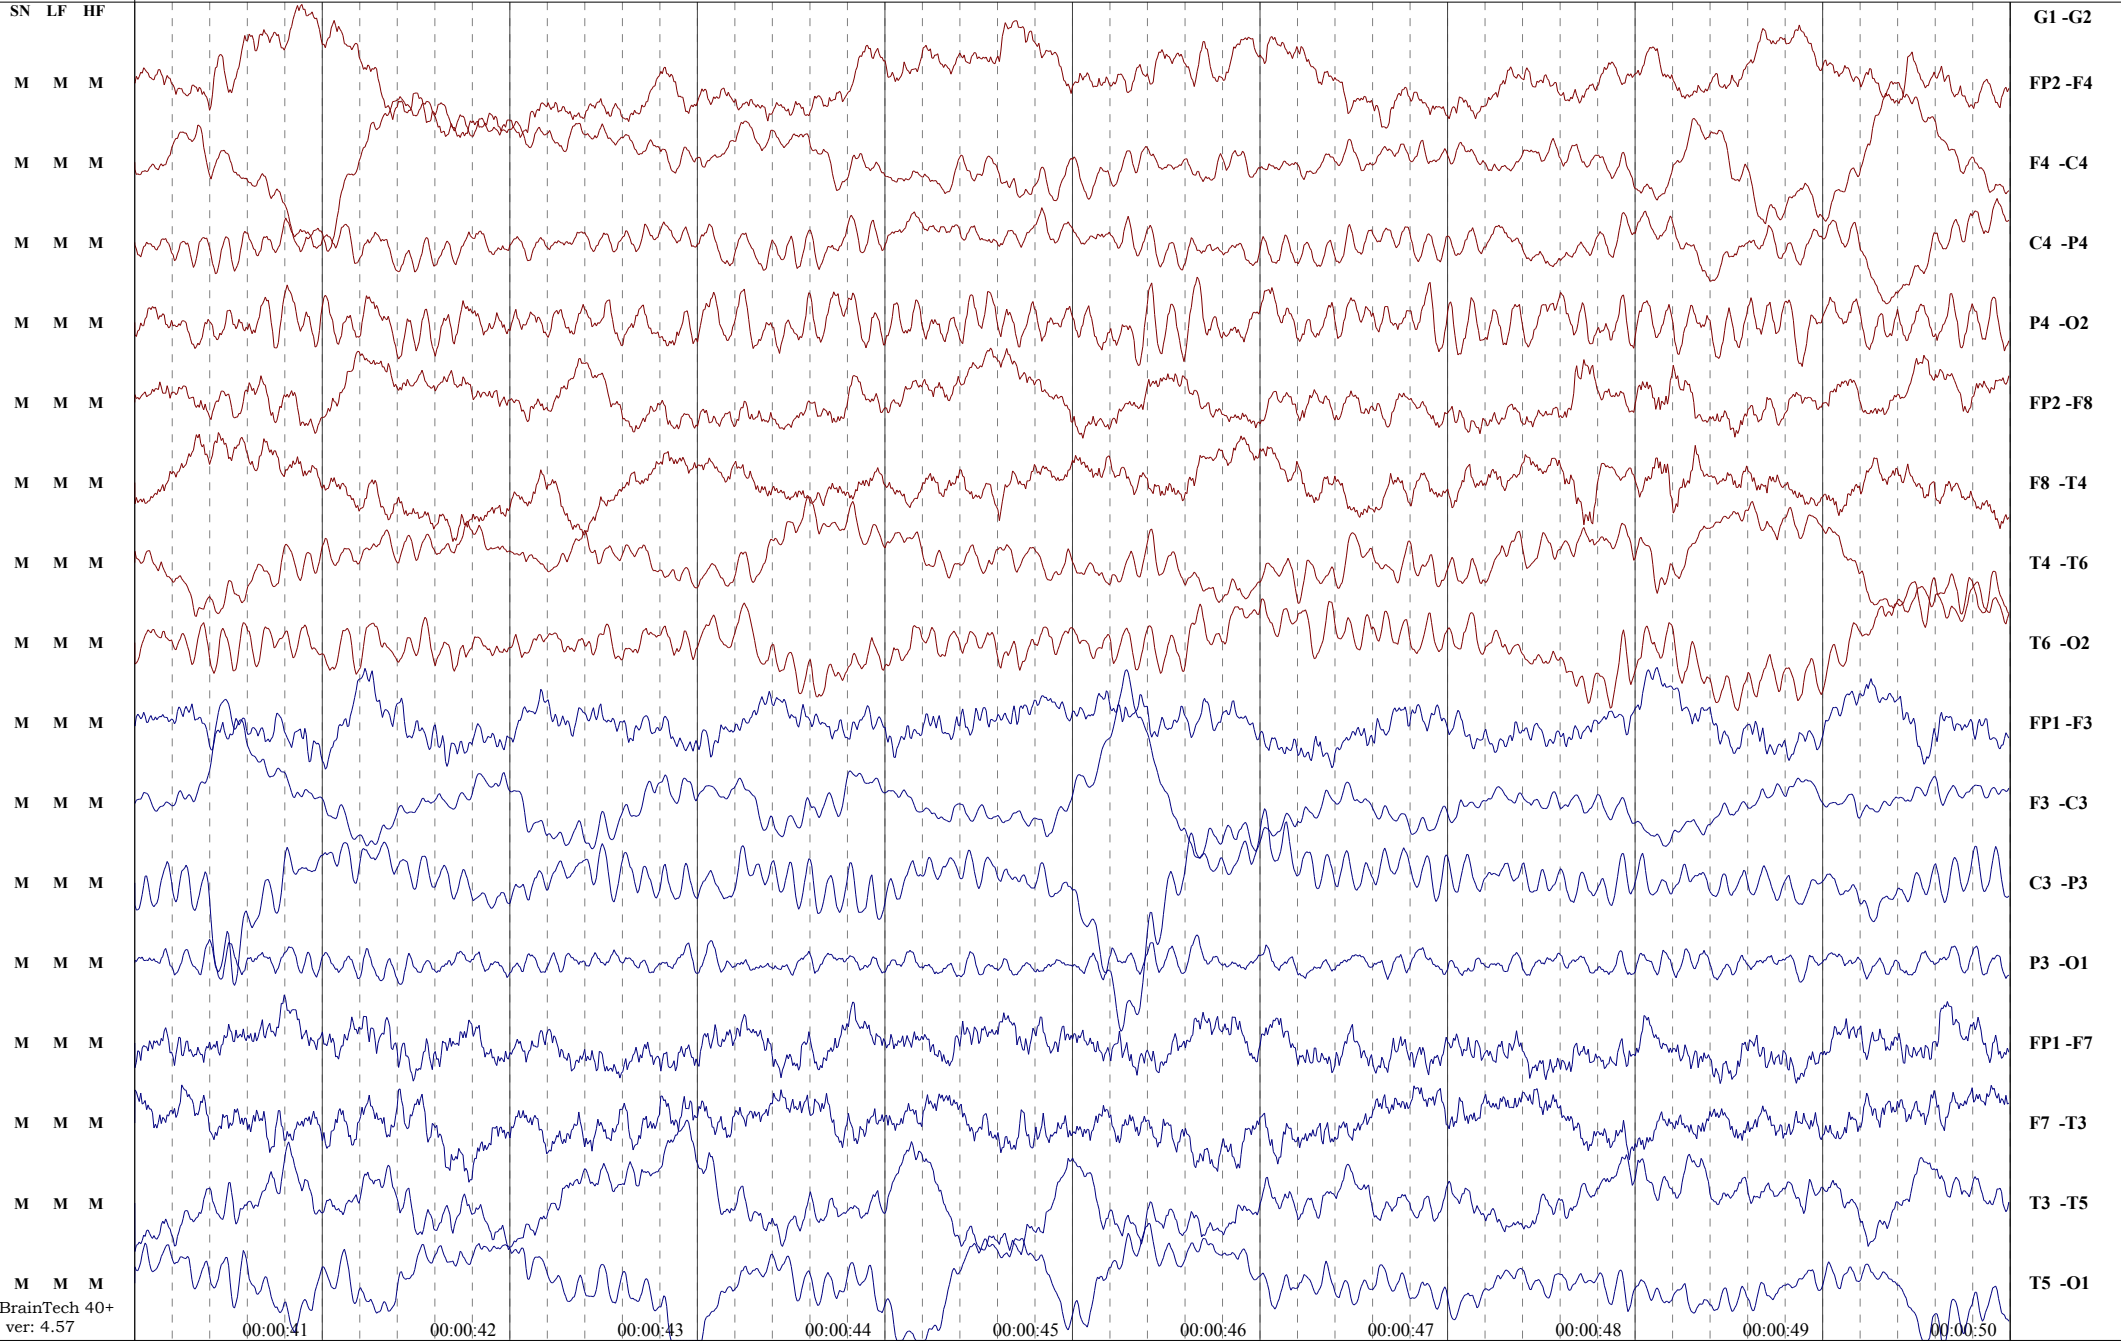


77
MRS. JAMILA BEGAM
35 Years/F

Date: 19-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 16:43:49
Page:6/27
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

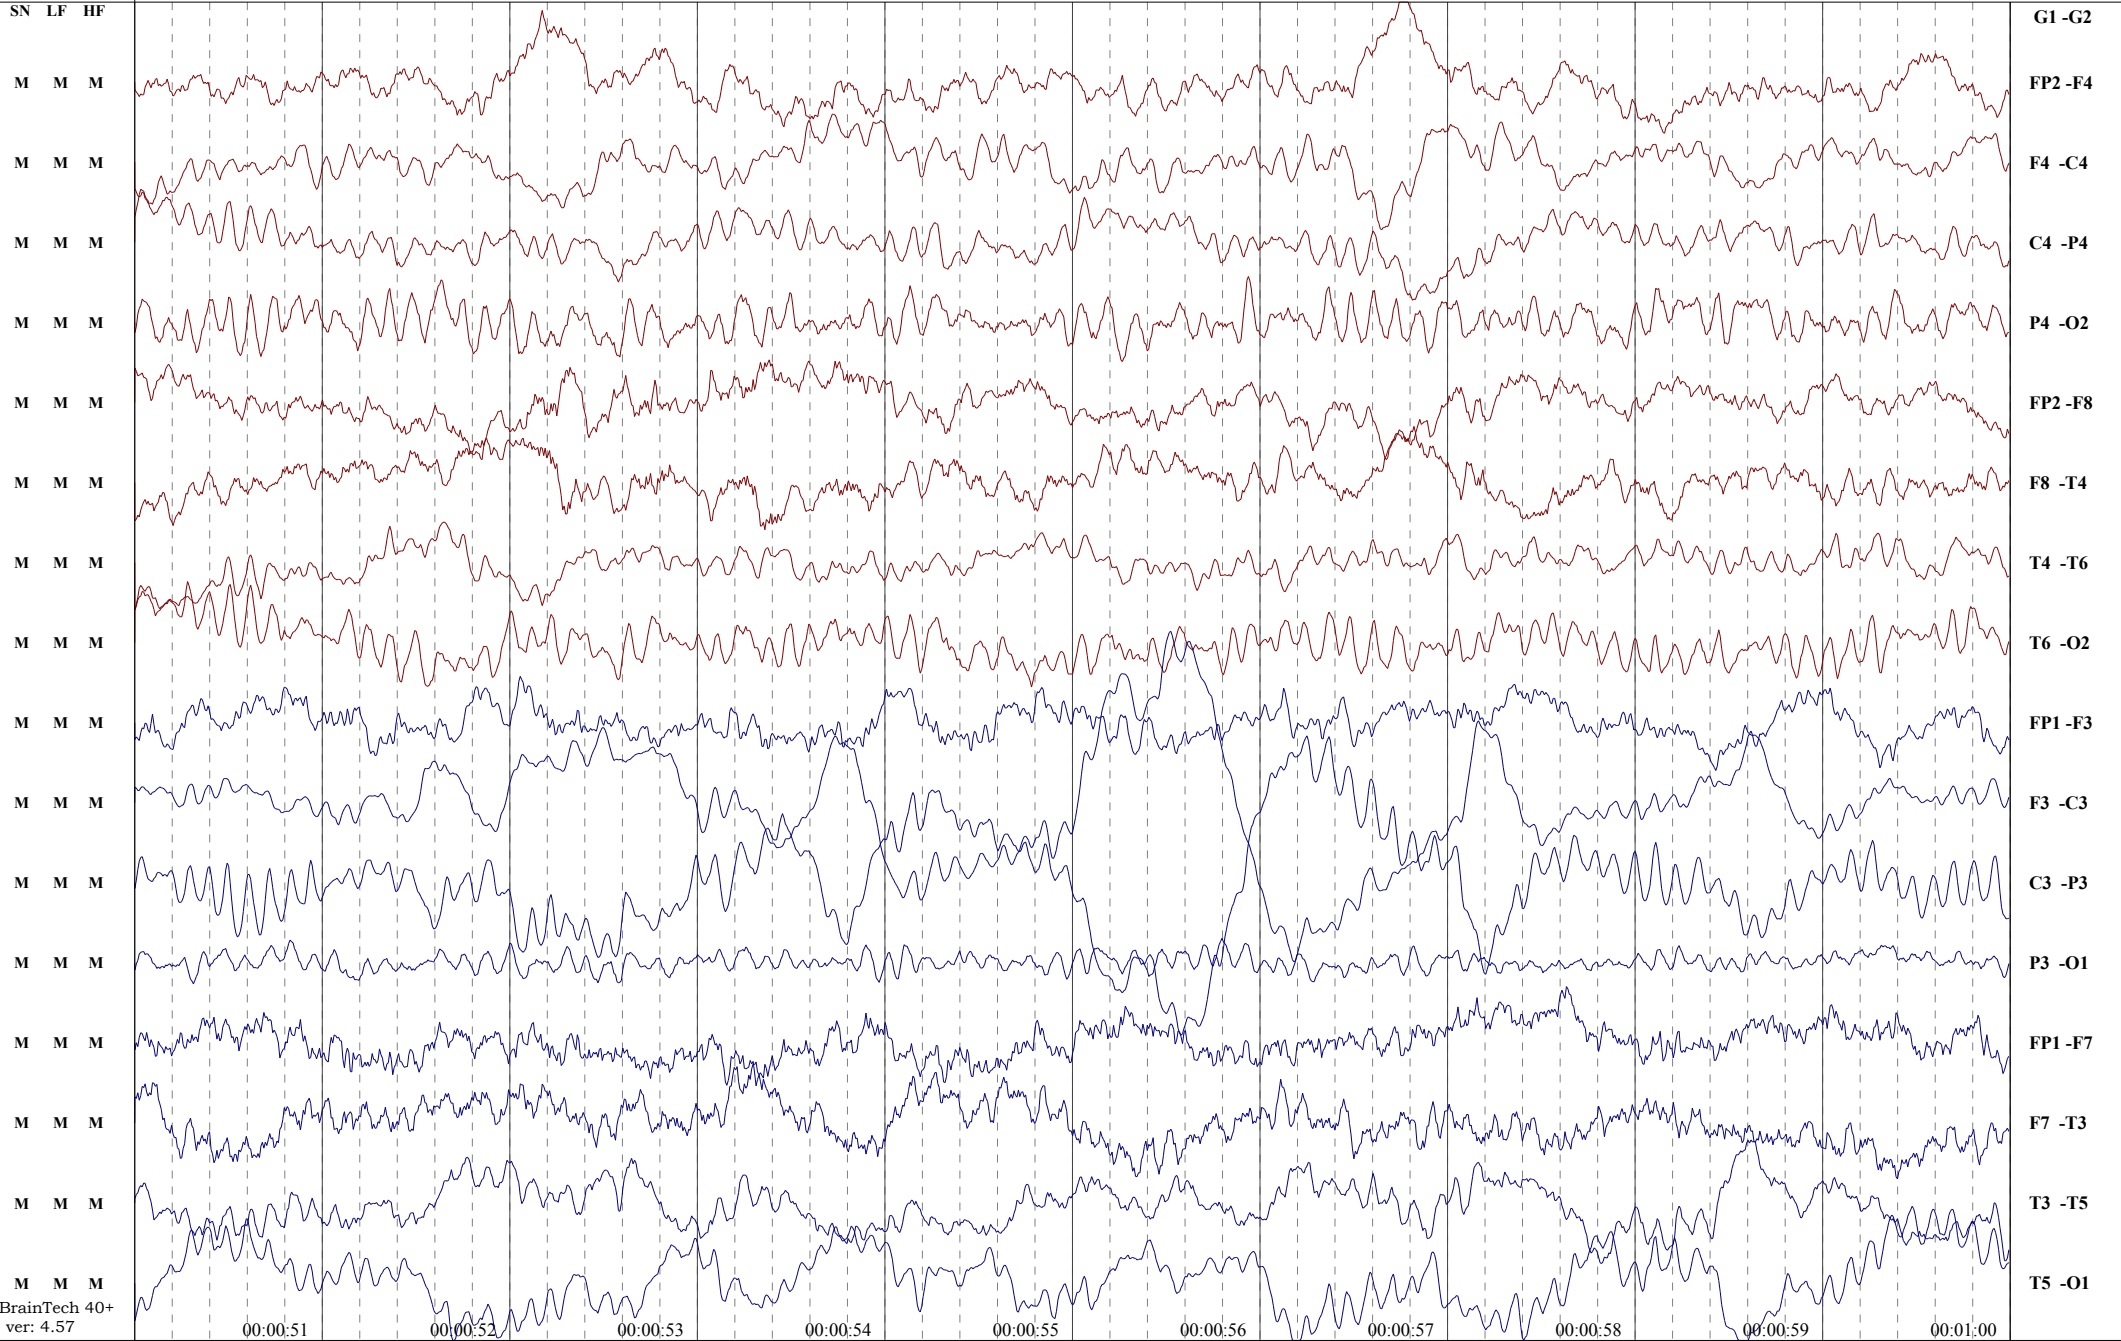


77
MRS. JAMILA BEGAM
35 Years/F

Date: 19-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 16:43:59
Page:7/27
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

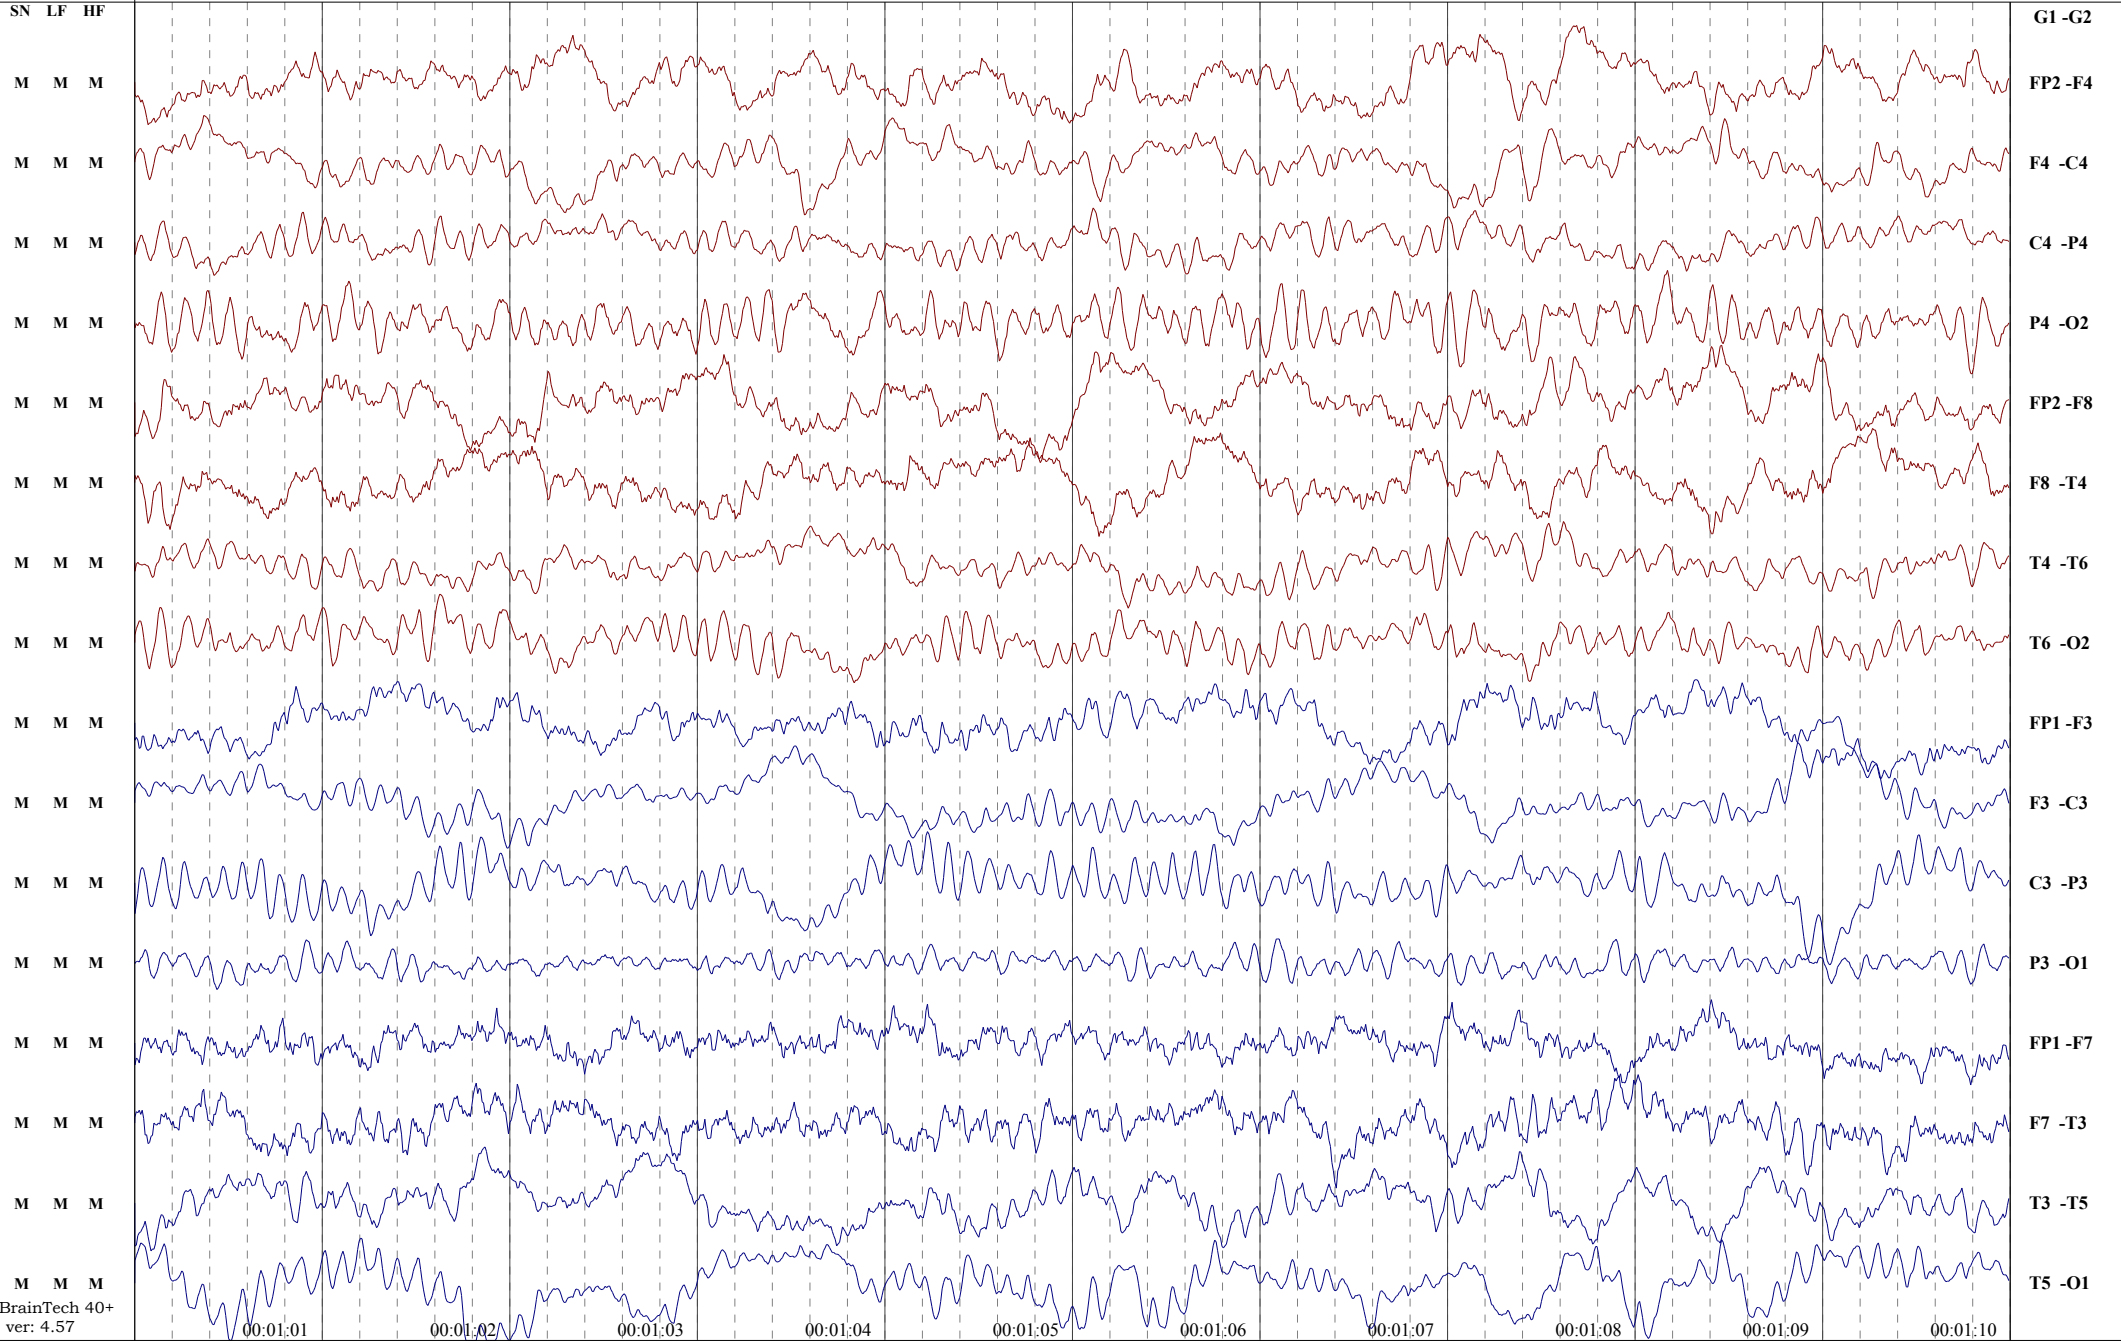


77
MRS. JAMILA BEGAM
35 Years/F

Date: 19-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 16:44:09
Page:8/27
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

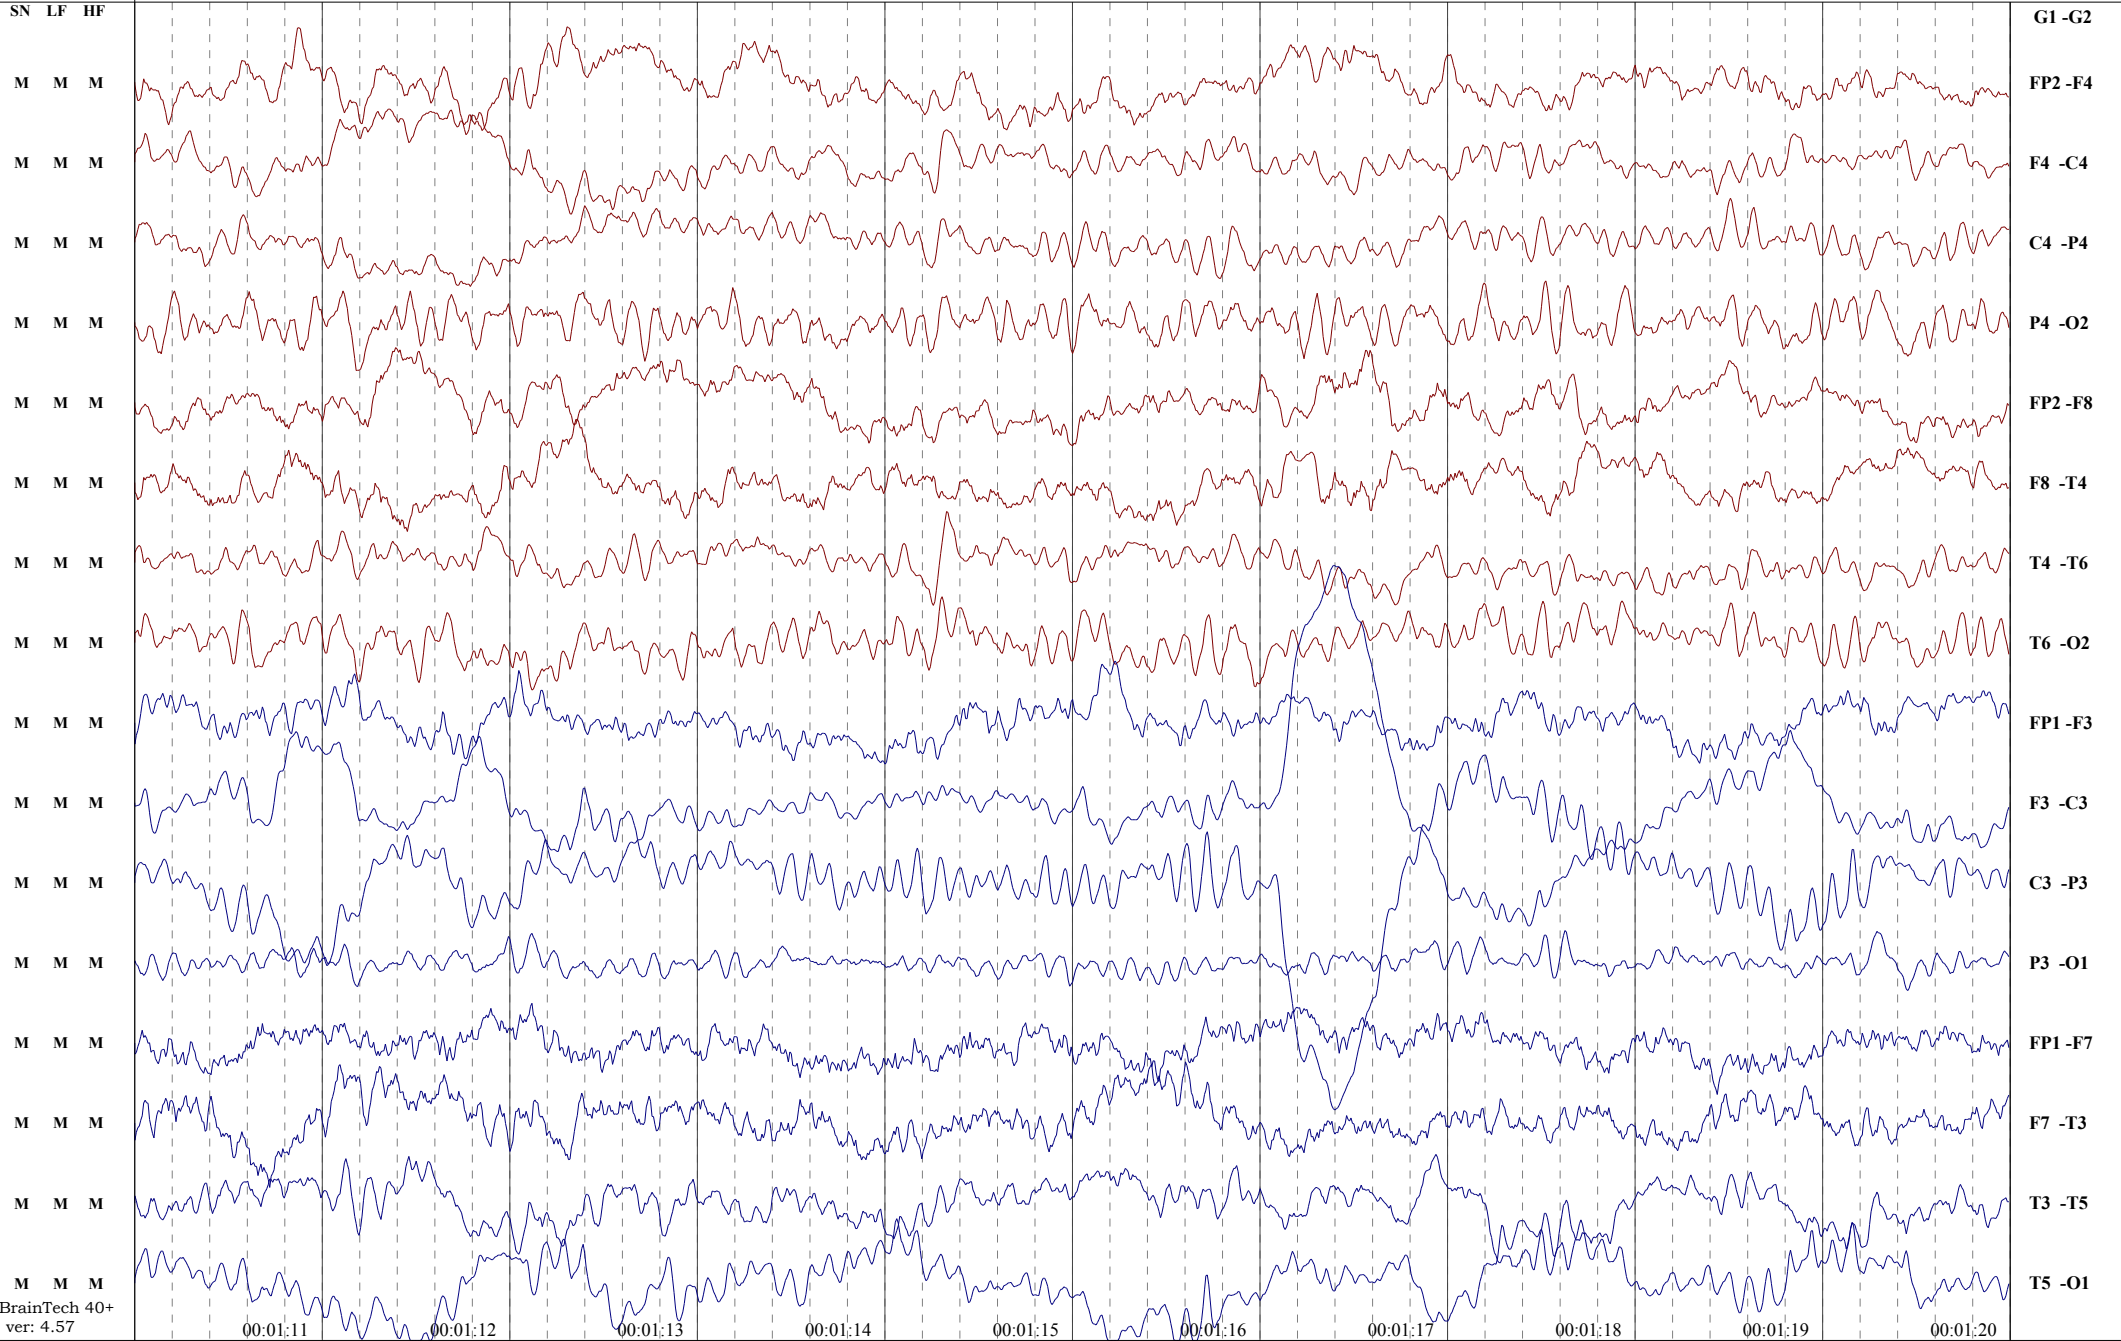


77
MRS. JAMILA BEGAM
35 Years/F

Date: 19-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 16:44:19
Page:9/27
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

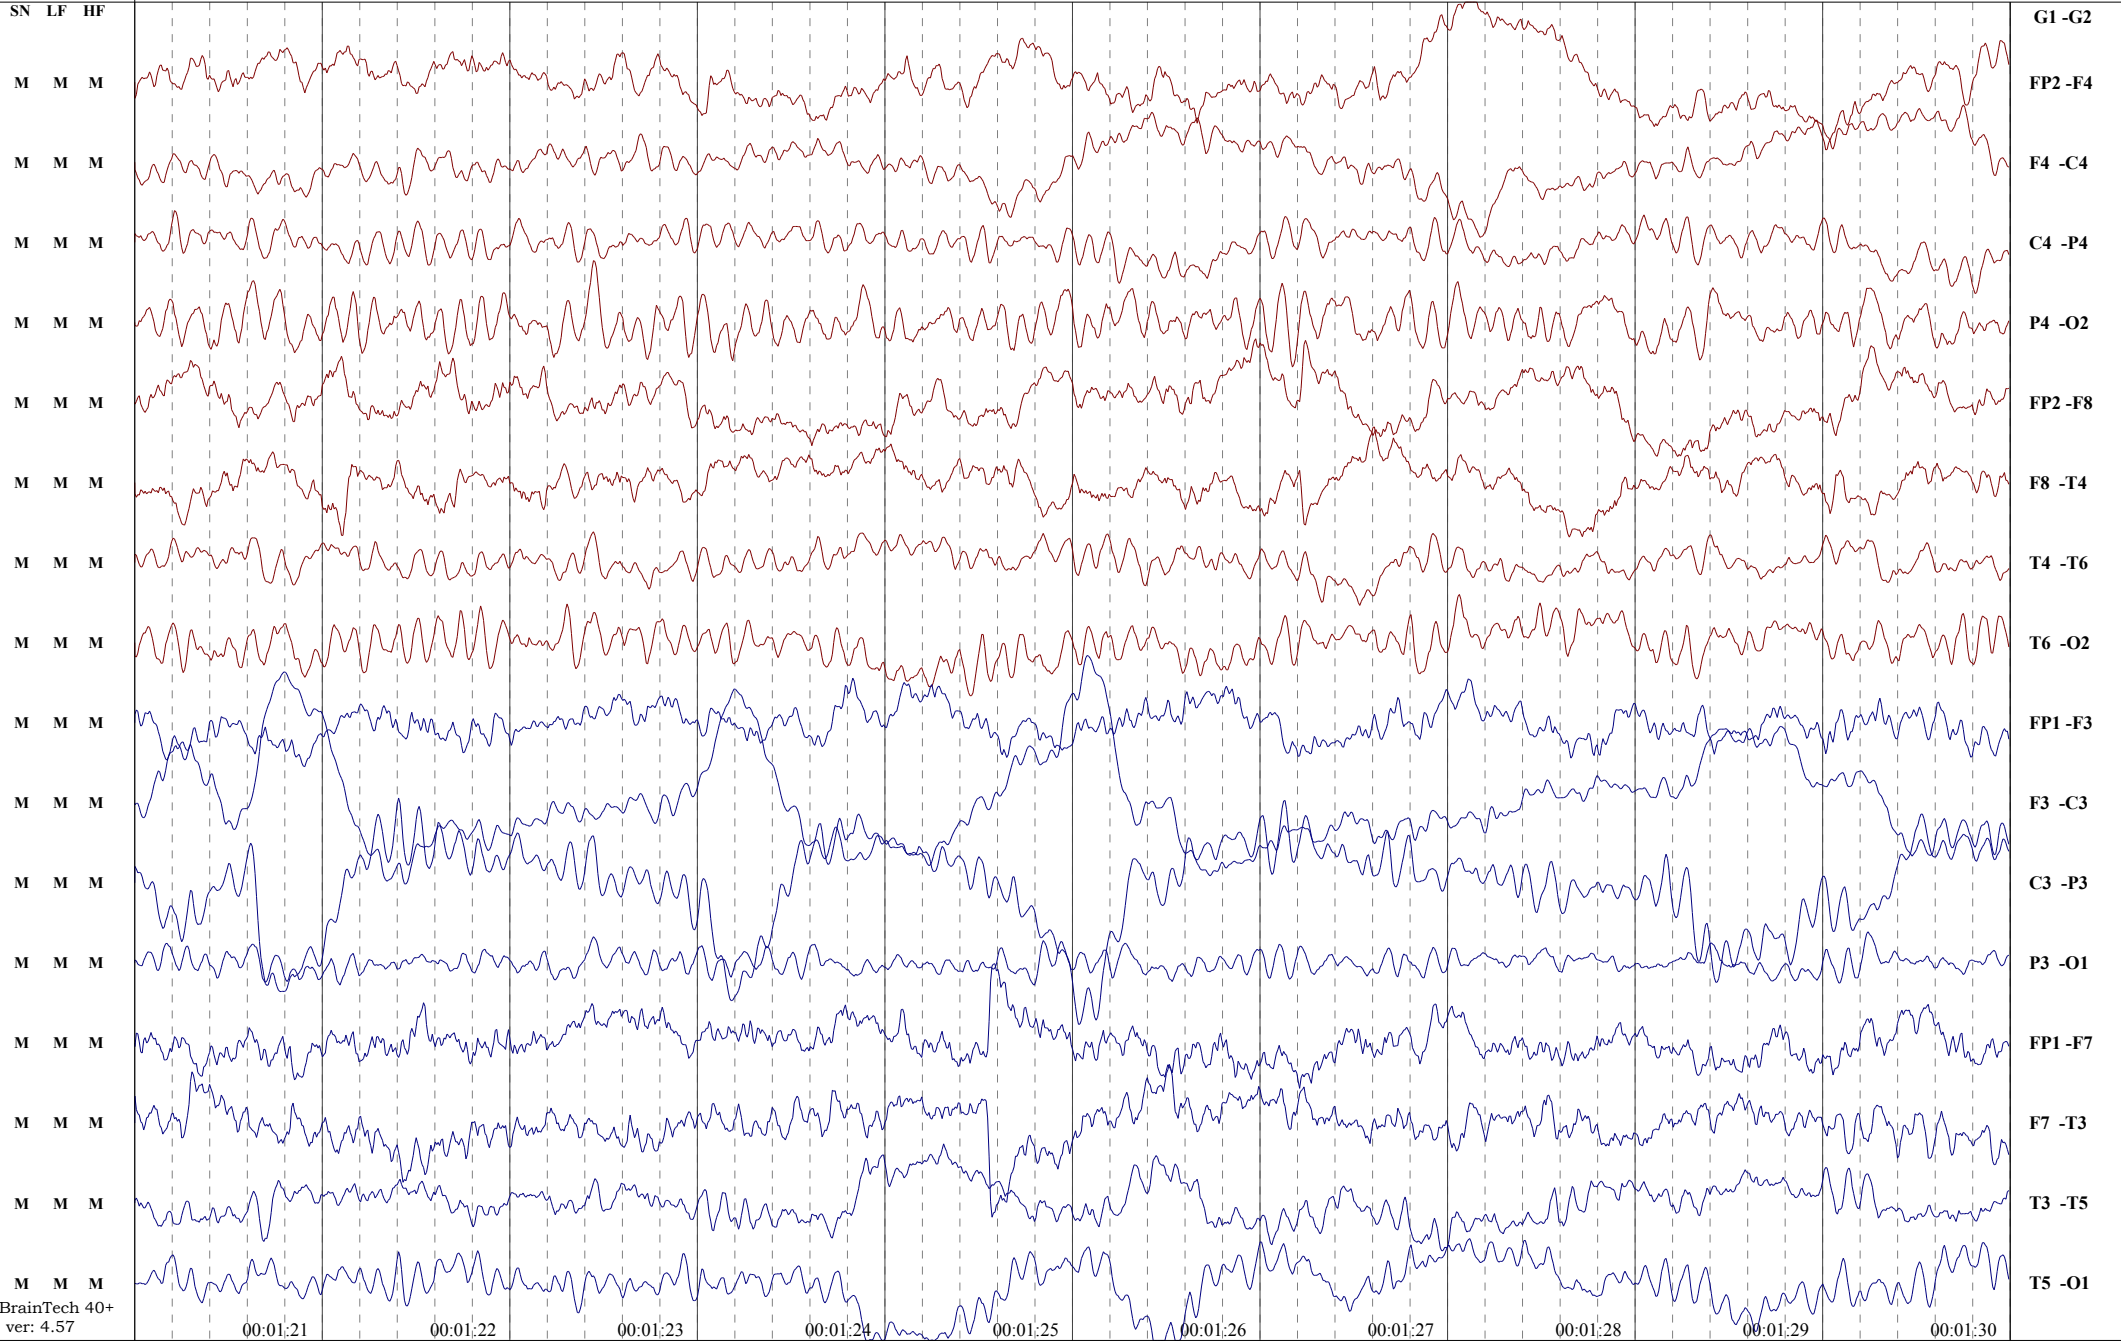


77
MRS. JAMILA BEGAM
35 Years/F

Date: 19-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 16:44:29
Page:10/27
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

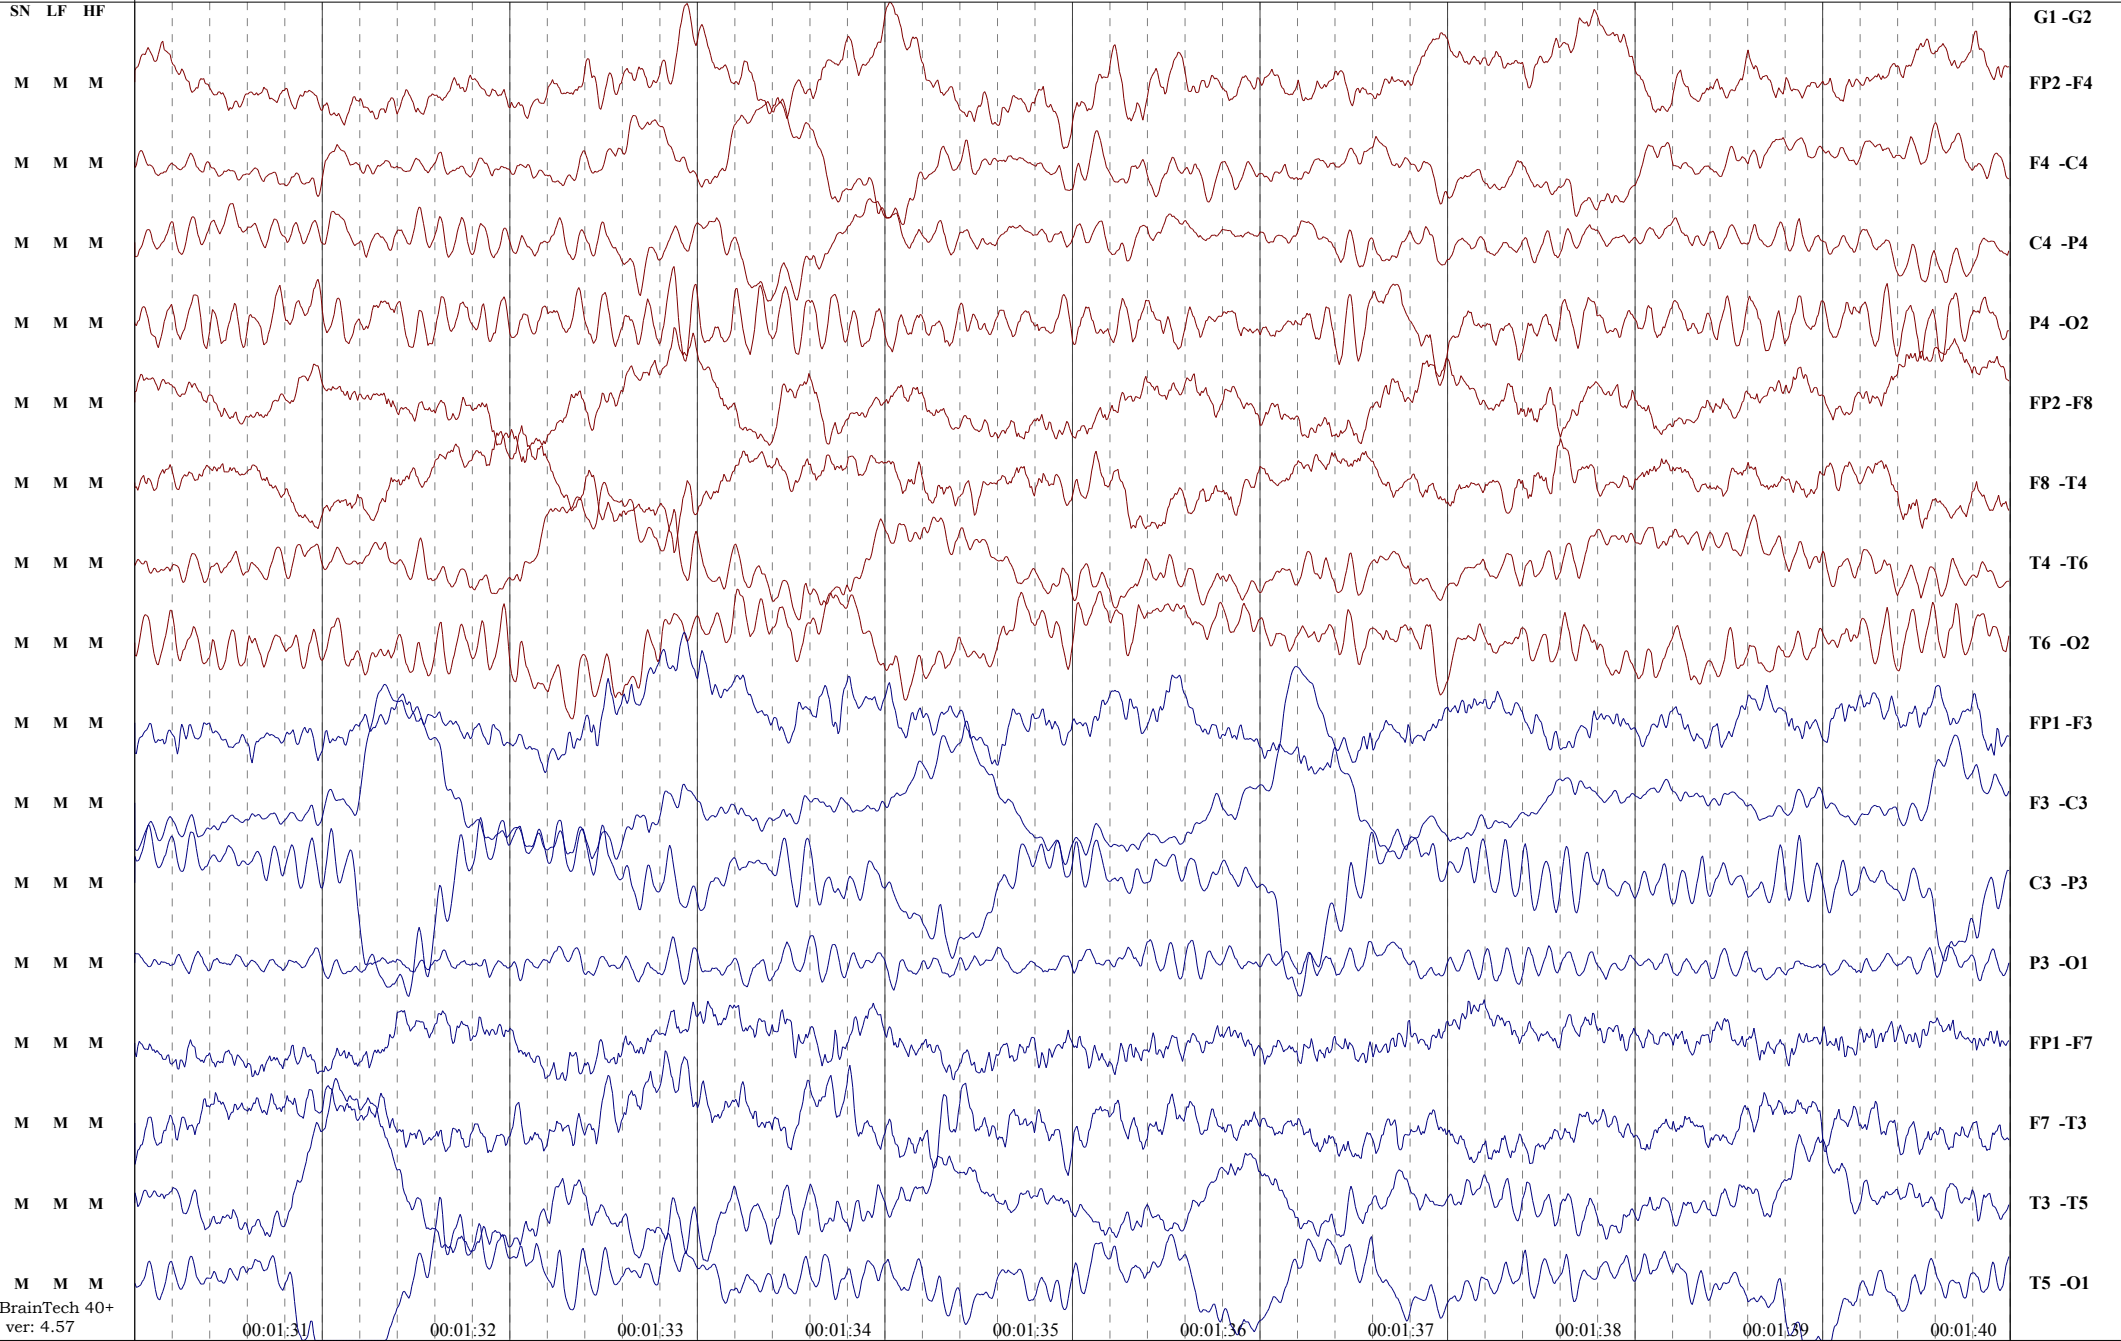


77
MRS. JAMILA BEGAM
35 Years/F

Date: 19-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 16:44:39
Page:11/27
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

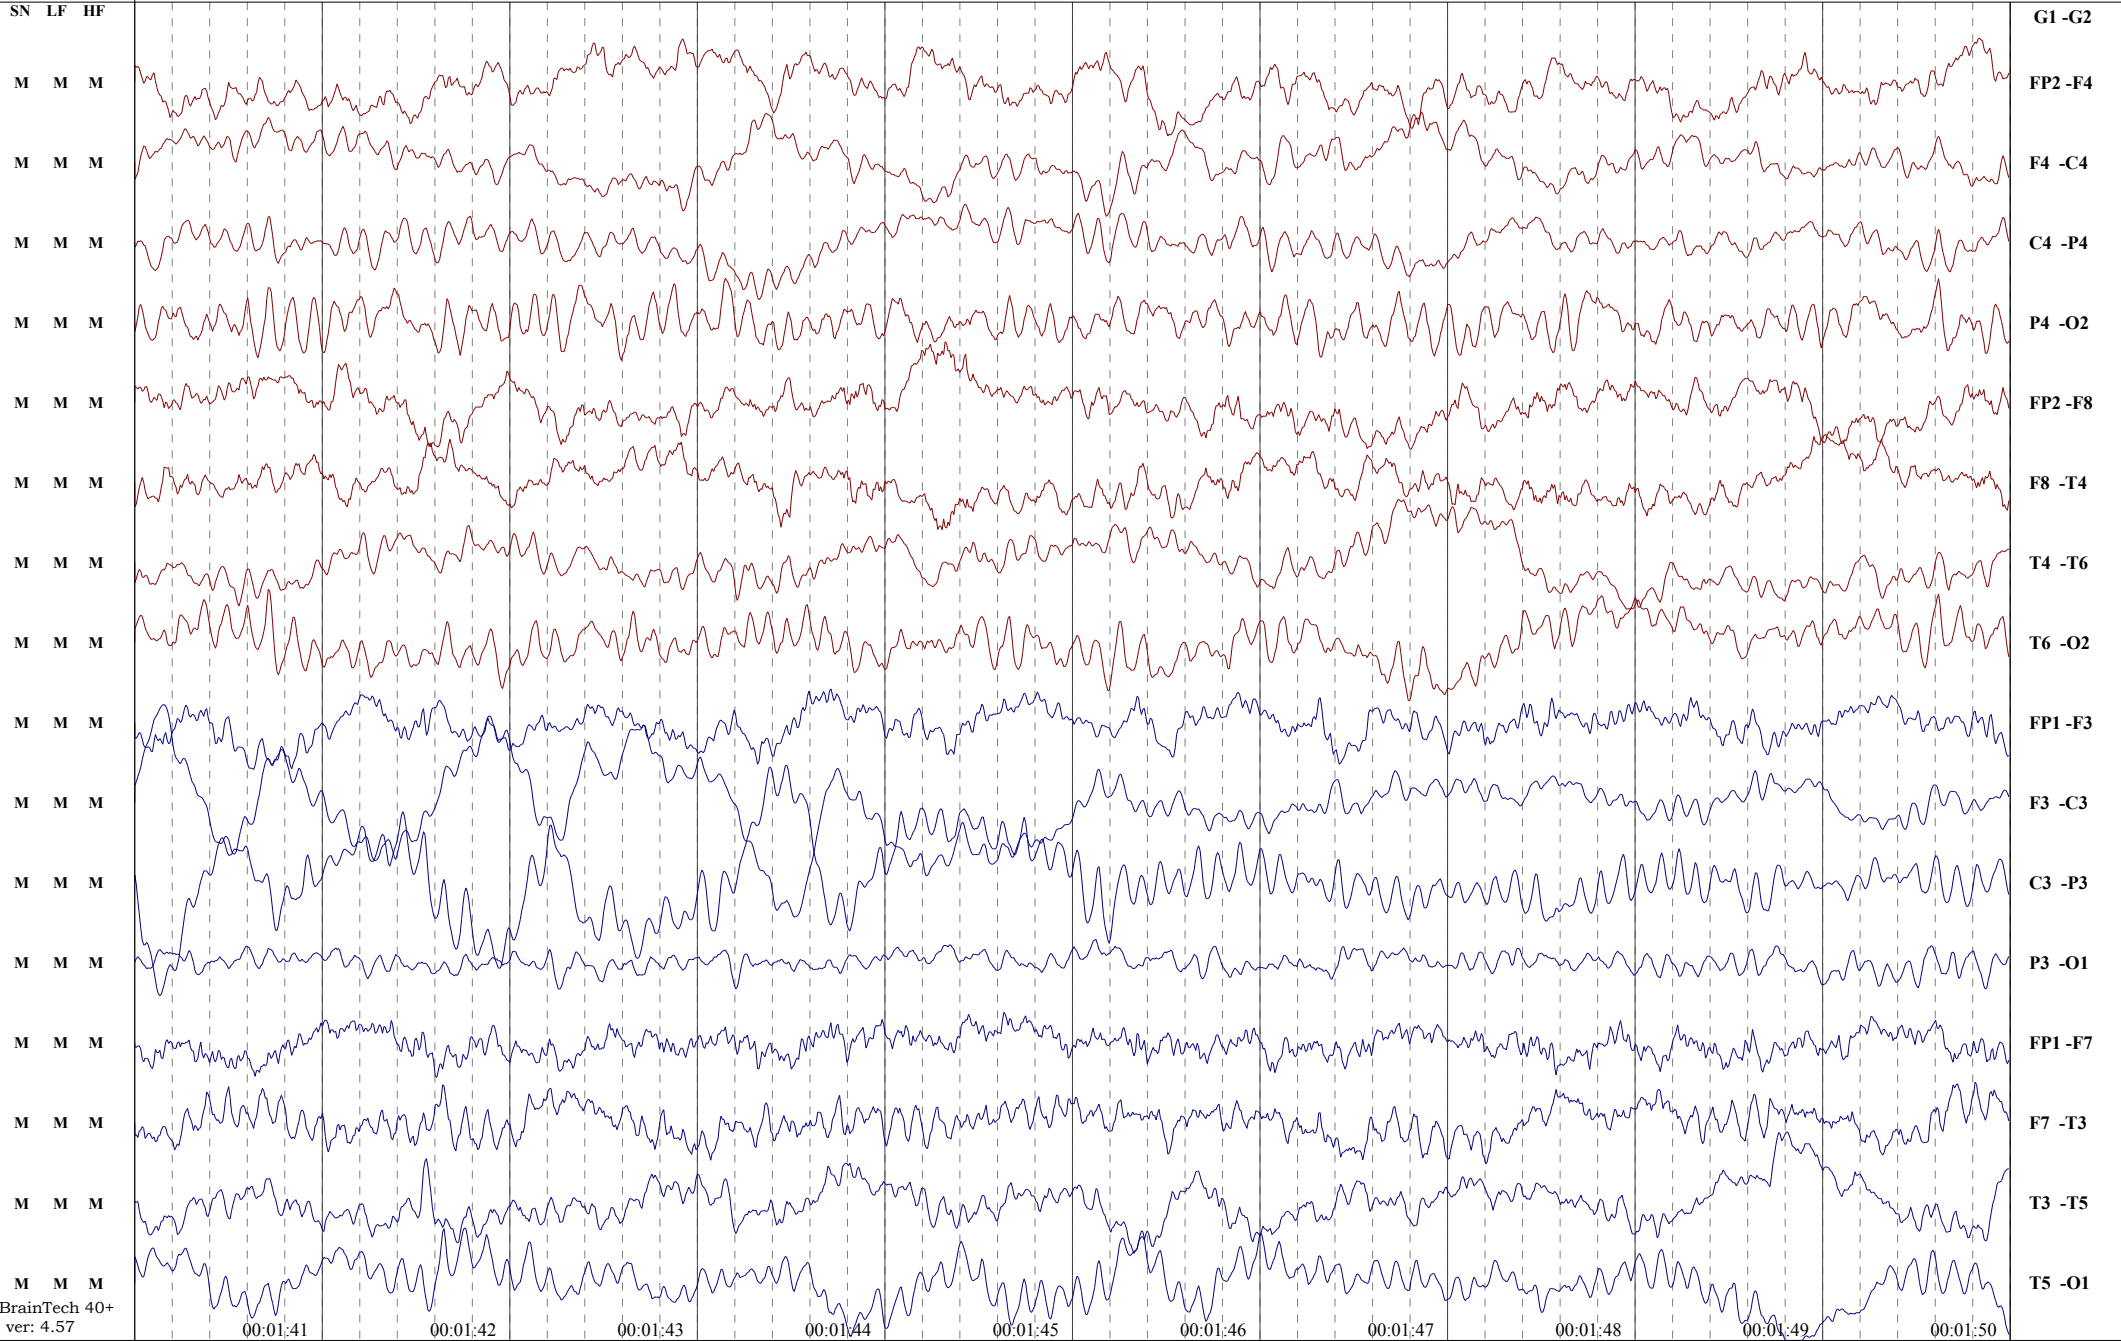


77
MRS. JAMILA BEGAM
35 Years/F


Date: 19-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 16:44:49
Page:12/27
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

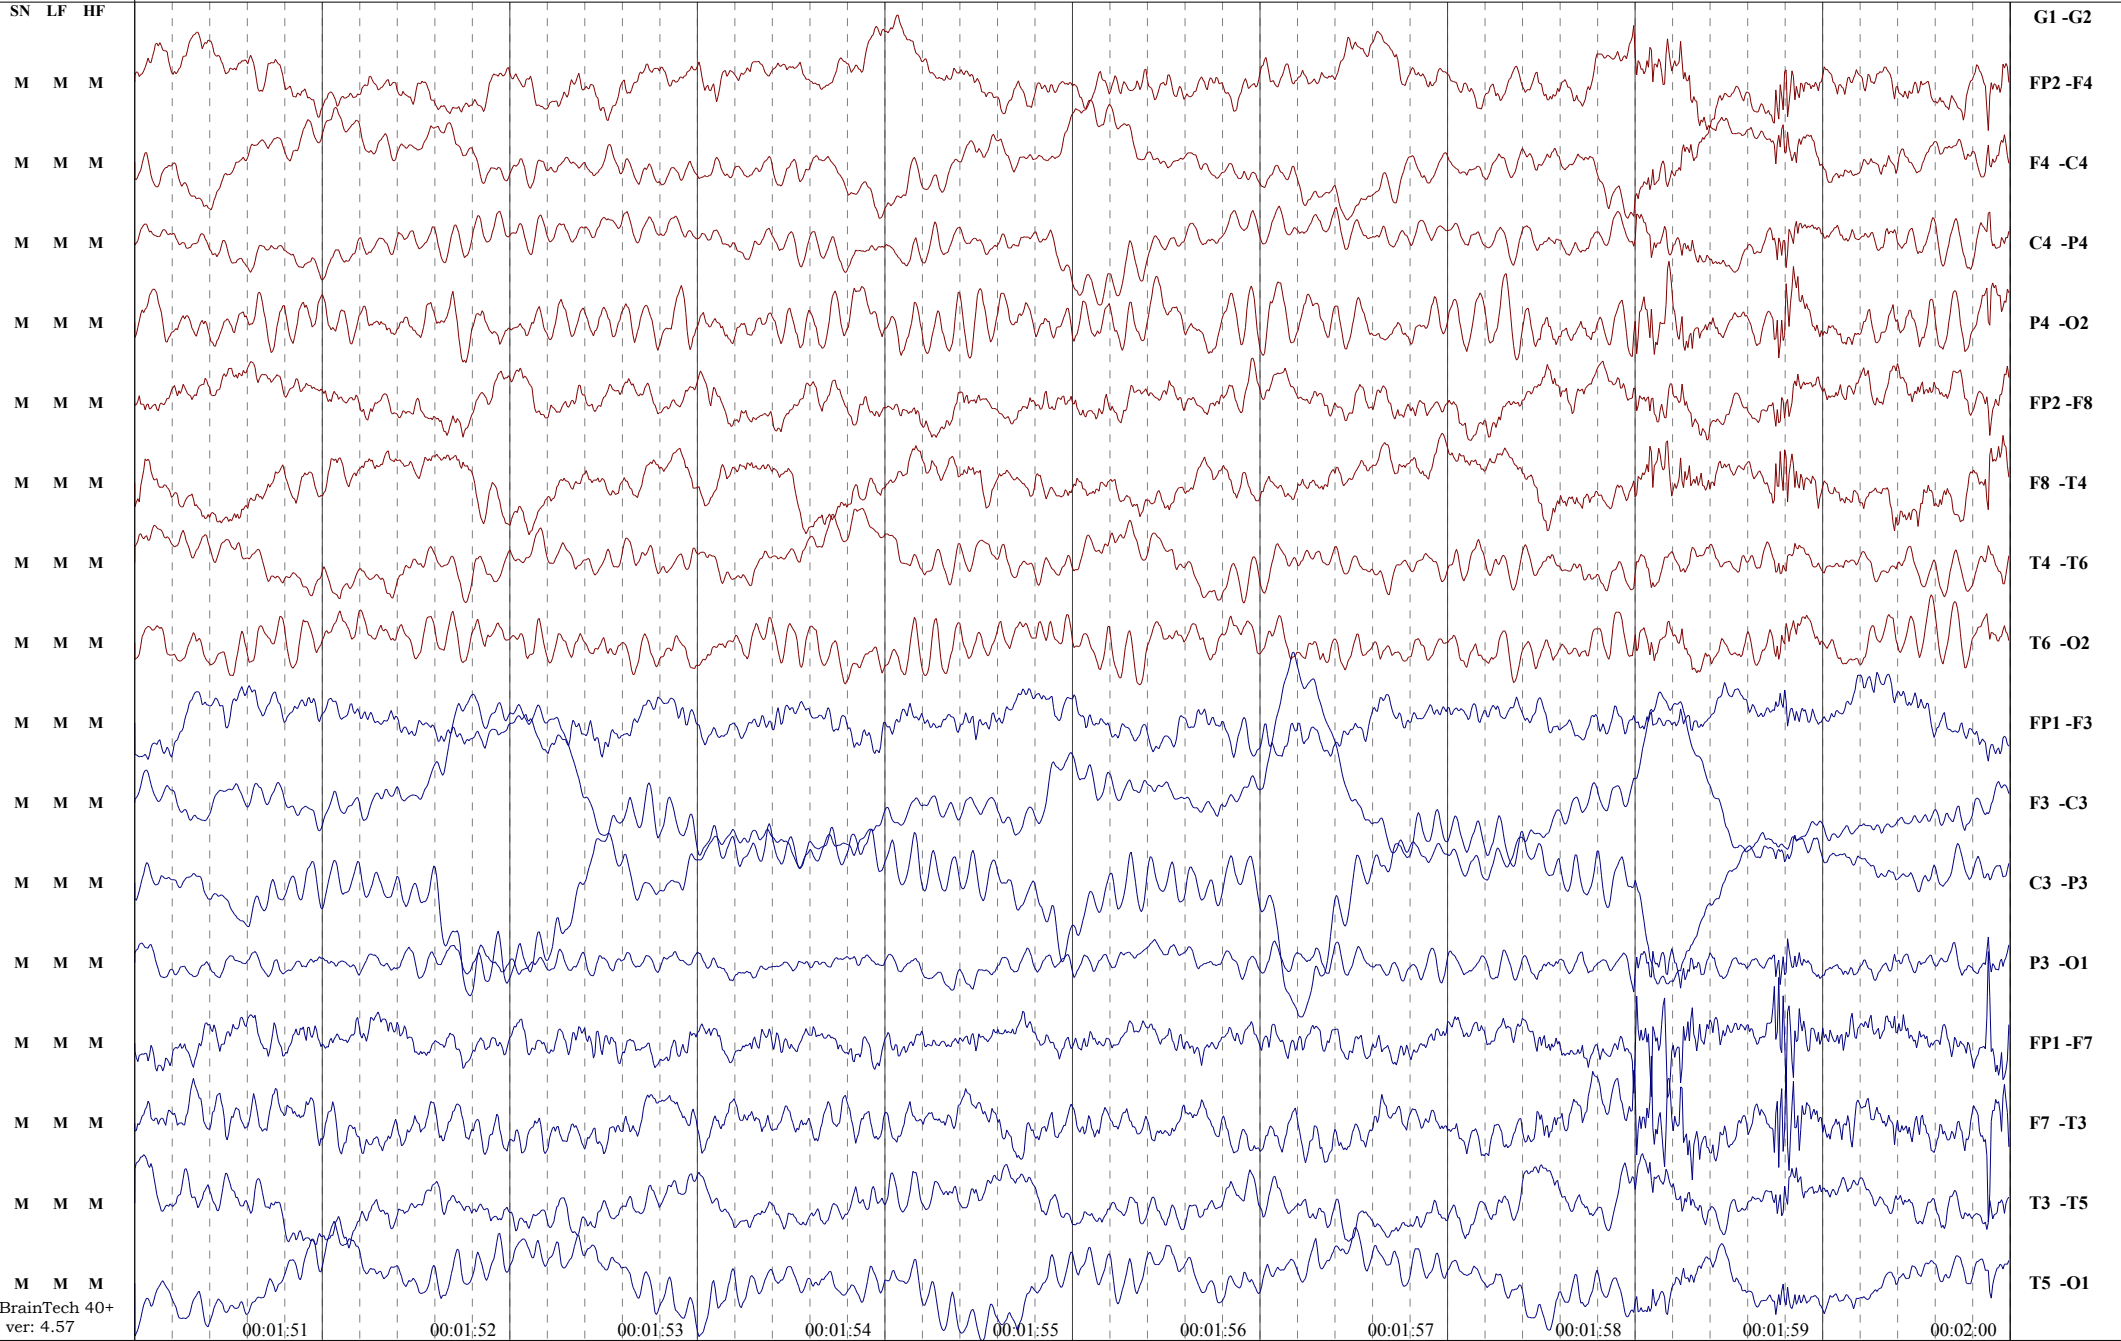

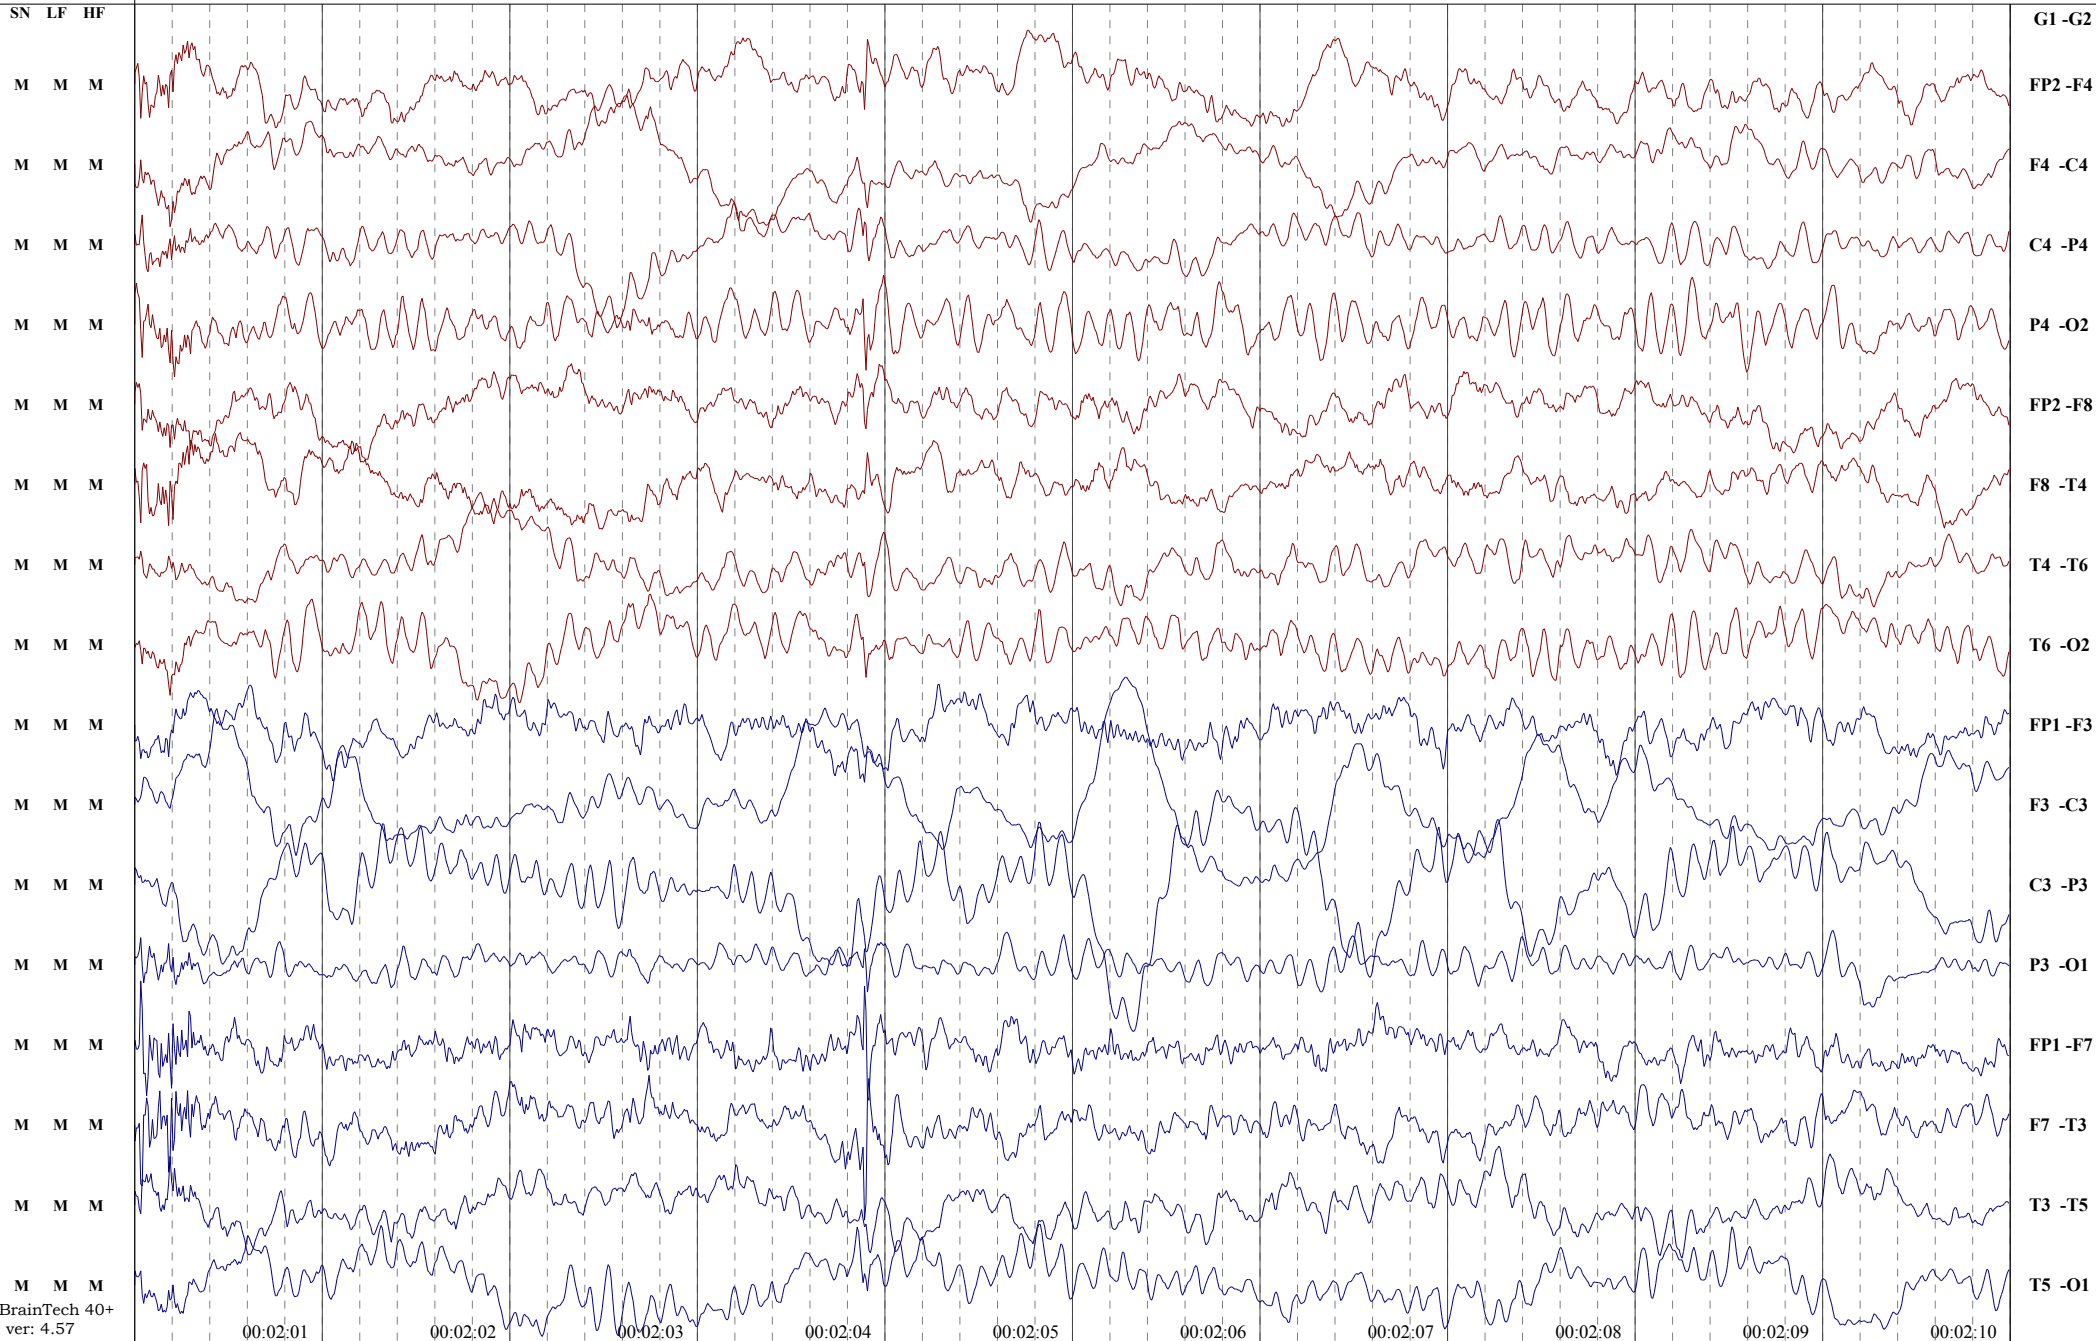

Clarity

PRATHAM HOSPITAL


77
MRS. JAMILA BEGAM
35 Years/F

Date: 19-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 16:45:09
Page:14/27
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

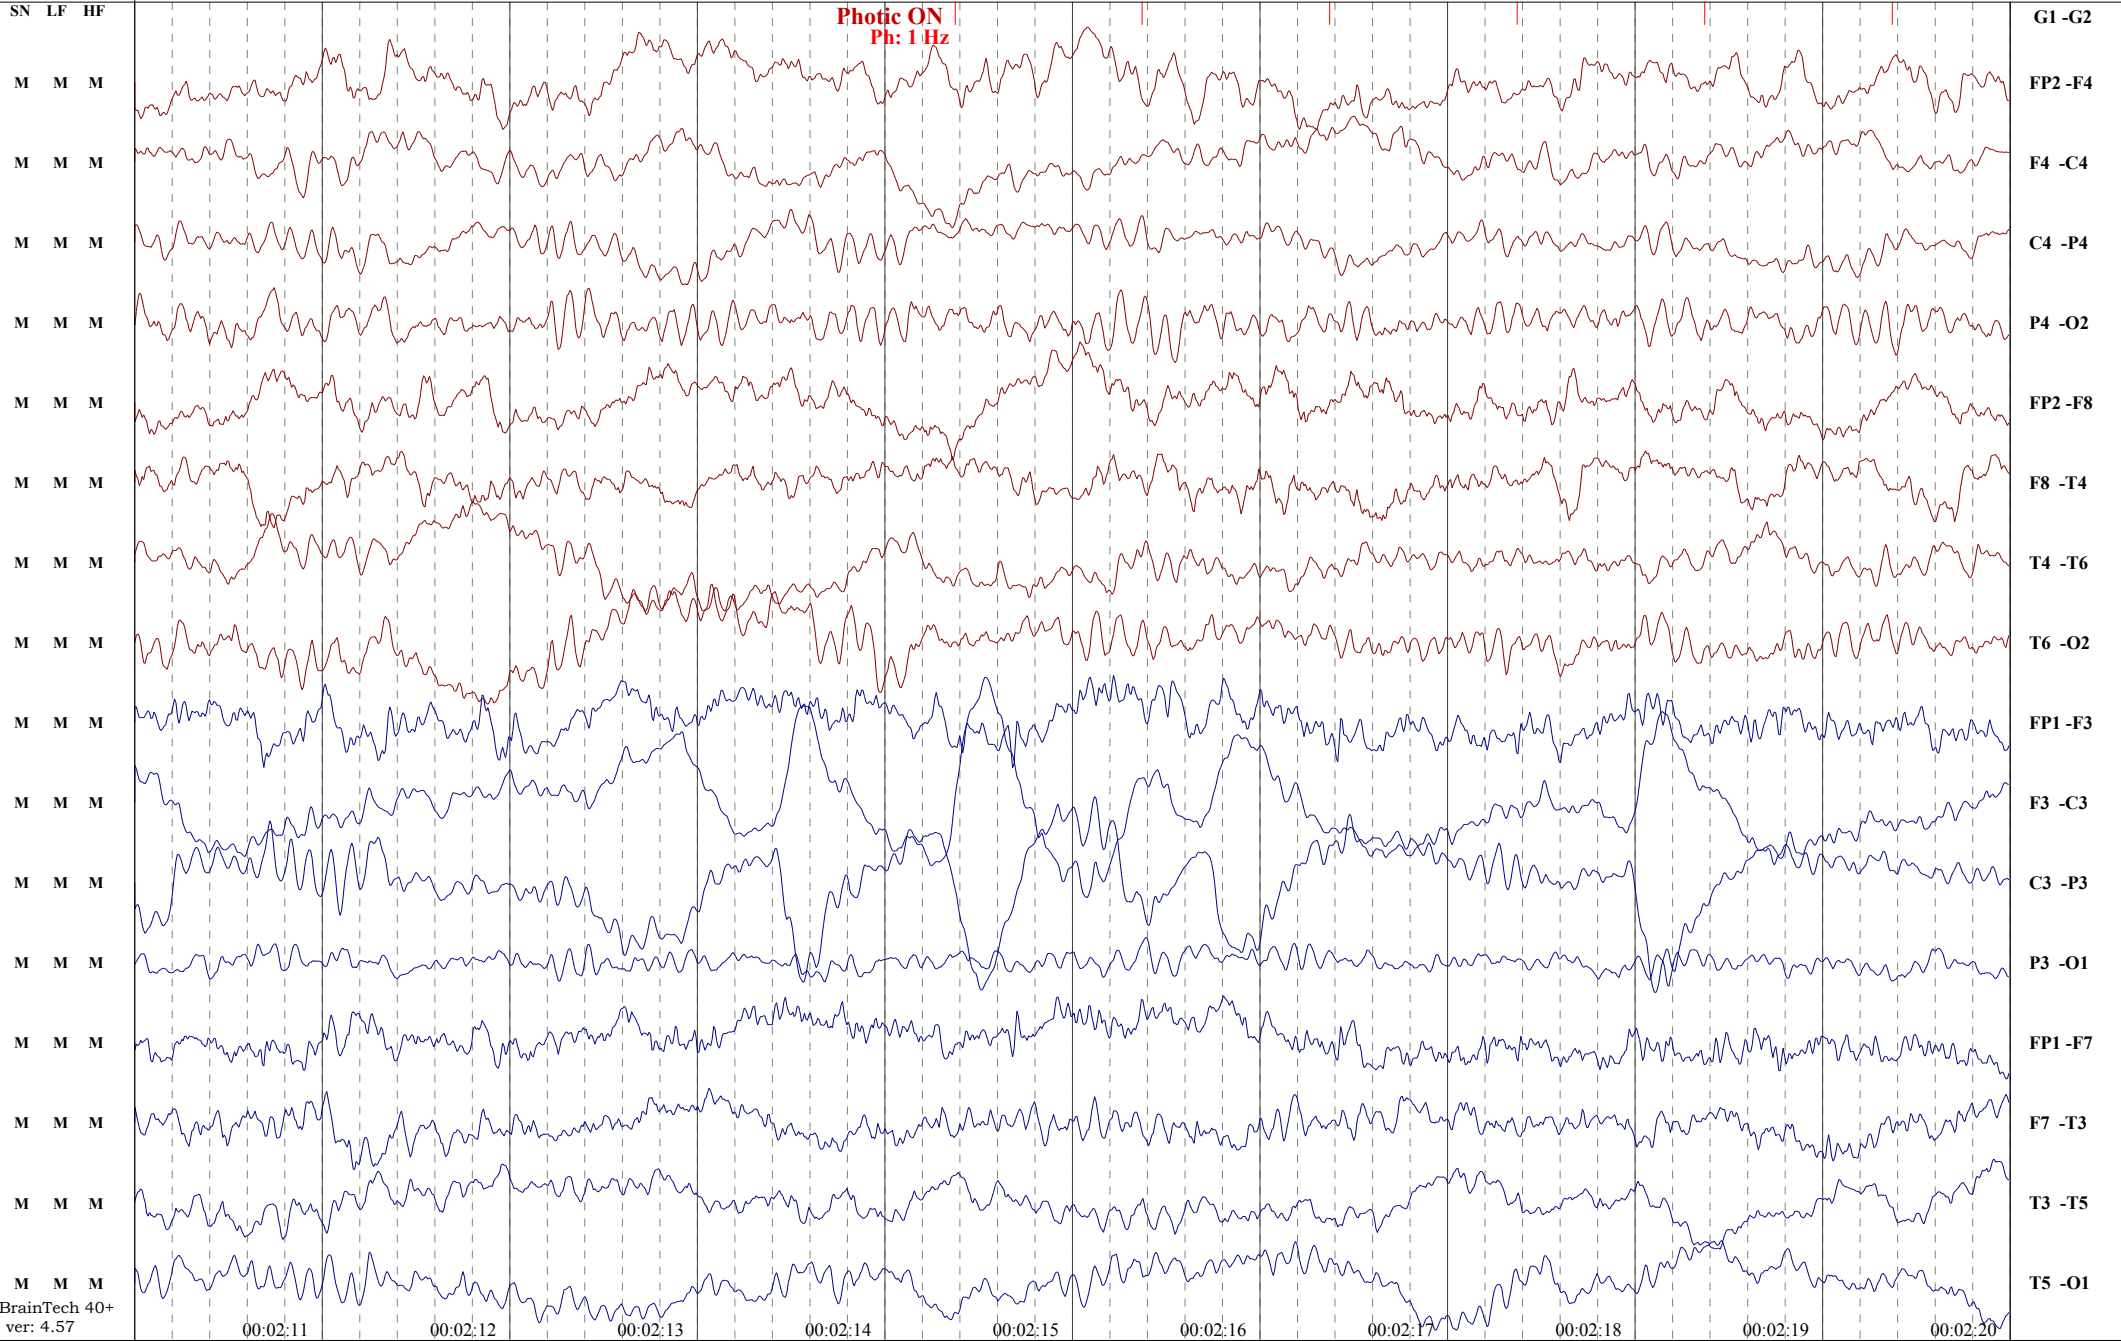


77
MRS. JAMILA BEGAM
35 Years/F

Date: 19-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 16:45:19
Page:15/27
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

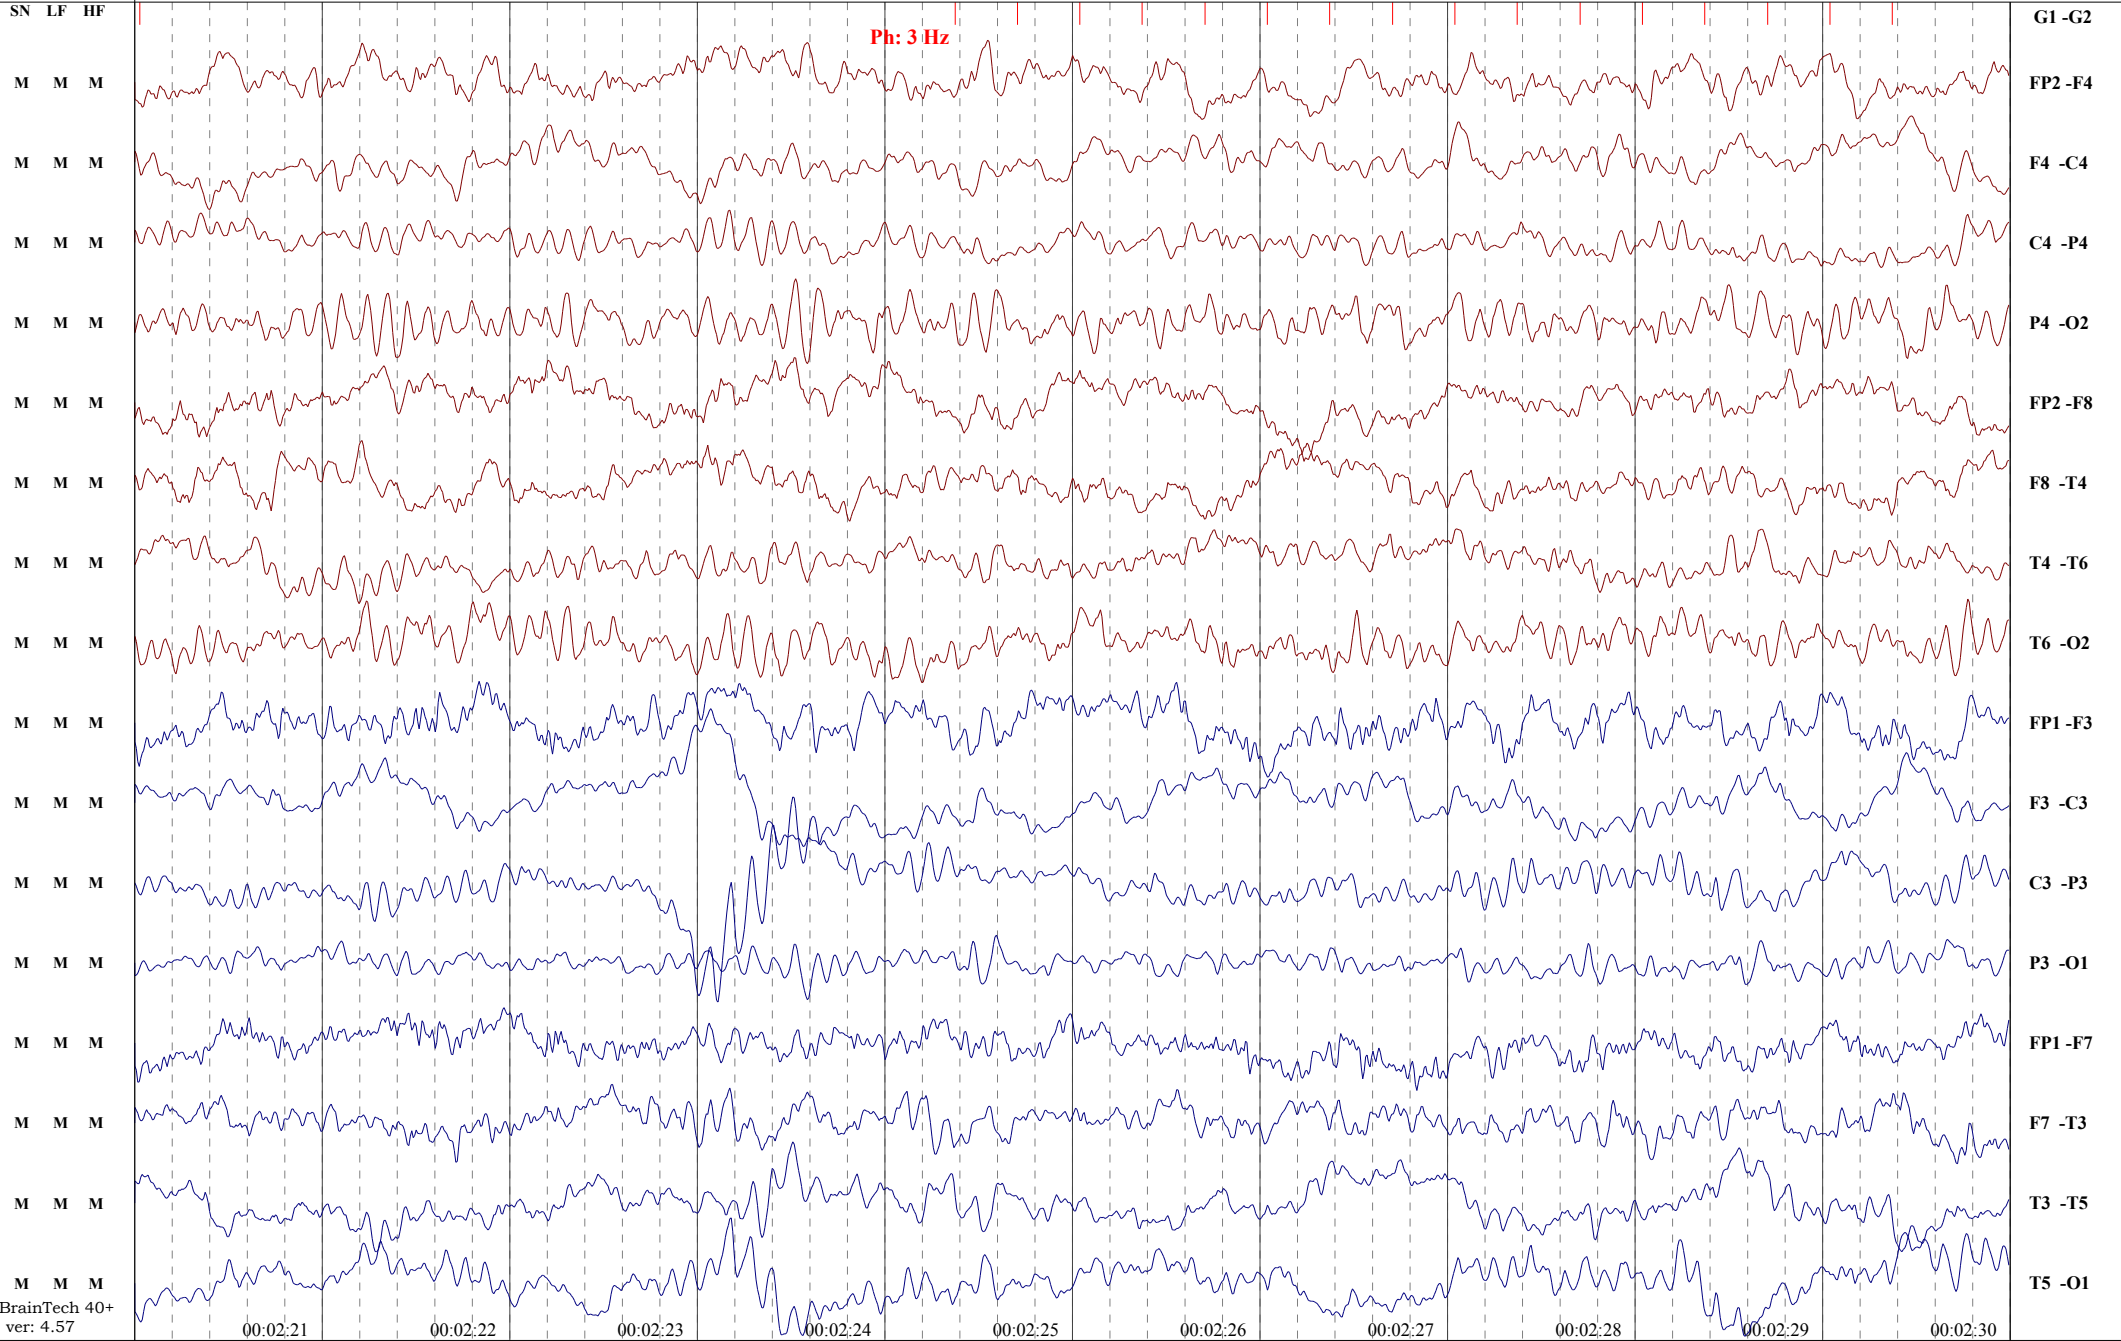


77
MRS. JAMILA BEGAM
35 Years/F

Date: 19-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 16:45:29
Page:16/27
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

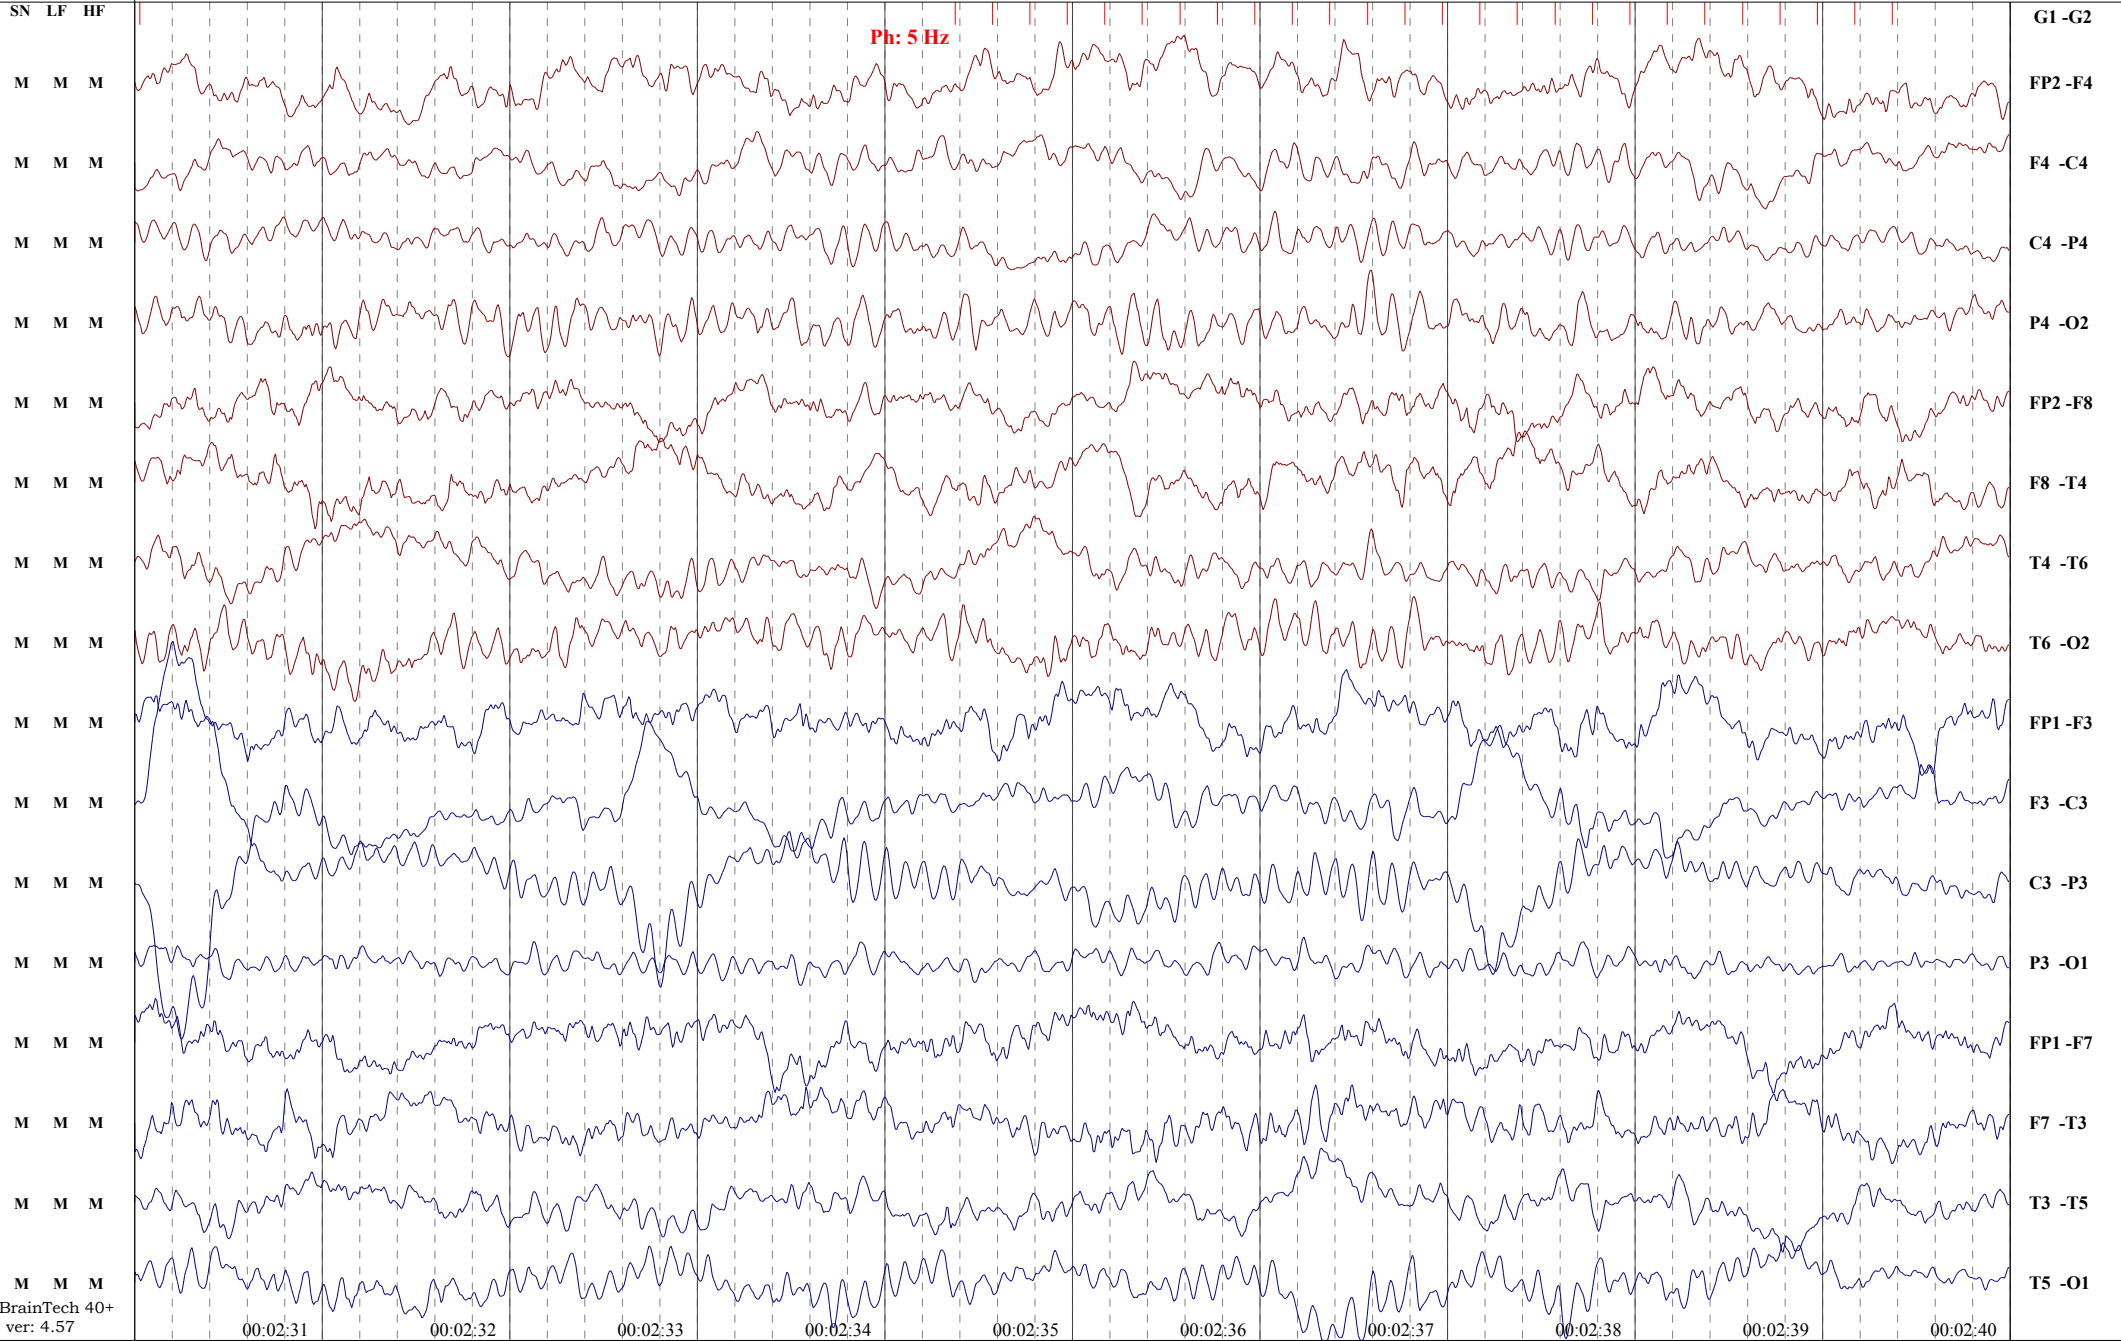


77
MRS. JAMILA BEGAM
35 Years/F

Date: 19-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 16:45:39
Page:17/27
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

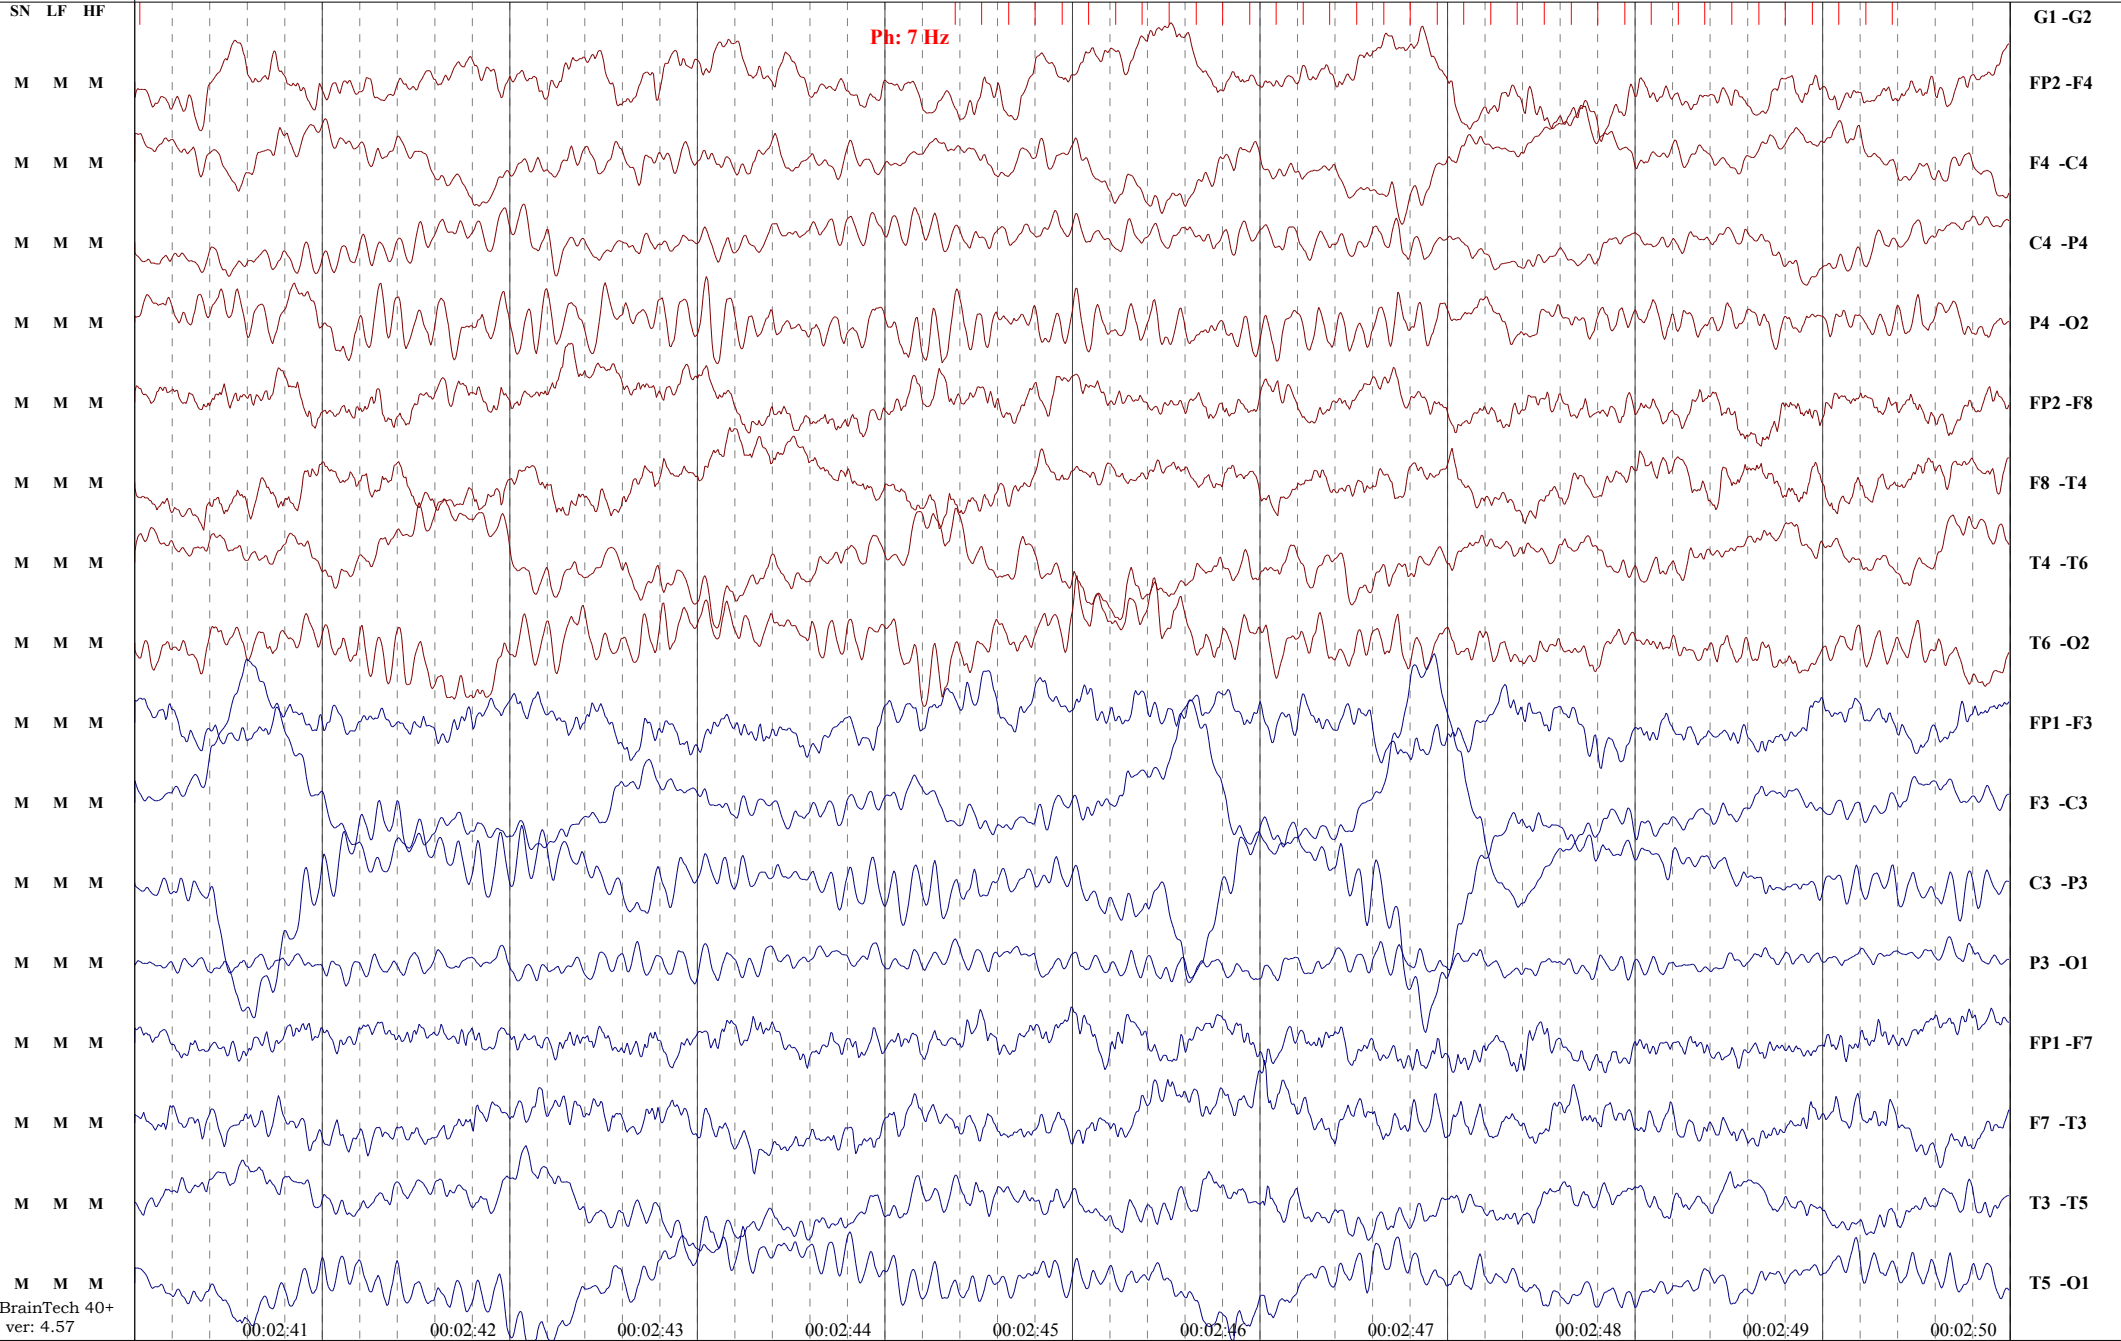


77
MRS. JAMILA BEGAM
35 Years/F

Date: 19-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 16:45:49
Page:18/27
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

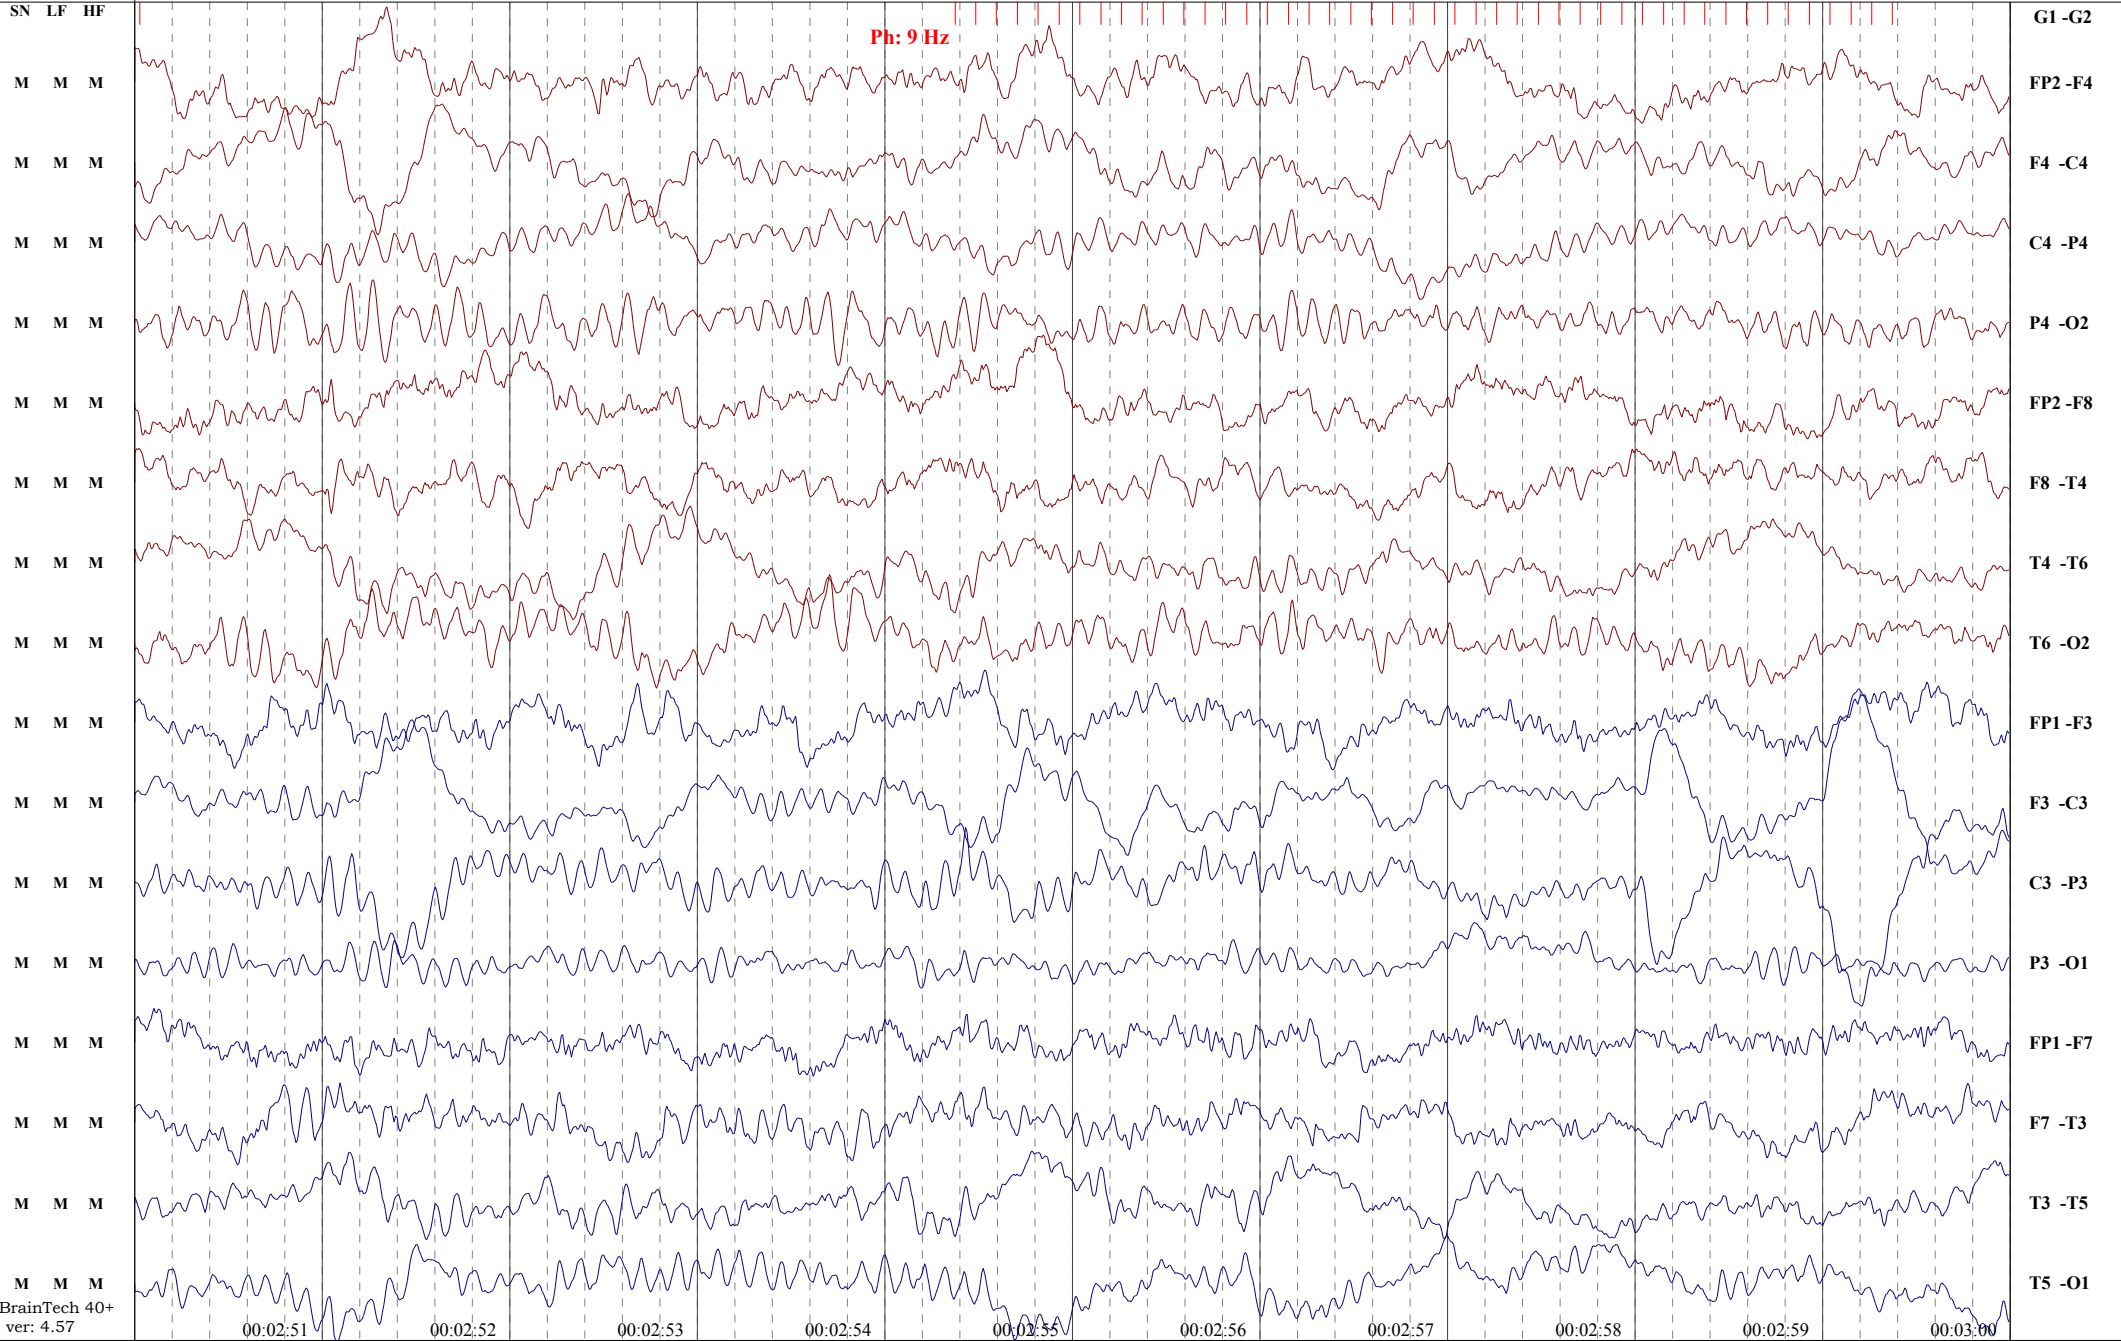


77
MRS. JAMILA BEGAM
35 Years/F

Date: 19-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 16:45:59
Page:19/27
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

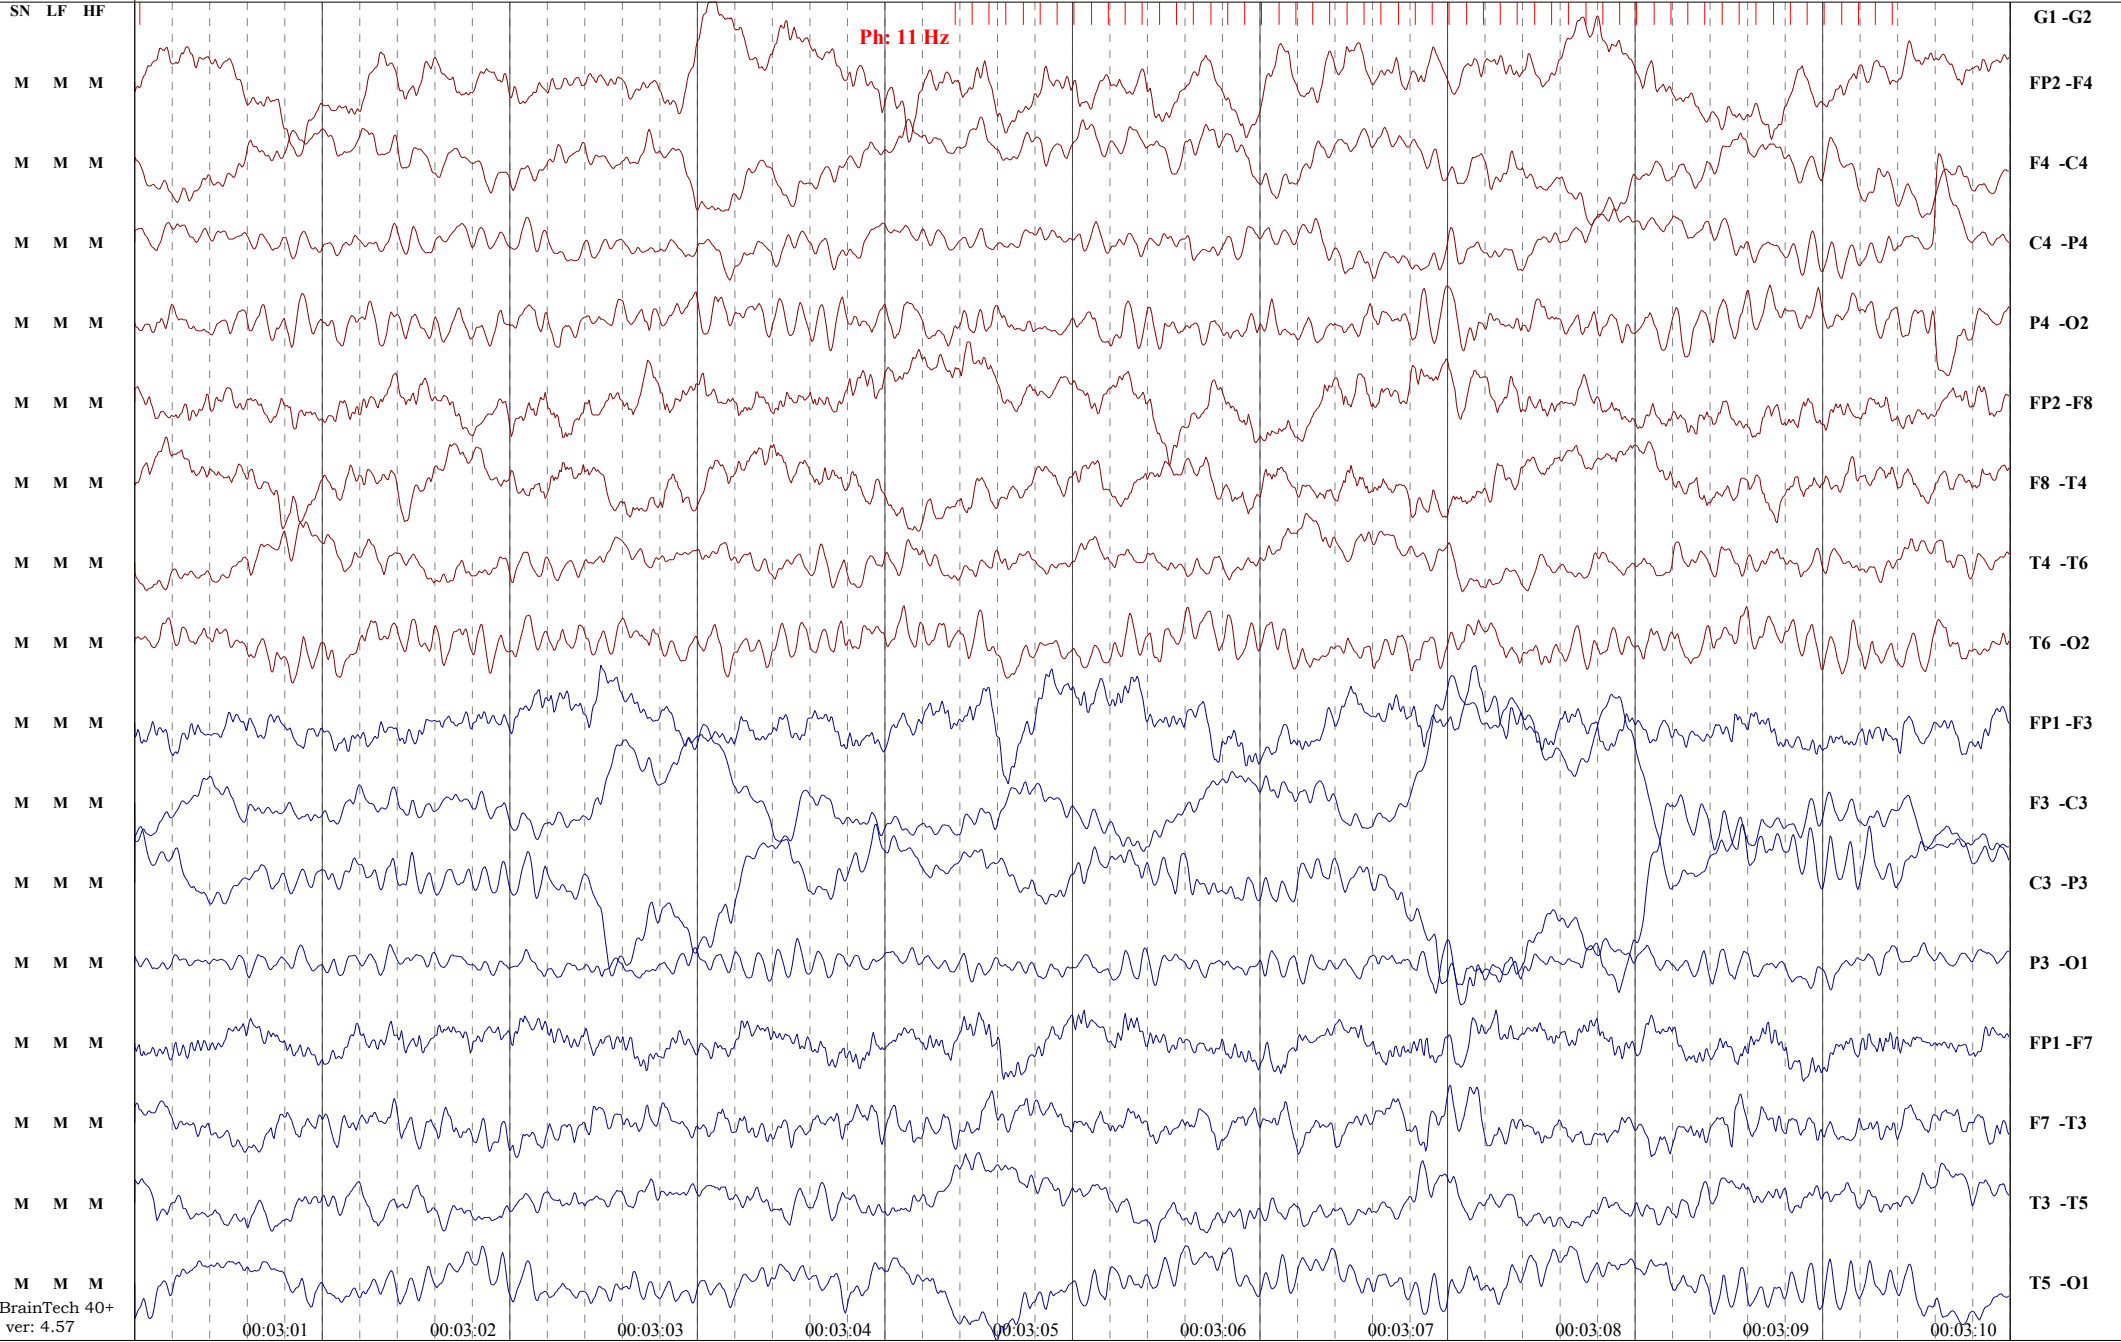


77
MRS. JAMILA BEGAM
35 Years/F


Date: 19-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 16:46:09
Page:20/27
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

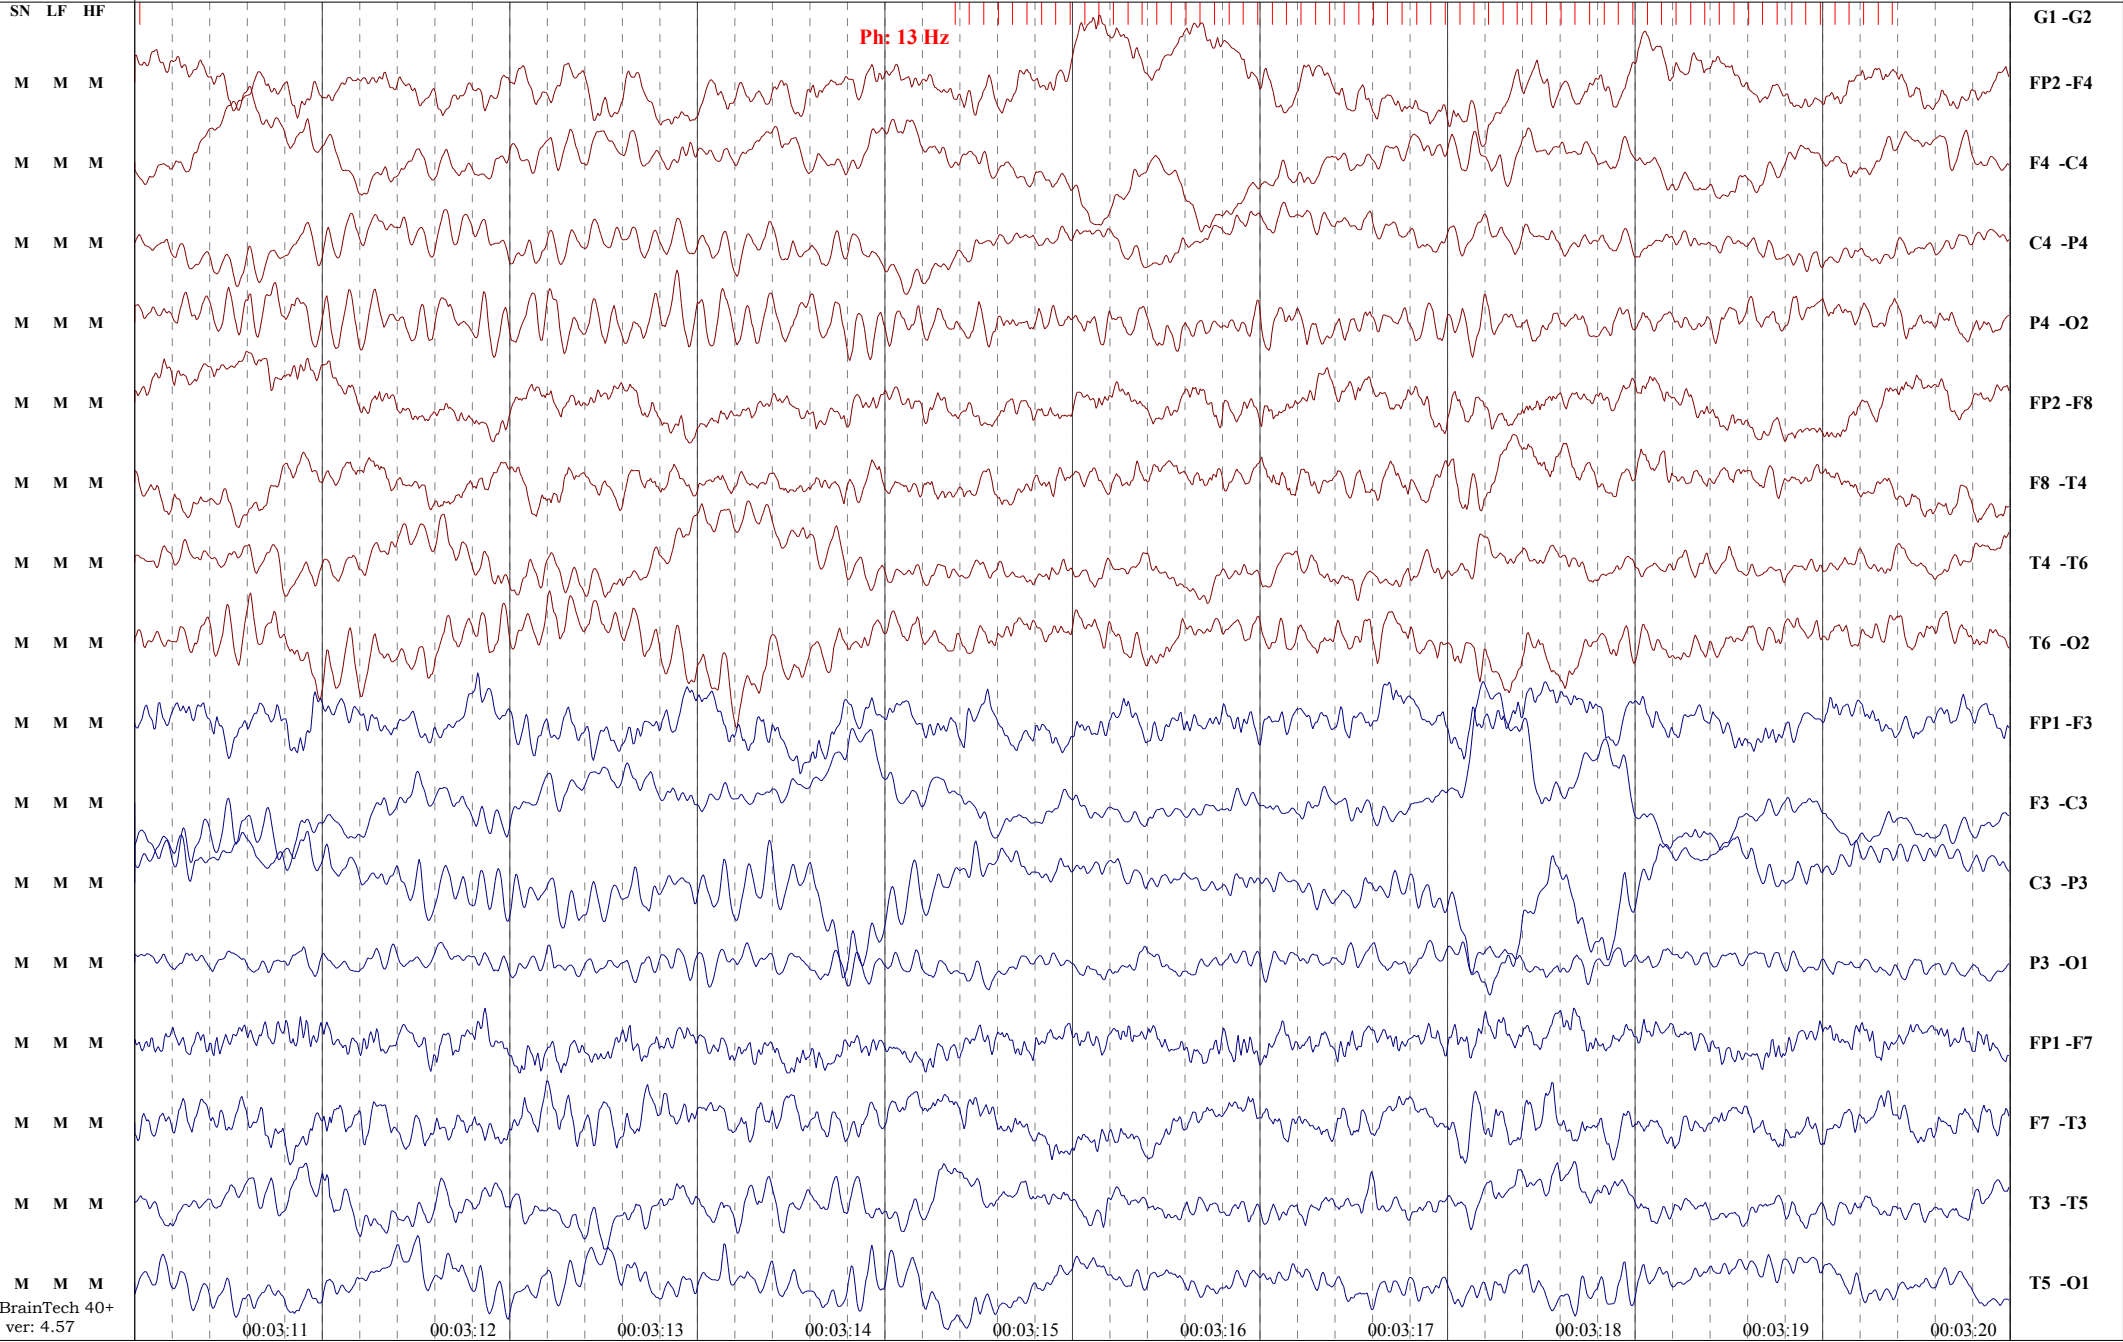

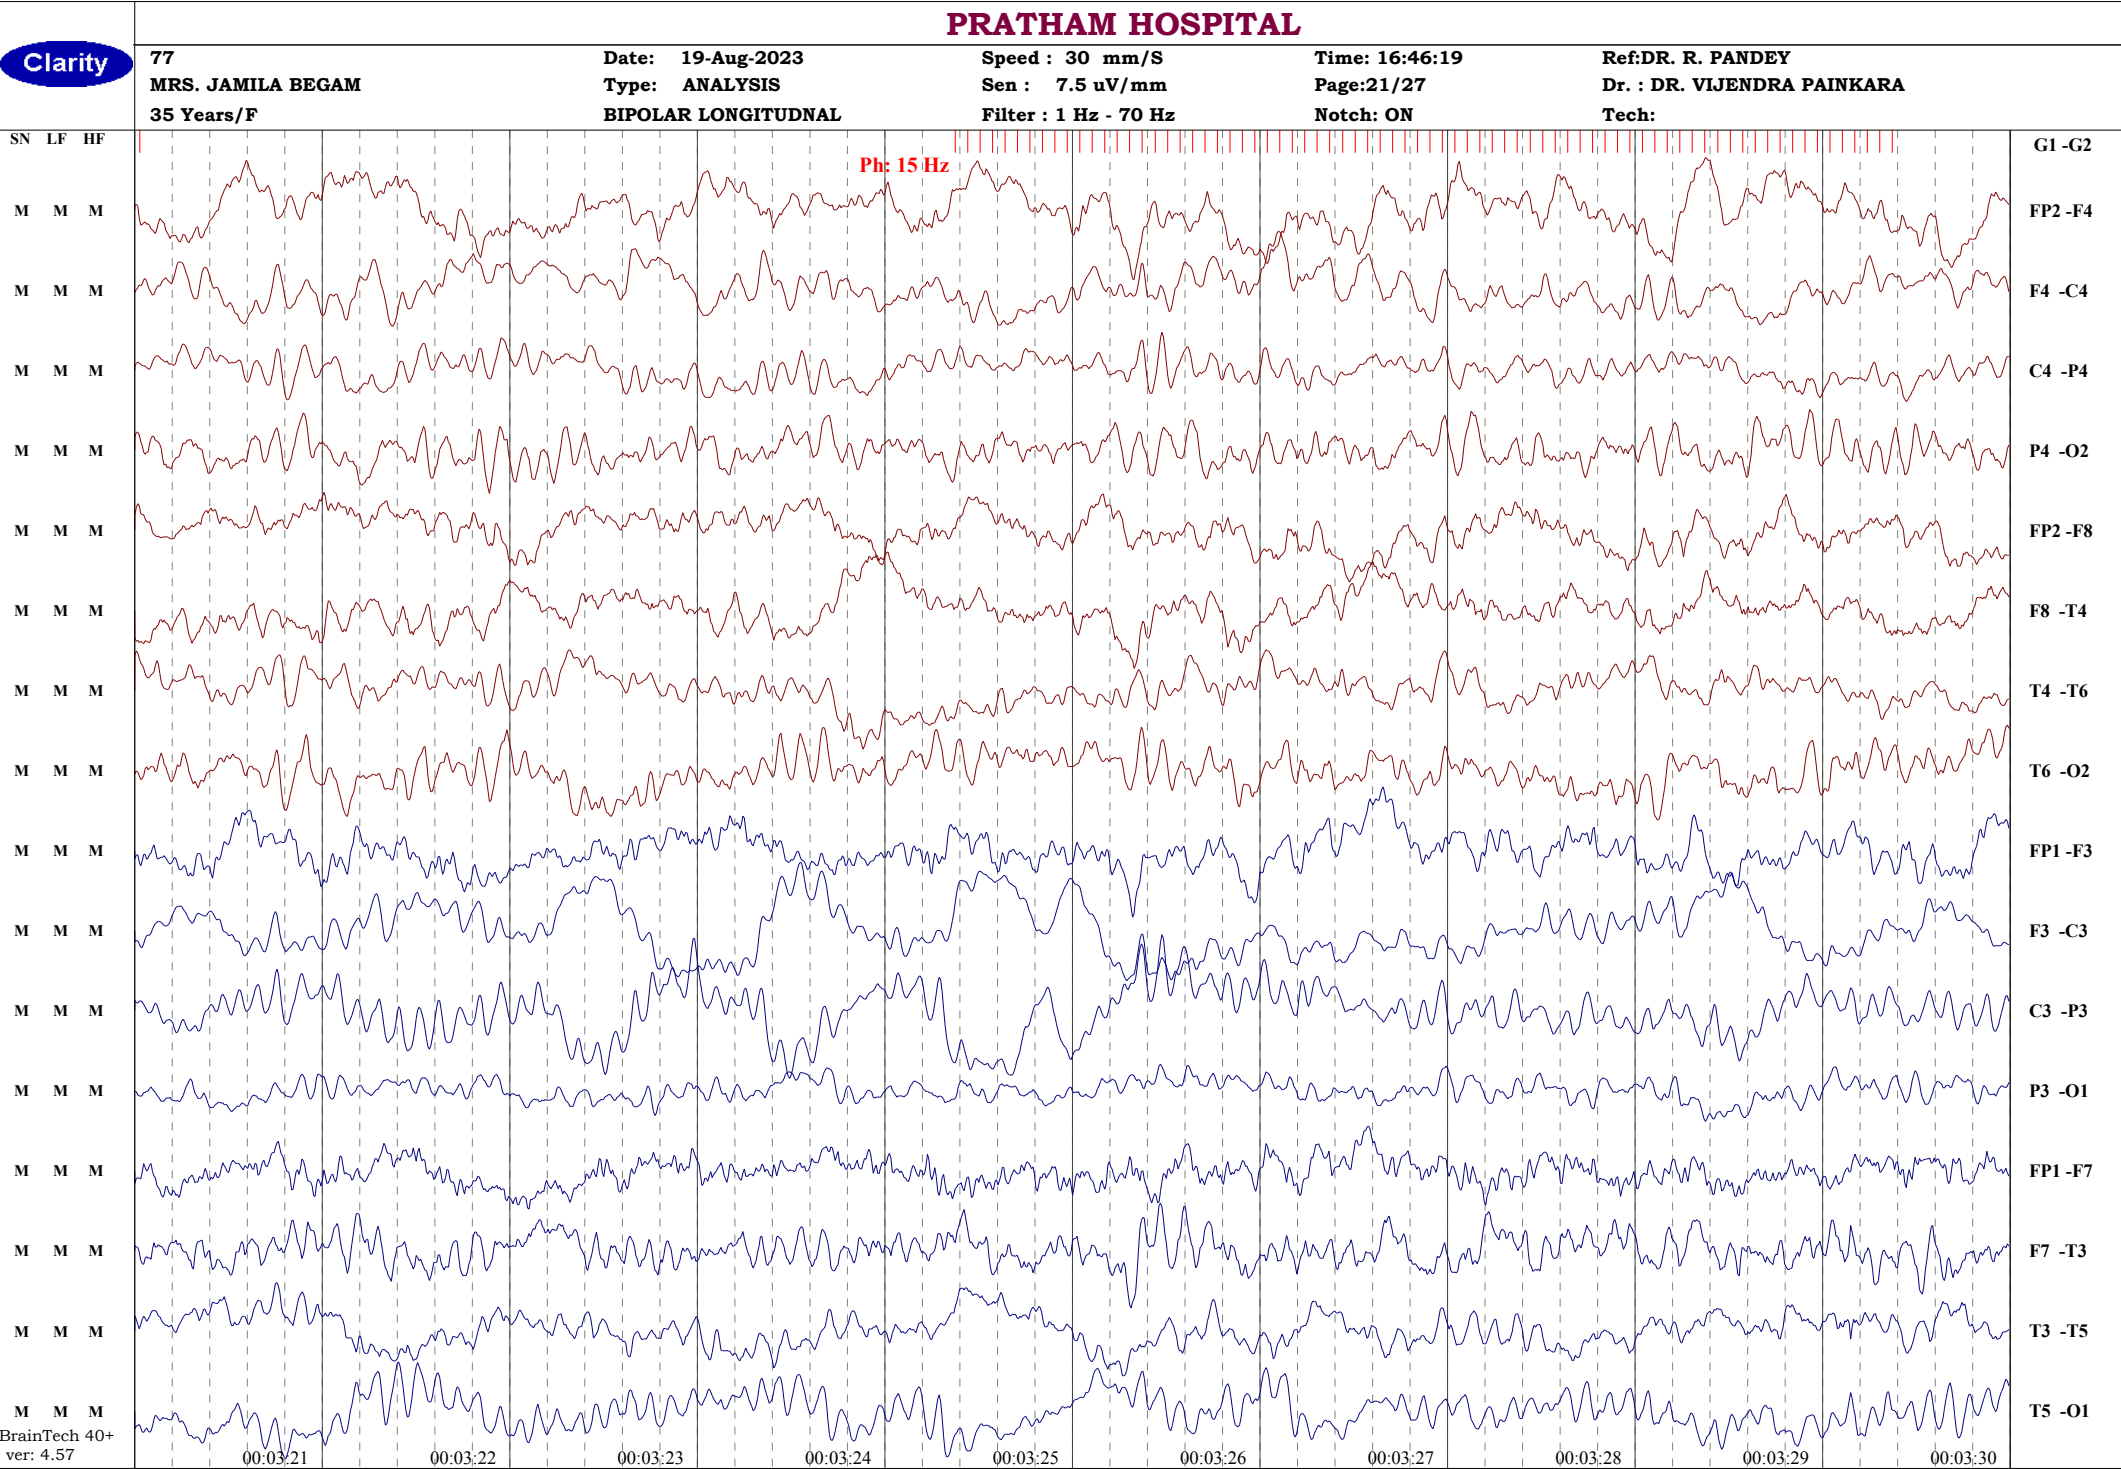


77
MRS. JAMILA BEGAM
35 Years/F

Date: 19-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 16:46:29
Page:22/27
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

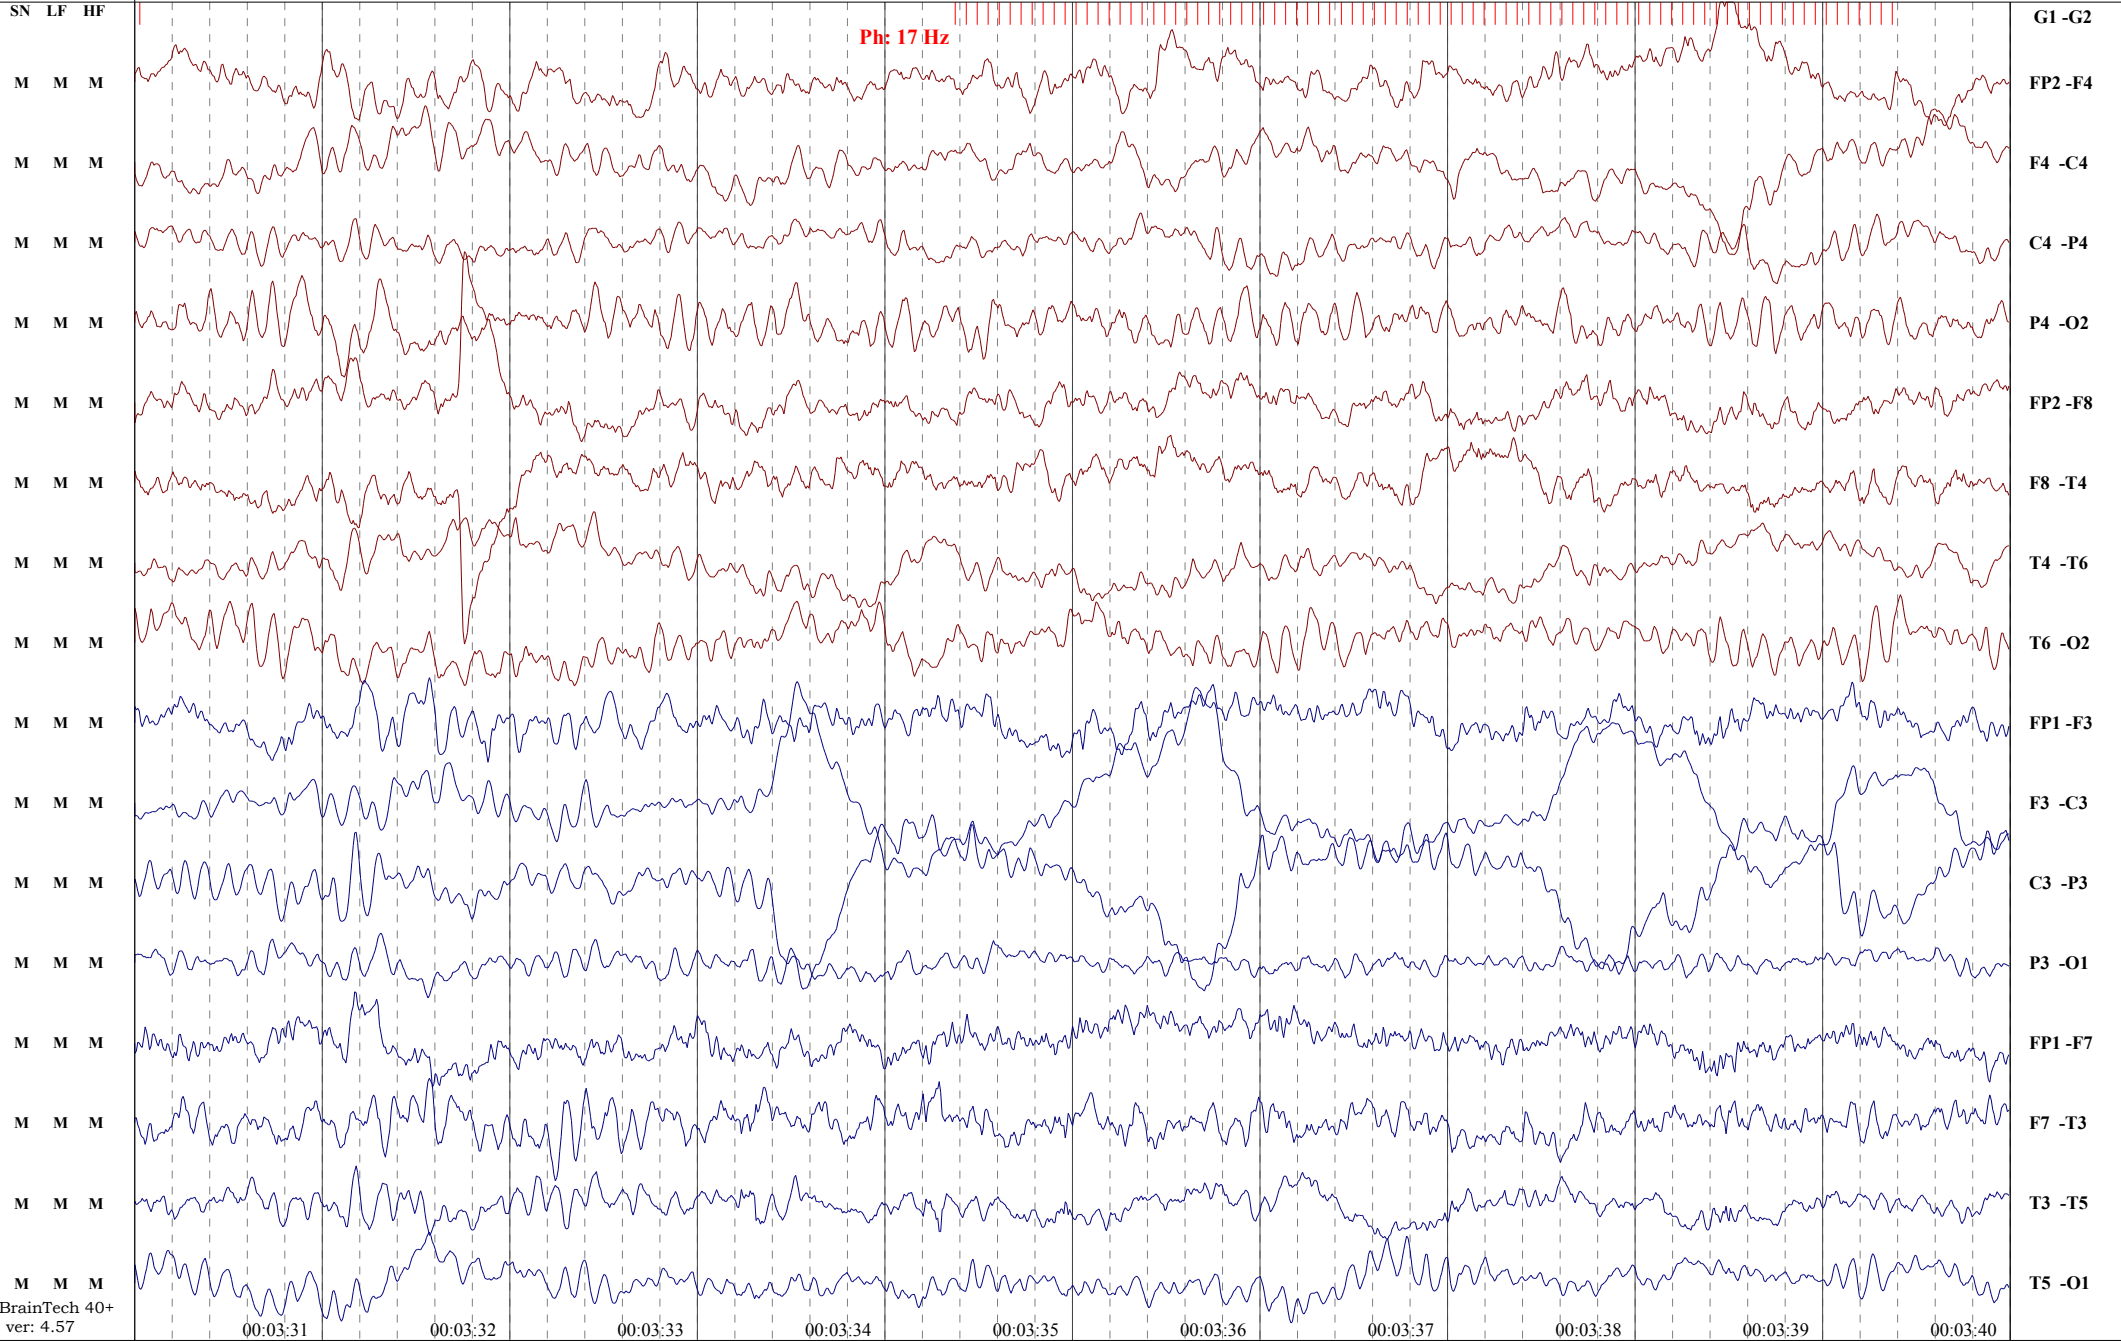


77
MRS. JAMILA BEGAM
35 Years/F

Date: 19-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 16:46:39
Page:23/27
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

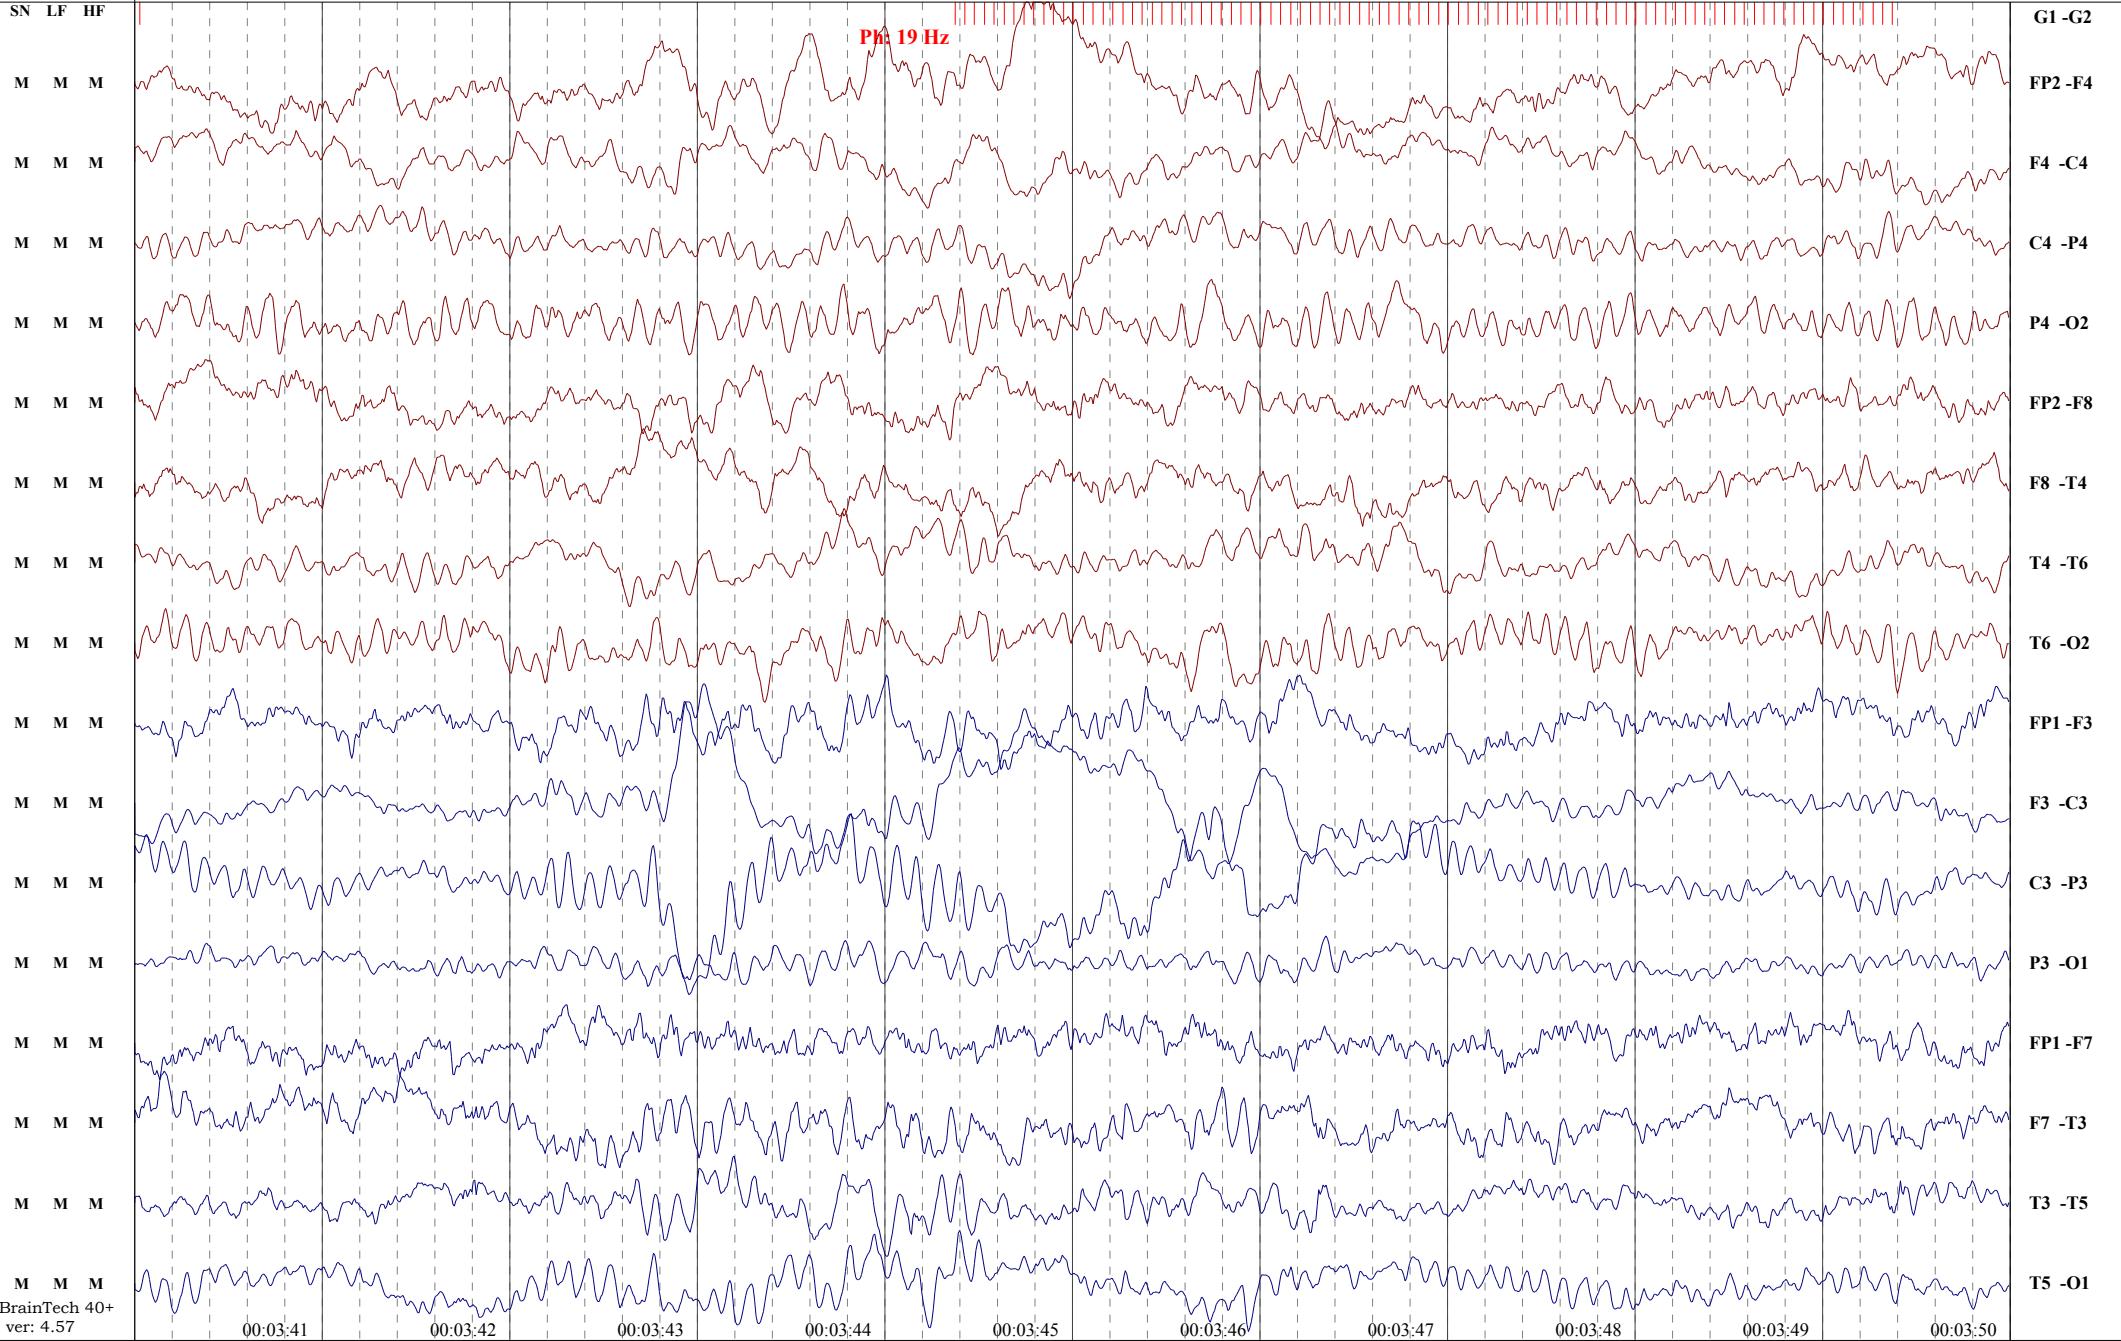


77
MRS. JAMILA BEGAM
35 Years/F

Date: 19-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 16:46:49
Page:24/27
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

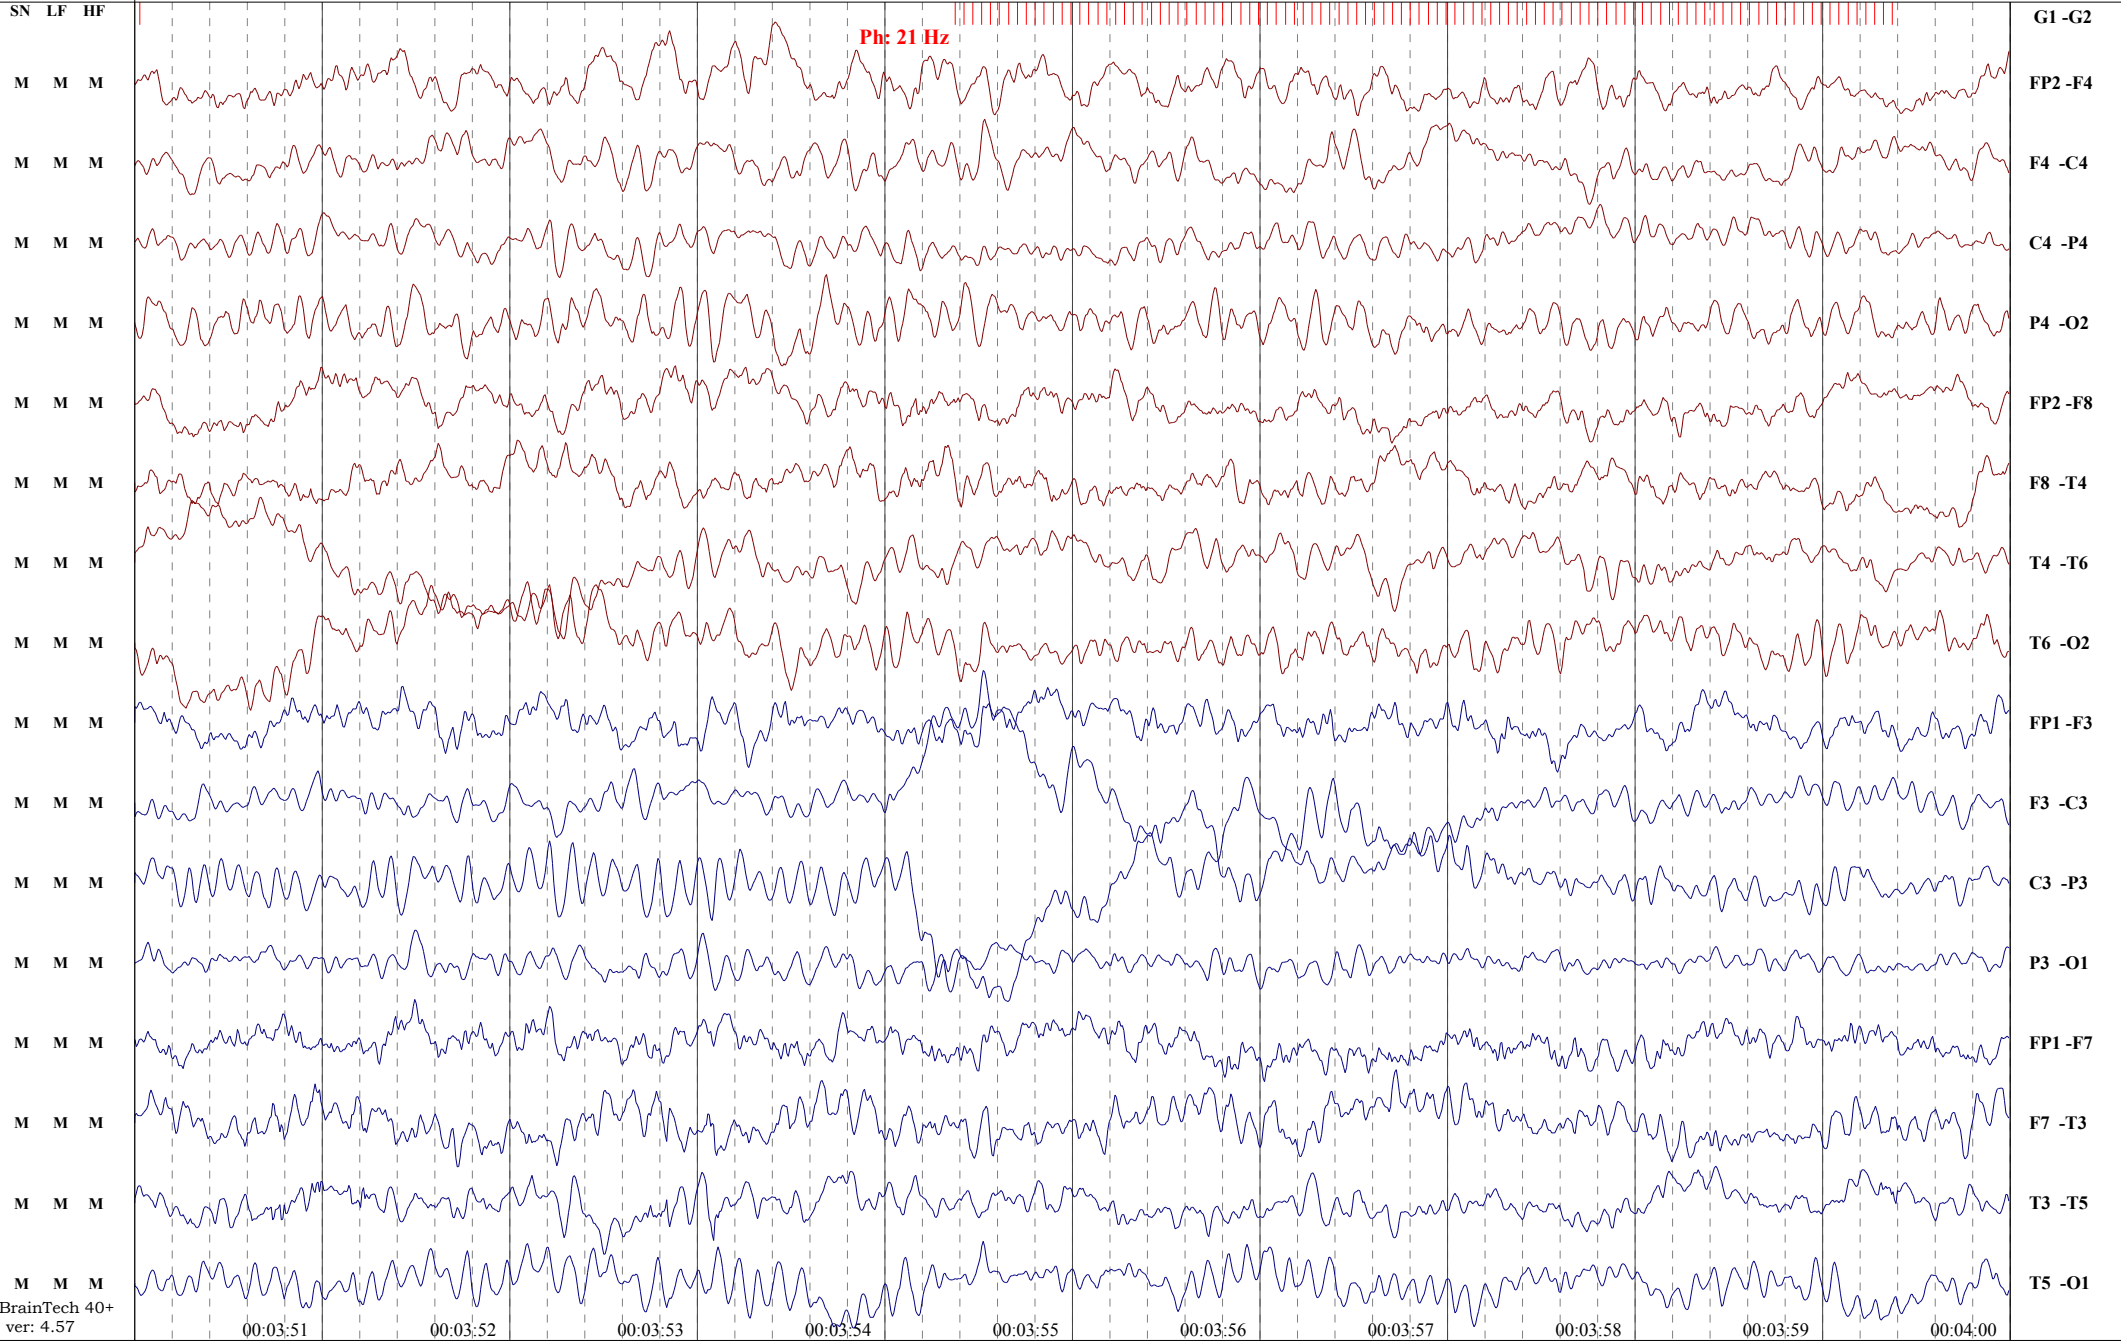

77
MRS. JAMILA BEGAM
35 Years/F


Date: 19-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 16:46:59
Page:25/27
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

Photic OFF

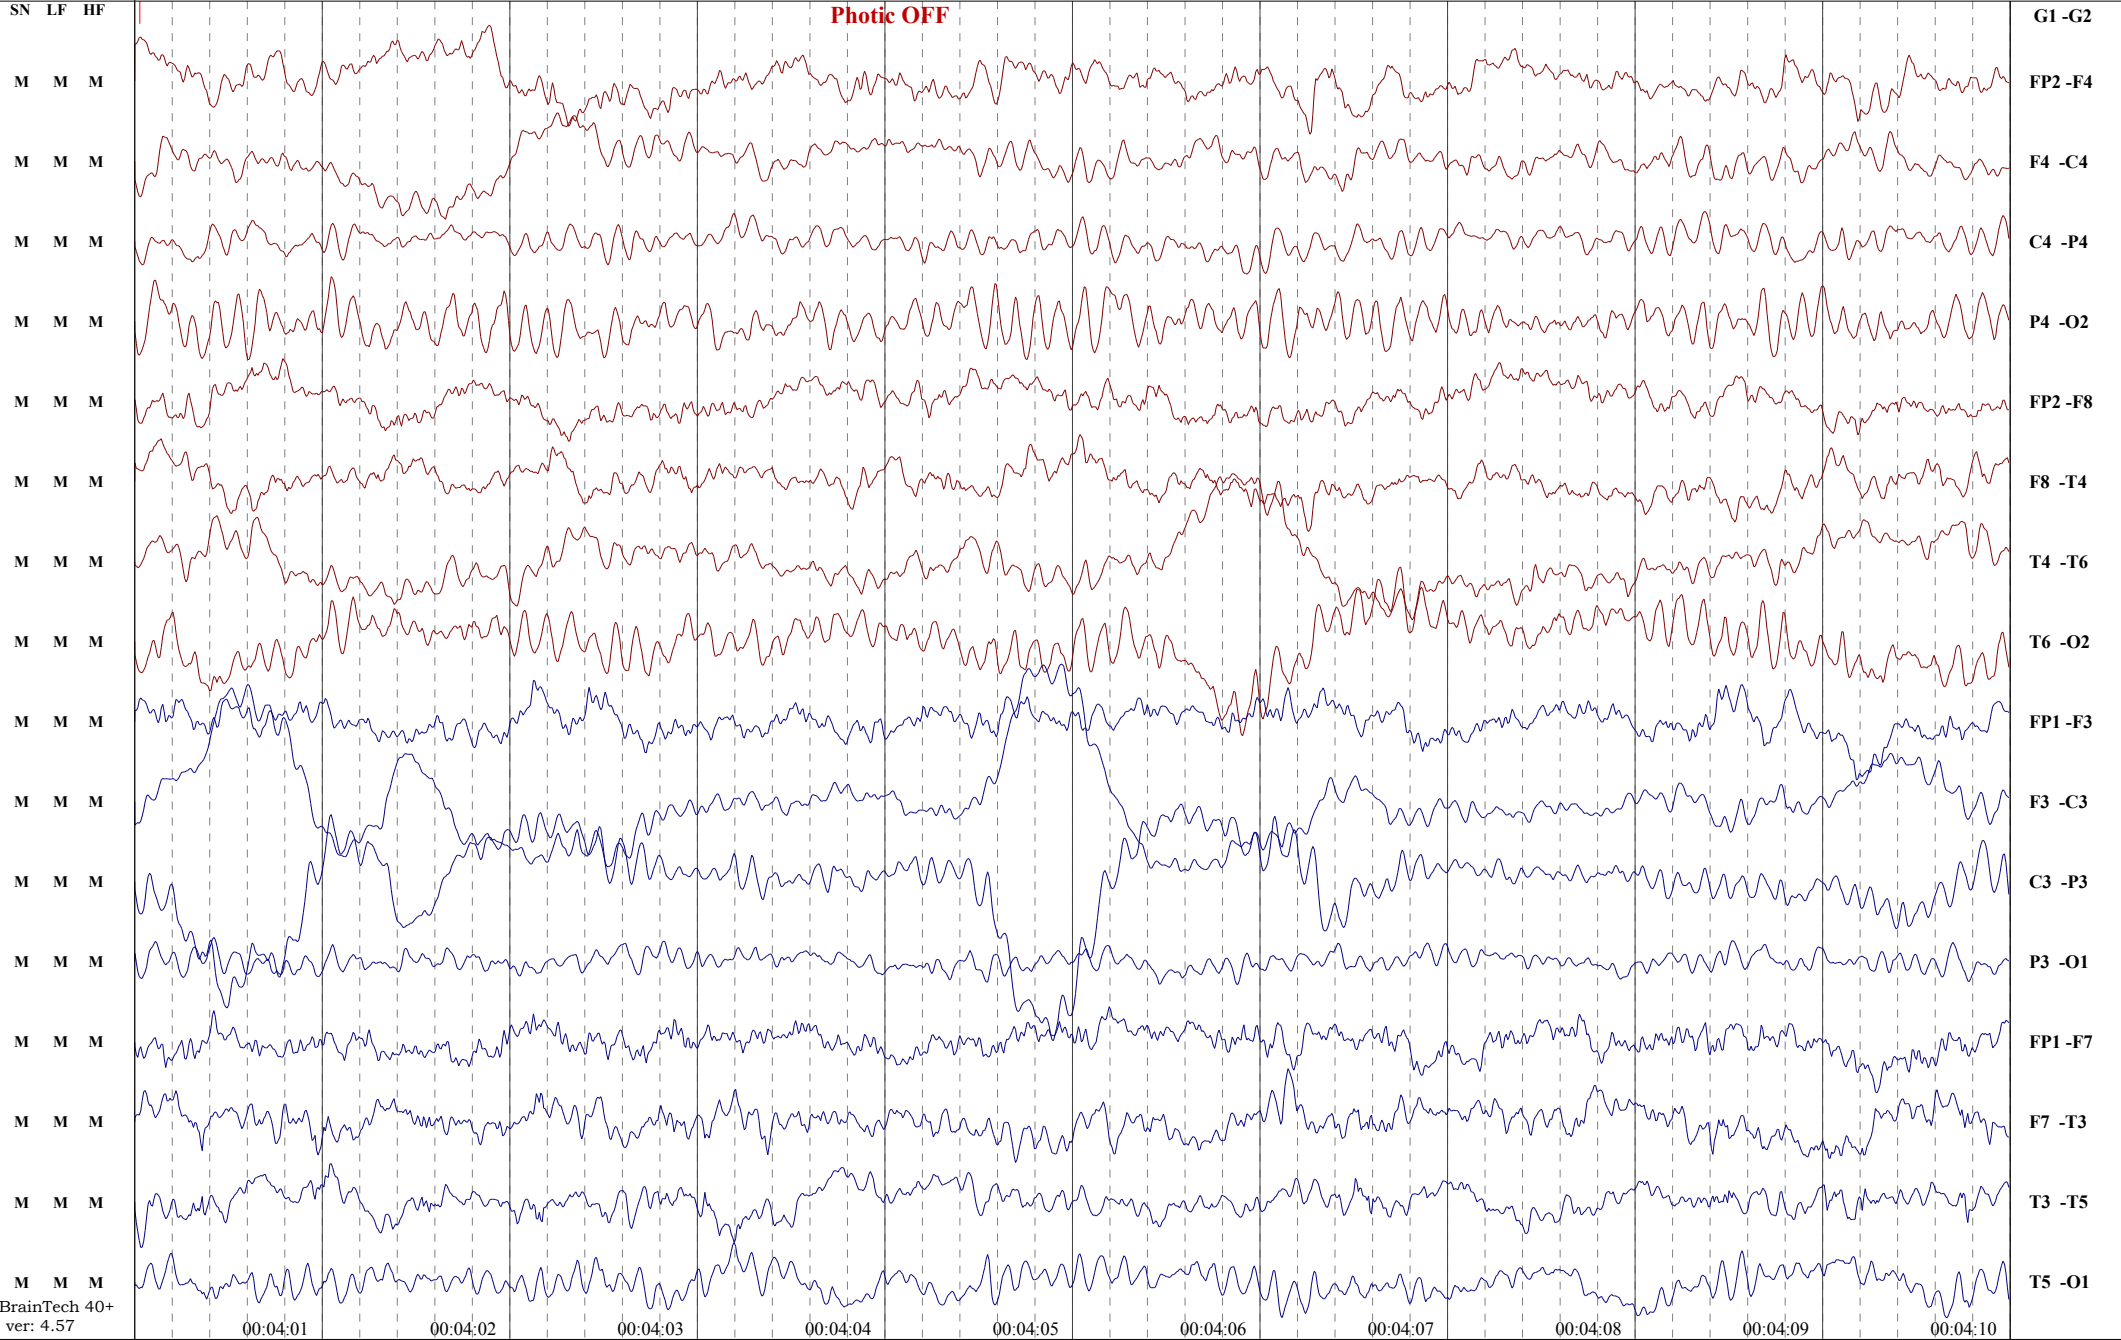


77
MRS. JAMILA BEGAM
35 Years/F

Date: 19-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 16:47:09
Page:26/27
Notch: ON

Ref:DR. R. PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

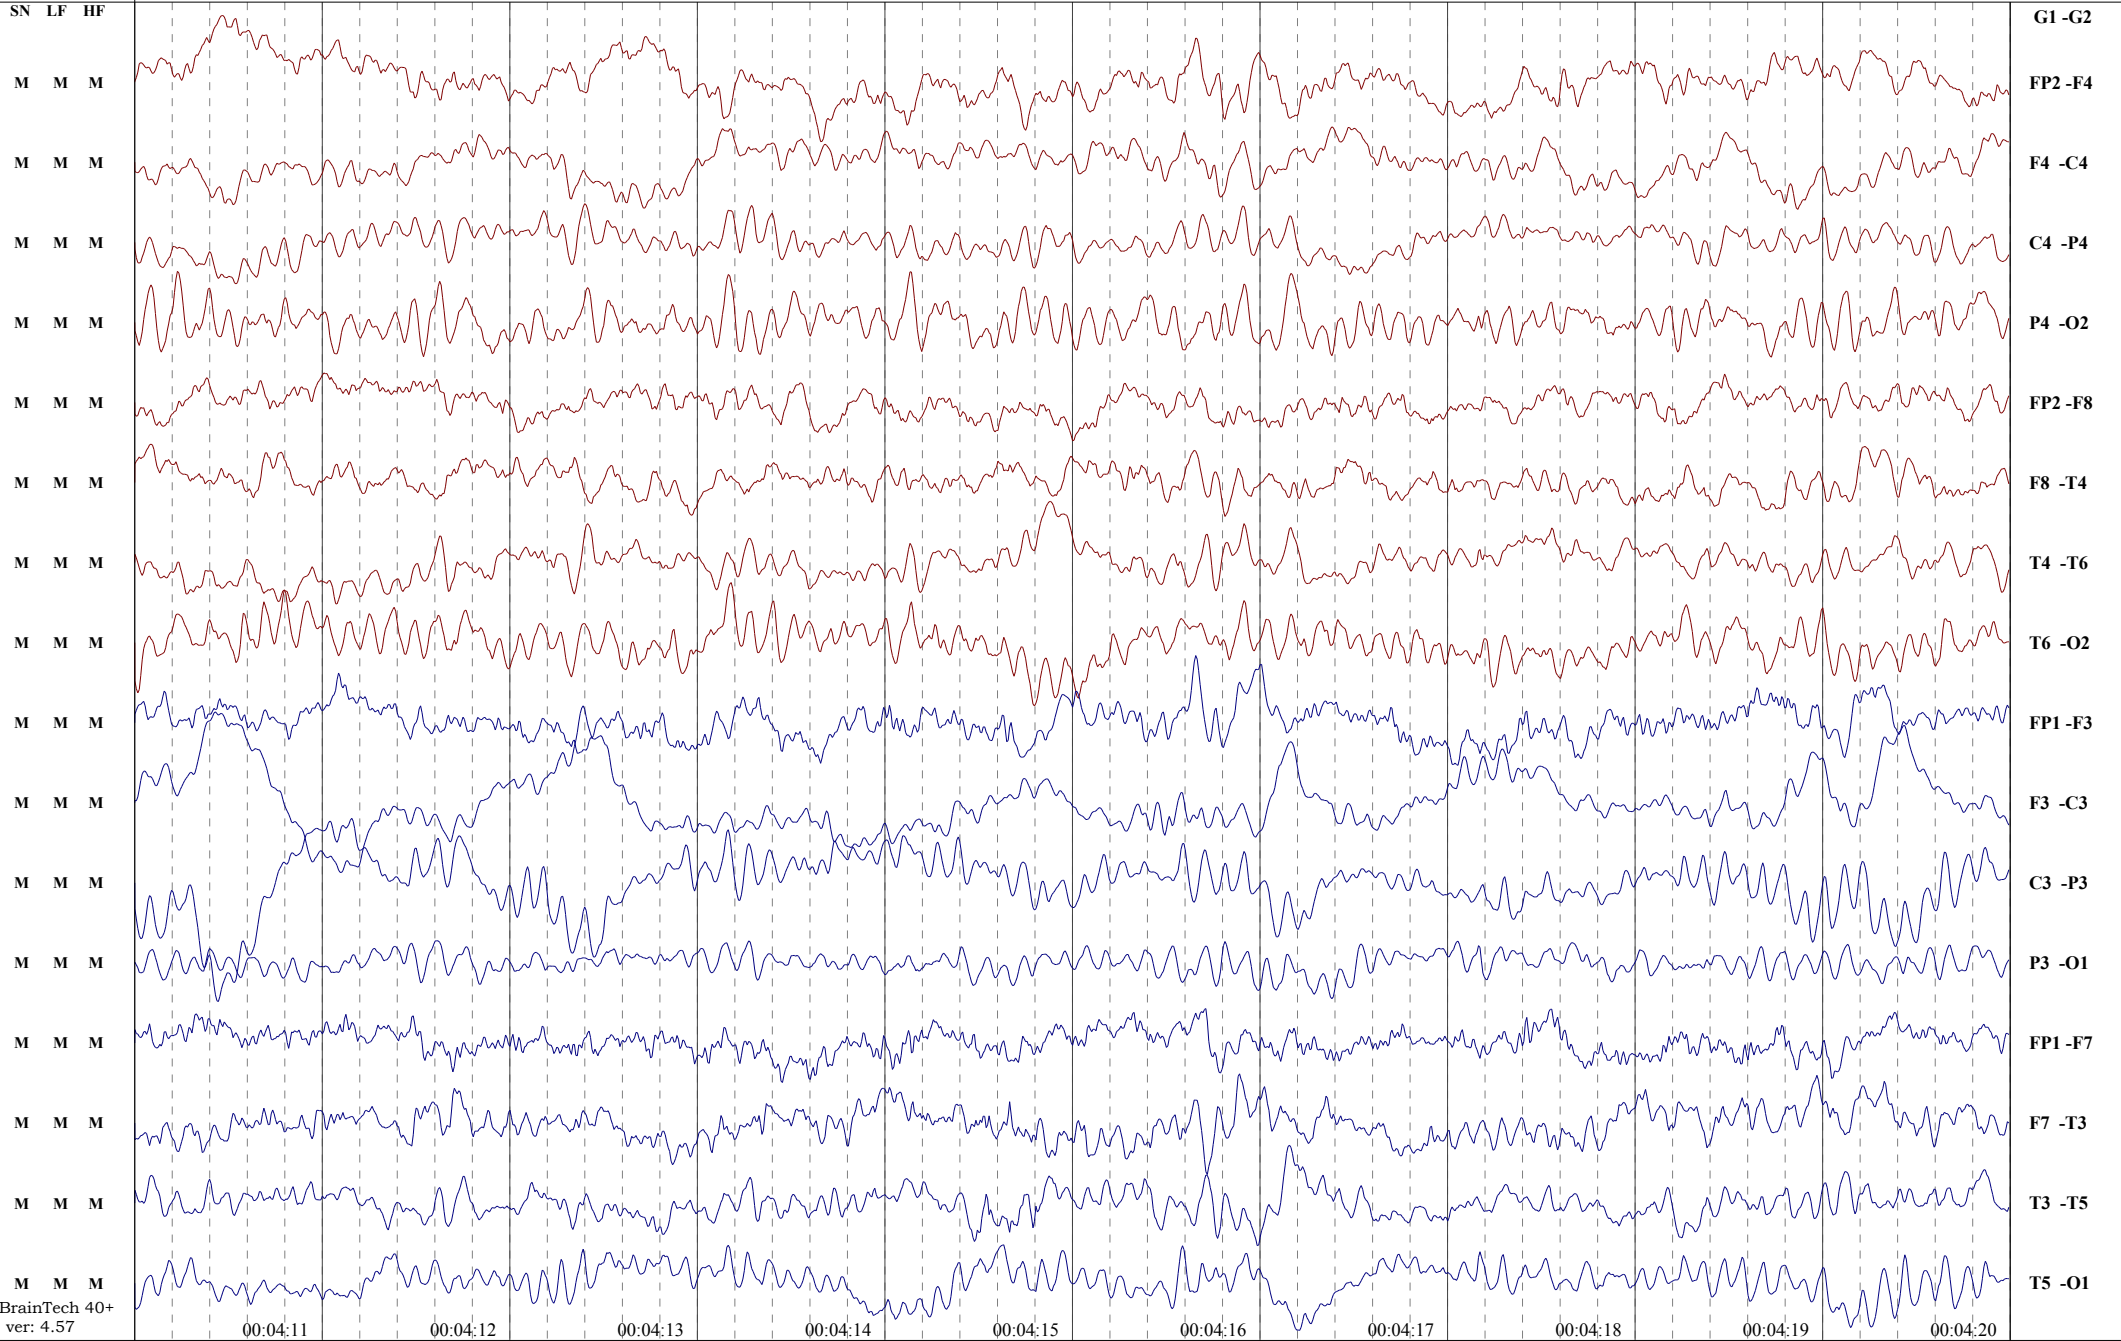

<div>Clarity</div>			PRATHAM HOSPITAL																	
77			Date: 19-Aug-2023			Speed : 30 mm/S			Time: 16:47:11			Ref:DR. R. PANDEY								
MRS. JAMILA BEGAM			Type: ANALYSIS			Sen : 7.5 uV/mm			Page:27/27			Dr. : DR. VIJENDRA PAINKARA								
35 Years/F			BIPOLAR LONGITUDNAL			Filter : 1 Hz - 70 Hz			Notch: ON			Tech:								
SN	LF	HF																		G1 -G2
M	M	M																		FP2 -F4
M	M	M																		F4 -C4
M	M	M																		C4 -P4
M	M	M																		P4 -O2
M	M	M																		FP2 -F8
M	M	M																		F8 -T4
M	M	M																		T4 -T6
M	M	M																		T6 -O2
M	M	M																		FP1 -F3
M	M	M																		F3 -C3
M	M	M																		C3 -P3
M	M	M																		P3 -O1
M	M	M																		FP1 -F7
M	M	M																		F7 -T3
M	M	M																		T3 -T5
M	M	M																		T5 -O1
BrainTech 40+ ver: 4.57																				