

Clarity

PRATHAM HOSPITAL


100
MR. SURENDRA
23 Years/M

Date: 28-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 18:31:04
Page:29/43
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

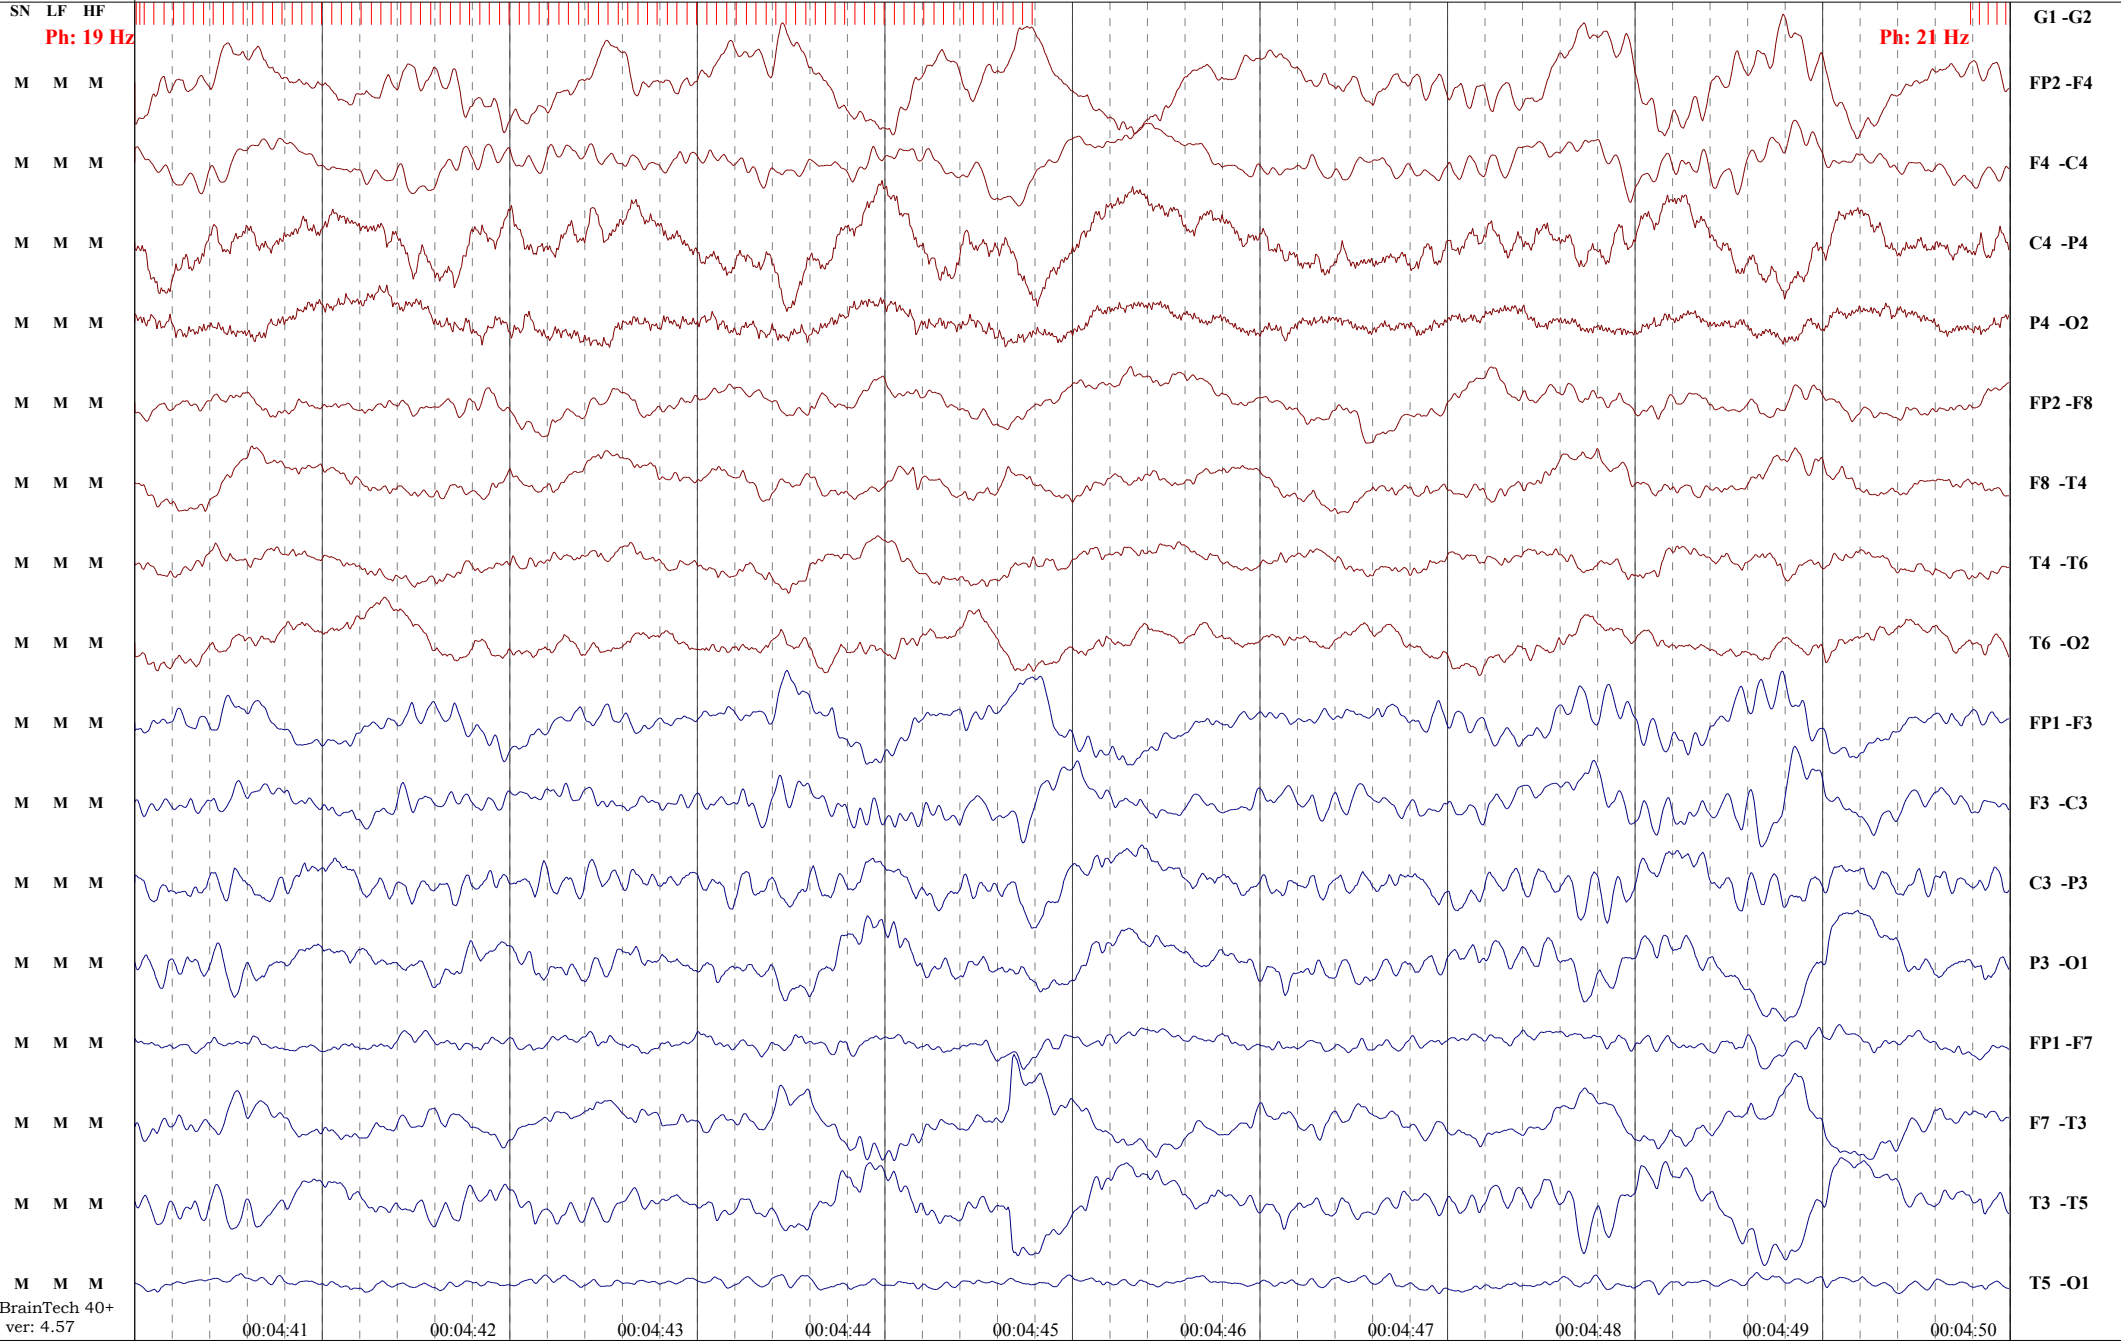


100
MR. SURENDRA
23 Years/M

Date: 28-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 18:32:54
Page:40/43
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

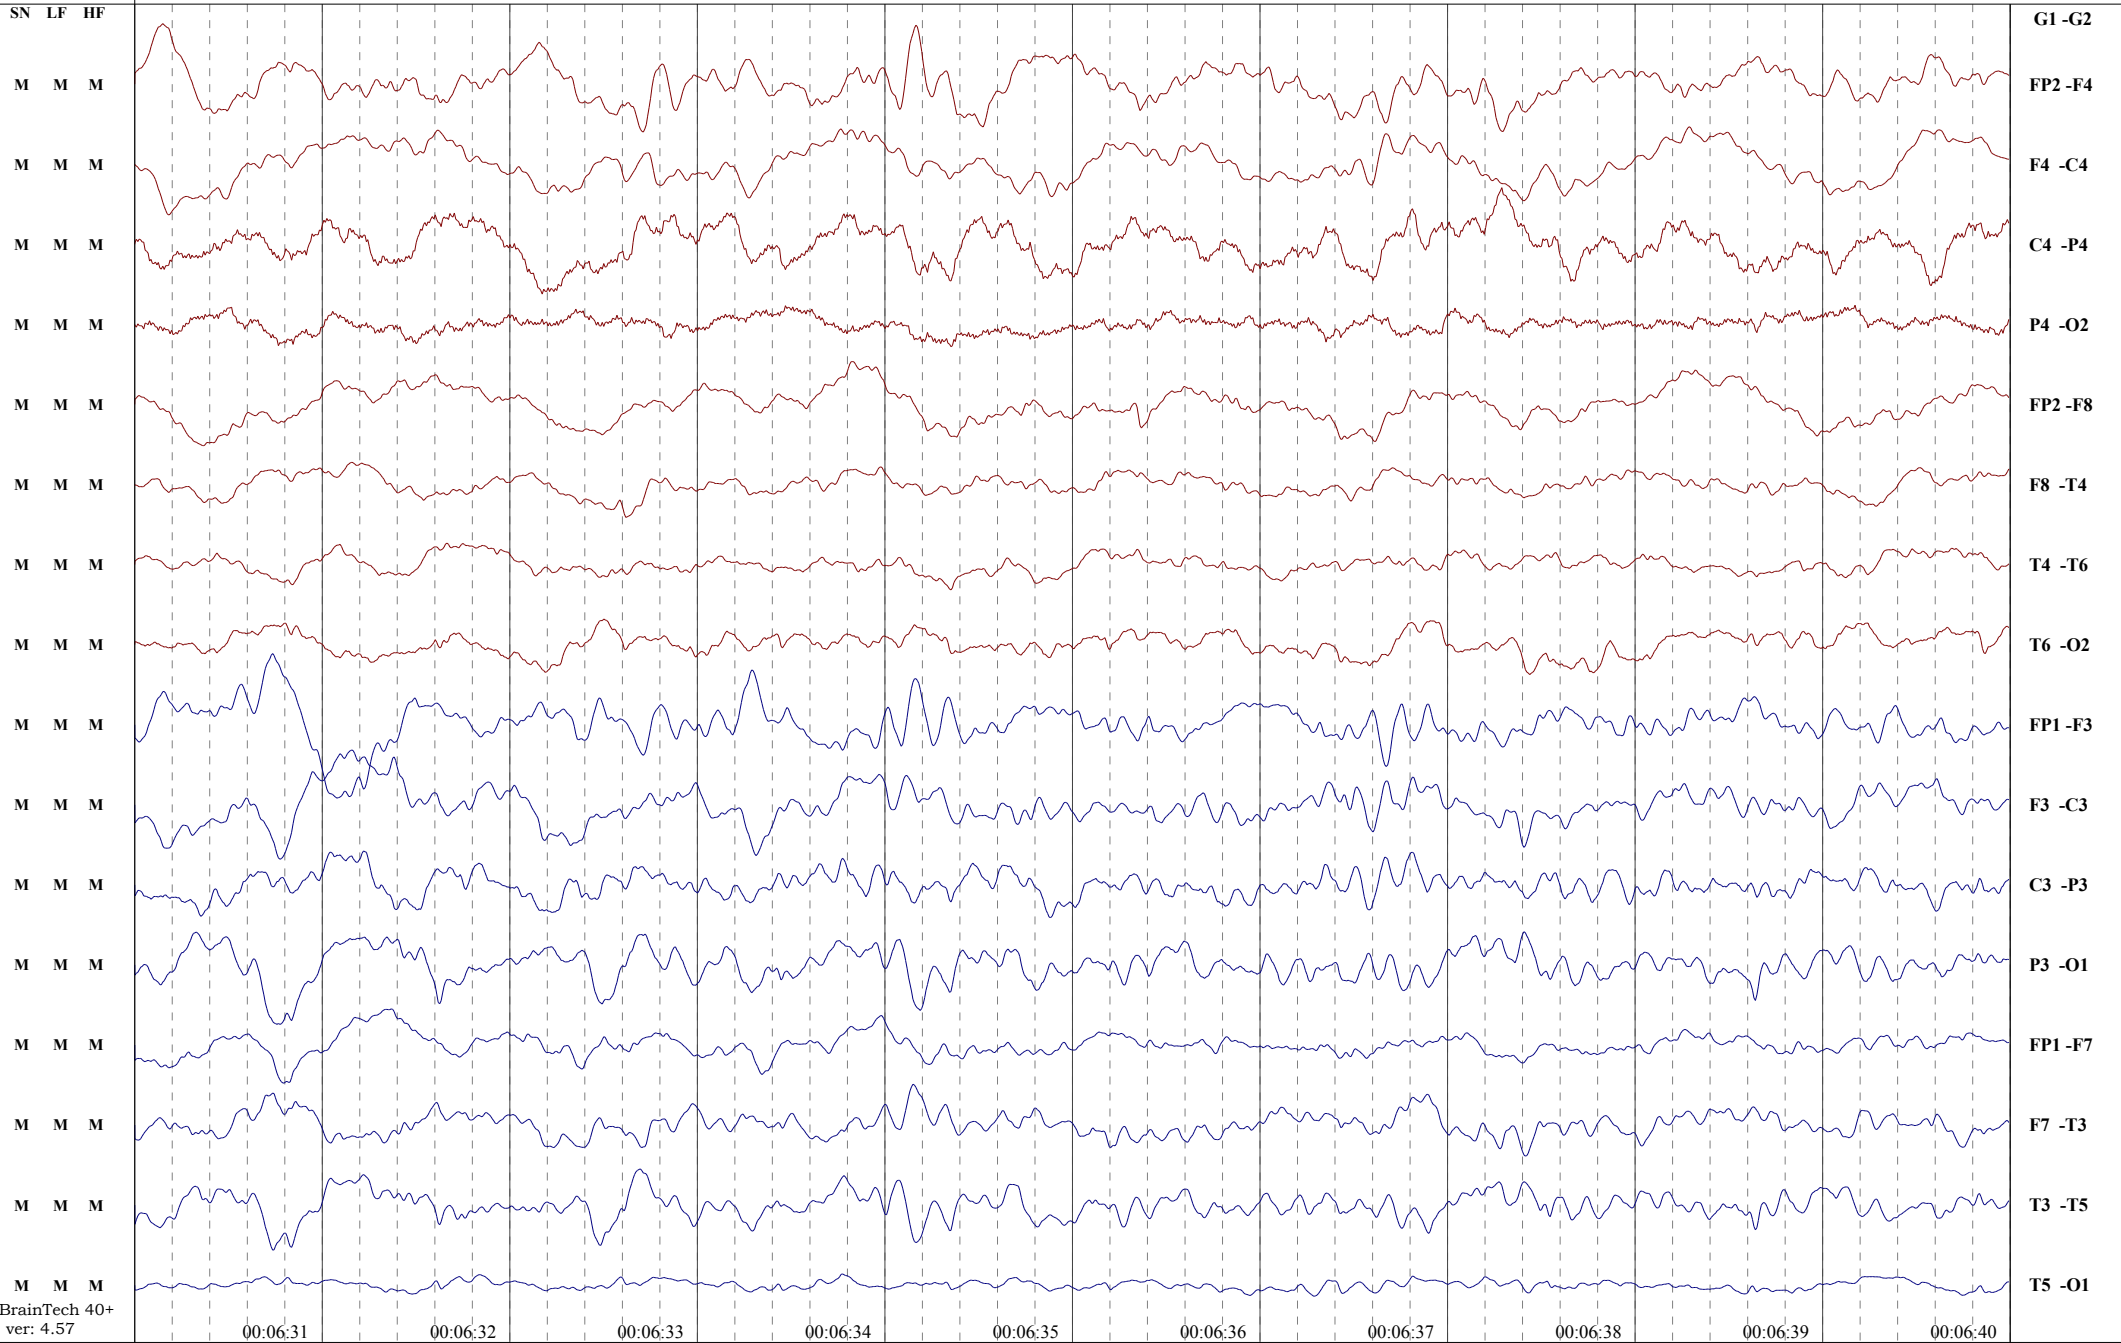

100
MR. SURENDRA
23 Years/M

Date: 28-Aug-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 18:33:14
Page:42/43
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

