


133
MRS. LAXMI KAMALSEN
73 Years/F

Date: 11-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 19:08:14
Page:1/25
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

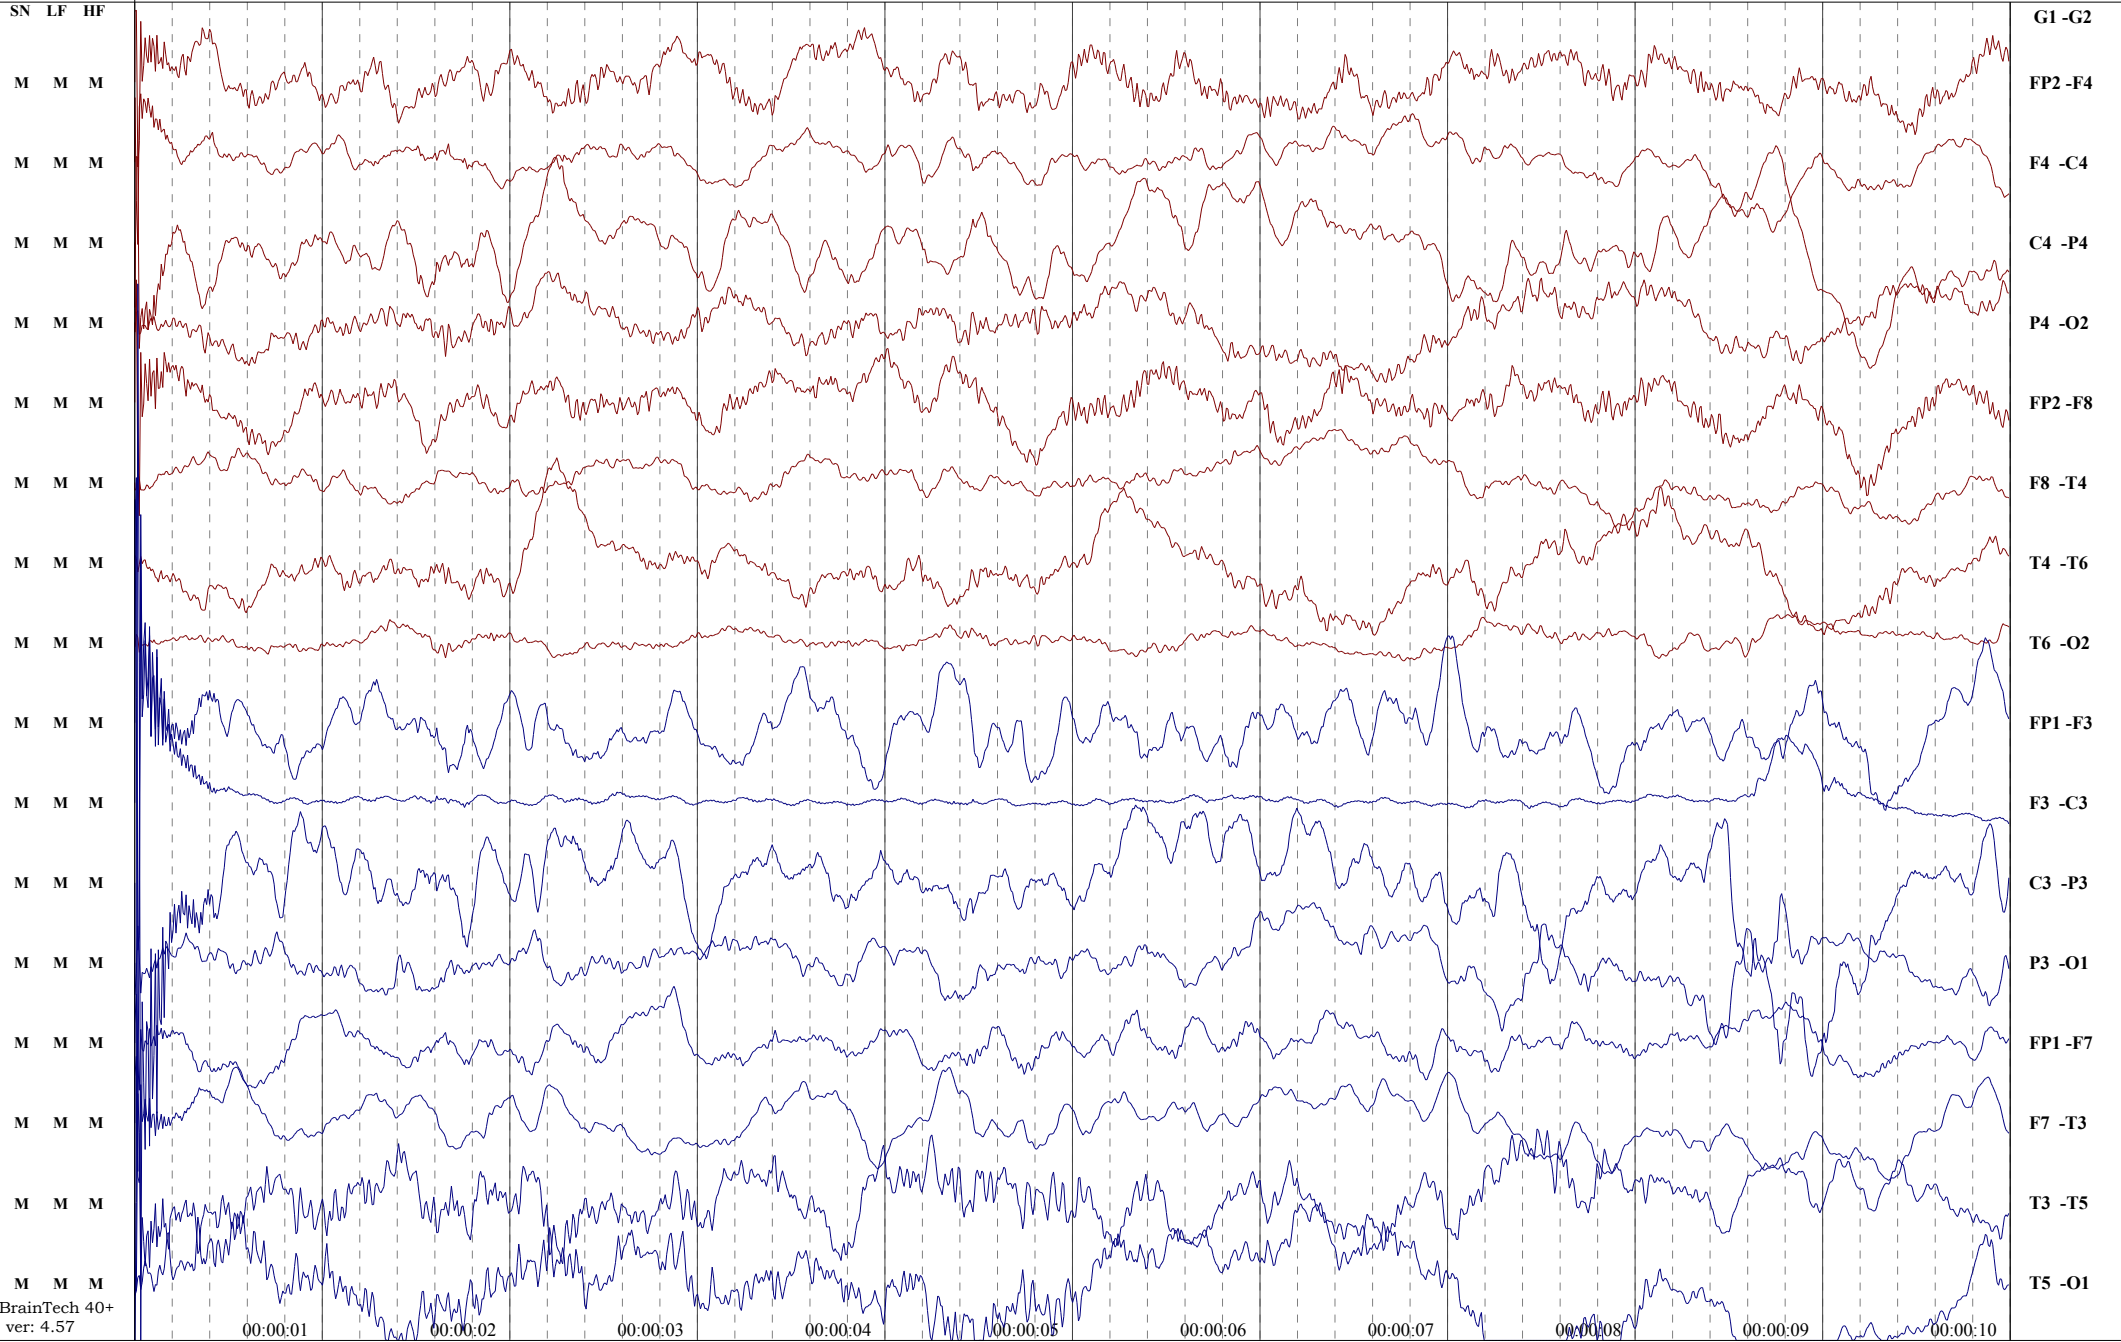


133
MRS. LAXMI KAMALSEN
73 Years/F

Date: 11-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 19:08:24
Page:2/25
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

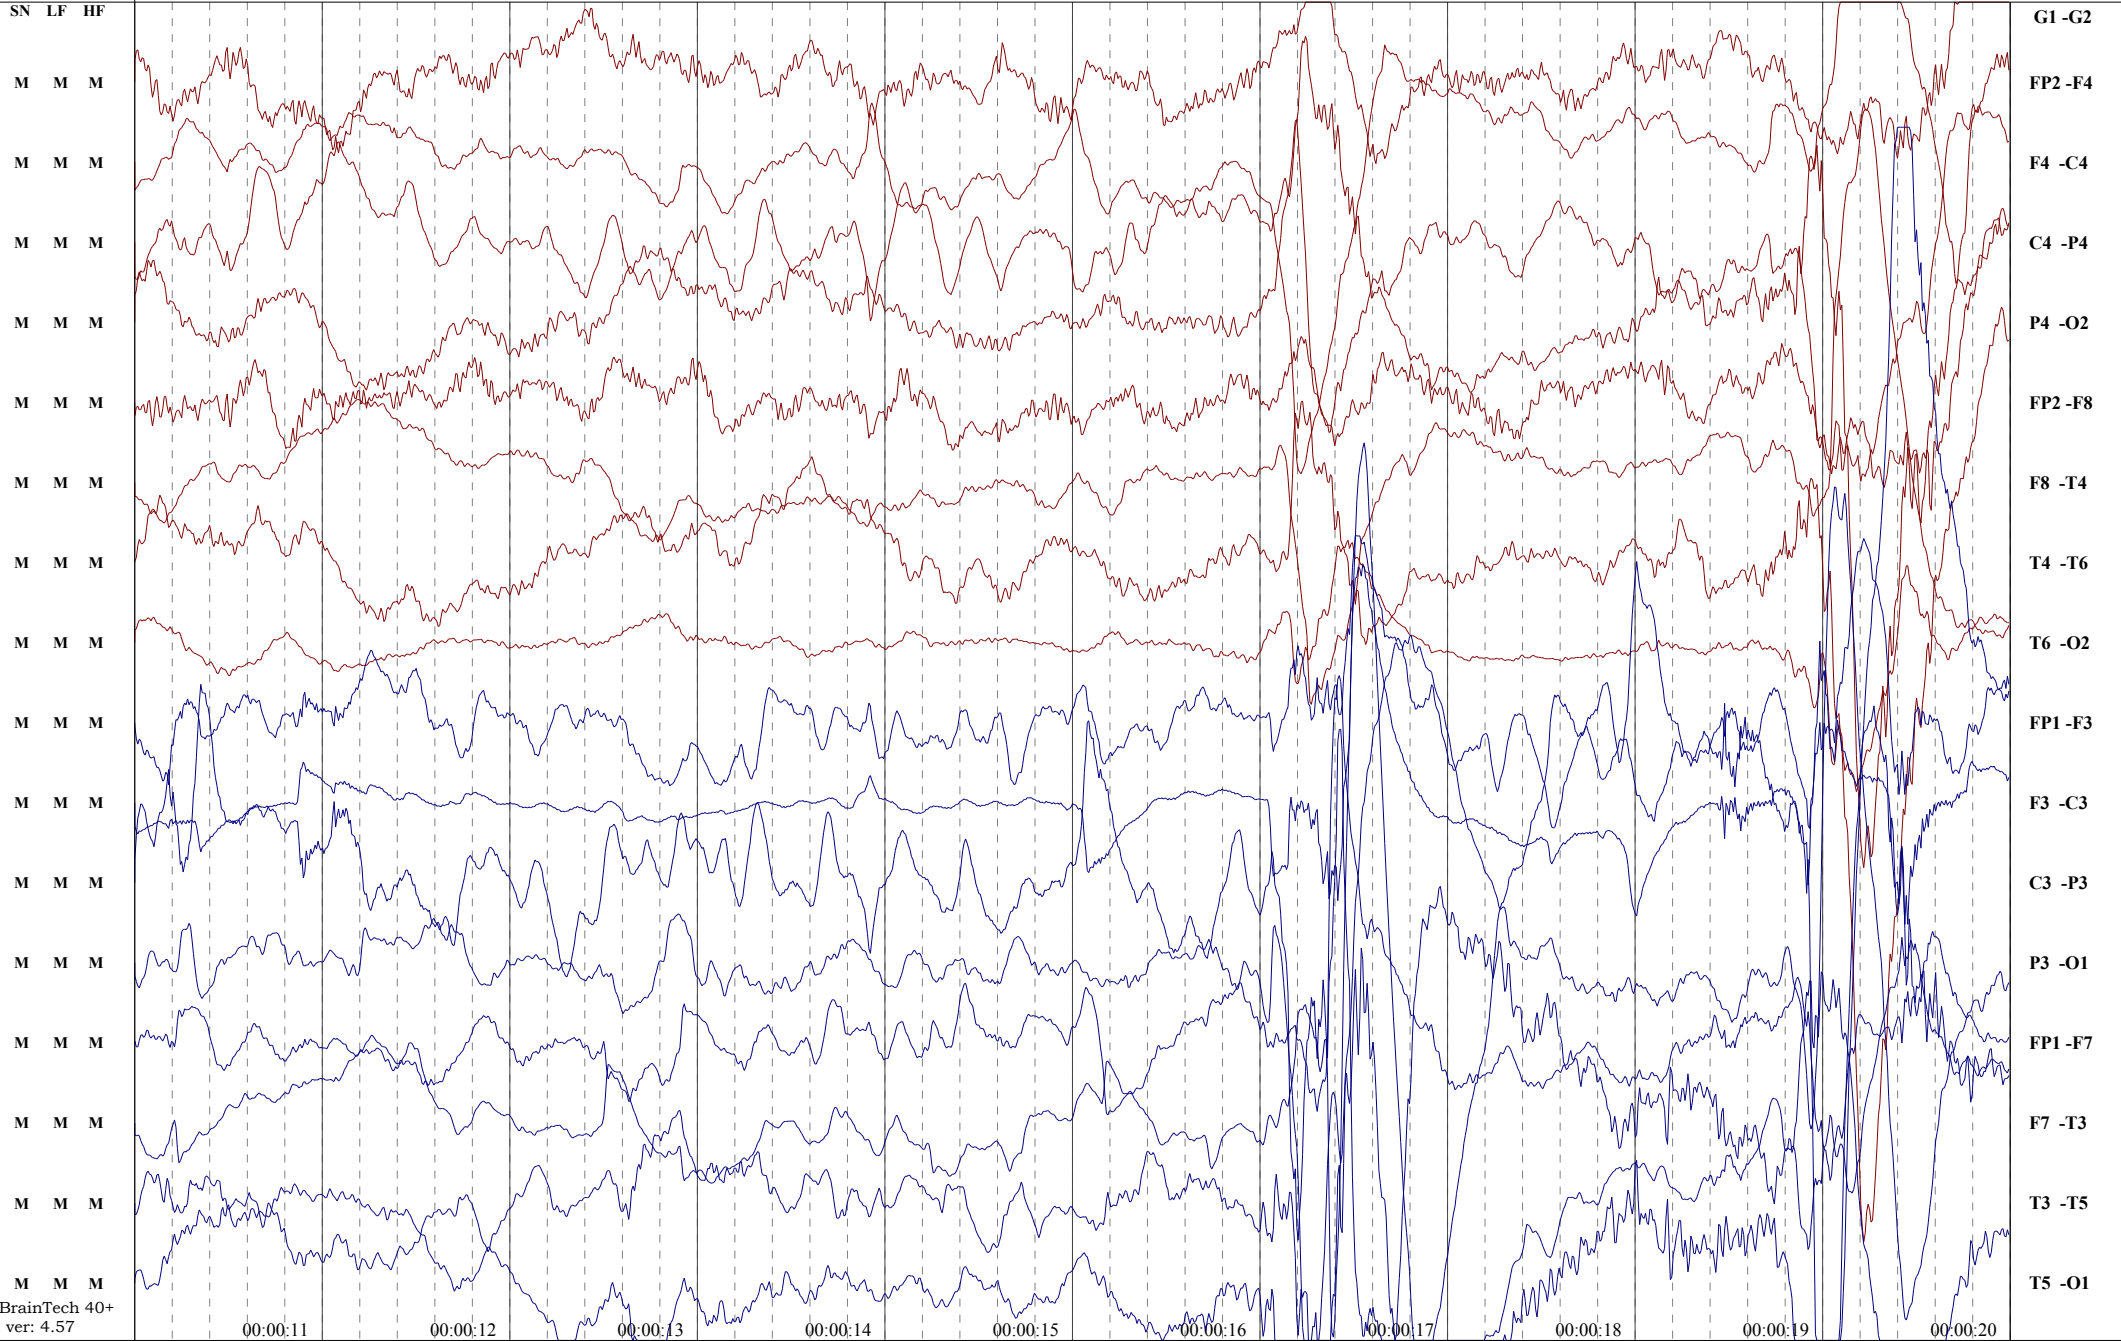


133
MRS. LAXMI KAMALSEN
73 Years/F

Date: 11-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 19:09:14
Page:7/25
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

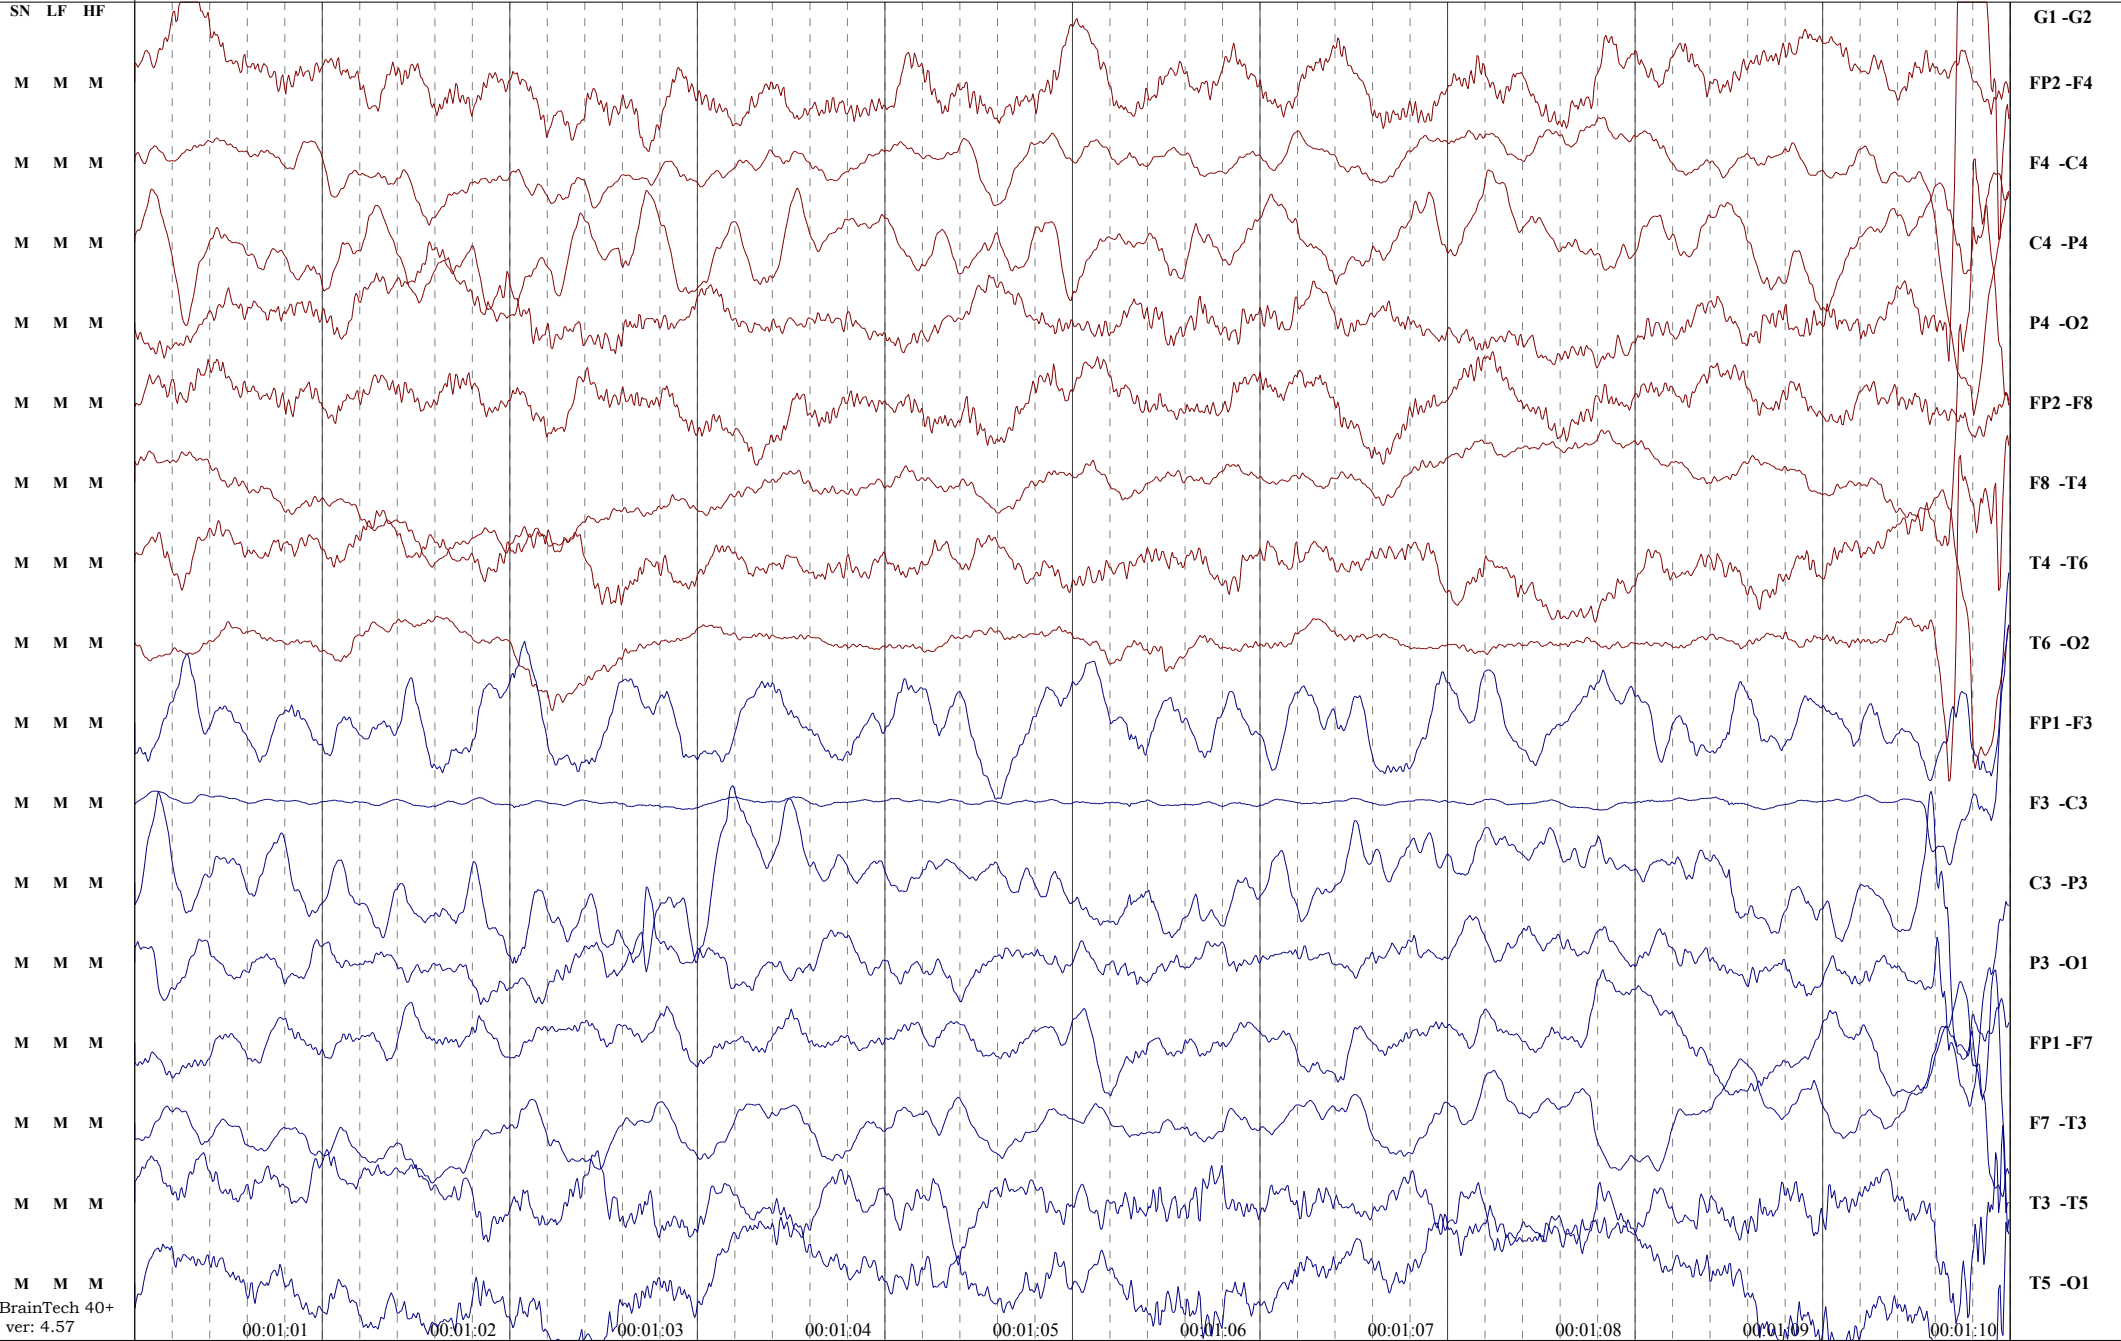


133
MRS. LAXMI KAMALSEN
73 Years/F

Date: 11-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 19:09:24
Page:8/25
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

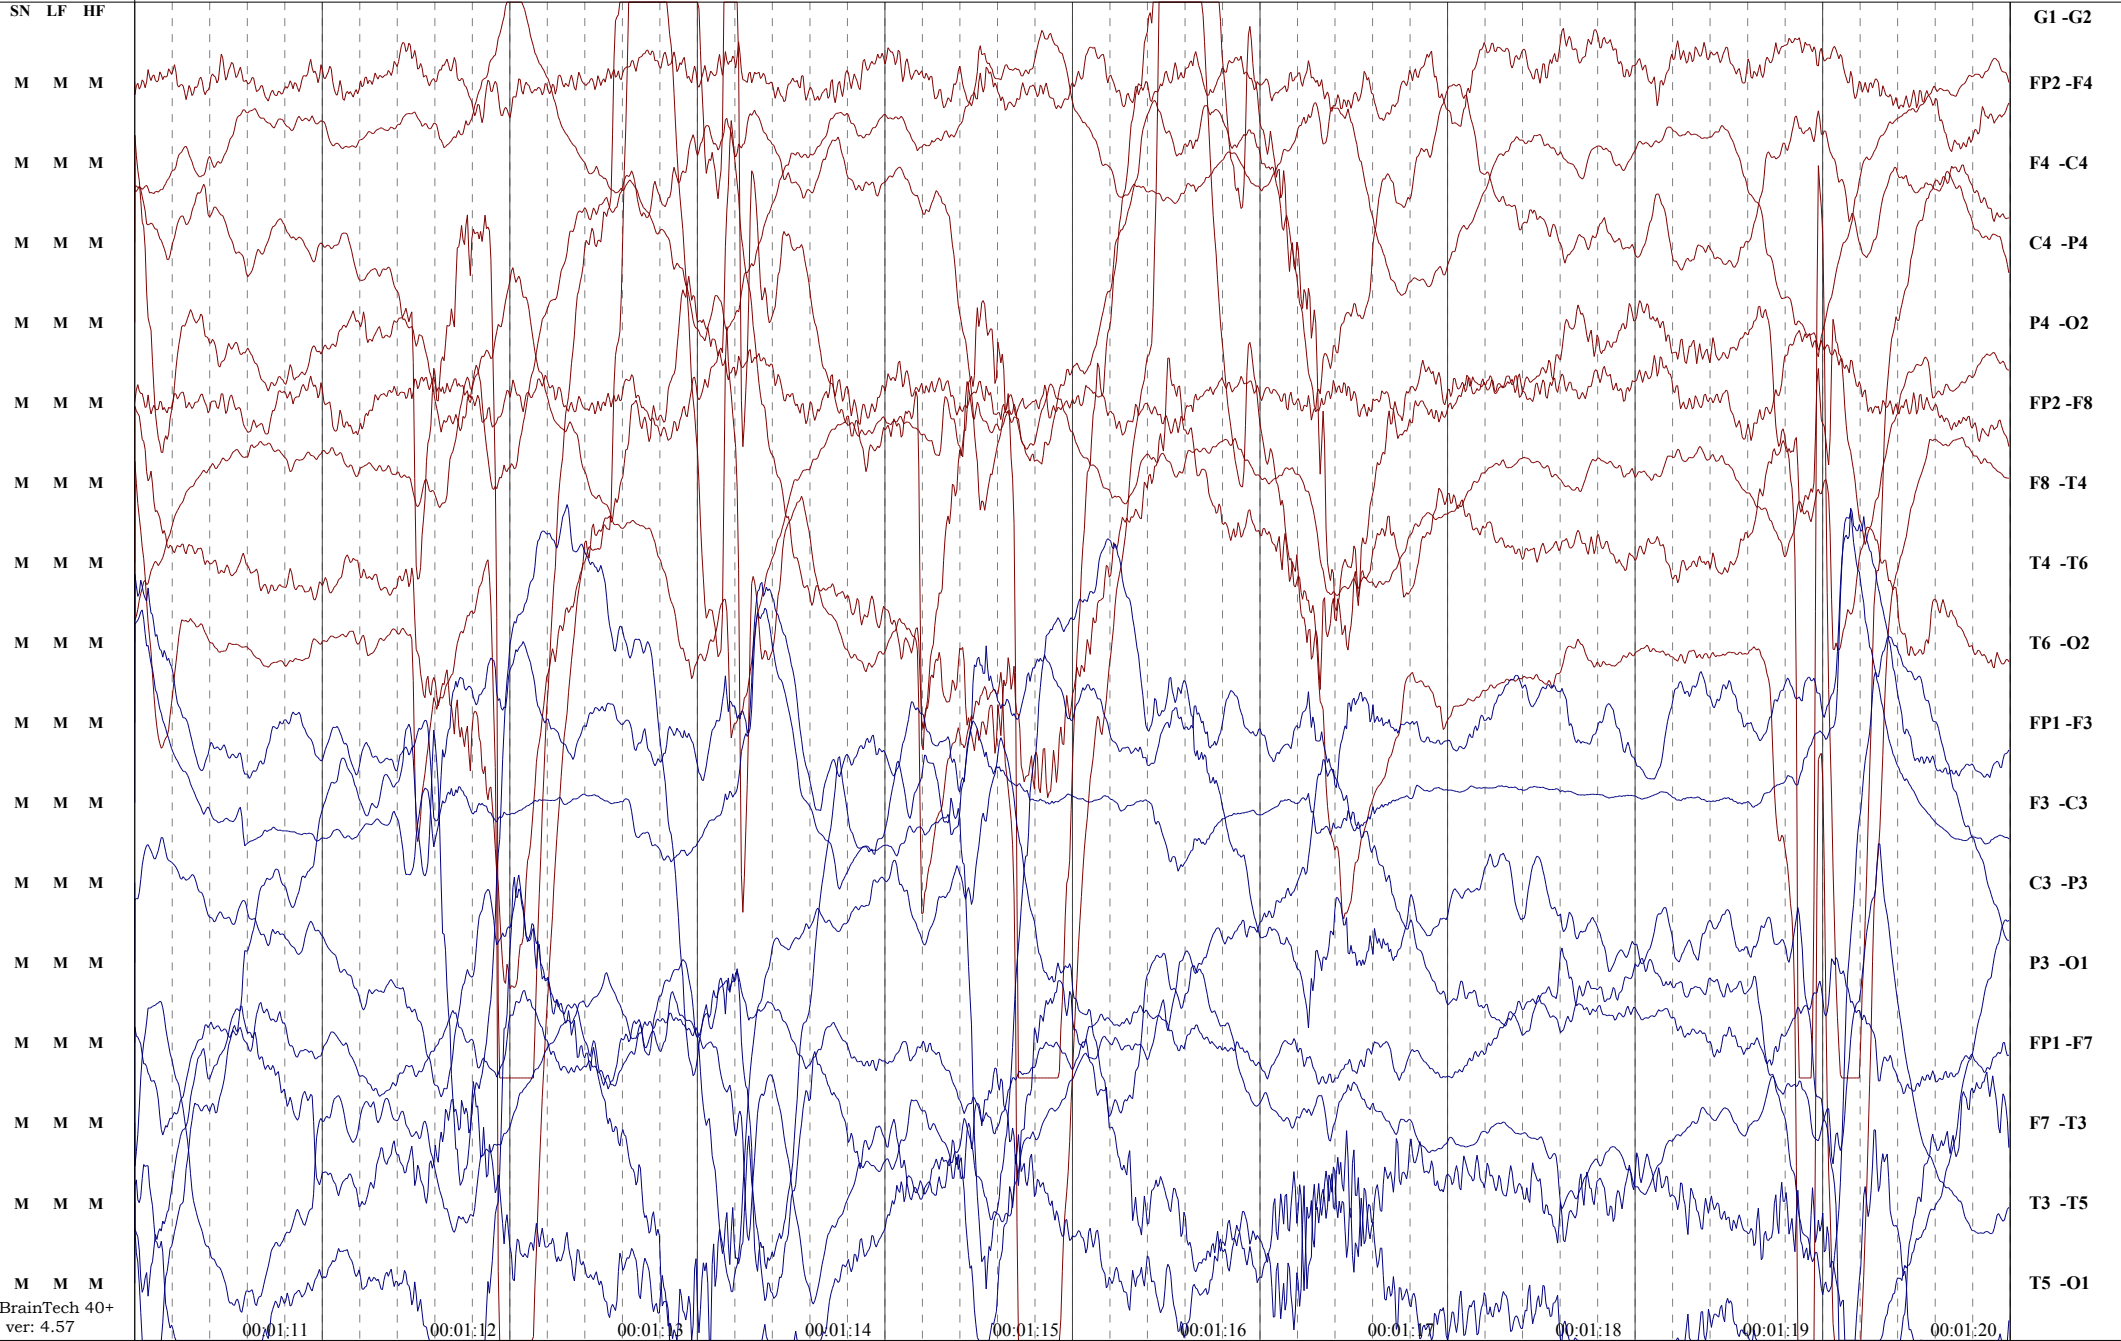


133
MRS. LAXMI KAMALSEN
73 Years/F

Date: 11-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 19:09:34
Page:9/25
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

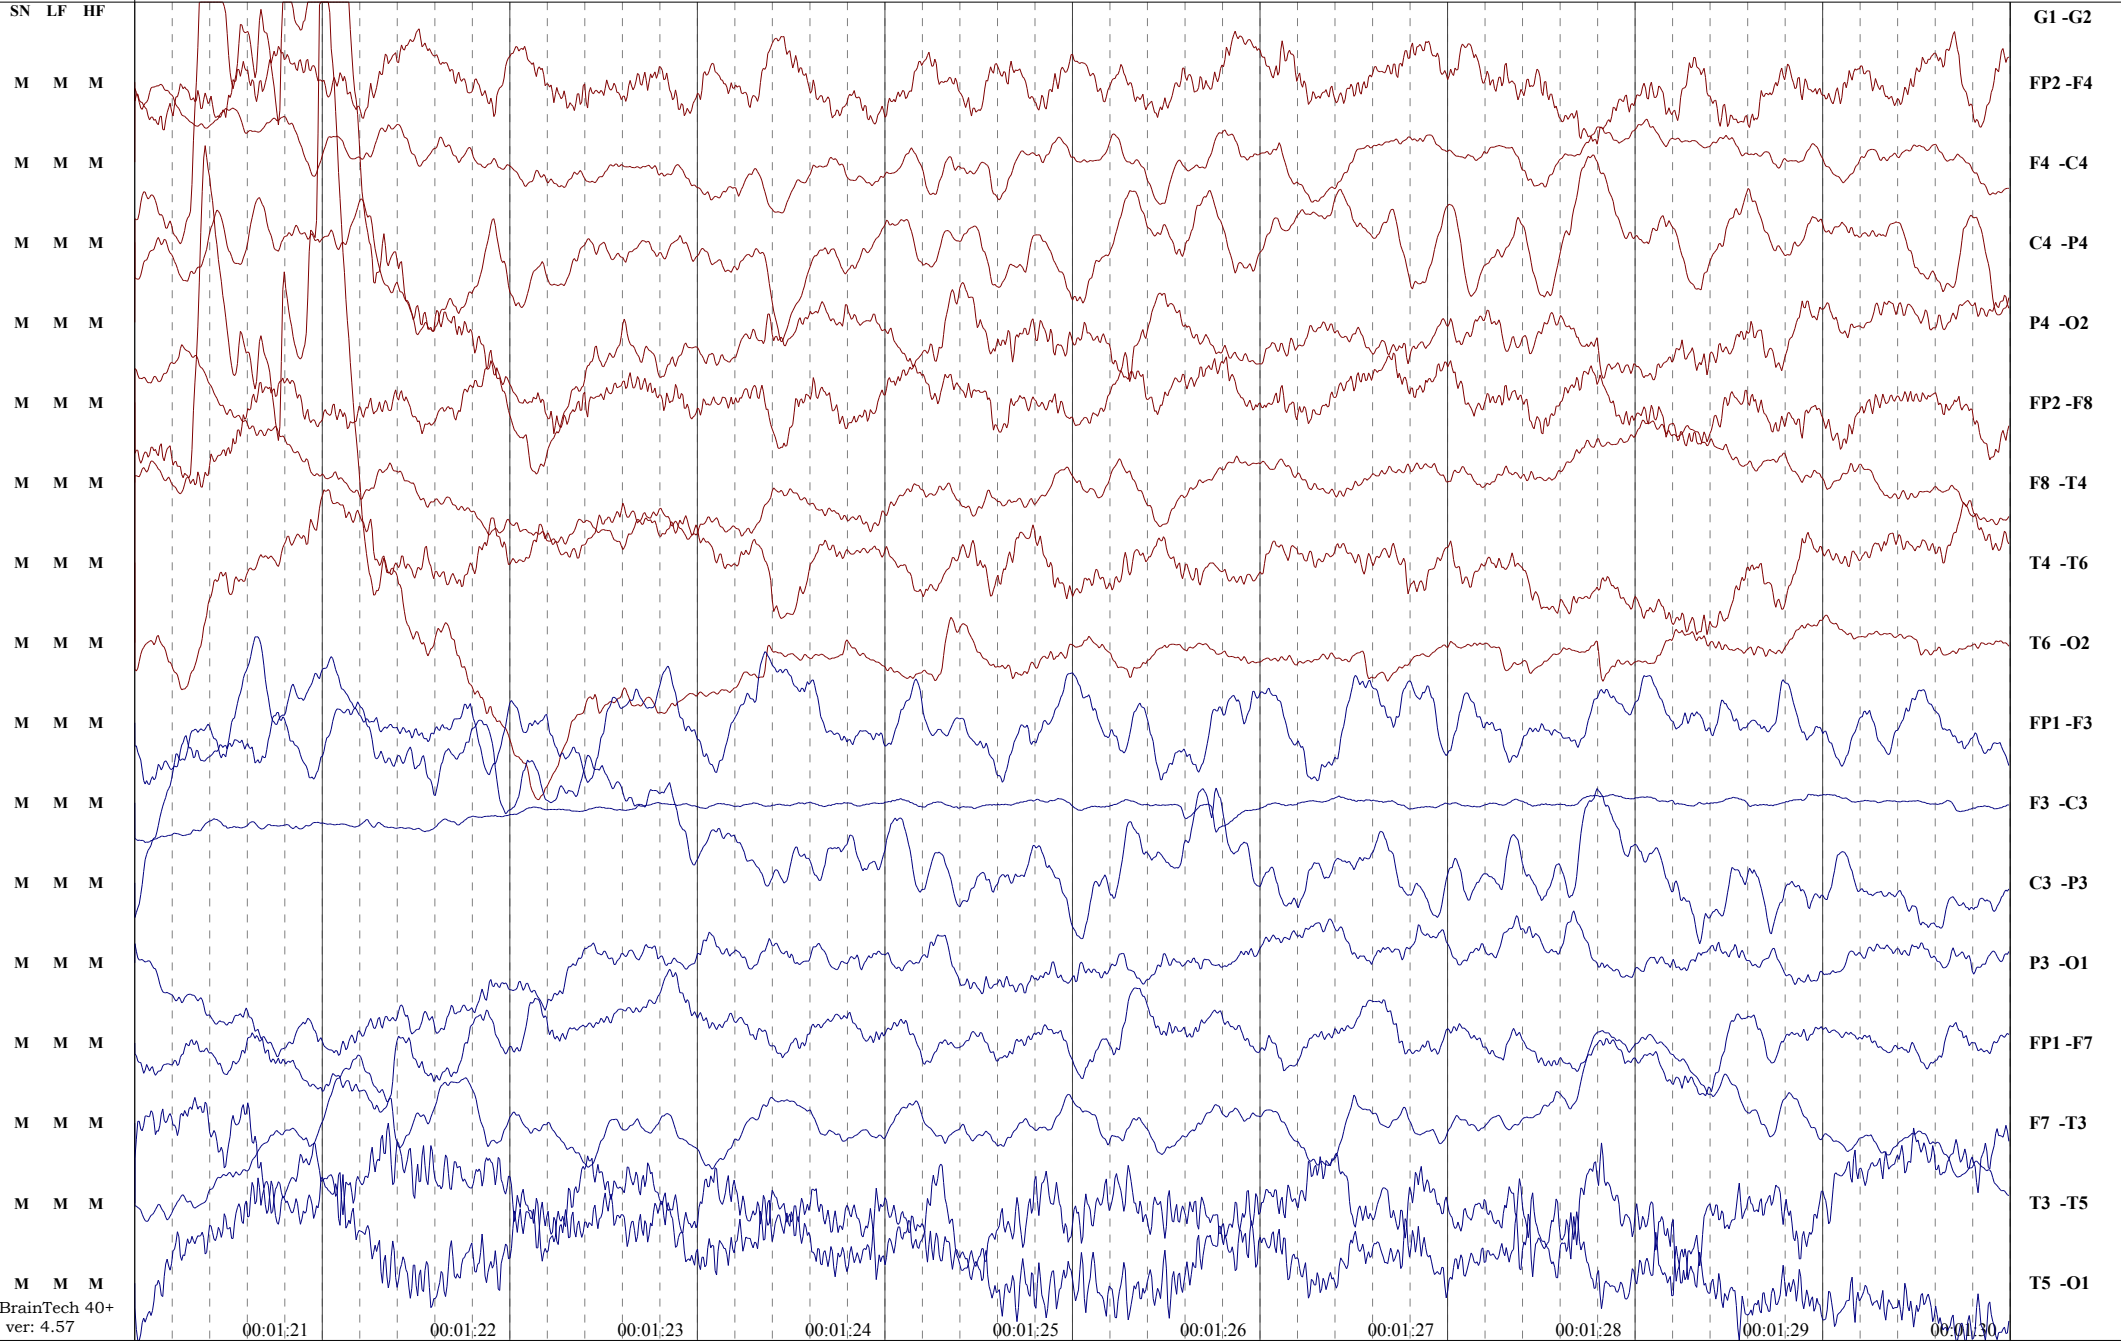

| | |
|--|-------------------------|
| | PRATHAM HOSPITAL |
|--|-------------------------|

Clarity

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:




133
MRS. LAXMI KAMALSEN
73 Years/F

Date: 11-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 19:10:04
Page:12/25
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

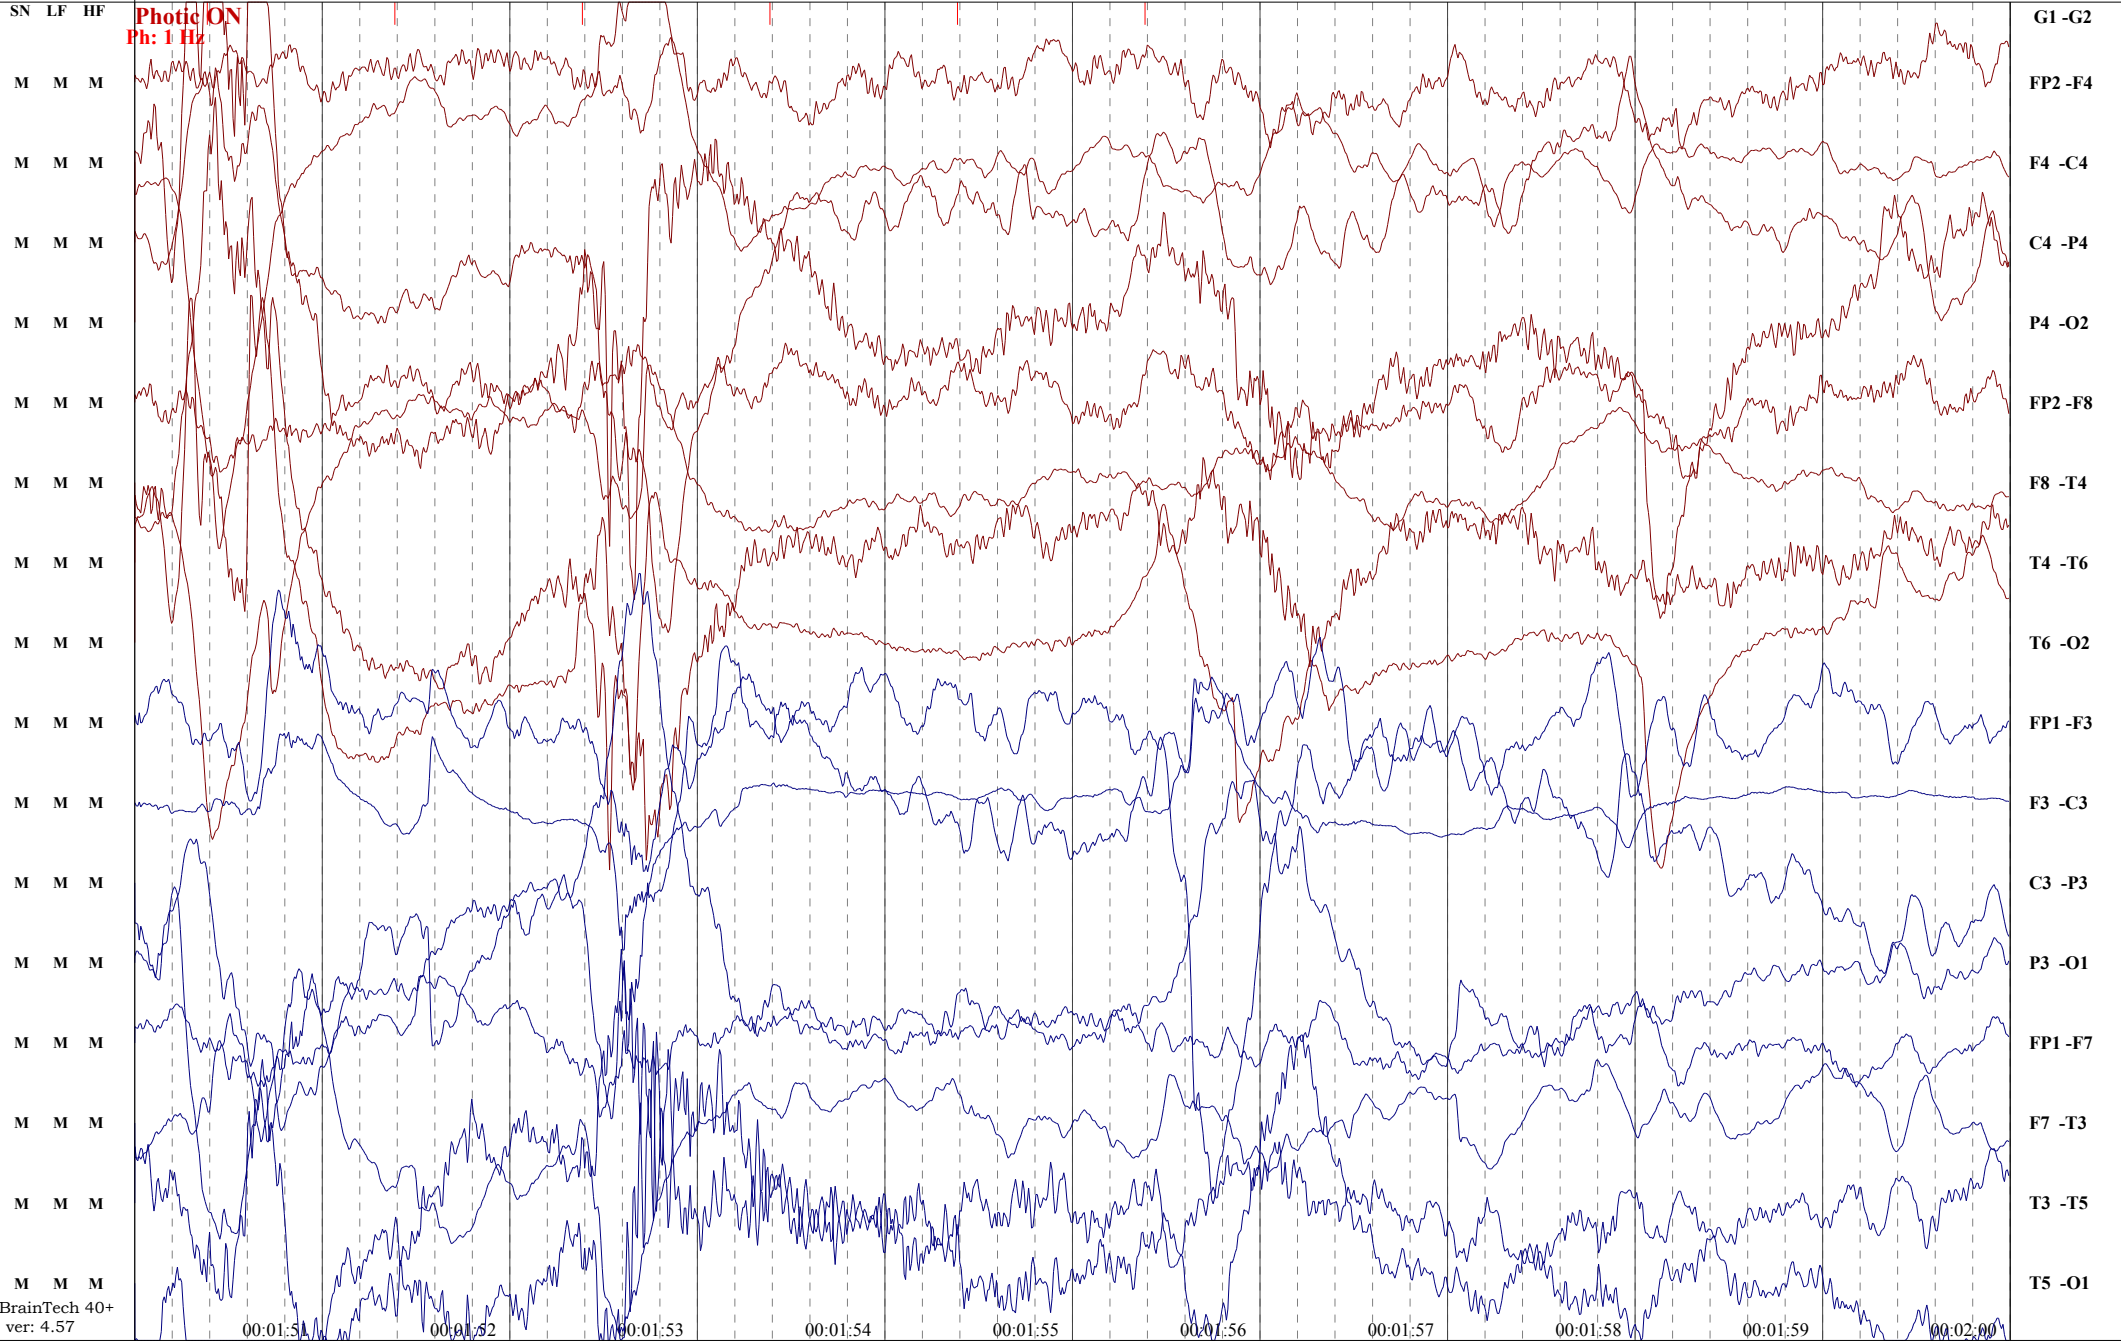


133
MRS. LAXMI KAMALSEN
73 Years/F

Date: 11-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 19:10:24
Page:14/25
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

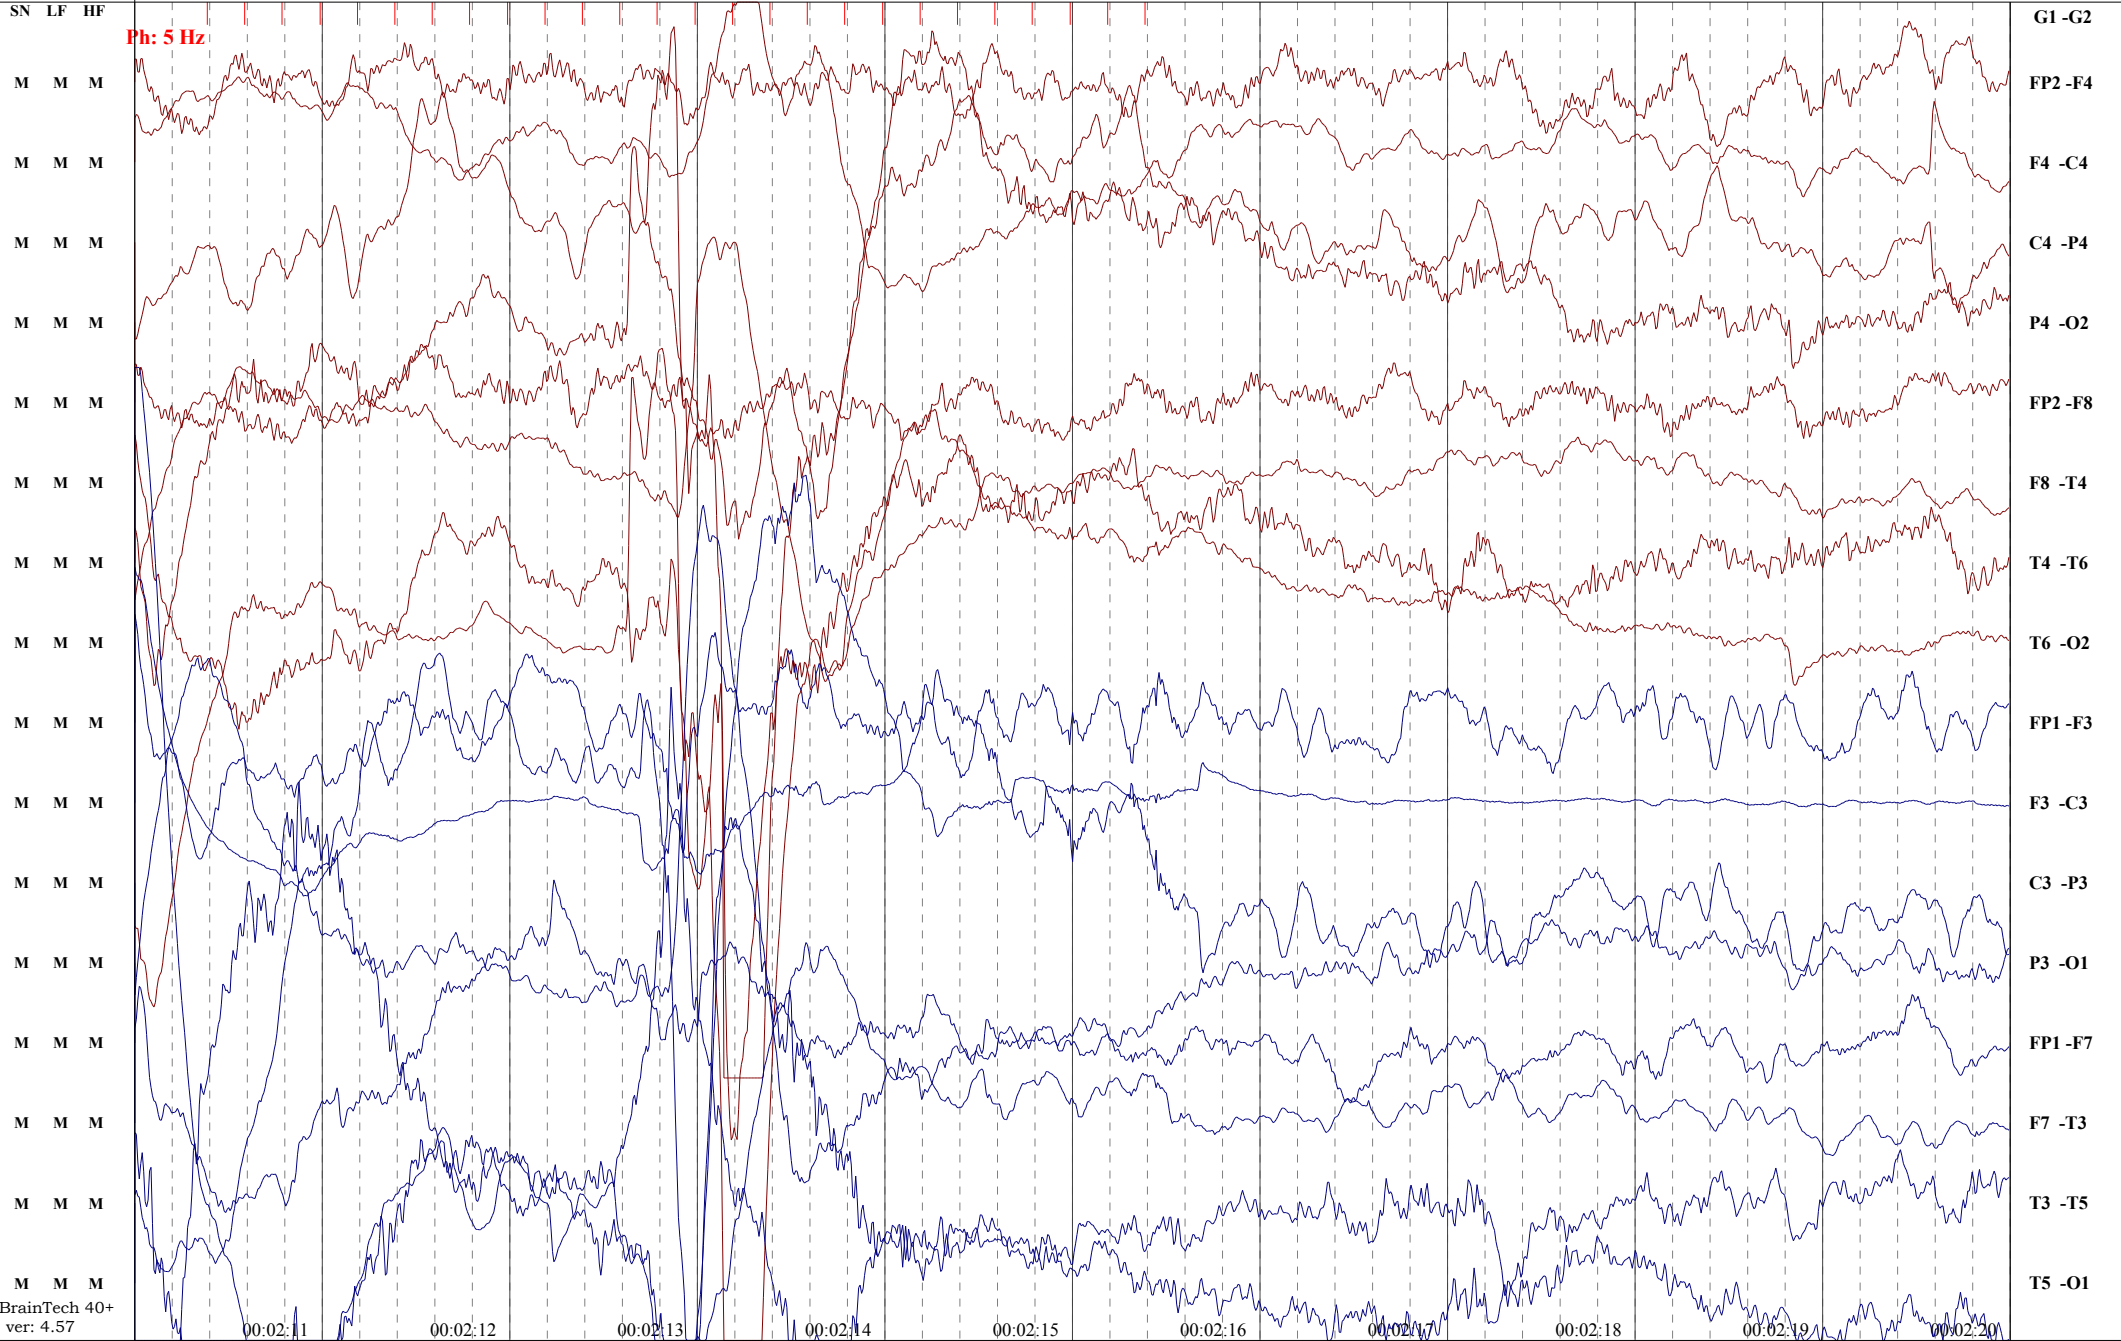


133
MRS. LAXMI KAMALSEN
73 Years/F


Date: 11-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 19:10:44
Page:16/25
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

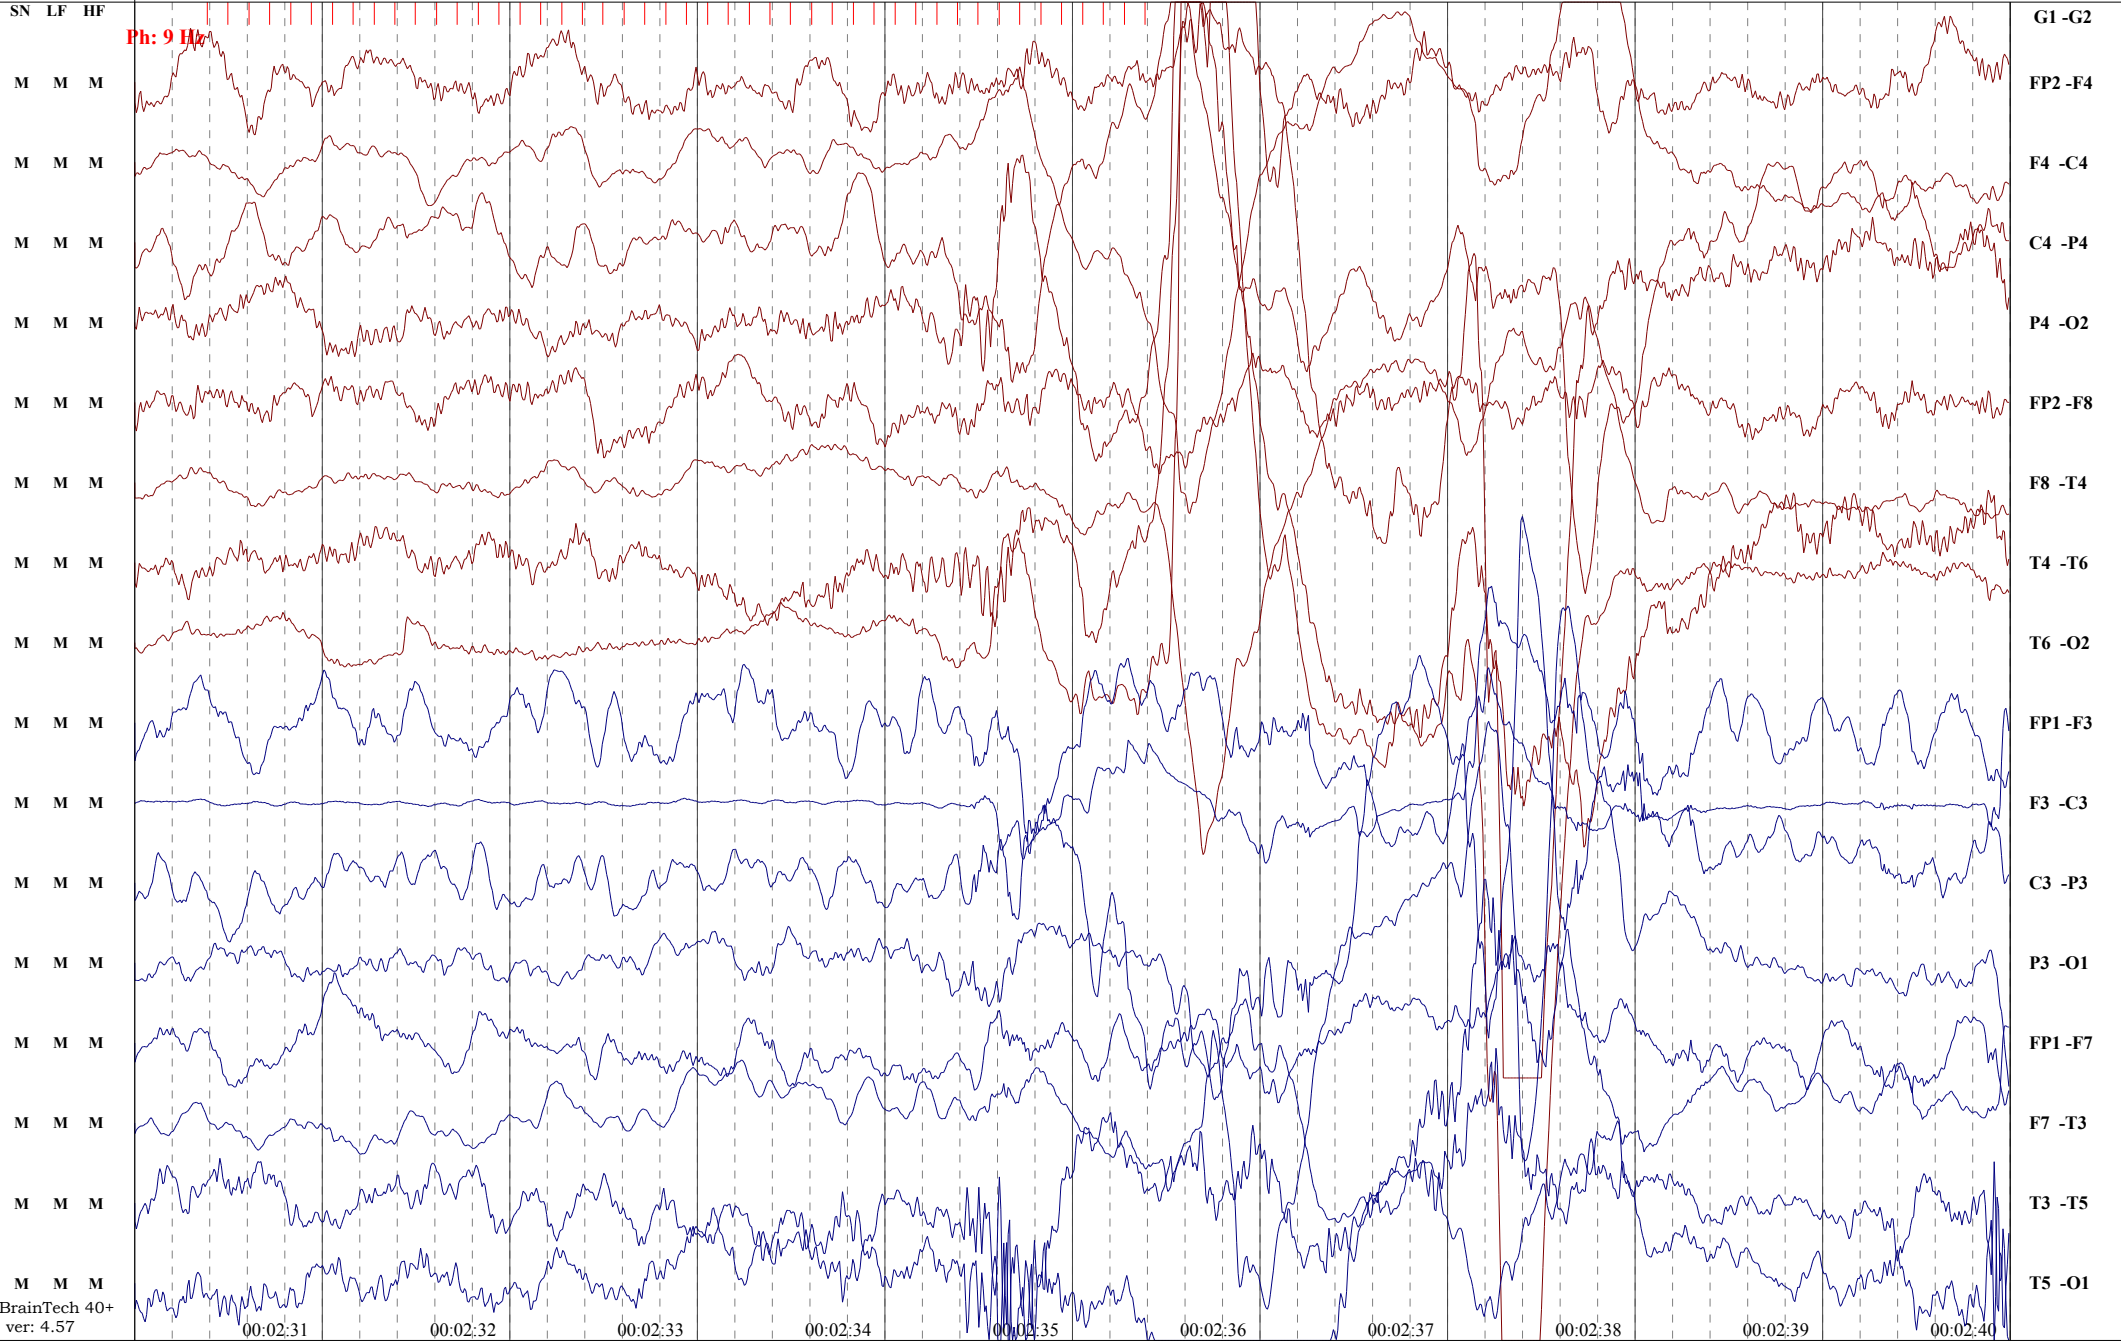

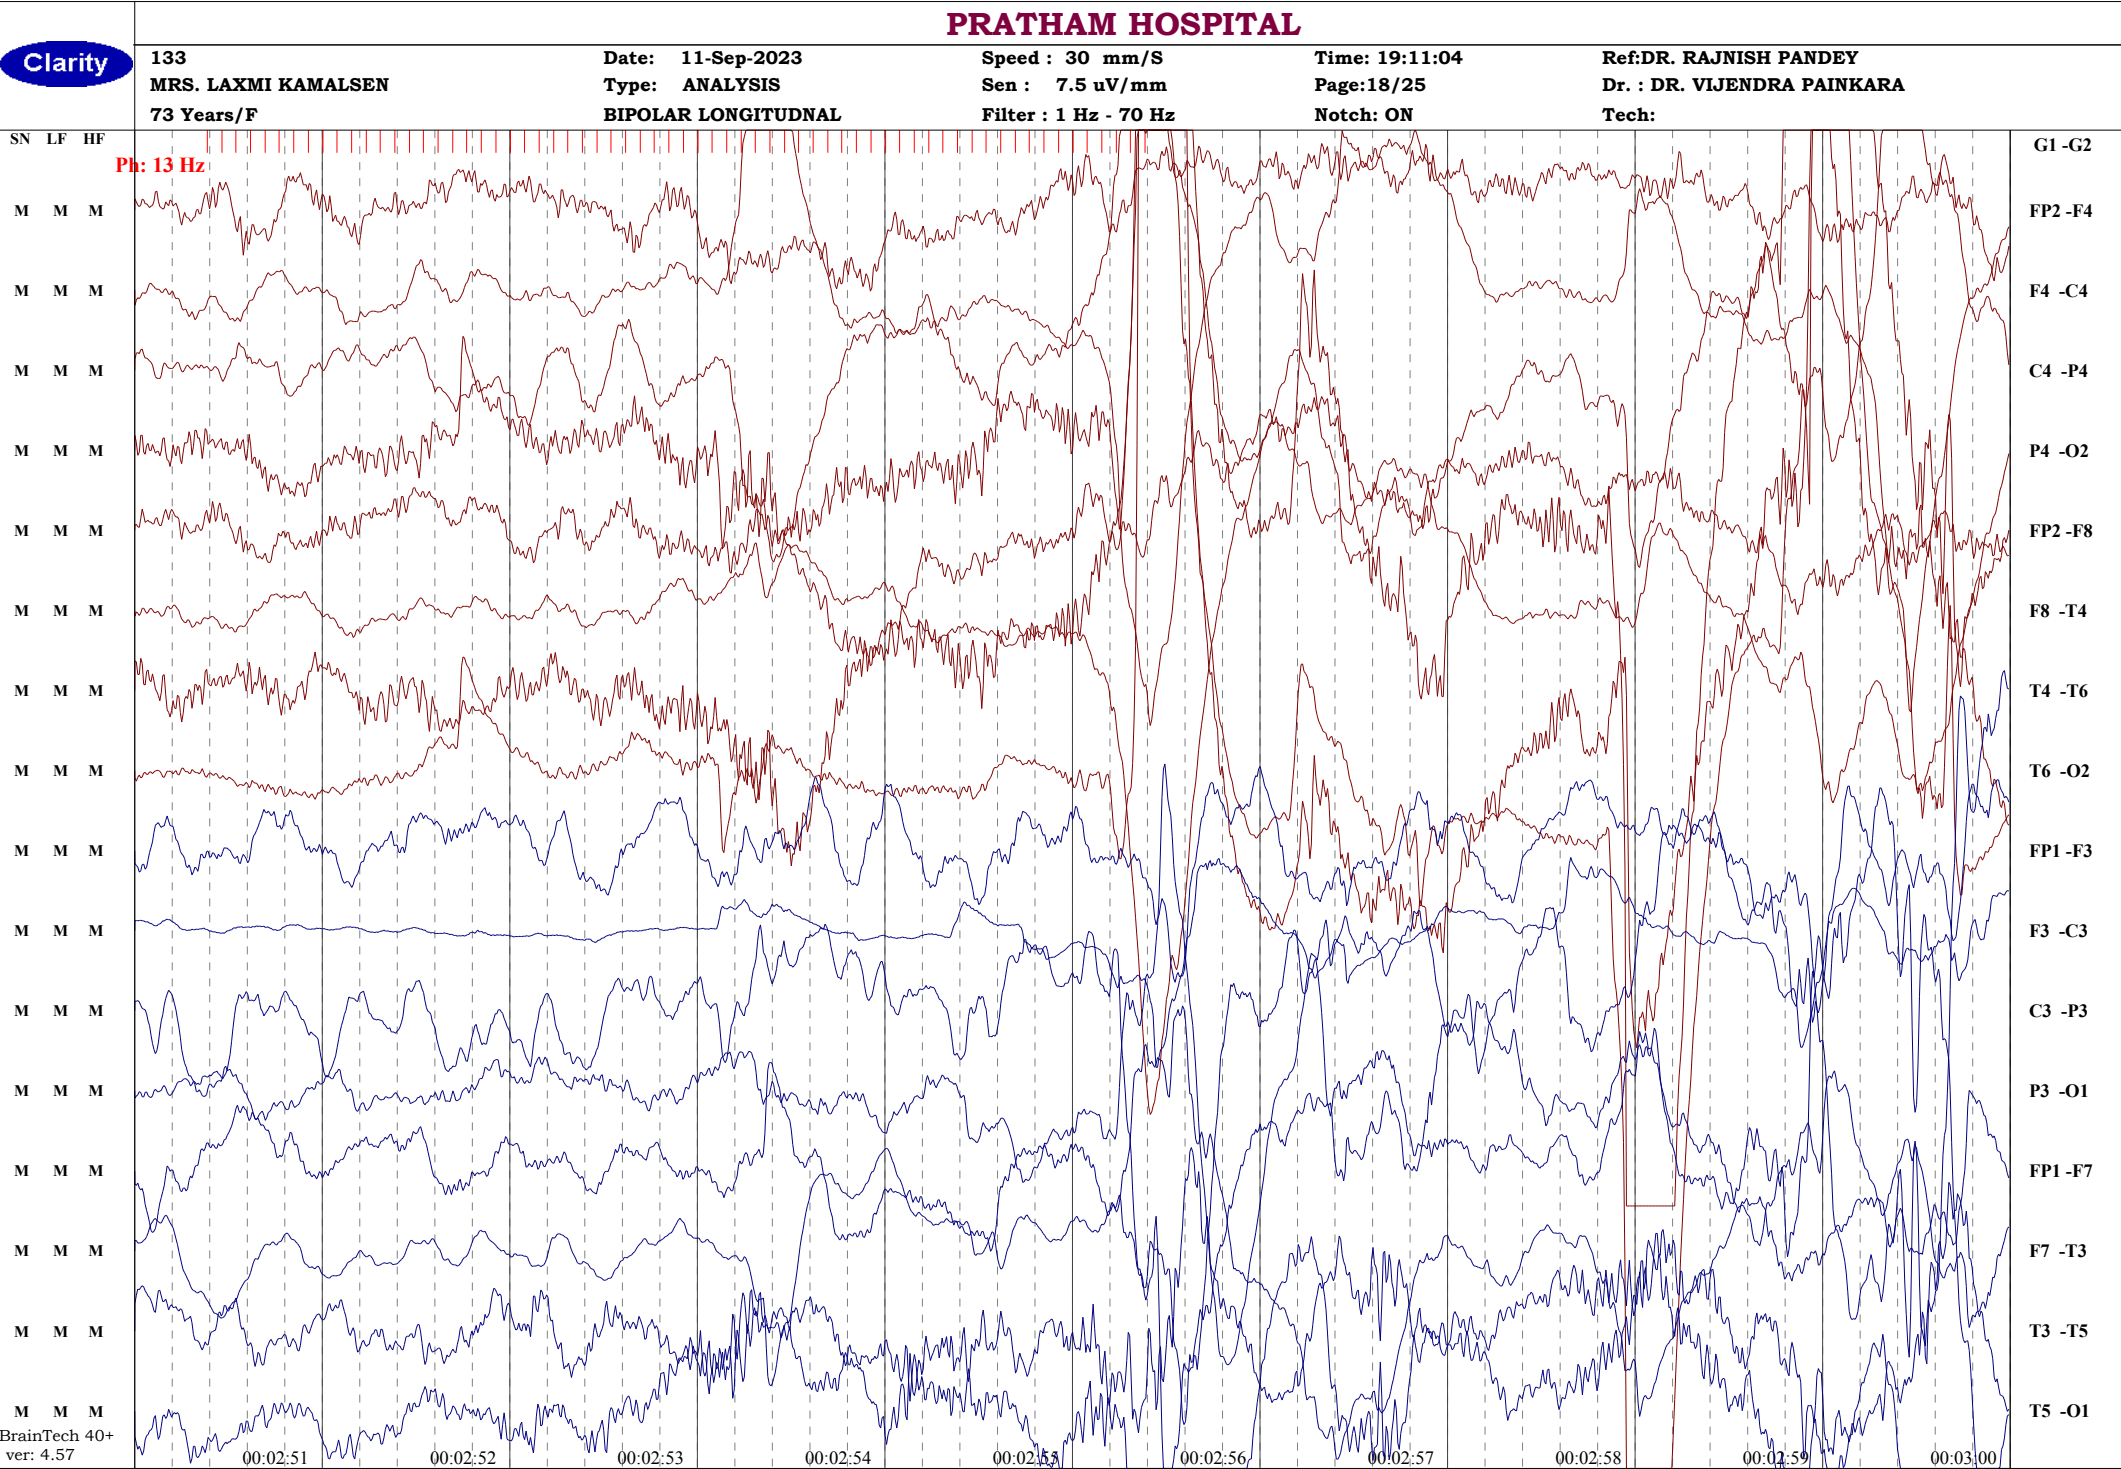

| | | | | | | | | | | | | | | | | | | | |
|-------------------------|----|----|---|-----------------------------|--|--|--|-----------------------|--|--|--|----------------|--|--|--|-----------------------------|--|--|---------|
| <div>Clarity</div> | | | | <div>PRATHAM HOSPITAL</div> | | | | | | | | | | | | | | | |
| 133 | | | | Date: 11-Sep-2023 | | | | Speed : 30 mm/S | | | | Time: 19:11:14 | | | | Ref:DR. RAJNISH PANDEY | | | |
| MRS. LAXMI KAMALSEN | | | | Type: ANALYSIS | | | | Sen : 7.5 uV/mm | | | | Page:19/25 | | | | Dr. : DR. VIJENDRA PAINKARA | | | |
| 73 Years/F | | | | BIPOLAR LONGITUDNAL | | | | Filter : 1 Hz - 70 Hz | | | | Notch: ON | | | | Tech: | | | |
| SN | LF | HF | | | | | | | | | | | | | | | | | G1 -G2 |
| | | | Ph: 15 Hz | | | | | | | | | | | | | | | | |
| M | M | M | | | | | | | | | | | | | | | | | FP2 -F4 |
| M | M | M | | | | | | | | | | | | | | | | | F4 -C4 |
| M | M | M | | | | | | | | | | | | | | | | | C4 -P4 |
| M | M | M | | | | | | | | | | | | | | | | | P4 -O2 |
| M | M | M | | | | | | | | | | | | | | | | | FP2 -F8 |
| M | M | M | | | | | | | | | | | | | | | | | F8 -T4 |
| M | M | M | | | | | | | | | | | | | | | | | T4 -T6 |
| M | M | M | | | | | | | | | | | | | | | | | T6 -O2 |
| M | M | M | | | | | | | | | | | | | | | | | FP1 -F3 |
| M | M | M | | | | | | | | | | | | | | | | | F3 -C3 |
| M | M | M | | | | | | | | | | | | | | | | | C3 -P3 |
| M | M | M | | | | | | | | | | | | | | | | | P3 -O1 |
| M | M | M | | | | | | | | | | | | | | | | | FP1 -F7 |
| M | M | M | | | | | | | | | | | | | | | | | F7 -T3 |
| M | M | M | | | | | | | | | | | | | | | | | T3 -T5 |
| M | M | M | | | | | | | | | | | | | | | | | T5 -O1 |
| BrainTech 40+ ver: 4.57 | | | | | | | | | | | | | | | | | | | |
| | | | 00:03:01 00:03:02 00:03:03 00:03:04 00:03:05 00:03:06 00:03:07 00:03:08 00:03:09 00:03:10 | | | | | | | | | | | | | | | | |

Clarity

PRATHAM HOSPITAL


133
MRS. LAXMI KAMALSEN
73 Years/F

Date: 11-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 19:12:05
Page:25/25
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

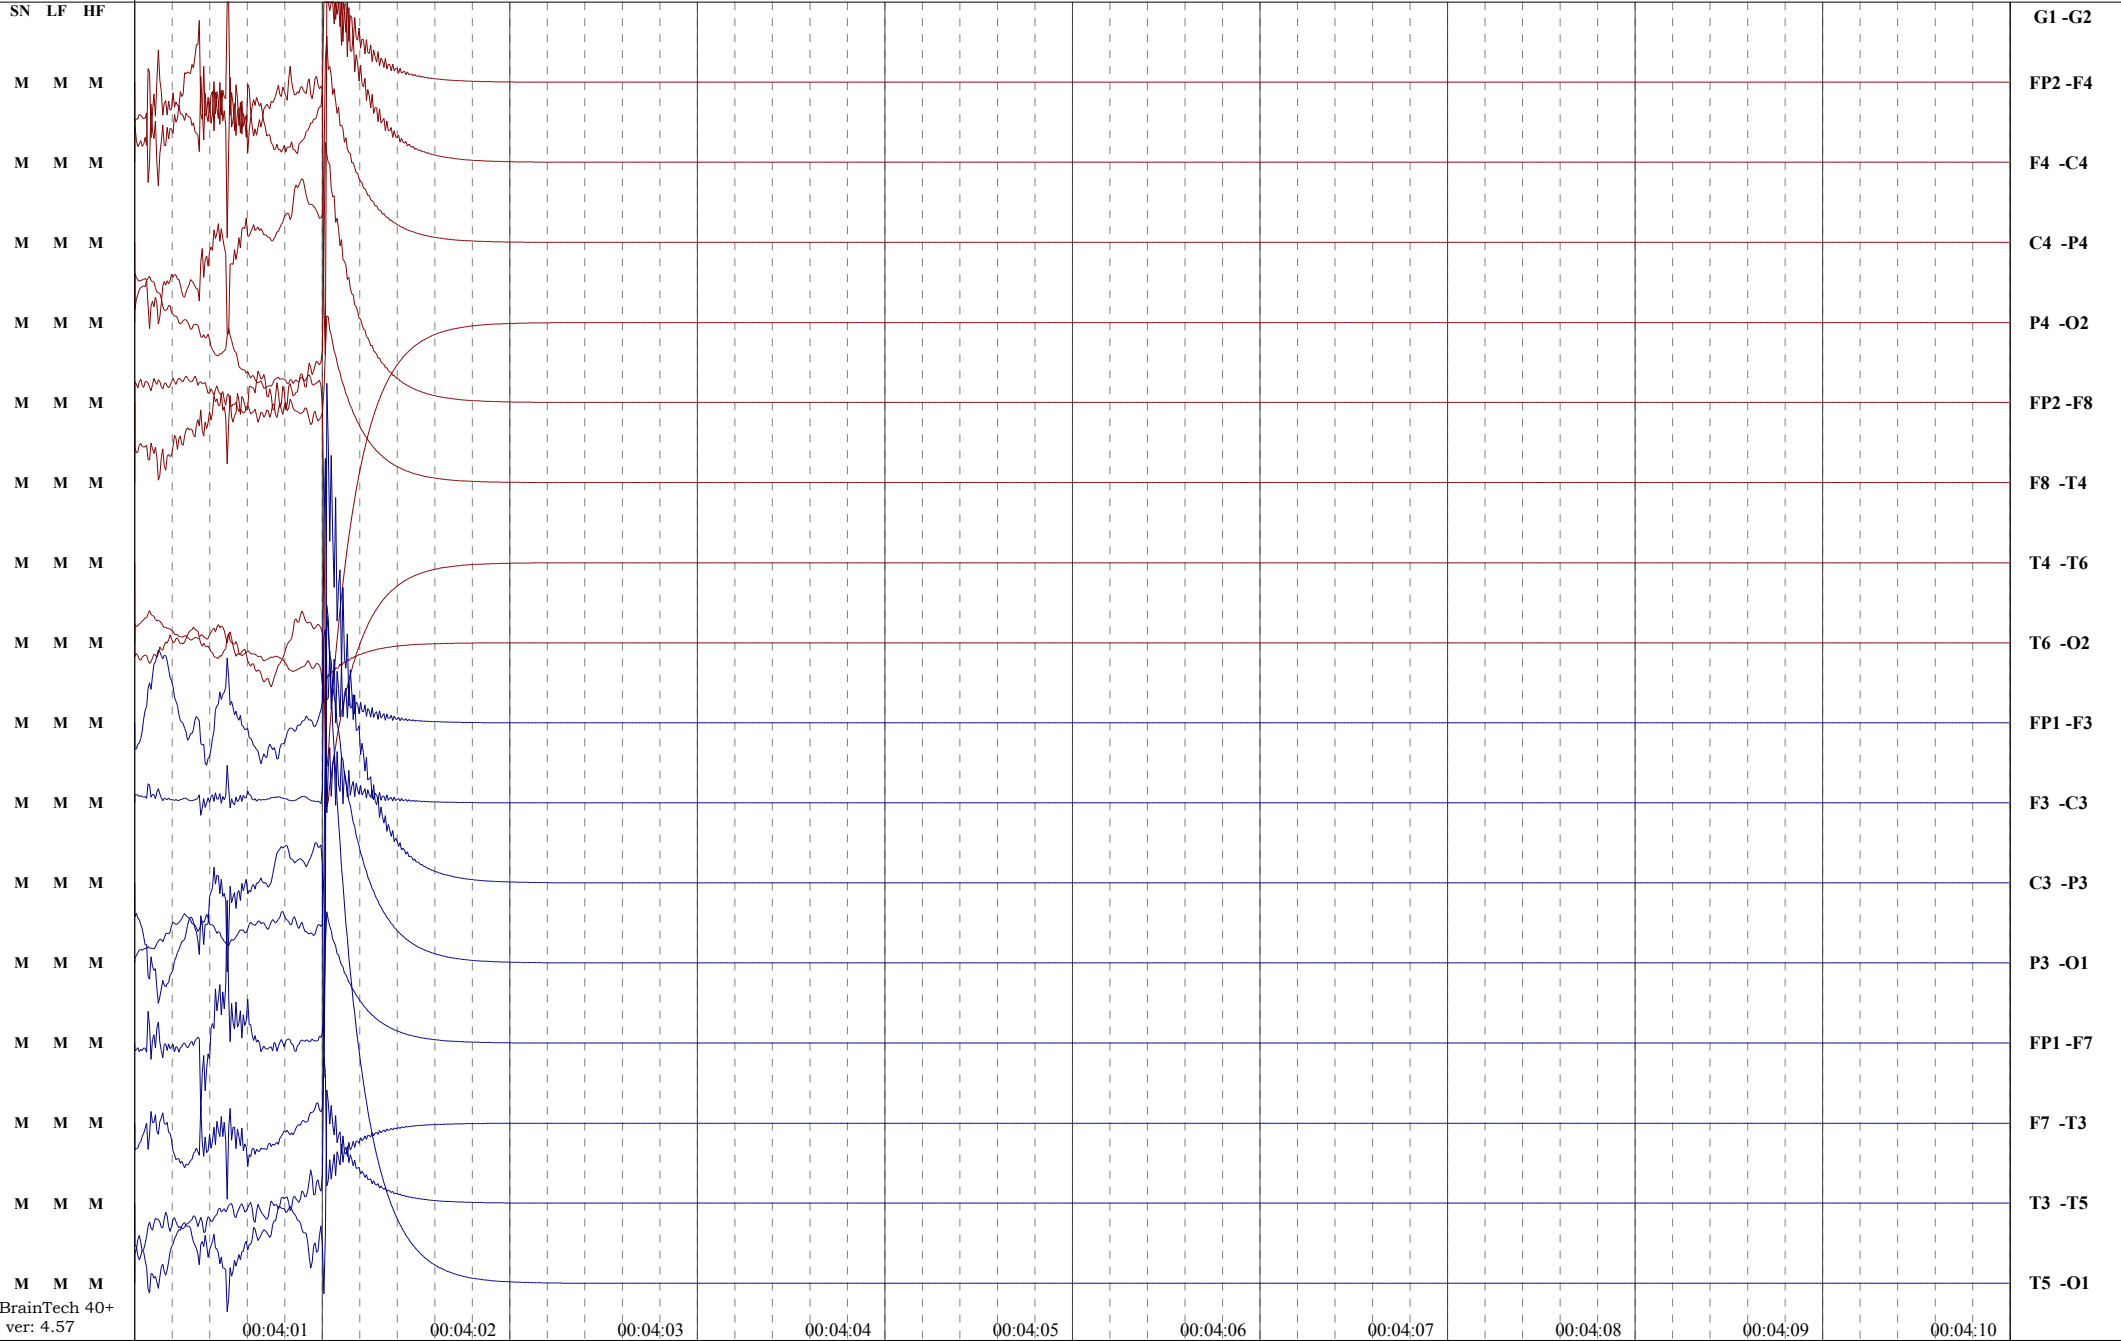

Clarity

PRATHAM HOSPITAL

133
MRS. LAXMI KAMALSEN
73 Years/F

Date: 11-Sep-2023
Type: ANALYSIS
BIPOLAR LONGITUDNAL

Speed : 30 mm/S
Sen : 7.5 uV/mm
Filter : 1 Hz - 70 Hz

Time: 19:12:05
Page:25/25
Notch: ON

Ref:DR. RAJNISH PANDEY
Dr. : DR. VIJENDRA PAINKARA
Tech:

